

P.U.E.'s FOR WATER & SEWER

EASEMENTS ARE NOT FULLY LABELED FOR CLARITY:
 (2) UTILITY LINES = 20' WIDE P.U.E.
 (1) UTILITY LINE = 20' WIDE P.U.E.
 FIRE HYDRANT LINES = 8' WIDE P.U.E. EXTENDED 4' BEYOND F.H.
 WATER METER = 6' WIDE P.U.E. EXTENDED 4' BEYOND W.M.

PUBLIC WATER & SEWER MAINS

ALL NEW 8" WATER & SEWER MAINS SHALL BE PUBLIC.

WATER & SEWER SERVICES

ALL NEW SEWER SERVICES SHALL BE 4" MINIMUM AND ALL NEW WATER SERVICES SHALL BE A 2". FIRE SPRINKLER LINE SIZE SHALL BE 4" MINIMUM.

FIRE PREVENTION

A NFPA 13R FIRE SPRINKLER SYSTEM IS REQUIRED FOR THIS PROJECT. ADDITIONALLY, A FIRE ALARM SYSTEM DESIGNED IN ACCORDANCE WITH NFPA 72 NATIONAL FIRE ALARM AND SIGNALING CODE IS REQUIRED.

FIRE SPRINKLER ROOMS

THE FIRE SPRINKLER ROOMS ARE CALLED OUT AS "F.S.R." IN EACH BUILDING

FIRE DEPARTMENT CONNECTION

FIRE DEPARTMENT CONNECTIONS ARE IDENTIFIED AS "F.D.C. #". # INDICATES BUILDING NUMBER.

FIRE HYDRANTS


FIRE HYDRANTS LOCATED IN CURBED LANDSCAPE ISLANDS SHALL HAVE PROTECTIVE BOLLARDS IN ACCORDANCE WITH C.O.F. STD. DET. No. 13-03-012

BACKFLOW PREVENTION

BACKFLOW PREVENTION SHALL BE IN ACCORDANCE WITH CITY CODE SECTION 7-03-001-0015

ABBREVIATIONS

- SS SEWER SERVICE
- WS WATER SERVICE
- FS FIRE SERVICE
- FH FIRE HYDRANT
- W WATER
- S SEWER
- F.D.C. FIRE DEPT. CONNECTION
- F.S.R. FIRE SPRINKLER ROOM

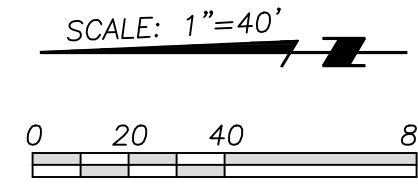

PRELIMINARY
NOT FOR CONSTRUCTION OR RECORDING

PRELIMINARY
NOT FOR CONSTRUCTION OR RECORDING

PROJECT NO. 18275	REVISIONS PER C.O.F. COMMENTS DATED 11/19/18
DESIGNED BY: FME	PER C.O.F. COMMENTS DATED 1/25/19
DRAWN BY: FME	PER C.O.F. COMMENTS DATED 3/11/19
CHECKED BY: KWH	PER C.O.F. COMMENTS DATED 5/21/19
DATE: 5/16/19	PER C.O.F. COMMENTS DATED 5/21/19

Mogollon
ENGINEERING & SURVEYING
411 N. Santa Fe Avenue
Flagstaff, Arizona 86001
Phone: 928-214-0214

Mogollon
ENGINEERING & SURVEYING
5/16/19
MES# 18275