



Notes:

- Handholes to be placed as most practical.
- Proposed conduit to be 2" Schedule 40 PVC installed with 24" cover.
- Locations indicated on plan are approximates. Final light locations are to be staked by a City of Fort Pierce representative.

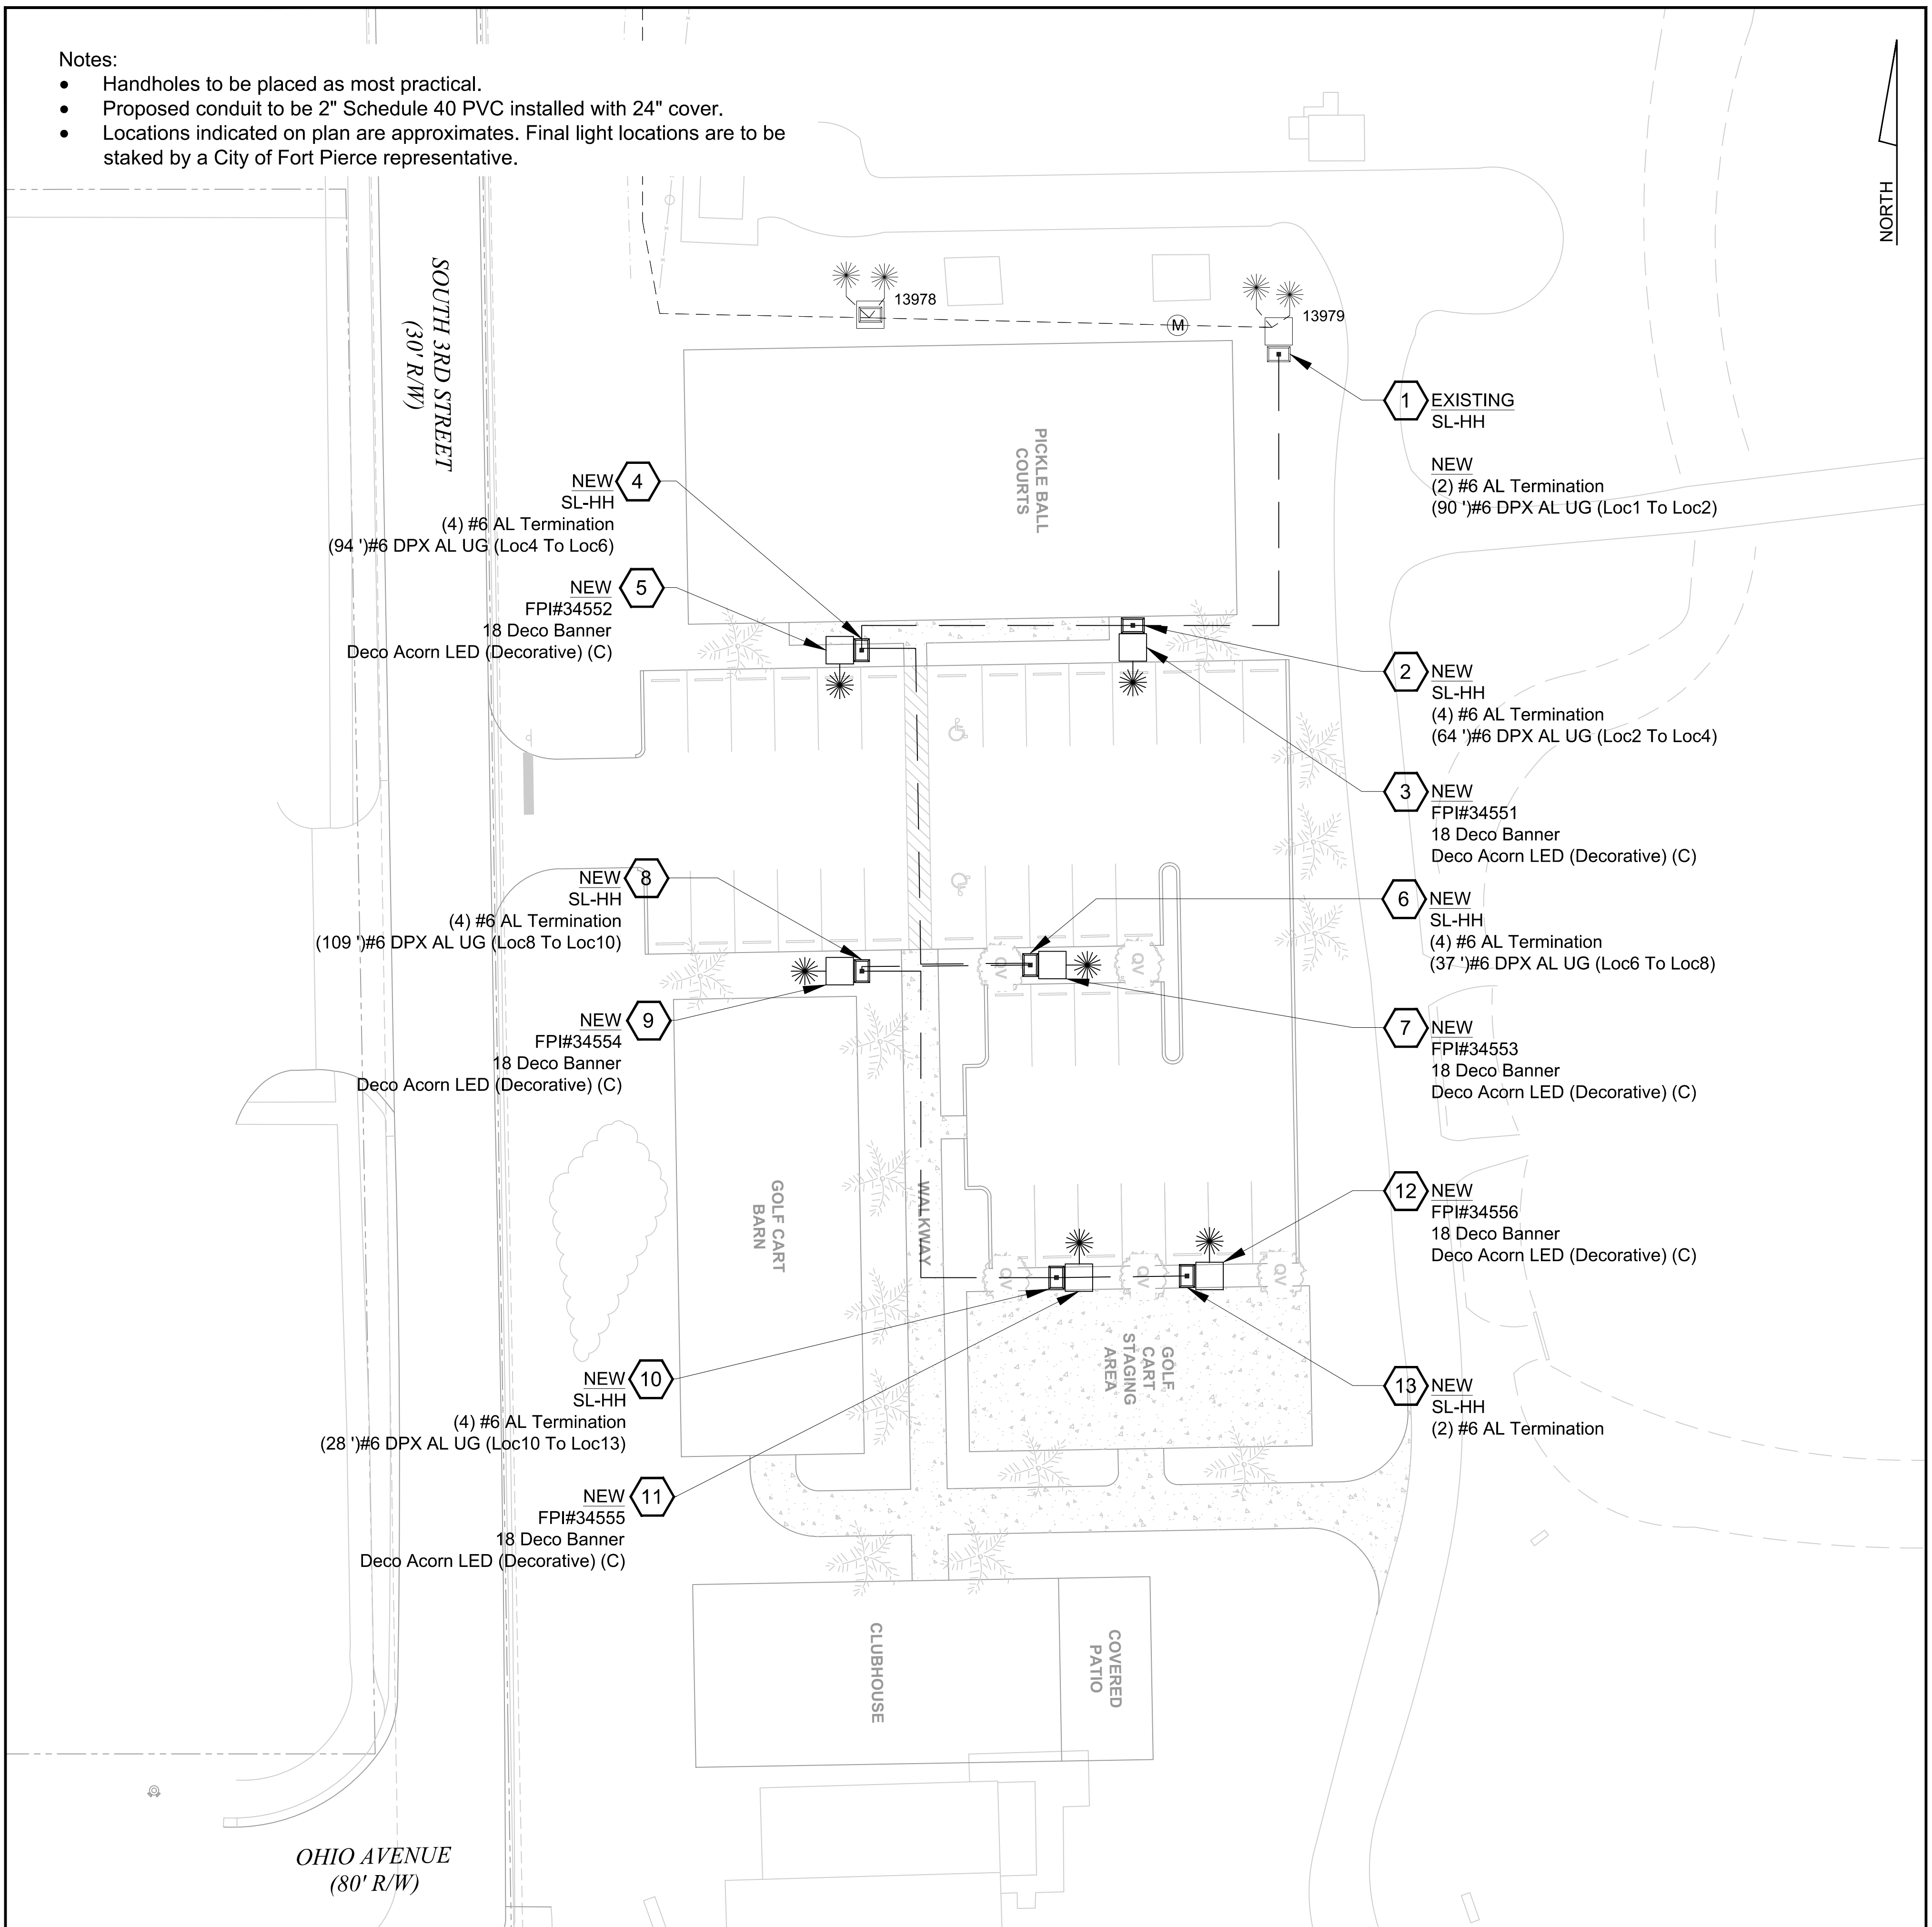

CITY-SL-LED-01
UNDERGROUND LIGHTING DETAIL

CONTACT FPUA ENGINEERING @ (888-1600 X6386) FOR
CONDUIT INSPECTION PRIOR TO BACKFILL

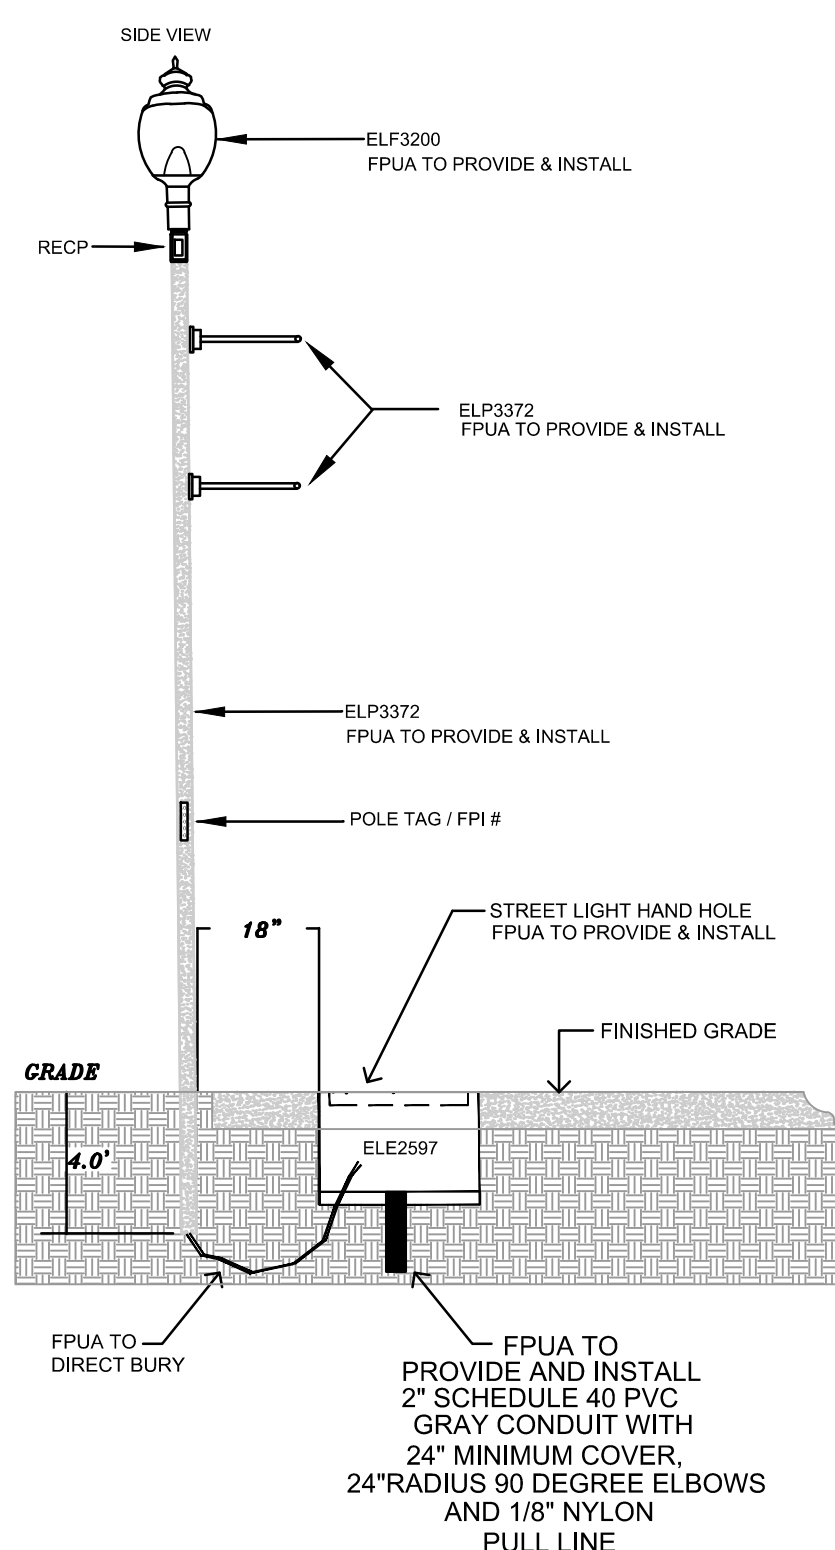

		New Outdoor Lights Indian Hills Golf Course Decorative Lighting Installation Plan	
03/29/2023 Layout Change Per City Eng. 03/27/2023 Engineer Review	MFC MFC TS	1" = 30' 1" = 30' 1" = 30'	JOB # 20230440-1 SHEET P&D DRAWN MPC SHEET 5 OF 6