


REVISIONS

REV #	DATE	BY:
1	1/29/25	J.P.

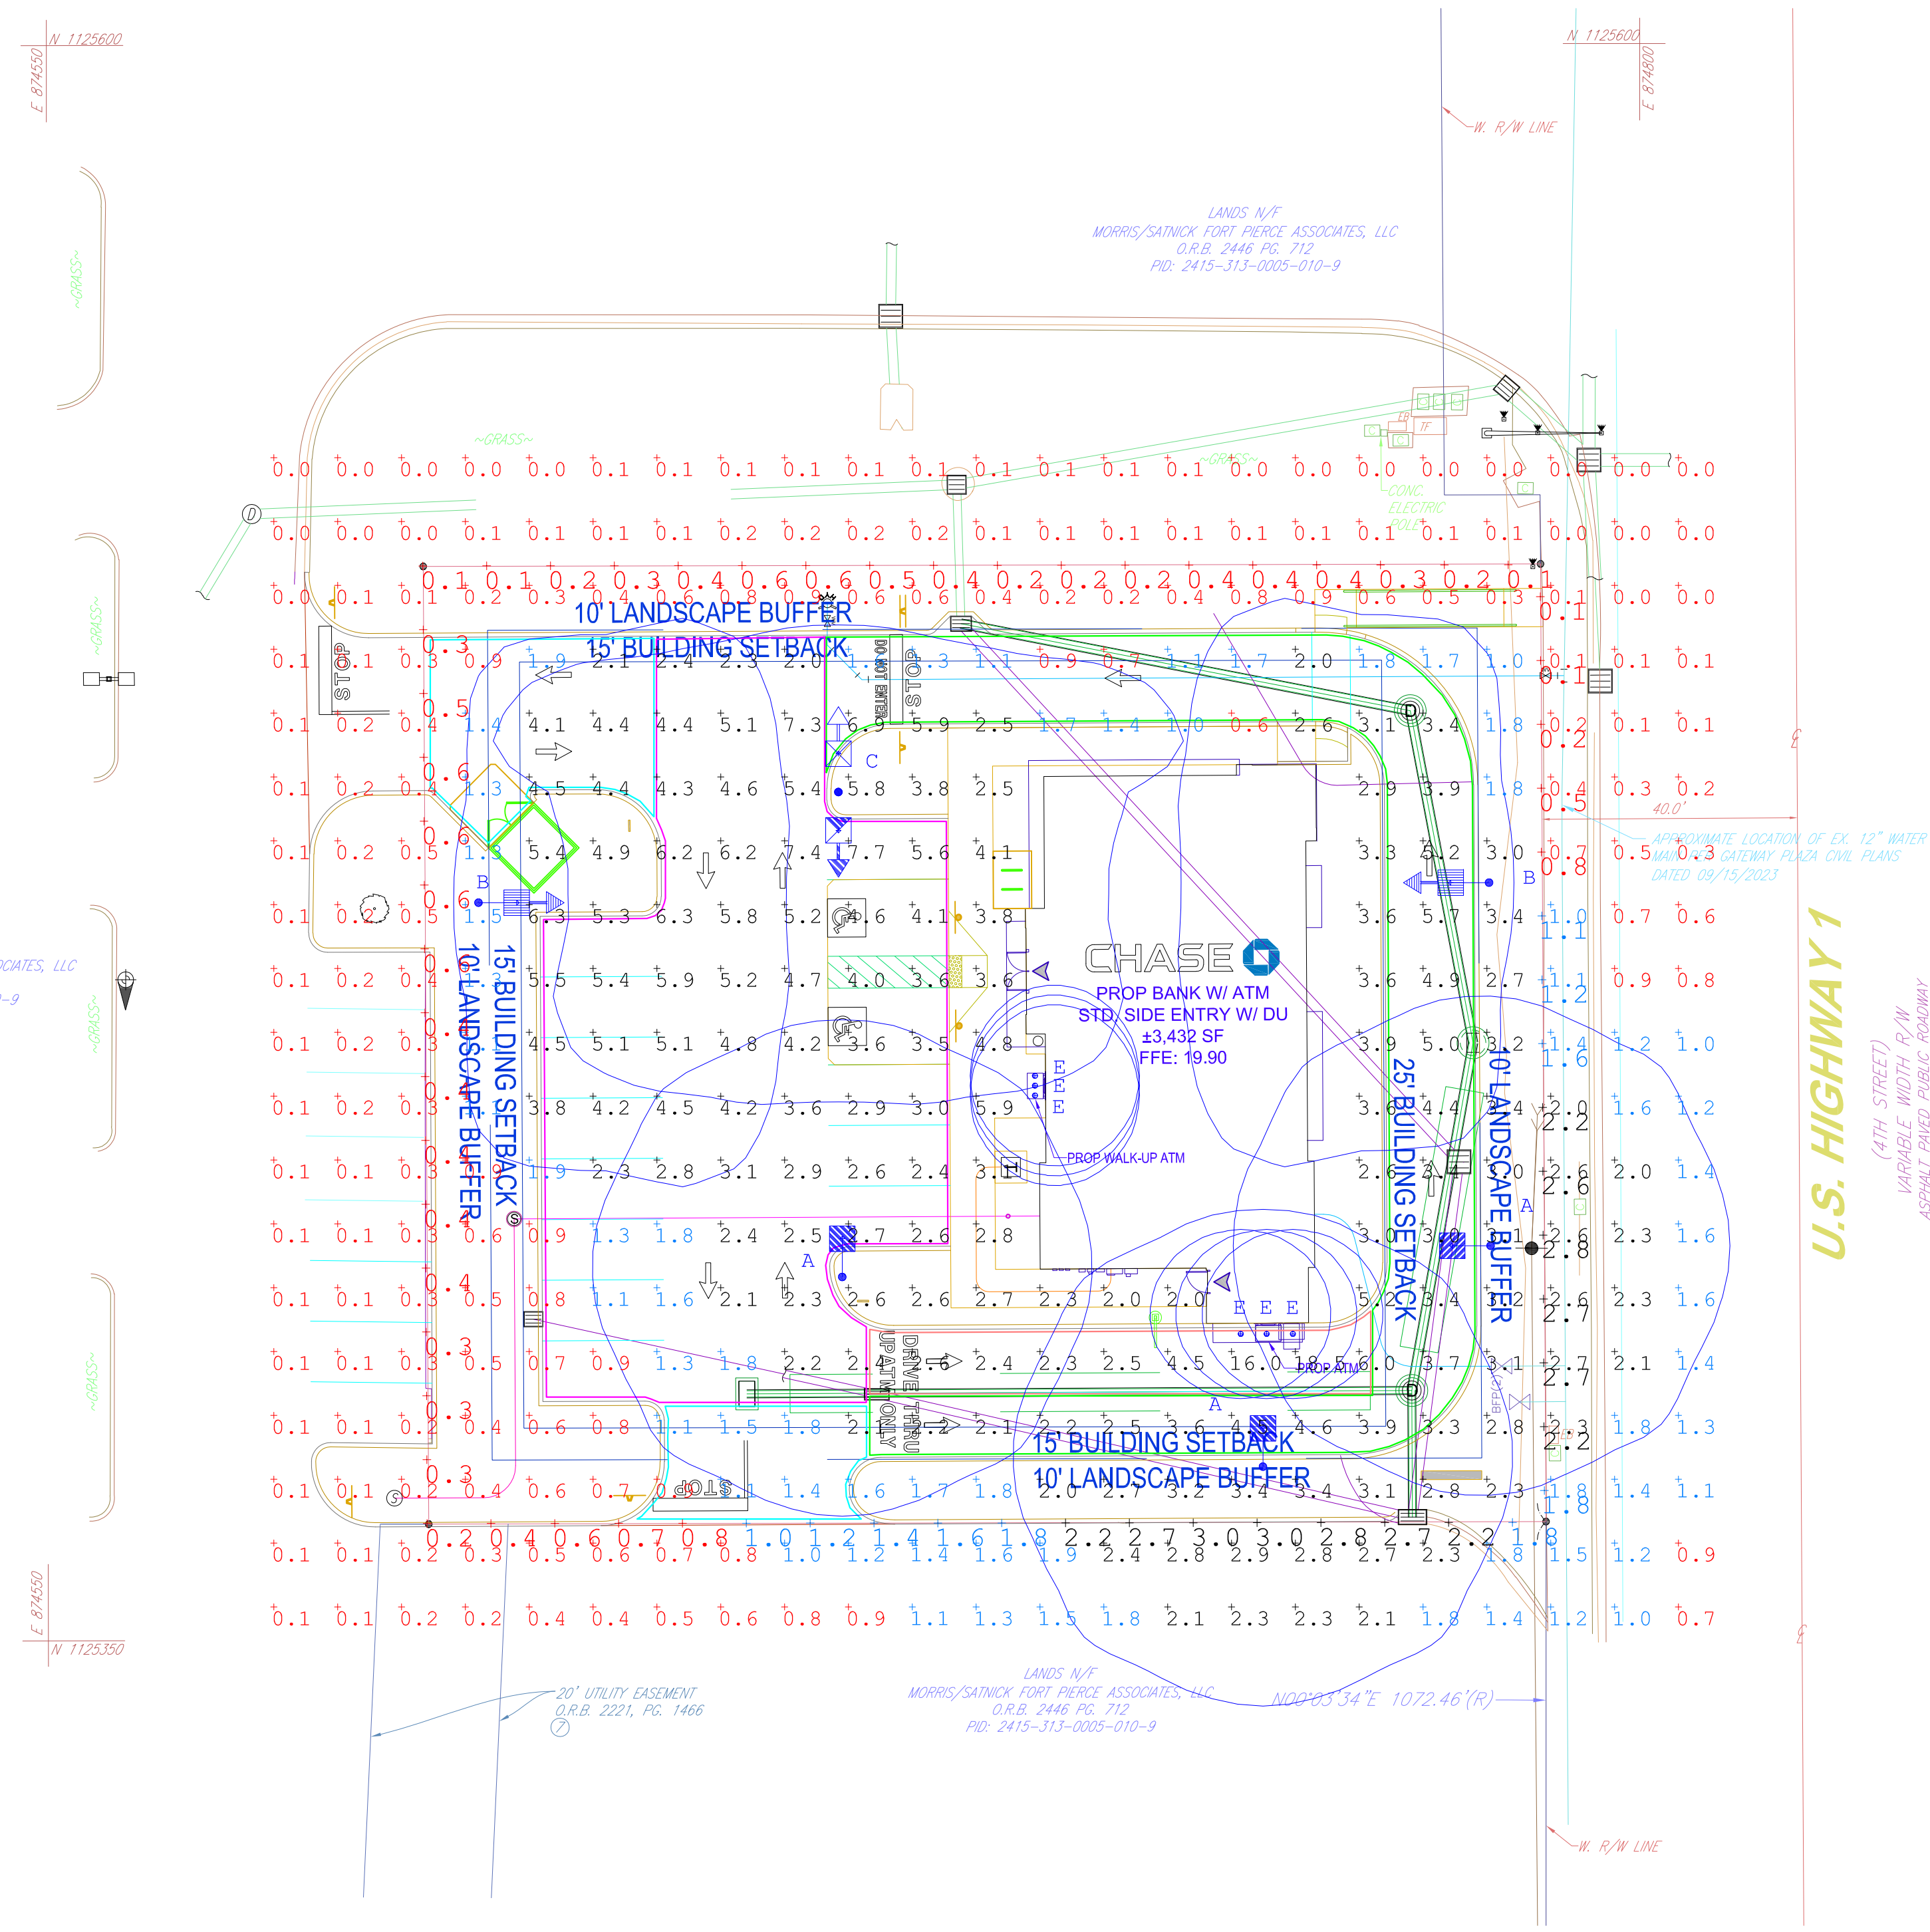

BASED ON THE INFORMATION PROVIDED, ALL DIMENSIONS AND LUMINAIRE LOCATIONS SHOWN REPRESENT RECOMMENDED POSITIONS. THE ENGINEER AND/OR ARCHITECT MUST DETERMINE APPLICABILITY OF THE LAYOUT TO EXISTING OR FUTURE FIELD CONDITIONS.

THIS LIGHTING PATTERN REPRESENTS ILLUMINATION LEVELS CALCULATED FROM LABORATORY DATA TAKEN UNDER CONTROLLED CONDITIONS UTILIZING CURRENT INDUSTRY STANDARD LAMP RATINGS IN ACCORDANCE WITH ILLUMINATING ENGINEERING SOCIETY APPROVED METHODS. ACTUAL PERFORMANCE OF ANY MANUFACTURER'S LUMINAIRE MAY VARY DUE TO VARIATION IN ELECTRICAL VOLTAGE, TOLERANCE IN LAMPS AND OTHER VARIABLE FIELD CONDITIONS.

Label	Units	Avg	Max	Min	Avg/Min	Max/Min	PtSpcLr	PtSpcTb
PROPERTY LINE	Fc	0.99	3.0	0.1	9.90	30.00	10	N.A.
DRIVE	Fc	2.97	6.9	0.6	4.95	11.50	10	10
DRIVE THRU	Fc	6.85	18.5	2.3	2.98	8.04		
ENTRANCE DRIVES	Fc	2.35	4.5	0.9	2.61	5.00		
PARKING	Fc	3.70	7.7	0.9	4.11	8.56		

Symbol	Qty	Label	Lum. Lumens	LLP	Description	Lum. Watts
	3	A	17408	0.950	WLS-NV-1-T5QW-48L-1050-40K7-SLM 20' MOUNTING HEIGHT	158
	2	B	12356	0.950	WLS-NV-1-T4-48L-1-40K7-HSS-SLM 20' MOUNTING HEIGHT	156
	1	C	N.A.	0.950	WLS-NV-1-T4-48L-1-40K7-HSS-SLM & WLS-NV-1-T2-32L-7-40K-SLM 20' MOUNTING HEIGHT	N.A.
	6	E	3000	0.950	WLS-NYX-NC-6-RD-H(H)-9-CCT58-DUALDIM-WW-W 4000K	30


CHASE BANK
FORT PIERCE, FL



6820 CORPORATION PKWY
FORT WORTH, TX 76126
WWW.WSLIGHTING.COM

REVISIONS

REV #	DATE	BY:
1	1/29/25	J.P.

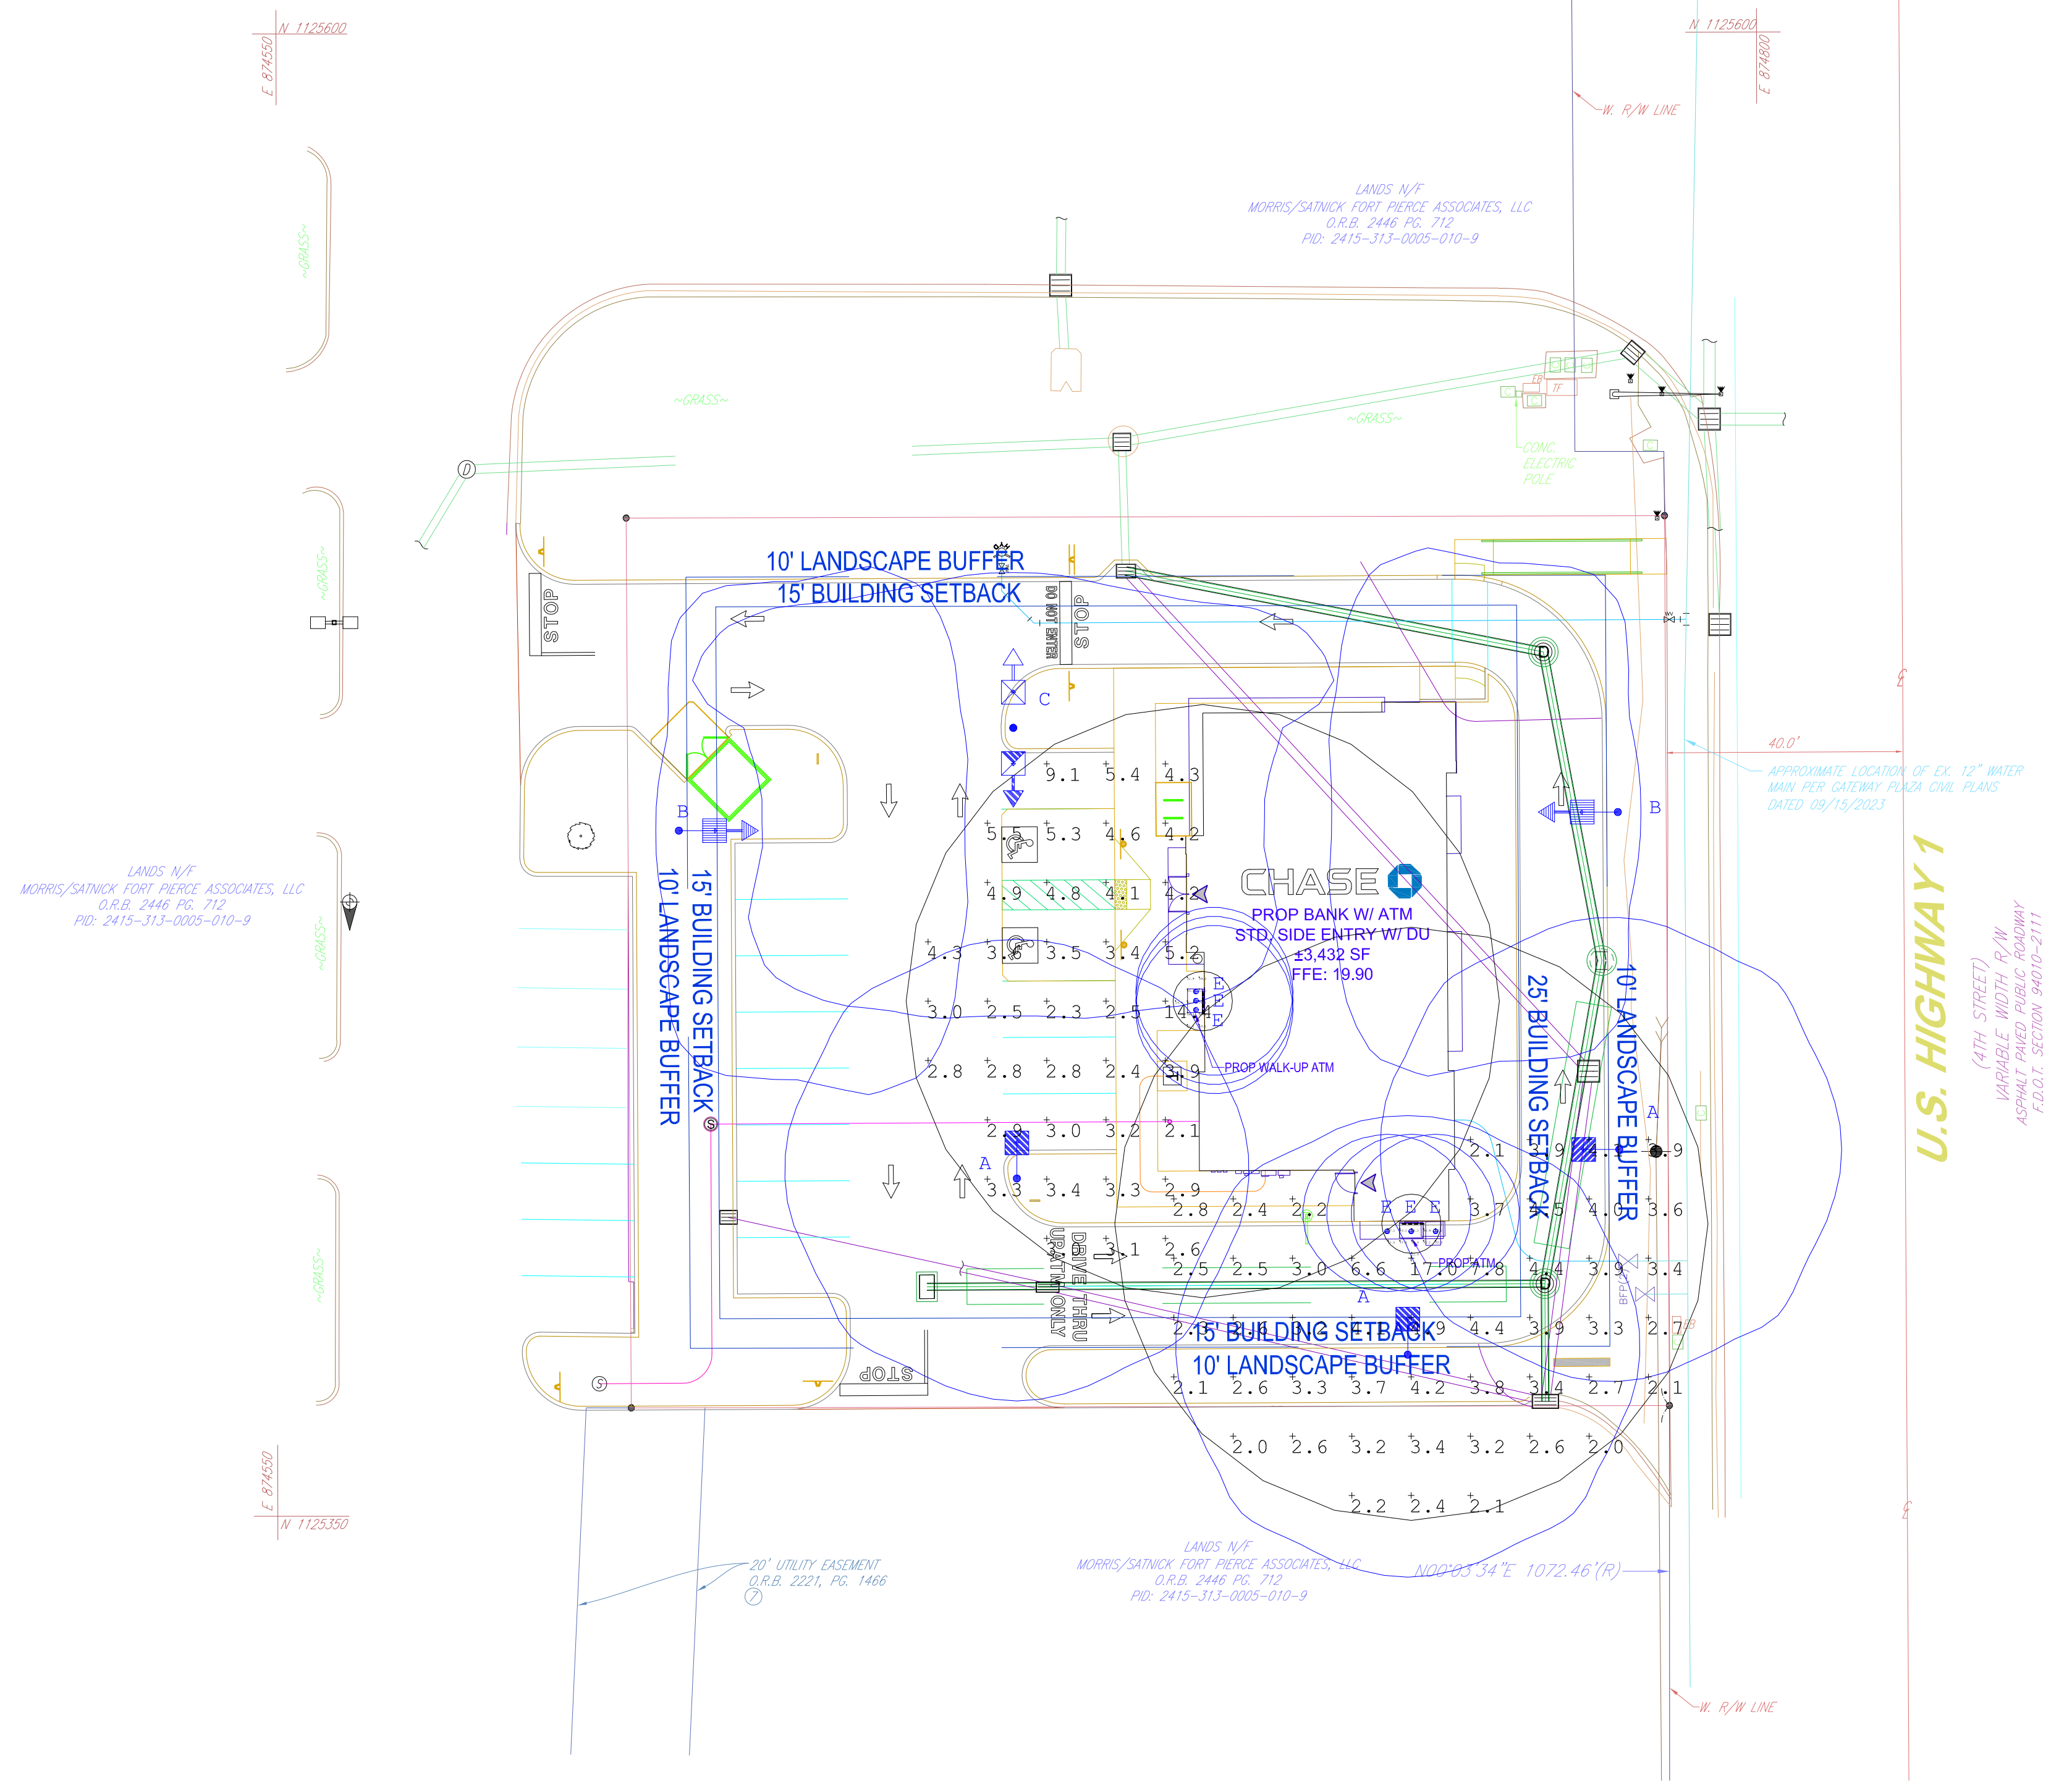

Calculation Summary

Label	Units	Avg	Max	Min	Avg/Min	Max/Min	PtSpLr	PtSpTb
DRIVE UP ATM 5' RADIUS	Fc	41.99	56.0	22.4	1.87	2.50	2	2
DRIVE UP ATM 50' RADIUS	Fc	3.61	17.0	2.0	1.81	8.50	10	10
DRIVE UP ATM_FACE	Fc	22.76	32.5	15.0	1.52	2.17	1	1
WALK UP ATM 5' RADIUS	Fc	48.45	76.6	26.4	1.84	2.90	2	2
WALK UP ATM 50' RADIUS	Fc	4.02	14.4	2.1	1.91	6.86	10	10
WALK UP ATM_FACE	Fc	20.77	30.8	13.1	1.59	2.35	1	1

BASED ON THE INFORMATION PROVIDED, ALL DIMENSIONS AND LUMINAIRE LOCATIONS SHOWN REPRESENT RECOMMENDED POSITIONS. THE ENGINEER AND/OR ARCHITECT MUST DETERMINE APPLICABILITY OF THE LAYOUT TO EXISTING OR FUTURE FIELD CONDITIONS.

THIS LIGHTING PATTERN REPRESENTS ILLUMINATION LEVELS CALCULATED FROM LABORATORY DATA TAKEN UNDER CONTROLLED CONDITIONS UTILIZING CURRENT INDUSTRY STANDARD LAMP RATINGS IN ACCORDANCE WITH ILLUMINATING ENGINEERING SOCIETY APPROVED METHODS. ACTUAL PERFORMANCE OF ANY MANUFACTURER'S LUMINAIRE MAY VARY DUE TO VARIATION IN ELECTRICAL VOLTAGE, TOLERANCE IN LAMPS AND OTHER VARIABLE FIELD CONDITIONS.

**CHASE BANK
FORT PIERCE, FL**



6820 CORPORATION PKWY
FORT WORTH, TX 76126
WWW.WLSLIGHTING.COM

WLS-17778

DATE - 1/7/25

SCALE: 1"=20'

817-731-0020

PM:KEN

BY: J.P.

SHEET 2 OF 2