

VISIT OUR WEBSITE AT:

www.rkci.com

INVOICE

INVOICE #: 019393

Engineering * Testing * Environmental * Facilities * Infrastructure

BILLING DATE :
6/17/2009

PROJECT :
AMD0905200
Hidalgo County Pct. No. 2 - Eldora
CLIENT :
A14055 Hidalgo County Precinct 2



Mr. Humberto Garza
Hidalgo County Precinct 2
301 East State
Pharr, TX 78577

REMITTANCE ADDRESS:
RABA-KISTNER CONSULTANTS, INC.
P.O. BOX 971037
DALLAS, TX 75397-1037
PHONE (210) 699-9090

C-CAP-08-023-09-02

INVOICE SUMMARY INFORMATION

Gardens - Border Colonia Access Program Contract No.
C-Cap-08-018-08-26- San Juan, Hidalgo County, Texas
Proposal #: PMD09-014-00

REVISED INVOICE 7/13/2009

FOR PROFESSIONAL SERVICES RENDERED THROUGH: 6/6/2009

SERVICE DATE	05/15/2009	174.20
SERVICE DATE	05/27/2009	213.25
SERVICE DATE	05/28/2009	82.40
SUBTOTAL INVOICE		<u>469.85</u>
AMOUNT DUE THIS INVOICE **		<u>469.85</u>

THIS IS AN INTERIM INVOICE UNLESS OTHERWISE NOTED

RK PROJECT MANAGER: DENNIS C. CHARKOW
CLIENT PHONE: 956-787-1891

DIRECT PAYMENT
9-1311-431-00-122-252-0-339 → \$469.85

PROJECT BUDGET SUMMARY

Project Budget	\$	5,879.00
Prior Billings		1,064.40
Total Available	\$	4,814.60

PROJECT ACCOUNTS RECEIVABLE SUMMARY

Amount Due This Invoice	\$	469.85
Total of Previous Invoices - Currently Unpaid		1,064.40
Total Due And Payable	\$	1,534.25

* Invoices are submitted monthly and are due on receipt. * Carrying charges may be assessed on invoices unpaid beyond 30 days from billing date.
PLEASE PAY FROM THIS INVOICE.


AP 07-09

BILLING DATE :
6/17/2009

PROJECT :
AMD0905200 A14055
Hidalgo County Pct. No. 2 - Eldora
Hidalgo County Precinct 2

SALARY / EXPENSE DETAILED BACKUP

DESCRIPTION	REMARKS	QUANTITY	RATE	AMOUNT
05/15/2009				
CMT FIELD & LABORATORY TESTING				
FIELD NUCLEAR DENSITY TEST	M09-012181	4.00	d 17.750	d 71.00
VEHICLE TRAVEL CHARGE	M09-012181	1.00	f 20.000	d 20.00
TECH TIME-DENSITY TESTING	M09-012181	2.00	d 41.600	d 83.20
			SUBTOTAL	174.20
05/27/2009				
CMT FIELD & LABORATORY TESTING				
CONCRETE CYLINDER	M09-012351	5.00	d 13.000	d 65.00
VEHICLE TRAVEL CHARGE	M09-012351	1.00	d 20.000	d 20.00
TECH TIME-CONCRETE TESTING	M09-012351	2.50	d 41.600	d 104.00
AIR CONTENT	M09-012351	1.00	d 24.250	d 24.25
			SUBTOTAL	213.25
05/28/2009				
CMT FIELD & LABORATORY TESTING				
VEHICLE TRAVEL CHARGE	M09-012351	1.00	d 20.000	d 20.00
TECH TIME CASTING	M09-012351	1.50	f 41.600	d 62.40
PICK UP SPEC				
			SUBTOTAL	82.40
			** TOTAL PROJECT AMD0905200	d 469.85

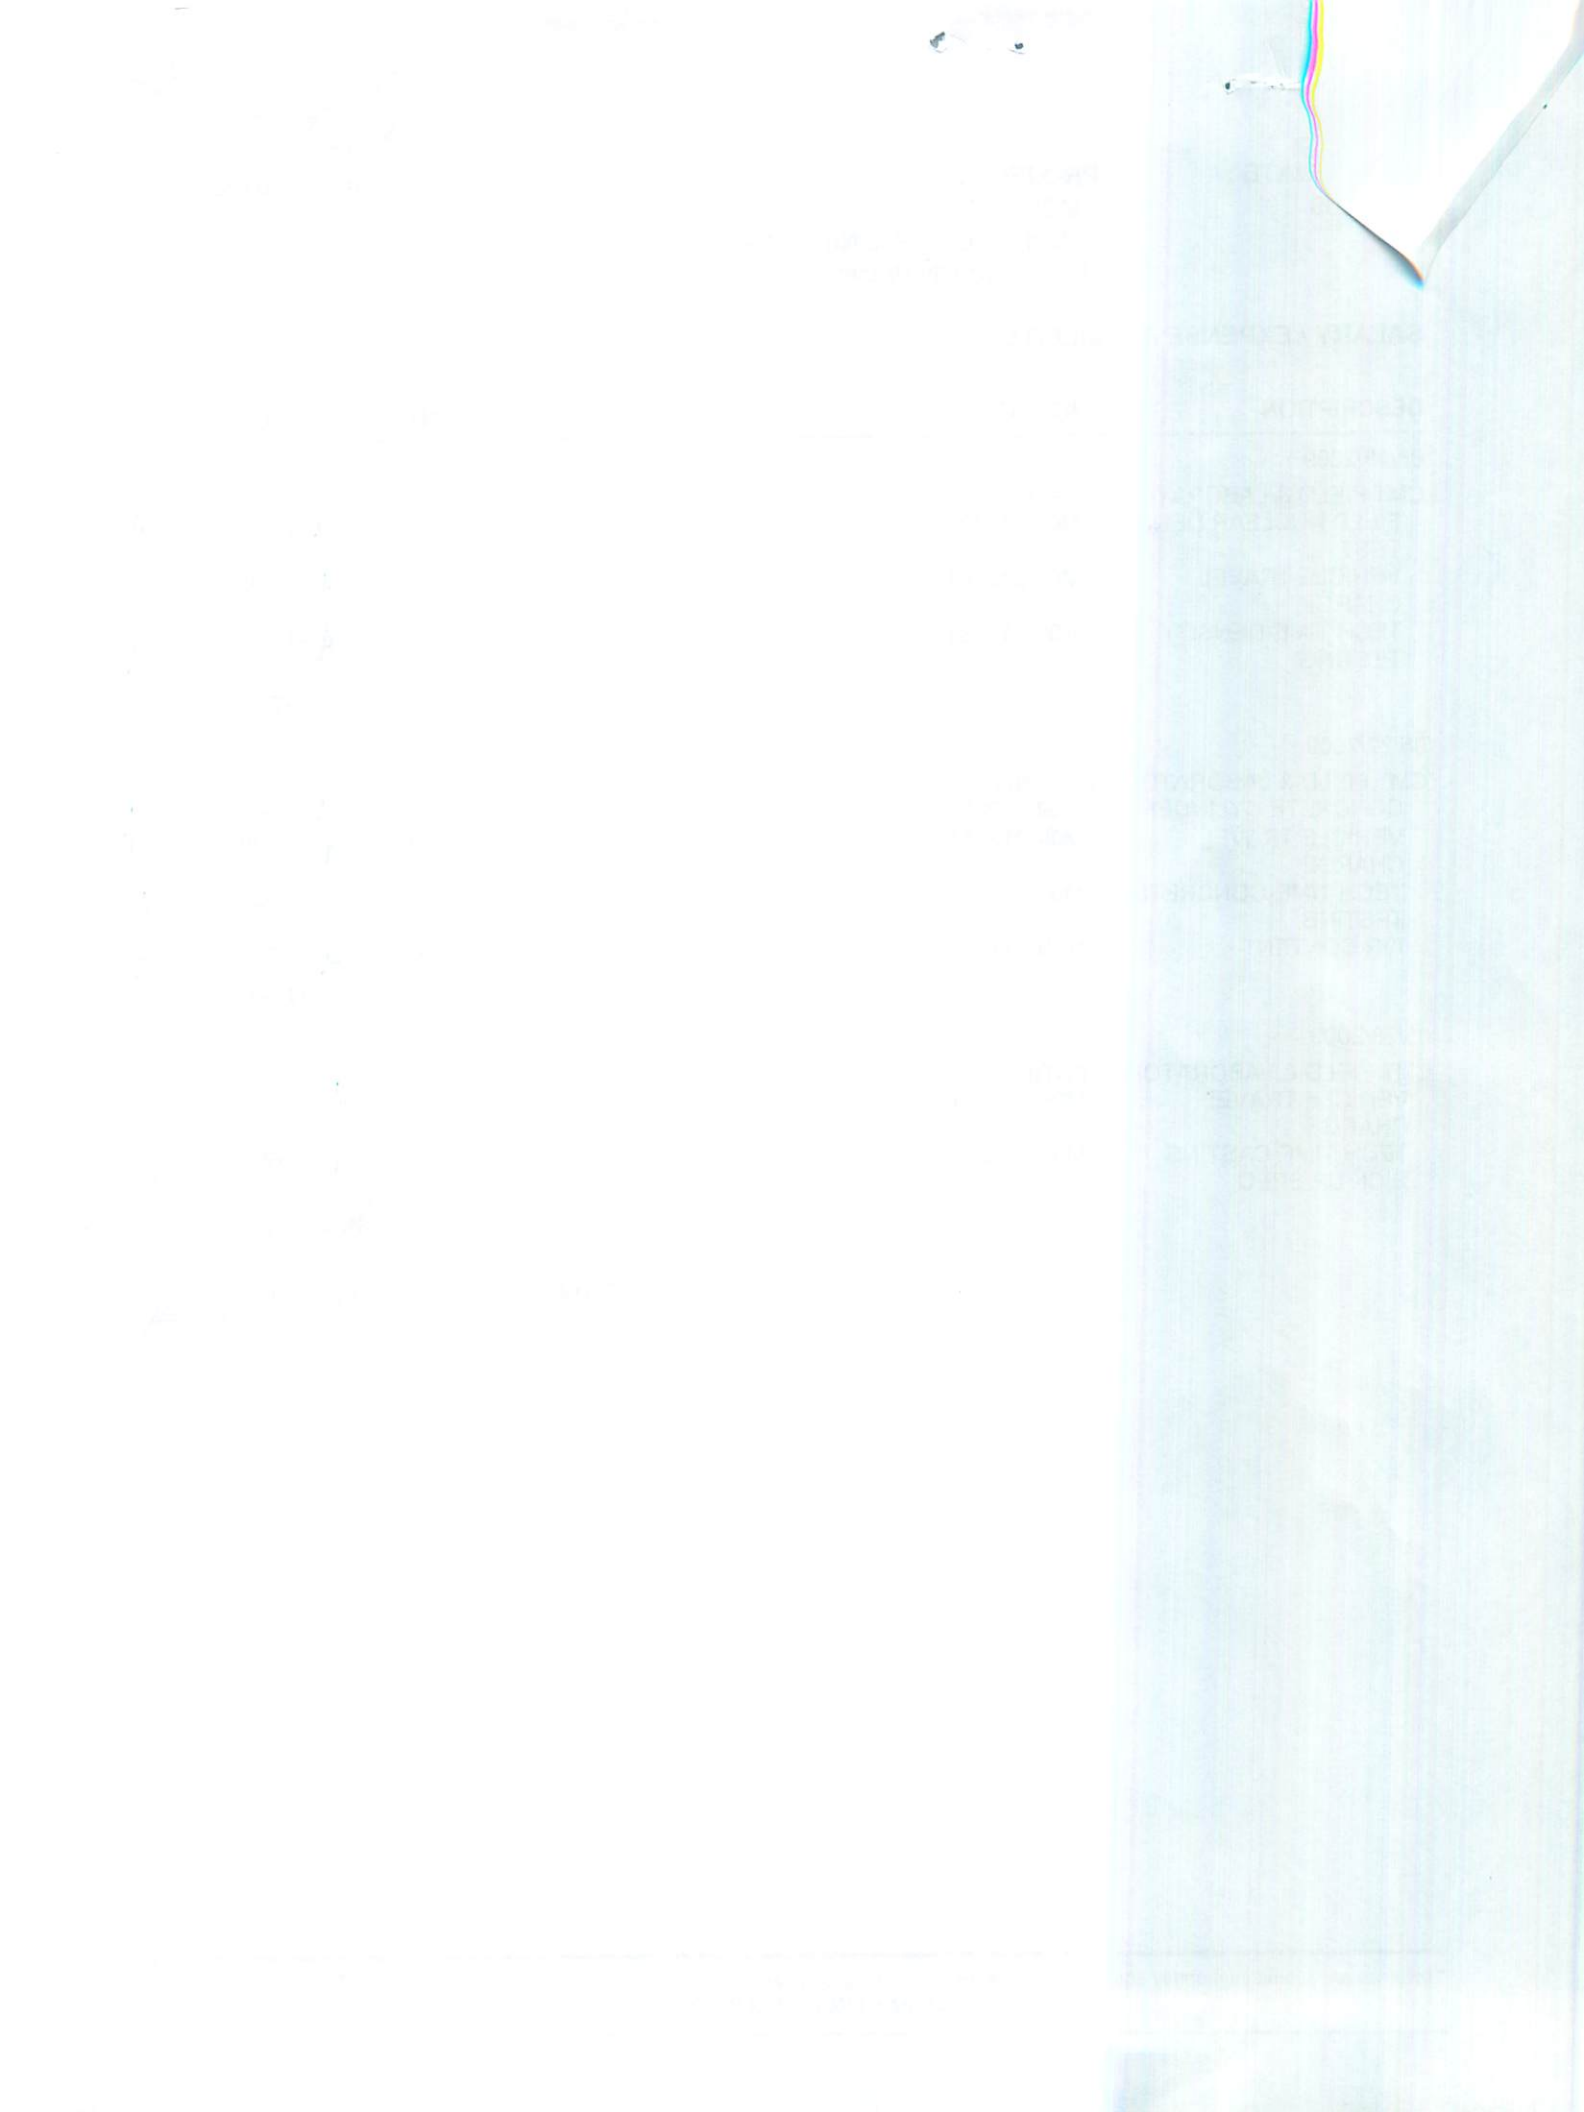



Raba-Kistner Consultants, Inc.
 800 E. Hackberry
 McAllen, Texas 78501
 (956) 682-5332 • FAX (956) 682-5487
 www.rkci.com

FIELD TEST REPORT

Soil/Base Material Nuclear Density Test

ATTN.: MR. ERALIO PALACIOS, H.C.PCNT. 2B-CAP COORD.
 TO: HIDALGO COUNTY PRECINCT NO. 2
 301 EAST STATE
 PHARR, TEXAS 78577

PROJECT NO.: AMD09-052-00
 DATE OF TEST: 05/15/2009
 ASSIGNMENT NO.: M09-012181
 REPORT VERSION: A
 SHEET NUMBER: 1 of 1
 TECHNICIAN: VICTOR SALINAS, III

PROJECT: Hidalgo County Pct. No. 2 - Eldora (Gardens-B.C.A.)
 Prog. Cont. No. C-CAP-08-018-08-26, San Juan, Tx.)

TEST NO.	TEST LOCATION	SOIL TYPE	LIFT NO.	MOISTURE CONTENT (%)	DRY DENSITY (PCF)	PERCENT PROCTOR (%)	CONFORM
5	Near STA.: 1 + 50, About 10'E of Centerline	1	FINAL	11.2	120.0	100.2	Yes
6	Near STA.: 3 + 00, About 10'W of Centerline	1	FINAL	10.9	120.4	100.5	Yes
7	Near STA.: 6 + 00, About 5'E of Centerline	1	FINAL	11.6	119.7	99.9	Yes
8	Near STA.: 9 + 00, on Centerline	1	FINAL	11.4	119.9	100.1	Yes

CURVE ID.	SOIL TYPE	OPTIMUM MOISTURE (%)	MAX. DRY DENSITY (PCF)	REQUIRED MOISTURE (%)	REQUIRED DENSITY (%)	LAB TEST PROCEDURE
1	Light Brown Caliche w/Gravel (In-Place Flexible Base Material) (PI:9)	10.9	119.8	8.9-12.9	95	TEX-113-E

REFERENCE: Angelica Street; Flexible Base/Pavement Section

FIELD TEST PROCEDURE: ASTM D 6938

GAUGE NUMBER: 4

REMARKS: Lift information provided by contractor.

PERSON NOTIFIED: Mr. Paulino R. w/Hidalgo County Precinct No. 2

CONTRACTOR: Jimmy Clossner & Sons Const. Co., Inc.

NOTICE: Raba-Kistner Consultants, Inc. considers the data and information contained in this report to be proprietary. This information is intended only for the use of the recipient(s) named herein. Test results presented herein relate only to those items tested. This document any information contained herein shall not be disclosed and shall not be duplicated or used in whole or in part for any purpose other than to validate test results without written approval from Raba-Kistner Consultants, Inc.

COPIES TO: Above (1)

- R. Gutierrez Engineering Corporation (1)
- Hidalgo County Precinct No. 2 (1)
- Jimmy Clossner & Sons Construction Comp., Inc. (1)

RABA-KISTNER CONSULTANTS, INC.

BY: Marta Vila, P.E.

Updated By: MM5/21/09 9:46 am



Raba-Kistner Consultants, Inc.
 800 E. Hackberry
 McAllen, Texas 78501
 (956) 682-5332 • FAX (956) 682-5487
 www.rkci.com

LABORATORY TEST REPORT

Compressive Strength Test

ATTN.: MR. ERALIO PALACIOS, H.C.PCNT. 2B-CAP COORD.
 TO: HIDALGO COUNTY PRECINCT NO. 2
 301 EAST STATE
 PHARR, TEXAS 78577

PROJECT NO.: AMD09-052-00
 CAST DATE: 05/27/2009
 ASSIGNMENT NO.: M09-012351
 REPORT VERSION: A
 TECHNICIAN: XAVIER R. SAENZ


PROJECT: Hidalgo County Pct. No. 2 - Eldora (Gardens-B.C.A. Prog. Cont. No. C-CAP-08-018-08-26, San Juan, Tx.)

SAMPLE LOCATION: Concrete Driveway Located at Physical Address 2903 Angelica Street

SET INDEX:	Set 1 of 1						
SUPPLIER:	Alamo Concrete	BATCH TIME:	10:41 a.m.	AIR CONTENT (%):	3.6		
TRUCK NO:	7245	SAMPLE TIME:	12:04 p.m.	UNIT WEIGHT (pcf):	ND		
TICKET NO:	1168	CONCRETE TEMP. (°F):	90	FIELD CURED (day):	1		
SAMPLED AT (cu yds):	10	AMBIENT TEMP. (°F):	90	SAMPLE TYPE:	Cylinder		
DESIGN STR.(psi):	3,000	SLUMP (in.):	4.75	SAMPLE SIZE(in.):	4 x 8		
PRODUCT NO.:	213031700						

SPECIMEN NUMBER	DATE OF TEST	AGE (days)	LOAD (lbs)	AREA (in. ²)	STRENGTH (psi)	PERCENT OF DESIGN	FRACTURE TYPE
9	06/03/2009	7	33,790	12.57	2,690	90	Type 3
10	06/03/2009	7	37,110	12.57	2,950	98	Type 3
11	06/24/2009	28	55,985	12.57	4,450	148	Type 3
12	06/24/2009	28	55,445	12.57	4,410	147	Type 3
13	06/24/2009	28	57,215	12.57	4,550	152	Type 3

NOTE: Some information on this test report provided by others. Testing and reporting was conducted in general accordance with the following applicable A.S.T.M. references: C31, C39, C109, C138, C143, C172, C173, C231, C495, C1019, and C1064.

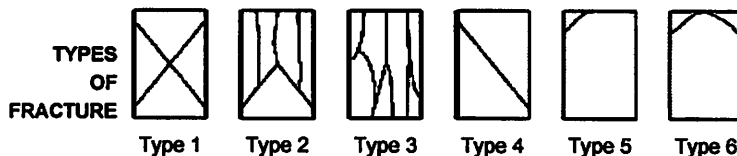

REMARKS: Mr. Joe Ybarra w/Jimmy Closner & Sons Construction Company, Inc., was verbally notified of field test results. ND-Not Determined; NP-Not Provided; NA-Not Applicable.

NOTICE: Raba-Kistner Consultants, Inc. considers the data and information contained in this report to be proprietary. This information is intended only for the use of the recipient(s) named herein. Test results presented herein relate only to those items tested. This document any information contained herein shall not be disclosed and shall not be duplicated or used in whole or in part for any purpose other than to validate test results without written approval from Raba-Kistner Consultants, Inc.

COPIES TO: Above (1)

R. Gutierrez Engineering Corporation(1)
 Hidalgo County Precinct No. 2(1)
 Jimmy Closner & Sons Construction Comp., Inc.(1)

RABA-KISTNER CONSULTANTS, INC

BY: *Maria Vilas PE*

Updated By: MMR 6/24/09 11:29 am