



SIGNATURE *[Signature]*
 R# 501038
 PO# 885818

Invoice

Date	Invoice #
4/8/2025	30087

P.O. Box 2724
 McAllen, Tx. 78502
 (956) 585-3773

Acct # 5-1290-441-67-115-218-3-740

Please send remittance with copy of invoice to:

Attn: Mrs. Aisha Gonzalez
 P.O. Box 2724
 McAllen, Tx. 78502

Bill To:

Hidalgo County Precinct #3
 724 Breyfogle Rd.
 Mission, TX 78574

Project Info:

C-24-0247-08-06
 WA#1 - Veterans Memorial Pavilion
 (ARPA-21-123-023)
 PO# 885818
 B2Z JOB #: 3104

Billing Period

March 2025

Description	Contract	Previous Applications	Current Completed	Total Completed	% Complete
Construction Material Testing Services (CMT)	\$ 35,050.20	\$ 15,772.59	\$ 1,752.51	\$ 17,525.10	50.0%
Total For This Billing Period					\$1,752.51

Work Authorization ~ Summary

WA No.	WA Amount	Previously Inv.	Percent Complete	Remaining Balance
1	\$35,050.20	\$15,772.59	50%	\$17,525.10

[Signature]
 Aisha Gonzalez - President

AI-99072

INVOICE RECEIVED BY *[Signature]*
 ON 4-8-25
 GOODS/SERVICES RECEIVED BY *[Signature]*
 ON 4-8-25

Client:
 Hidalgo County Precinct No. 3
 724 Breyfogle Rd
 Mission, TX 78574

Project:
 3104
 Veterans Memorial Pavilion
 300 S. Inspiration Rd.
 Mission, TX 78572

General Information

Sample Date:	03/14/2025	MF Sample Number:	8452
Sample From:	Subgrade	Material Type:	Subgrade
Sampled By:	Jorge Solis	Location Details:	Center of slab

Test Results

<p>Proctor Curve</p>	<table border="1"> <tr> <th>Preparation</th> <th>Method</th> </tr> <tr> <td>Dry</td> <td>Mechanical - Circular Face Rammer</td> </tr> </table>	Preparation	Method	Dry	Mechanical - Circular Face Rammer												
	Preparation	Method															
Dry	Mechanical - Circular Face Rammer																
	<table border="1"> <tr> <th>Moisture Content (%)</th> <th>Dry Density (Lbs./Cu.Ft.)</th> </tr> <tr> <td>10.77</td> <td>103.92</td> </tr> <tr> <td>13.27</td> <td>107.49</td> </tr> <tr> <td>16.24</td> <td>109.16</td> </tr> <tr> <td>20.06</td> <td>105.06</td> </tr> <tr> <td>Optimum Moisture:</td> <td>16.1</td> </tr> <tr> <td>Maximum Dry Density:</td> <td>109.2</td> </tr> <tr> <td>Specific Gravity (Assumed):</td> <td>2.65</td> </tr> </table>	Moisture Content (%)	Dry Density (Lbs./Cu.Ft.)	10.77	103.92	13.27	107.49	16.24	109.16	20.06	105.06	Optimum Moisture:	16.1	Maximum Dry Density:	109.2	Specific Gravity (Assumed):	2.65
Moisture Content (%)	Dry Density (Lbs./Cu.Ft.)																
10.77	103.92																
13.27	107.49																
16.24	109.16																
20.06	105.06																
Optimum Moisture:	16.1																
Maximum Dry Density:	109.2																
Specific Gravity (Assumed):	2.65																

Test Completed Date:	03/20/2025	Test Completed By:	Jorge Solis
-----------------------------	------------	---------------------------	-------------

Test Results: The test is for informational purposes.

Test Method (As Applicable): Tex 114-E / ASTM D-698 Method-A, Method-B or Method-C ;
 Tex 104-E, Tex 105-E, Tex 106-E / ASTM D4318 ;
 Tex 110-E / ASTM C-136

Respectfully Submitted by B2Z Engineering

Jorge Solis

 Jorge Solis, Laboratory Manager

Mission Office
 900 S Stewart Rd, Ste. 2
 Mission, TX 78572
 Phone: 956-585-3773

Client:
 Hidalgo County Precinct No. 3
 724 Breyfogle Rd
 Mission, TX 78574

Project:
 3104
 Veterans Memorial Pavilion
 300 S. Inspiration Rd.
 Mission, TX 78572

General Information

Sample Date:	03/14/2025	Sample Number:	8452
Sample From:	Subgrade	Material Type:	Subgrade
Technician:	Jorge Solis	Location Details:	Center of slab

Atterberg Limits

Liquid Limit (%)	Plastic Limit (%)	Plastic Index	Specification Requirements	Pass/Fail
33	14	19	PI 8-30	Pass

Test Completed Date:	03/14/2025	Test Completed By:	Jorge Solis
----------------------	------------	--------------------	-------------

Test Results: The above test result meets the technical specifications.

Test Method (As Applicable):
 Tex 104-E, Tex 105-E, Tex 106-E / ASTM D4318

Respectfully Submitted by B2Z Engineering

Jorge Solis
 Jorge Solis, Laboratory Manager


Client:
Hidalgo County Precinct No. 3
724 Breyfogle Rd
Mission, TX 78574

Project:
3104
Veterans Memorial Pavilion
300 S. Inspiration Rd.
Mission, TX 78572

General Information

Sample Date:	03/14/2025	MF Sample Number:	8453
Sample From:	Stockpile	Material Description:	Flexbase
Sampled By:	Jorge Solis	Location Details:	Jobsite

Test Results

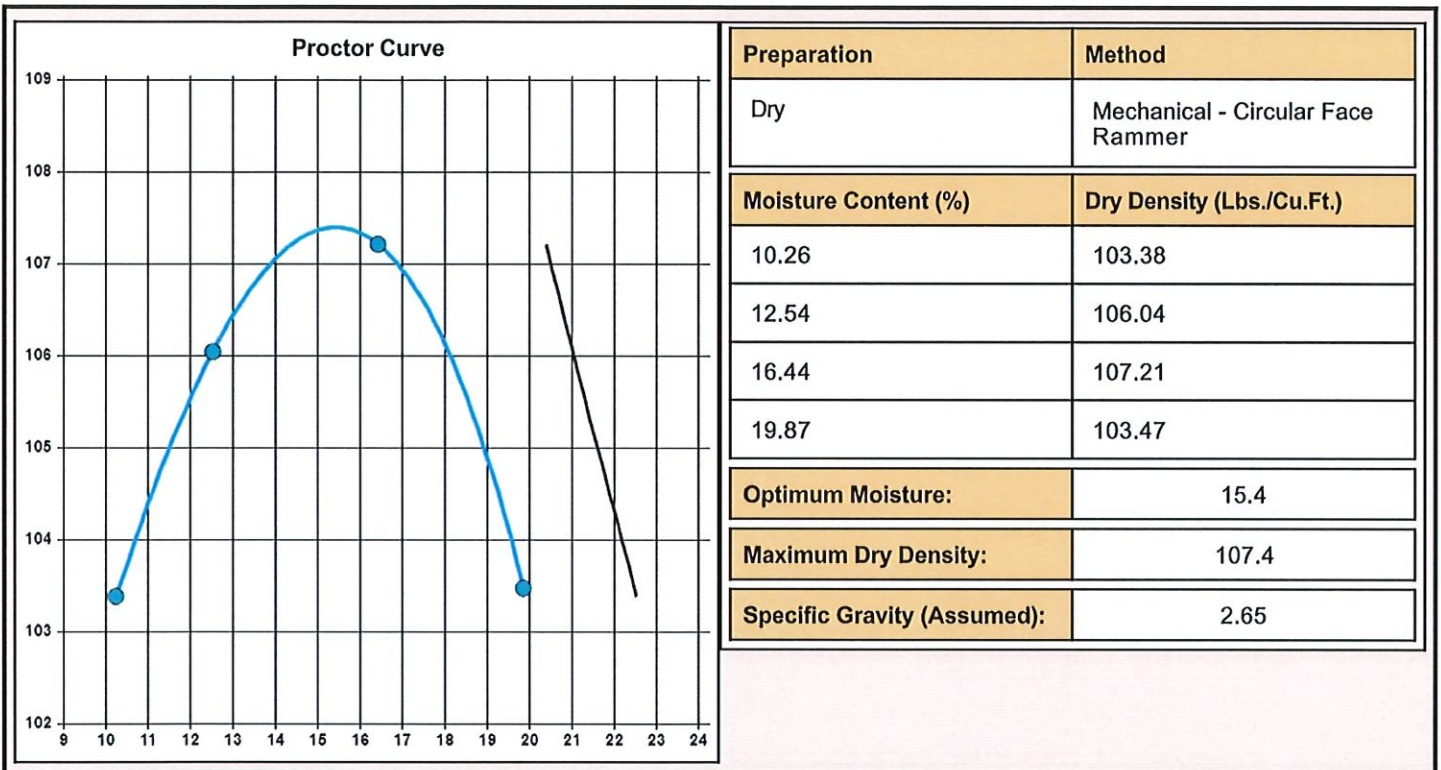

Test Completed Date:	03/20/2025	Test Completed By:	Jorge Solis
-----------------------------	------------	---------------------------	-------------

Test Results: The test is for informational purposes.

Test Method (As Applicable): Tex 114-E / ASTM D-698 Method-A, Method-B or Method-C ;
Tex 104-E, Tex 105-E, Tex 106-E / ASTM D4318 ;
Tex 110-E / ASTM C-136

Respectfully Submitted by B2Z Engineering

Jorge Solis

Jorge Solis, Laboratory Manager

Client:Hidalgo County Precinct No. 3
724 Breyfogle Rd
Mission, TX 78574**Project:**3104
Veterans Memorial Pavilion
300 S. Inspiration Rd.
Mission, TX 78572**General Information**

Sample Date:	03/14/2025	Sample Number:	8453
Sample From:	Stockpile	Material Description:	Flexbase
Technician:	Jorge Solis	Location Details:	Jobsite

Atterberg Limits

Liquid Limit (%)	Plastic Limit (%)	Plastic Index	Specification Requirements	Pass/Fail
24	20	4	≤ 12	Pass

Test Completed Date:	03/19/2025	Test Completed By:	Jorge Solis
-----------------------------	------------	---------------------------	-------------

Test Results: The above test result meets the technical specifications.
--

Test Method (As Applicable):
Tex 104-E, Tex 105-E, Tex 106-E / ASTM D4318

Respectfully Submitted by B2Z Engineering



Jorge Solis, Laboratory Manager