

WR: 90695066

JOVITA ST (KRISTI EST)

Reference Pole 1
Latitude: 26.2722
Longitude: -98.3555

Pole 5
48509944534135
Install
35-5
Secondary DE Pole
DS501
Install
14 Ft Alum Upswept
122 W LED Light
DS1460-A

Pole 4
48511954534105
Install
35-5
Secondary TAN Pole
DS500
Install
14 Ft Alum Upswept
122 W LED Light
DS1460-A

Pole 3
48513594534079
Install
35-5
Secondary TAN Pole
DS500
Install
14 Ft Alum Upswept
122 W LED Light
DS1460-A

Pole 2
48514254534098
Existing
40-5
Single Phase Pole
Deadend
DS115
Install
Secondary DE Framing
DS501
Install
Sidewalk Guy

Pole 1
48515654534076
Existing
40-5
3 Phase Pole
DS301
Install
14 Ft Alum Upswept
122 W LED Light
DS1460-A

Pole 6
48516484534141
Existing
40-2
Single Phase DE Pole
DS115
Existing
25 kVA - 120 V-240 V
XFMR
120/240 1Ph 3 Wire
DS1012

CIAC \$21,372.18
CUSTOMER TO TRIM
VEGETATION/BRANCHES
FOR LINE PATH
TO UNMETERED
ESID#10032789483942293


Note to Crew:
-Update each pole ID tag with correct 14 digit GPS location number marked in **RED** which matches the XY coordinates obtained by GPS. **Blue** numbers refer to previous location ID
INSTALLING OH FACILITIES TO SERVE 11 SLTS FOR HIDALGO COUNTY
CONTACT: MARTIN MARTINEZ 956-292-7025

Job Description: 11 NEW SL's - 122W LED MOUNTED ON 14 FT POLES		WR: 90695066	
Customer: MARTIN MARTINEZ		WO: DCP0375219	
Location: 175 4907 LA HOMAR RD		Man Hours: 70.86	
District: 175 - Mission		County: HIDALGO	
City: MISSION		Project ID: TXLEDTCC1	
Circuit / Station: 94SB2820/PALMHURST		Crew HQ: 11712	
N V: 12.47KV		Phases: ABC N	
Drawn By: MICHAEL MORIN		OWR: N/A	
Tree Trimming: By Customer		ESID: N/A	
Office #: 9562786994		Accessible: Yes	
Issued for:		Scale: 1"=100'	
<h1>Final</h1>		Page 1 of 3	
		Rev. N/A	

COLOR CODE LEGEND
RED -New Facilities
GREEN -Exisitng/Transfer Facilities
BLUE -Facilities to Be Removed



WR: 90695066

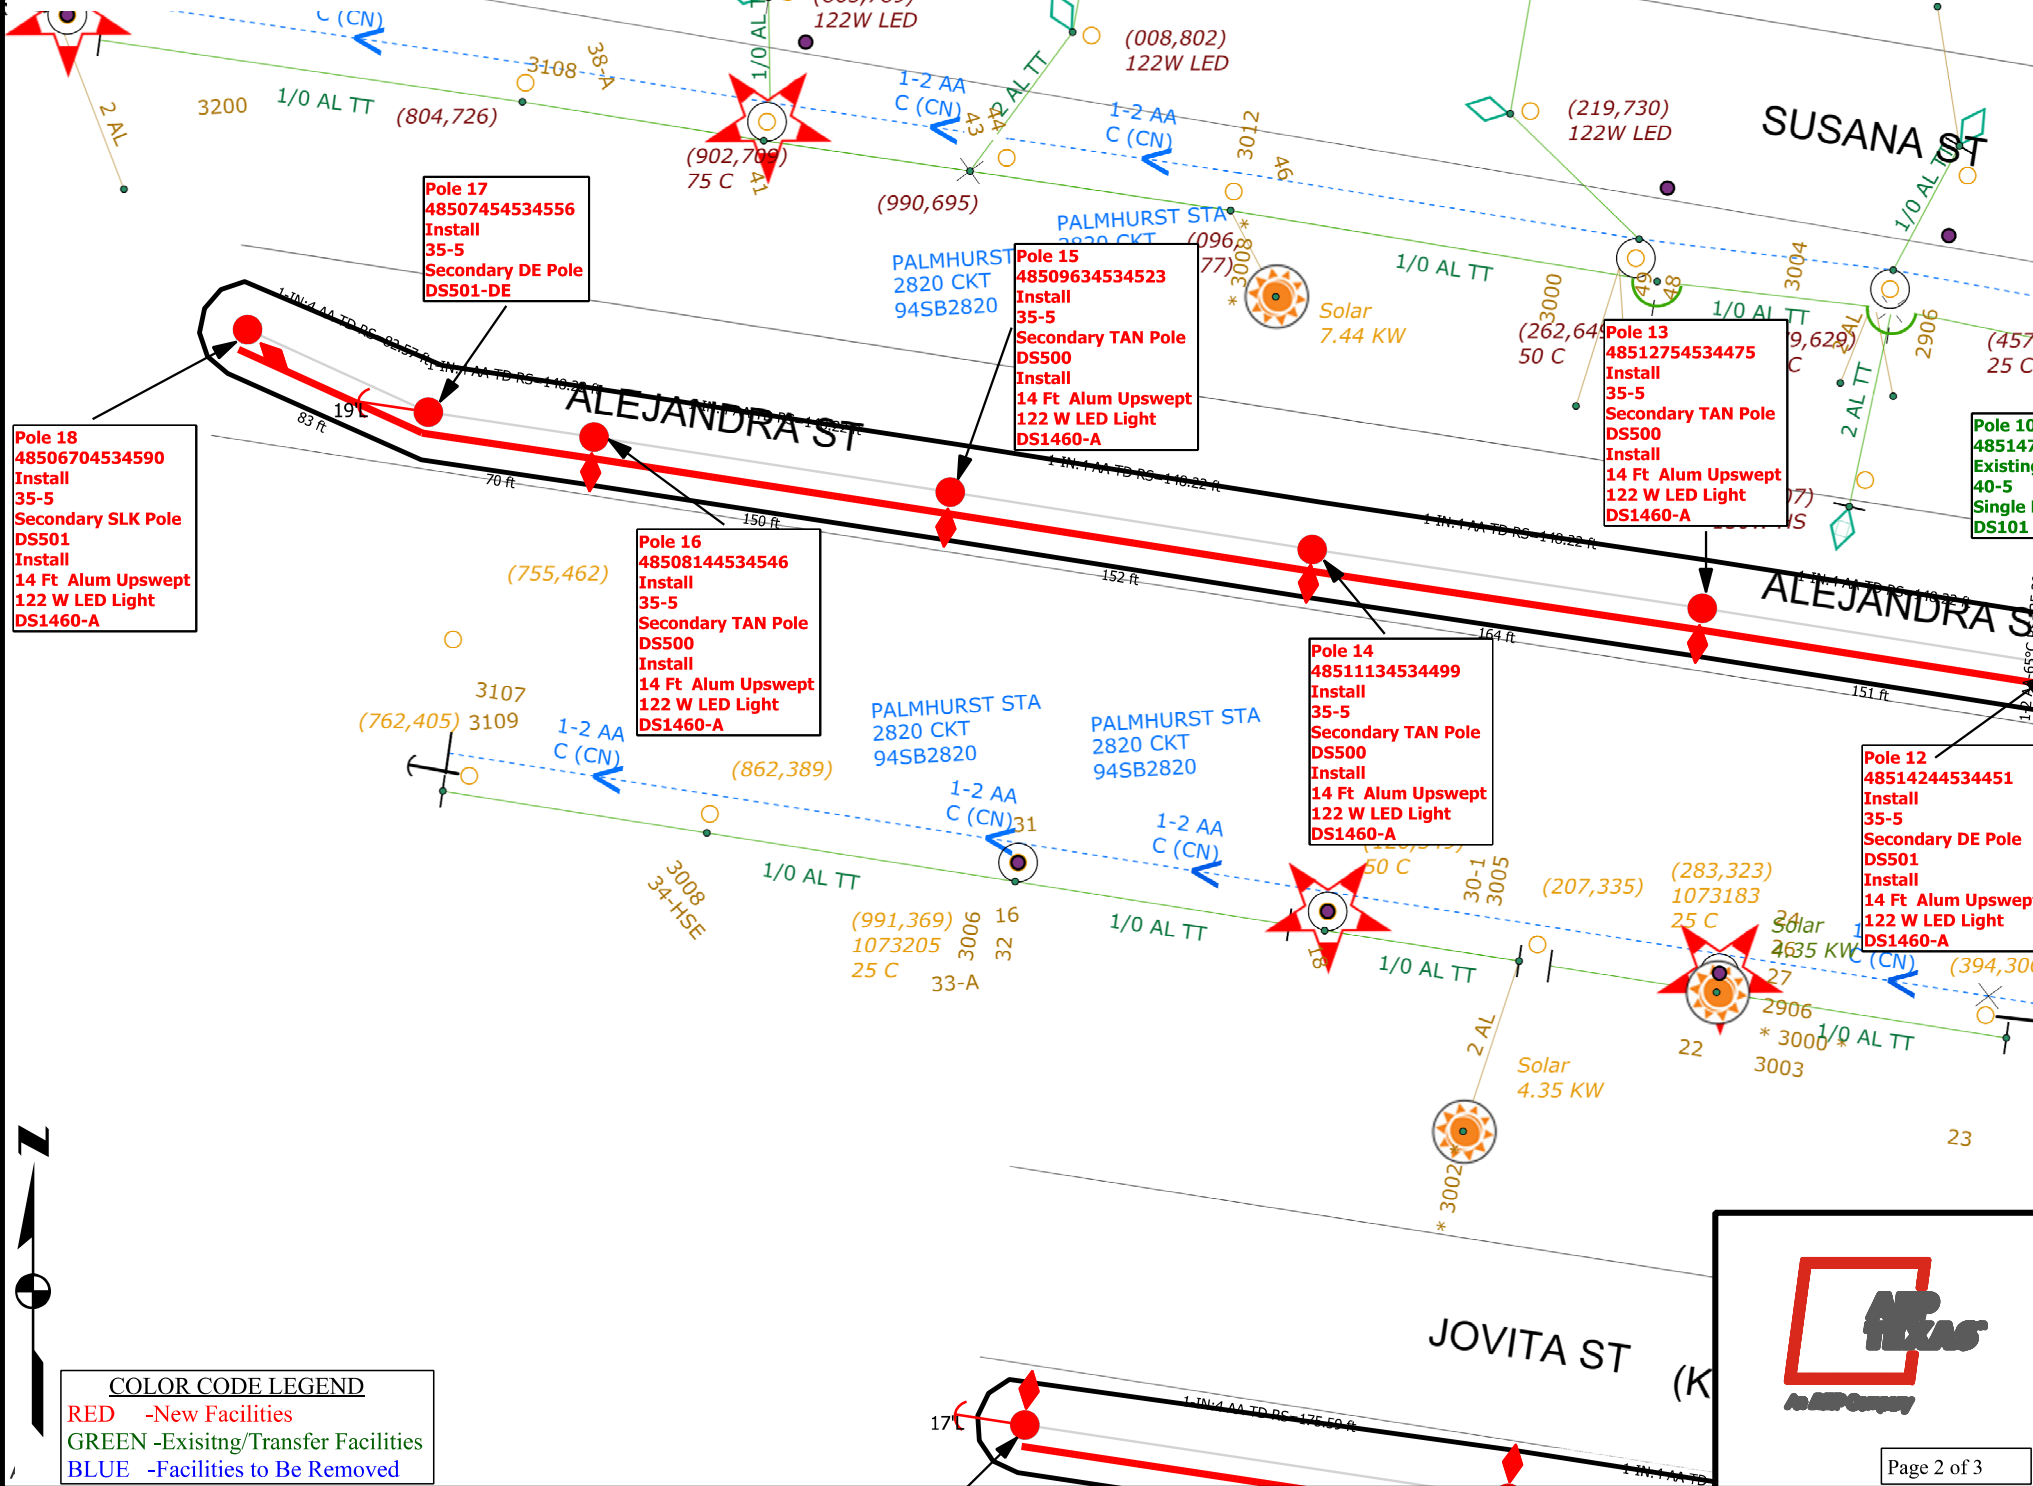

Pole 18
 48506704534590
 Install
 35-5
 Secondary SLK Pole
 DS501
 Install
 14 Ft Alum Upswept
 122 W LED Light
 DS1460-A

Pole 17
 48507454534556
 Install
 35-5
 Secondary DE Pole
 DS501-DE

Pole 16
 48508144534546
 Install
 35-5
 Secondary TAN Pole
 DS500
 Install
 14 Ft Alum Upswept
 122 W LED Light
 DS1460-A

Pole 15
 48509634534523
 Install
 35-5
 Secondary TAN Pole
 DS500
 Install
 14 Ft Alum Upswept
 122 W LED Light
 DS1460-A


Pole 14
 48511134534499
 Install
 35-5
 Secondary TAN Pole
 DS500
 Install
 14 Ft Alum Upswept
 122 W LED Light
 DS1460-A

Pole 13
 48512754534475
 Install
 35-5
 Secondary TAN Pole
 DS500
 Install
 14 Ft Alum Upswept
 122 W LED Light
 DS1460-A

Pole 12
 48514244534451
 Install
 35-5
 Secondary DE Pole
 DS501
 Install
 14 Ft Alum Upswept
 122 W LED Light
 DS1460-A

COLOR CODE LEGEND
 RED -New Facilities
 GREEN -Existing/Transfer Facilities
 BLUE -Facilities to Be Removed



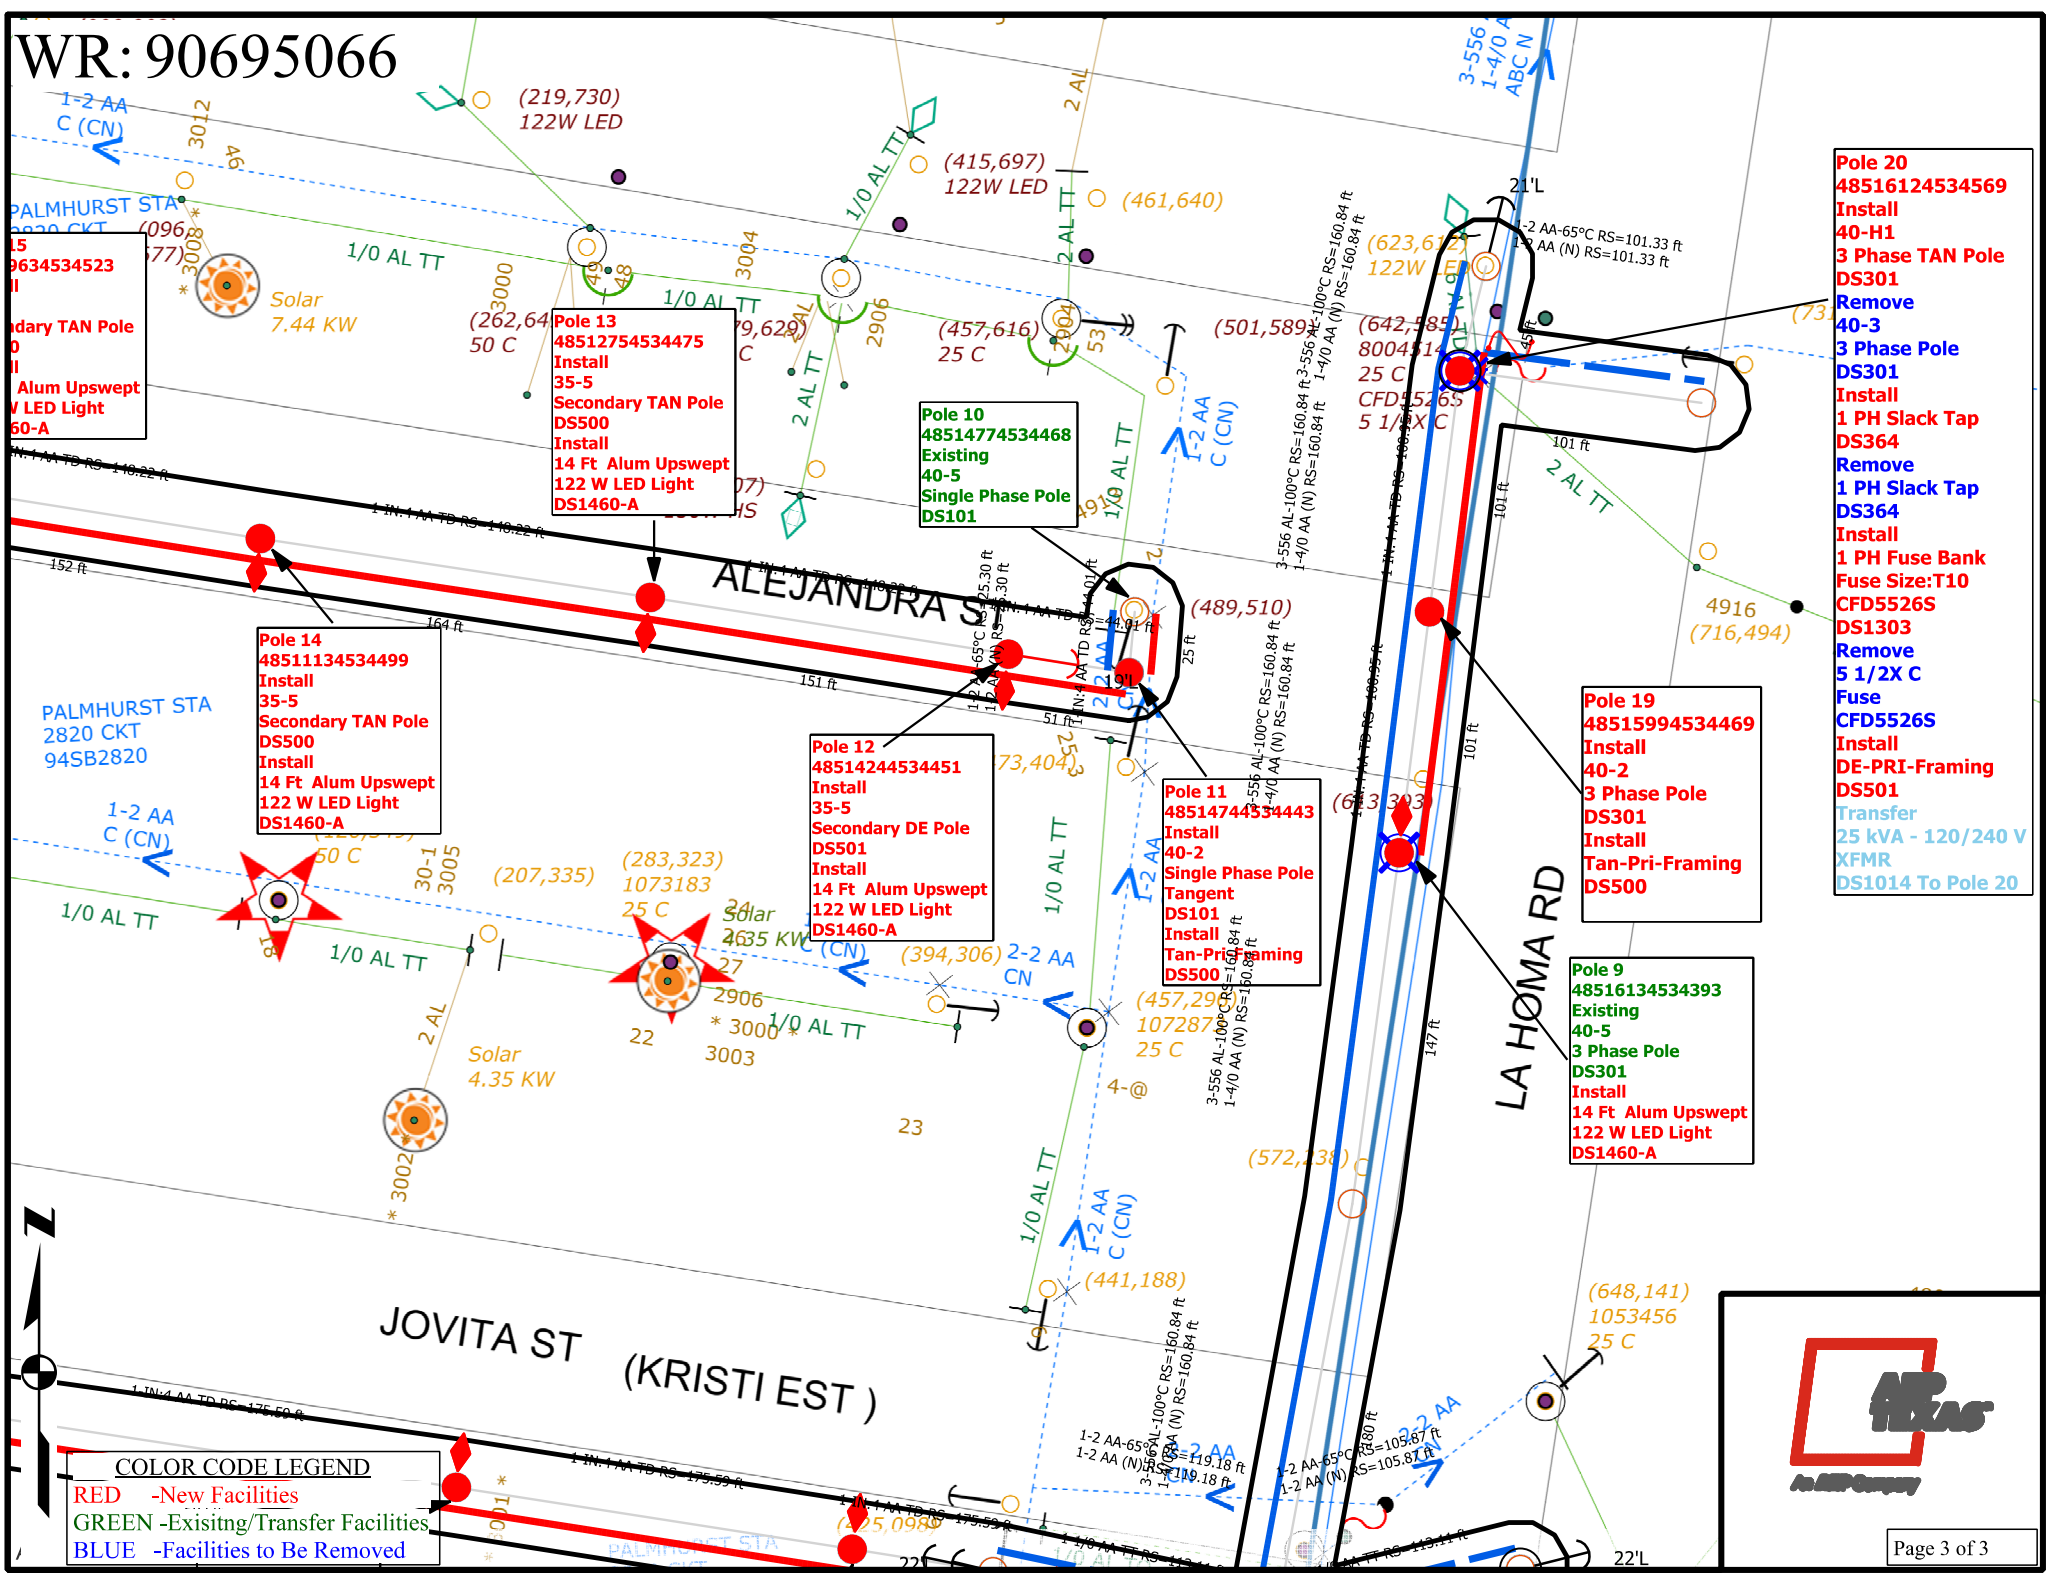

Pole 20
 48516124534569
 Install
 40-H1
 3 Phase TAN Pole
 DS301
 Remove
 40-3
 3 Phase Pole
 DS301
 Install
 1 PH Slack Tap
 DS364
 Remove
 1 PH Slack Tap
 DS364
 Install
 1 PH Fuse Bank
 Fuse Size:T10
 CFD5526S
 DS1303
 Remove
 5 1/2X C
 Fuse
 CFD5526S
 Install
 DE-PRI-Framing
 DS501
 Transfer
 25 kVA - 120/240 V
 XFMR
 DS1014 To Pole 20

Pole 19
 48515994534469
 Install
 40-2
 3 Phase Pole
 DS301
 Install
 Tan-Pri-Framing
 DS500

Pole 9
 48516134534393
 Existing
 40-5
 3 Phase Pole
 DS301
 Install
 14 Ft Alum Upswept
 122 W LED Light
 DS1460-A

Pole 11
 48514744534443
 Install
 40-2
 Single Phase Pole
 Tangent
 DS101
 Install
 Tan-Pri-Framing
 DS500

Pole 12
 48514244534451
 Install
 35-5
 Secondary DE Pole
 DS501
 Install
 14 Ft Alum Upswept
 122 W LED Light
 DS1460-A

Pole 13
 48512754534475
 Install
 35-5
 Secondary TAN Pole
 DS500
 Install
 14 Ft Alum Upswept
 122 W LED Light
 DS1460-A

Pole 14
 48511134534499
 Install
 35-5
 Secondary TAN Pole
 DS500
 Install
 14 Ft Alum Upswept
 122 W LED Light
 DS1460-A

COLOR CODE LEGEND
 RED -New Facilities
 GREEN -Existing/Transfer Facilities
 BLUE -Facilities to Be Removed

