



Pharr, Texas 78577
 San Benito, Texas 78556
 Laredo, Texas 78041

Client Address: Hidalgo County Precinct 4
 1051 N. Doolittle
 Edinburg, TX. 78542 USA

Account No.: HCP4-2019
 Project No: 01-25-19143
 Project Desc.: South East Park (Betts/Esparza) Project

===== Invoice Detail by Report =====

<u>Report No.</u>	<u>Sampled</u>	<u>Qty</u>	<u>Billing Code</u>	<u>Unit Type</u>	<u>Unit Rate</u>	<u>Extension</u>
43643-1	03/05/2026	1.00	M500-5 - Soil Vehicle Trip (each)	Each	\$55.00	\$55.00
43643-1	03/05/2026	0.50	M501 - Clerical	Hour	\$78.00	\$39.00
43643-1	03/05/2026	0.50	M510 - Project Management (hourly)	Hour	\$105.00	\$52.50
43643-1	03/05/2026	1.00	M520 - Test Report (each)	Report	\$40.00	\$40.00
43643-1	03/05/2026	0.50	P101 - Project Engineer (hourly)	Hour	\$180.00	\$90.00
43643-1	03/05/2026	1.00	S100 - Atterberg Limits (each)	Each	\$80.00	\$80.00
43643-1	03/05/2026	1.00	S104 - Percent Passing No. 200 Sieve (each)	Each	\$58.00	\$58.00
43643-1	03/05/2026	1.00	S105 - Standard Proctor (each)	Each	\$220.00	\$220.00
43643-1	03/05/2026	4.00	T702 - Soil Field Testing & Observation (hourly)	Hour	\$90.00	\$360.00
Client PO Nbr: 900107						Report Number 43643-1 for a Subtotal of: \$994.50
43643-2	03/05/2026	0.50	M501 - Clerical	Hour	\$78.00	\$39.00
43643-2	03/05/2026	0.50	M510 - Project Management (hourly)	Hour	\$105.00	\$52.50
43643-2	03/05/2026	1.00	M520 - Test Report (each)	Report	\$40.00	\$40.00
43643-2	03/05/2026	0.50	P101 - Project Engineer (hourly)	Hour	\$180.00	\$90.00
43643-2	03/05/2026	1.00	S100 - Atterberg Limits (each)	Each	\$80.00	\$80.00
43643-2	03/05/2026	1.00	S104 - Percent Passing No. 200 Sieve (each)	Each	\$58.00	\$58.00
43643-2	03/05/2026	1.00	S105 - Standard Proctor (each)	Each	\$220.00	\$220.00
43643-2	03/05/2026	2.00	T701 - Engineering Tech (Sample Prep.)	Hour	\$90.00	\$180.00
Client PO Nbr: 900107						Report Number 43643-2 for a Subtotal of: \$759.50
43643-3	03/05/2026	0.50	M501 - Clerical	Per Report	\$78.00	\$39.00
43643-3	03/05/2026	0.50	M510 - Project Management (hourly)	Hour	\$105.00	\$52.50
43643-3	03/05/2026	1.00	M520 - Test Report (each)	Report	\$40.00	\$40.00
43643-3	03/05/2026	0.50	P101 - Project Engineer (hourly)	Hour	\$180.00	\$90.00
43643-3	03/05/2026	1.00	S100 - Atterberg Limits (each)	Each	\$80.00	\$80.00
43643-3	03/05/2026	1.00	S104 - Percent Passing No. 200 Sieve (each)	Each	\$58.00	\$58.00

REMIT TO: Millennium Engineers Group, Inc.
 PO BOX 4569
 Edinburg, Texas 78540

Net 30 Days

Past Due Balances Subject to 1.5% Service Charge Per Month



Pharr, Texas 78577
 San Benito, Texas 78556
 Laredo, Texas 78041

===== Invoice Detail by Report =====

<u>Report No.</u>	<u>Sampled</u>	<u>Qty</u>	<u>Billing Code</u>	<u>Unit Type</u>	<u>Unit Rate</u>	<u>Extension</u>
43643-3	03/05/2026	1.00	S105 - Standard Proctor (each)	Each	\$220.00	\$220.00
43643-3	03/05/2026	2.00	T701 - Engineering Tech (Sample Prep.)	Hour	\$90.00	\$180.00
Client PO Nbr: 900107						Report Number 43643-3 for a Subtotal of: \$759.50
43643-4	03/05/2026	0.50	M501 - Clerical	Hour	\$78.00	\$39.00
43643-4	03/05/2026	0.50	M510 - Project Management (hourly)	Hour	\$105.00	\$52.50
43643-4	03/05/2026	1.00	M520 - Test Report (each)	Report	\$40.00	\$40.00
43643-4	03/05/2026	0.50	P101 - Project Engineer (hourly)	Hour	\$180.00	\$90.00
43643-4	03/05/2026	1.00	S100 - Atterberg Limits (each)	Each	\$80.00	\$80.00
43643-4	03/05/2026	1.00	S104 - Percent Passing No. 200 Sieve (each)	Each	\$58.00	\$58.00
43643-4	03/05/2026	1.00	S105 - Standard Proctor (each)	Each	\$220.00	\$220.00
43643-4	03/05/2026	2.00	T701 - Engineering Tech (Sample Prep.)	Hour	\$90.00	\$180.00
Client PO Nbr: 900107						Report Number 43643-4 for a Subtotal of: \$759.50
43643-5	03/05/2026	0.50	M501 - Clerical	Hour	\$78.00	\$39.00
43643-5	03/05/2026	0.50	M510 - Project Management (hourly)	Hour	\$105.00	\$52.50
43643-5	03/05/2026	1.00	M520 - Test Report (each)	Report	\$40.00	\$40.00
43643-5	03/05/2026	0.50	P101 - Project Engineer (hourly)	Hour	\$180.00	\$90.00
43643-5	03/05/2026	1.00	S100 - Atterberg Limits (each)	Each	\$80.00	\$80.00
43643-5	03/05/2026	1.00	S104 - Percent Passing No. 200 Sieve (each)	Each	\$58.00	\$58.00
43643-5	03/05/2026	1.00	S105 - Standard Proctor (each)	Each	\$220.00	\$220.00
43643-5	03/05/2026	2.00	T701 - Engineering Tech (Sample Prep.)	Hour	\$90.00	\$180.00
Client PO Nbr: 900107						Report Number 43643-5 for a Subtotal of: \$759.50
43728-1	03/16/2026	1.00	C300 - Air Content (Pressure)	Each	\$25.00	\$25.00
43728-1	03/16/2026	4.00	C303 - Concrete Specimen (Compression)	Each	\$16.00	\$64.00
43728-1	03/16/2026	1.00	C319 - Slump Test	Each	\$20.00	\$20.00
43728-1	03/16/2026	2.00	M500-1 - Vehicle Trip Charge (Concrete)	Each	\$55.00	\$110.00
43728-1	03/16/2026	1.00	M501 - Clerical	Per Report	\$78.00	\$78.00
43728-1	03/16/2026	1.00	M510 - Project Management (hourly)	Hour	\$105.00	\$105.00
43728-1	03/16/2026	2.00	M520 - Test Report (each)	Report	\$40.00	\$80.00
43728-1	03/16/2026	1.00	P101 - Project Engineer (hourly)	Hour	\$180.00	\$180.00
43728-1	03/16/2026	9.00	T704 - Concrete Engineering Technician	Hour	\$90.00	\$810.00
Client PO Nbr: 900107						Report Number 43728-1 for a Subtotal of: \$1,472.00
43769-1	03/18/2026	1.00	M500-5 - Soil Vehicle Trip (each)	Each	\$55.00	\$55.00

REMIT TO: Millennium Engineers Group, Inc.
 PO BOX 4569
 Edinburg, Texas 78540

Net 30 Days

Past Due Balances Subject to 1.5% Service Charge Per Month



Pharr, Texas 78577
 San Benito, Texas 78556
 Laredo, Texas 78041

===== Invoice Detail by Report =====

<u>Report No.</u>	<u>Sampled</u>	<u>Qty</u>	<u>Billing Code</u>	<u>Unit Type</u>	<u>Unit Rate</u>	<u>Extension</u>	
43769-1	03/18/2026	0.50	M501 - Clerical	Hour	\$78.00	\$39.00	
43769-1	03/18/2026	0.50	M510 - Project Management (hourly)	Hour	\$105.00	\$52.50	
43769-1	03/18/2026	1.00	M520 - Test Report (each)	Report	\$40.00	\$40.00	
43769-1	03/18/2026	0.50	P101 - Project Engineer (hourly)	Hour	\$180.00	\$90.00	
43769-1	03/18/2026	3.00	S108 - Nuclear Density Test (each)	Each	\$28.00	\$84.00	
43769-1	03/18/2026	4.00	T702 - Soil Field Testing & Observation (hourly)	Hour	\$90.00	\$360.00	
Client PO Nbr: 900107						Report Number 43769-1 for a Subtotal of:	\$720.50
43782-1	03/19/2026	1.00	M500-5 - Soil Vehicle Trip (each)	Each	\$55.00	\$55.00	
43782-1	03/19/2026	0.50	M501 - Clerical	Per Report	\$78.00	\$39.00	
43782-1	03/19/2026	0.50	M510 - Project Management (hourly)	Hour	\$105.00	\$52.50	
43782-1	03/19/2026	1.00	M520 - Test Report (each)	Report	\$40.00	\$40.00	
43782-1	03/19/2026	0.50	P101 - Project Engineer (hourly)	Hour	\$180.00	\$90.00	
43782-1	03/19/2026	6.00	S108 - Nuclear Density Test (each)	Each	\$28.00	\$168.00	
43782-1	03/19/2026	4.00	T702 - Soil Field Testing & Observation (hourly)	Hour	\$90.00	\$360.00	
Client PO Nbr: 900107						Report Number 43782-1 for a Subtotal of:	\$804.50
43799-1	03/20/2026	1.00	M500-5 - Soil Vehicle Trip (each)	Each	\$55.00	\$55.00	
43799-1	03/20/2026	0.50	M501 - Clerical	Hour	\$78.00	\$39.00	
43799-1	03/20/2026	0.50	M510 - Project Management (hourly)	Hour	\$105.00	\$52.50	
43799-1	03/20/2026	1.00	M520 - Test Report (each)	Report	\$40.00	\$40.00	
43799-1	03/20/2026	0.50	P101 - Project Engineer (hourly)	Hour	\$180.00	\$90.00	
43799-1	03/20/2026	3.00	S108 - Nuclear Density Test (each)	Each	\$28.00	\$84.00	
43799-1	03/20/2026	4.00	T702 - Soil Field Testing & Observation (hourly)	Hour	\$90.00	\$360.00	
Client PO Nbr: 900107						Report Number 43799-1 for a Subtotal of:	\$720.50
43805-1	03/21/2026	1.00	M500-5 - Soil Vehicle Trip (each)	Each	\$55.00	\$55.00	
43805-1	03/21/2026	0.50	M501 - Clerical	Hour	\$78.00	\$39.00	
43805-1	03/21/2026	0.50	M510 - Project Management (hourly)	Hour	\$105.00	\$52.50	
43805-1	03/21/2026	1.00	M520 - Test Report (each)	Report	\$40.00	\$40.00	
43805-1	03/21/2026	0.50	P101 - Project Engineer (hourly)	Hour	\$180.00	\$90.00	
43805-1	03/21/2026	5.00	S108 - Nuclear Density Test (each)	Each	\$28.00	\$140.00	
43805-1	03/21/2026	4.00	T702 - Soil Field Testing & Observation (hourly)	Hour	\$90.00	\$360.00	
Client PO Nbr: 900107						Report Number 43805-1 for a Subtotal of:	\$776.50

REMIT TO: Millennium Engineers Group, Inc.
 PO BOX 4569
 Edinburg, Texas 78540

Net 30 Days

Past Due Balances Subject to 1.5% Service Charge Per Month



Pharr, Texas 78577
 San Benito, Texas 78556
 Laredo, Texas 78041

===== Invoice Detail by Report =====

<u>Report No.</u>	<u>Sampled</u>	<u>Qty</u>	<u>Billing Code</u>	<u>Unit Type</u>	<u>Unit Rate</u>	<u>Extension</u>	
43832-1	03/24/2026	1.00	M500-5 - Soil Vehicle Trip (each)	Each	\$55.00	\$55.00	
43832-1	03/24/2026	0.50	M501 - Clerical	Hour	\$78.00	\$39.00	
43832-1	03/24/2026	0.50	M510 - Project Management (hourly)	Hour	\$105.00	\$52.50	
43832-1	03/24/2026	1.00	M520 - Test Report (each)	Report	\$40.00	\$40.00	
43832-1	03/24/2026	0.50	P101 - Project Engineer (hourly)	Hour	\$180.00	\$90.00	
43832-1	03/24/2026	8.00	S108 - Nuclear Density Test (each)	Each	\$28.00	\$224.00	
43832-1	03/24/2026	6.00	T702 - Soil Field Testing & Observation (hourly)	Hour	\$90.00	\$540.00	
Client PO Nbr: 900107						Report Number 43832-1 for a Subtotal of:	\$1,040.50
43841-1	03/25/2026	1.00	M500-5 - Soil Vehicle Trip (each)	Each	\$55.00	\$55.00	
43841-1	03/25/2026	0.50	M501 - Clerical	Hour	\$78.00	\$39.00	
43841-1	03/25/2026	0.50	M510 - Project Management (hourly)	Hour	\$105.00	\$52.50	
43841-1	03/25/2026	1.00	M520 - Test Report (each)	Report	\$40.00	\$40.00	
43841-1	03/25/2026	0.50	P101 - Project Engineer (hourly)	Hour	\$180.00	\$90.00	
43841-1	03/25/2026	4.00	S108 - Nuclear Density Test (each)	Each	\$28.00	\$112.00	
43841-1	03/25/2026	4.00	T702 - Soil Field Testing & Observation (hourly)	Hour	\$90.00	\$360.00	
Client PO Nbr: 900107						Report Number 43841-1 for a Subtotal of:	\$748.50
						Total for this Invoice:	\$10,315.50

REMIT TO: Millennium Engineers Group, Inc.
 PO BOX 4569
 Edinburg, Texas 78540

Net 30 Days

Past Due Balances Subject to 1.5% Service Charge Per Month



Area Offices
 5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
 30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
 5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Report On: Proctor - Soils

Lab No: 43643-1

Project No: 01-25-19143 Acct. No.: HCP4-2019

Report No: 43643-1


Page 1 of 1

Client: Hidalgo County Precinct 4
 1051 N. Doolittle
 Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/09/2026 **Revised**
Prev. Rpt. Date: 03/09/2026 **Test Report**
Sample Date: 03/05/2026
Sampled By: Garza, Jose
By Order Of: Celos Gonzalez
Client PO: 900107
Field ID: P-0305-104

Location: Large Pavilion (Basketball)
 Onsite
Material: Subgrade

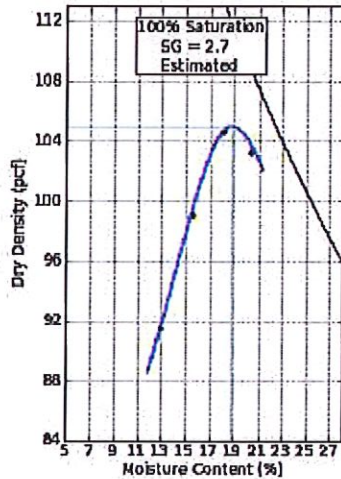

% Moisture		Dry Density Lbs./Cu.Ft.	
12.9		91.50	
15.6		99.00	
18.0		104.6	
20.4		103.2	
18.7	Optimum	104.9	Maximum

Sieve	% Passing	Low	Hi
No. 4	100		
No. 10	100		
No. 40	99		
No. 200	66		

Color: dk Brown
 Description: Sandy Lean Clay
 Texture: Silt Loam
 Liquid Limit: 43
 Plastic Limit: 15
 Plasticity Index: 28
 Group Symbol: CL

Desc of Rammer: Manual
 Preparation Method: Moist

Test Method (As Applicable): ASTM D 1140, ASTM D 2487, ASTM D 4318, ASTM D-698 Method-B

Respectfully Submitted,
 Millennium Engineers Group, Inc.

Juan Borjon
 Juan Borjon, P.E.





5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Area Offices

Report On: Proctor - Soils

Lab No: 43643-2

Project No: 01-25-19143

Acct. No.: HCP4-2019

Report No: 43643-2

Page 1 of 1


Client: Hidalgo County Precinct 4
1051 N. Doolittle
Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/09/2026 **Revised**
Prev. Rpt. Date: 03/09/2026 **Test Report**
Sample Date: 03/05/2026
Sampled By: Jose Garza
By Order Of: Celos Gonzalez
Client PO: 900107
Field ID: P-0305-105

Location: Small Pavilion
Onsite

Material: Subgrade

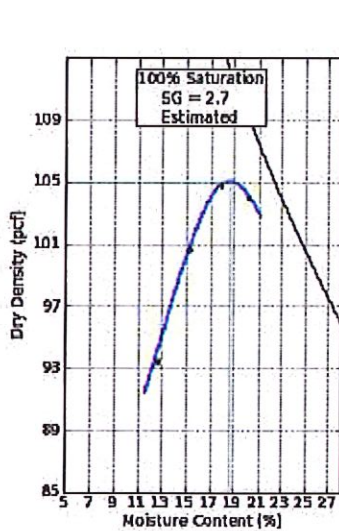

% Moisture	Dry Density Lbs./Cu.Ft.
12.6	93.40
15.2	100.6
17.8	104.8
20.2	104.0
18.6 Optimum	105.0 Maximum

Sieve	% Passing	Low	Hi
No. 4	100		
No. 10	100		
No. 40	99		
No. 200	67		

Color: Brown
Description: Sandy Lean Clay

Texture: Silt Loam

Liquid Limit: 43
Plastic Limit: 14
Plasticity Index: 29
Group Symbol: CL

Desc of Rammer: Manual
Preparation Method: Moist

Test Method (As Applicable): ASTM D 1140, ASTM D 2487, ASTM D 4318, ASTM D-698 Method-B

Respectfully Submitted,
Millennium Engineers Group, Inc.

Juan Borjon
Juan Borjon, P.E.



Area Offices
 5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
 30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
 5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Report On: Proctor - Soils

Lab No: 43643-3

Project No: 01-25-19143 Acct. No.: HCP4-2019

Report No: 43643-3

Page 1 of 1


Client: Hidalgo County Precinct 4
 1051 N. Doolittle
 Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/09/2026 **Revised**
Prev. Rpt. Date: 03/09/2026 **Test Report**
Sample Date: 03/05/2026
Sampled By: Jose Garza
By Order Of: Celos Gonzalez
Client PO: 900107
Field ID: P-0305-106

Location: Large Restrooms, Onsite
 East Side of Large Pavilion

Material: Subgrade

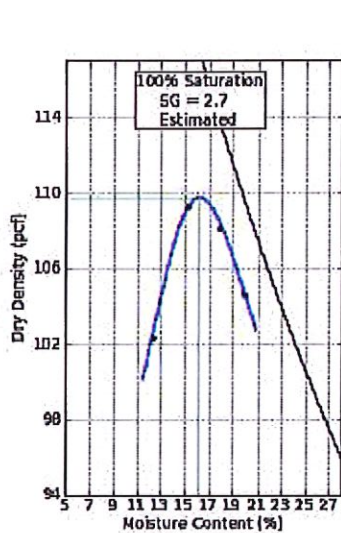

% Moisture		Dry Density Lbs./Cu.Ft.	
	12.5		102.3
	15.2		109.2
	17.8		108.1
	19.9		104.6
	16.2 Optimum		109.7 Maximum
Sieve	% Passing	Low	Hi
No. 10	100		
No. 40	100		
No. 200	61		

Color: Brown
 Description: Sandy Lean Clay
 Texture: Silt Loam
 Liquid Limit: 37
 Plastic Limit: 13
 Plasticity Index: 24
 Group Symbol: CL

Desc of Rammer: Manual
 Preparation Method: Moist

Test Method (As Applicable): ASTM D 1140, ASTM D 2487, ASTM D 4318, ASTM D-698 Method-B

Respectfully Submitted,
 Millennium Engineers Group, Inc.

Juan Borjon
 Juan Borjon, P.E.





Area Offices

5804 N. Gumwood Ave.	Pharr, Texas 78577	956-702-8500
30745 E. Exp 83	San Benito, Texas 78586	956-300-2500
5918 McPherson Rd., Ste. 5	Laredo, Texas 78041	956-552-8200

Report On: Proctor - Soils

Lab No: 43643-4

Report No: 43643-4

Page 1 of 1

Project No: 01-25-19143 Acct. No.: HCP4-2019


Client: Hidalgo County Precinct 4
1051 N. Doolittle
Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/09/2026 **Revised**
Prev. Rpt. Date: 03/09/2026 **Test Report**
Sample Date: 03/05/2026
Sampled By: Jose Garza
By Order Of: Celos Gonzalez
Client PO: 900107
Field ID: P-0305-107

Location: Small Restrooms, Onsite
East Side of Basketball Pavilion

Material: Subgrade

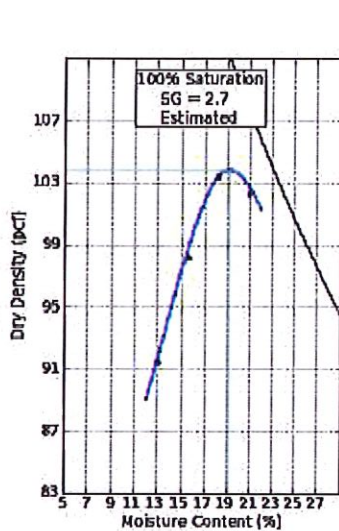

<u>% Moisture</u>	<u>Dry Density Lbs./Cu.Ft.</u>
13.1	91.40
15.6	98.20
18.2	103.4
21.0	102.3
19.2 Optimum	103.8 Maximum

<u>Sieve</u>	<u>% Passing</u>	<u>Low</u>	<u>Hi</u>
No. 4	100		
No. 10	100		
No. 40	99		
No. 200	70		

Color: Brown
Description: Sandy Lean Clay

Texture: Silt Loam

Liquid Limit: 46
Plastic Limit: 15
Plasticity Index: 31
Group Symbol: CL

Desc of Rammer: Manual
Preparation Method: Moist

Test Method (As Applicable): ASTM D 1140, ASTM D 2487, ASTM D 4318, ASTM D-698 Method-B

Respectfully Submitted,
Millennium Engineers Group, Inc.

Juan Borjon
Juan Borjon, P.E.



Area Offices
 5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
 30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
 5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Report On: Proctor - Soils

Lab No: 43643-5

Project No: 01-25-19143 Acct. No.: HCP4-2019

Report No: 43643-5

Page 1 of 1


Client: Hidalgo County Precinct 4
 1051 N. Doolittle
 Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/10/2026 **Revised**
Prev. Rpt. Date: 03/10/2026 **Test Report**
Sample Date: 03/05/2026
Sampled By: Jose Garza
By Order Of: Celos Gonzalez
Client PO: 900107
Field ID: P-0305-108

Location: Tony's Pit

Material: Select Fill

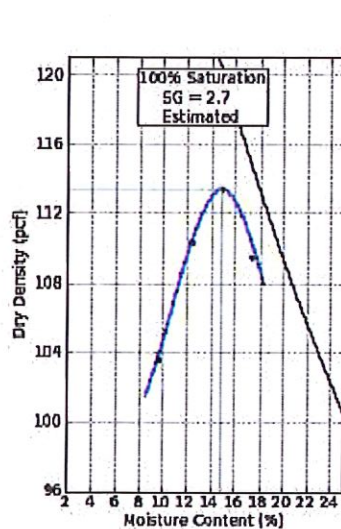

		<u>% Moisture</u>	<u>Dry Density Lbs./Cu.Ft.</u>
		9.6	103.6
		12.4	110.3
		14.9	113.4
		17.4	109.5
		14.9 Optimum	113.4 Maximum
<u>Sieve</u>	<u>% Passing</u>	<u>Low</u>	<u>Hi</u>
No. 4	99		
No. 10	99		
No. 40	98		
No. 200	55		
Color: Brown			
Description: Sandy Lean Clay			
Texture: Sandy Loam			
<u>Required</u>			
Liquid Limit: 29			
Plastic Limit: 13			
Plasticity Index: 16 8-20			
Group Symbol: CL			

Desc of Rammer: Manual
 Preparation Method: Moist

Test Method (As Applicable): ASTM D 1140, ASTM D 2487, ASTM D 4318, ASTM D-698 Method-B

Respectfully Submitted,
 Millennium Engineers Group, Inc.

Juan Borjon
 Juan Borjon, P.E.





Area Offices
 5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
 30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
 5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Report On: Air Content & Slump

Lab No: 43728-1

Report No: 43728-1

Page 1 of 1

Project No: 01-25-19143 **Acct. No.:** HCP4-2019

Client: Hidalgo County Precinct 4
1051 N. Doolittle
Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/17/2026 **Revised**
Prev. Rpt. Date: 03/17/2026 **Test Report**
Sample Date: 03/16/2026
Sampled By: Ramirez, Ricardo
By Order Of: Celos Gonzalez
Client PO: 900107
Field ID: 01-25-19143

Location: Sidewalk

Material: Set #1 = 4(4x8) cylinders

Spec Nbr	Sampled At	Truck No	Total Yards	Ticket No	Water Added	Mix Code	Time Sampled	Amb Temp (°F)	Mix Temp (°F)	Slump (In.)	Air %
1	Truck	365	9.5	617886	No	3000CR1	09:15 am	57	68	4.50	1.00

Placement Location: Sidewalk on North Edge of Project

Date Tested: 03/16/2026
Source: CRM
Plant: 1

Remarks: On 03/17/2026, a representative of Millennium Engineers Group, Inc. was dispatched to the project site to pick up the specimens cast on the previous day. The specimens were transported to the laboratory where they were stripped from their forms, properly labeled, and placed in curing tanks in preparation for compressive strength testing intervals of 7 and 28 days.

Test Method (As Applicable): Unless noted, concrete was sampled and tested in accordance with ASTM C172, C143, C231, C1064, C1231/C617, C1054 and C138. Compressive strength tests per ASTM C39, C31.

Respectfully Submitted,
Millennium Engineers Group, Inc.

Juan Borjon
Juan Borjon, P.E.





5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Area Offices

Report On: Soil Densities

Lab No: 43769-1

Project No: 01-25-19143 Acct. No.: HCP4-2019

Report No: 43769-1

Page 1 of 1

Client: Hidalgo County Precinct 4
1051 N. Doolittle
Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Location: Restroom Area

Report Date: 03/19/2026 **Revised**
Prev. Rpt. Date: 03/19/2026 **Test Report**
Sample Date: 03/18/2026
Sampled By: Torre, Cesar
By Order Of: Celos Gonzalez
Client PO: 900107

Proctor No	Proctor Date	Optimum Moisture (%)	Maximum Dry Density (pcf)	Color / Description
43643-5	03/05/2026	14.9	113.4	Brown / Sandy Lean Clay

Specification

Specification No.	Compaction, %	Moisture Band	
		Minimum	Maximum
1	95	-2.0	2.0

Material: Subgrade

Test No.	Depth Inches	Location	Wet Density (pcf)	Moisture Content (%)	Dry Density (pcf)	Proctor Number	Spec. No.	Percent Proctor Density	Pass Fail
1	6	Small Restroom, 13'N, 18'E from SWC of Pad	124.9	14.8	108.8	43643-5	1	95.9	Pass
2	6	Large Restroom, 10'E, 14'S from NWC of Pad	124.8	17.3	106.4	43643-5	1	93.8	Fail

Gauge No.: 76308 Daily Standard Counts: 03/18/2026 DS: 2472 MS: 673

Remarks: Retest on No.2
Test Methods: ASTM D2922, D3017

Respectfully Submitted,
Millennium Engineers Group, Inc.

Juan Borjon
Juan Borjon, P.E.





Area Offices
 5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
 30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
 5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Report On: Soil Densities

Lab No: 43782-1

Project No: 01-25-19143 Acct. No.: HCP4-2019

Report No: 43782-1

Page 1 of 2

Client: Hidalgo County Precinct 4
1051 N. Doolittle
Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/20/2026 **Revised**
Prev. Rpt. Date: 03/20/2026 **Test Report**
Sample Date: 03/19/2026
Sampled By: Guerrero, Ayme
By Order Of: Celos Gonzalez
Client PO: 900107

Location: Large Pavilion, Large and Small Restroom

Proctor No	Proctor Date	Optimum Moisture (%)	Maximum Dry Density (pcf)	Color / Description
43643-1	03/05/2026	18.7	104.9	dk Brown / Sandy Lean Clay
43643-3	03/05/2026	16.2	109.7	Brown / Sandy Lean Clay
43643-5	03/05/2026	14.9	113.4	Brown / Sandy Lean Clay

Specification

Specification No.	Compaction, %	Moisture Band	
		Minimum	Maximum
1	95	-3.0	3.0

Material: Select Fill, 2nd Lift.

Test No.	Depth Inches	Location	Wet Density (pcf)	Moisture Content (%)	Dry Density (pcf)	Proctor Number	Spec. No.	Percent Proctor Density	Pass Fail
3	6	Small Restroom, 6' South End. 5' North End.	132.3	14.2	115.9	43643-5	1	102.2	Pass

Material: Subgrade, 1st Lift.

Test No.	Depth Inches	Location	Wet Density (pcf)	Moisture Content (%)	Dry Density (pcf)	Proctor Number	Spec. No.	Percent Proctor Density	Pass Fail
1	6	Large Restroom 3' East End.	123.9	16.1	106.7	43643-3	1	97.3	Pass
2	12	Large Restroom, 6' West End.	126.4	15.9	109.1	43643-3	1	99.5	Pass
4	12	Large Pavilion, 15' SEC. 6' East Edge.	121.6	15.9	104.9	43643-1	1	100.0	Pass
5	12	Large Pavilion, 55' North Edge. 25' East Edge.	123.5	16.2	106.3	43643-1	1	101.3	Pass

Respectfully Submitted,
Millennium Engineers Group, Inc.

Juan Borjon
Juan Borjon, P.E.





Area Offices
 5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
 30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
 5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Report On: Soil Densities

Lab No: 43782-1

Project No: 01-25-19143 Acct. No.: HCP4-2019

Report No: 43782-1

Page 2 of 2

Client: Hidalgo County Precinct 4
1051 N. Doolittle
Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Location: Large Pavilion, Large and Small Restroom

Report Date: 03/20/2026 **Revised**
Prev. Rpt. Date: 03/20/2026 **Test Report**
Sample Date: 03/19/2026
Sampled By: Guerrero, Ayme
By Order Of: Celos Gonzalez
Client PO: 900107

Material: Subgrade, 1st Lift.

Test No.	Depth Inches	Location	Wet Density (pcf)	Moisture Content (%)	Dry Density (pcf)	Proctor Number	Spec. No.	Percent Proctor Density	Pass Fail
6	12	Large Pavilion, 8' NWC.	126.9	16.3	109.1	43643-1	1	104.0	Pass

Gauge No.: 80569 Daily Standard Counts: 03/19/2026 DS: 2575 MS: 695

Test Methods: ASTM D2922, D3017

Respectfully Submitted,
Millennium Engineers Group, Inc.

Juan Borjon
Juan Borjon, P.E.





5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Area Offices

Report On: Soil Densities

Lab No: 43799-1

Project No: 01-25-19143 Acct. No.: HCP4-2019

Report No: 43799-1

Page 1 of 1

Client: Hidalgo County Precinct 4
1051 N. Doolittle
Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Location: Restrooms

Report Date: 03/22/2026

Sample Date: 03/20/2026

Sampled By: Torre, Cesar

By Order Of: Celos Gonzalez

Client PO: 900107

Proctor No	Proctor Date	Optimum Moisture (%)	Maximum Dry Density (pcf)	Color / Description
43643-5	03/05/2026	14.9	113.4	Brown / Sandy Lean Clay

Specification

Specification No.	Compaction, %	Moisture Band	
		Minimum	Maximum
1	95	-2.0	3.0

Material: Select Fill, 1st Lift

Test No.	Depth Inches	Location	Wet Density (pcf)	Moisture Content (%)	Dry Density (pcf)	Proctor Number	Spec. No.	Percent Proctor Density	Pass Fail
1	6	Small Restroom, 10'S, 13'E of NWC of Pad	127.6	15.8	110.2	43643-5	1	97.2	Pass
2	6	Large Restroom, 20'W, 10'S of SEC of Pad	127.6	15.6	110.4	43643-5	1	97.4	Pass
3	6	Large Restroom, 15'E, 8'S, of NWC of Pad	127.2	17.2	108.5	43643-5	1	95.7	Pass

Gauge No.: 76308 Daily Standard Counts: 03/20/2026 DS: 2495 MS: 673

Test Methods: ASTM D2922, D3017

Respectfully Submitted,
Millennium Engineers Group, Inc.

Juan Borjon
Juan Borjon, P.E.





5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Area Offices

Report On: Soil Densities

Lab No: 43805-1

Project No: 01-25-19143 Acct. No.: HCP4-2019

Report No: 43805-1

Page 1 of 2

Client: Hidalgo County Precinct 4
1051 N. Doolittle
Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/22/2026

Sample Date: 03/21/2026

Sampled By: Perez, Javier

By Order Of: Celos Gonzalez

Client PO: 900107

Location: Pavillion, Large and Small Restrooms

Proctor No	Proctor Date	Optimum Moisture (%)	Maximum Dry Density (pcf)	Color / Description
43643-2	03/05/2026	18.6	105.0	Brown / Sandy Lean Clay
43643-5	03/05/2026	14.9	113.4	Brown / Sandy Lean Clay

Specification

Specification No.	Compaction, %	Moisture Band	
		Minimum	Maximum
1	98	-3.0	3.0

Material: Select Fill

Test No.	Depth Inches	Location	Wet Density (pcf)	Moisture Content (%)	Dry Density (pcf)	Proctor Number	Spec. No.	Percent Proctor Density	Pass Fail
1	6	Large Restroom, 10' W, 10' N, SEC of Pad, 2nd Lift	129.3	14.1	113.3	43643-5	1	99.9	Pass
2	6	Large Restroom, 15' W, 8' N, SWC of Pad, 2nd Lift	128.6	14.6	112.2	43643-5	1	98.9	Pass
5	6	Small Restroom, 5' W of Center Point, 1st Lift	128.3	14.9	111.7	43643-5	1	98.5	Pass

Material: Subgrade

Test No.	Depth Inches	Location	Wet Density (pcf)	Moisture Content (%)	Dry Density (pcf)	Proctor Number	Spec. No.	Percent Proctor Density	Pass Fail
3	12	Small Pavillion, 15' S, 10' E, NWC of Pad, 1st and Final Lift	123.5	15.6	106.8	43643-2	1	101.7	Pass

Respectfully Submitted,
Millennium Engineers Group, Inc.

Juan Borjon
Juan Borjon, P.E.





Area Offices
 5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
 30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
 5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Report On: Soil Densities

Lab No: 43805-1

Project No: 01-25-19143 Acct. No.: HCP4-2019

Report No: 43805-1

Page 2 of 2

Client: Hidalgo County Precinct 4
 1051 N. Doolittle
 Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/22/2026

Sample Date: 03/21/2026

Sampled By: Perez, Javier

By Order Of: Celos Gonzalez

Client PO: 900107

Location: Pavillion, Large and Small Restrooms

Material: Subgrade

Test No.	Depth Inches	Location	Wet Density (pcf)	Moisture Content (%)	Dry Density (pcf)	Proctor Number	Spec. No.	Percent Proctor Density	Pass Fail
4	12	Small Pavillion, 15' N, 20' W, SEC of Pad, 1st and Final Lift	122.0	15.4	105.7	43643-2	1	100.7	Fail

Gauge No.: 79169 Daily Standard Counts: 03/21/2026 DS: 2329 MS: 641

Remarks: ** Re-testing will be required for Test No. 4.
 Test Methods: ASTM D2922, D3017

Respectfully Submitted,
 Millennium Engineers Group, Inc.

Juan Borjon
 Juan Borjon, P.E.





5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Area Offices

Report On: Soil Densities

Lab No: 43832-1

Project No: 01-25-19143 Acct. No.: HCP4-2019

Report No: 43832-1

Page 1 of 2

Client: Hidalgo County Precinct 4
1051 N. Doolittle
Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/24/2026

Sample Date: 03/24/2026

Sampled By: Garza, Jose

By Order Of: Celso Gonzalez

Client PO: 900107

Location: Restroom Area and Large Pavilion

Proctor No	Proctor Date	Optimum Moisture (%)	Maximum Dry Density (pcf)	Color / Description
43643-5	03/05/2026	14.9	113.4	Brown / Sandy Lean Clay

Specification

Specification No.	Compaction, %	Moisture Band	
		Minimum	Maximum
1	98	-2.0	2.0

Material: Select Fill

Test No.	Depth Inches	Location	Wet Density (pcf)	Moisture Content (%)	Dry Density (pcf)	Proctor Number	Spec. No.	Percent Proctor Density	Pass Fail
1	6	Small Restrooms, SWC 7' E and 11' N, 4th Lift.	137.7	15.4	119.3	43643-5	1	105.2	Pass
2	6	Small Restrooms, NEC 10' W and 13' S, 4th Lift.	137.7	14.5	120.3	43643-5	1	106.1	Pass
3	6	Basketball Pavilion, SEC 16' W and 9' N, 1st Lift.	132.3	16.6	113.5	43643-5	1	100.1	Pass
4	6	Basketball Pavilion, NEC 19' W and 14' S, 1st Lift.	130.1	15.9	112.3	43643-5	1	99.0	Pass
5	6	Basketball Pavilion, NWC 6' E and 17' S, 1st Lift.	132.9	14.0	116.6	43643-5	1	102.8	Pass
6	6	Basketball Pavilion, SWC 13' E and 21' N, 1st Lift.	136.0	15.0	118.3	43643-5	1	104.3	Pass
7	6	Big Restrooms, NWC 18' E and 8' S, 3rd Lift.	136.3	14.1	119.5	43643-5	1	105.4	Pass

Respectfully Submitted,
Millennium Engineers Group, Inc.

Juan Borjon
Juan Borjon, P.E.





Area Offices
 5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
 30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
 5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Report On: Soil Densities

Lab No: 43832-1

Report No: 43832-1

Page 2 of 2

Project No: 01-25-19143 **Acct. No.:** HCP4-2019

Client: Hidalgo County Precinct 4
1051 N. Doolittle
Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/24/2026

Sample Date: 03/24/2026

Sampled By: Garza, Jose

By Order Of: Celso Gonzalez

Client PO: 900107

Location: Restroom Area and Large Pavilion

Material: Select Fill

Test No.	Depth Inches	Location	Wet Density (pcf)	Moisture Content (%)	Dry Density (pcf)	Proctor Number	Spec. No.	Percent Proctor Density	Pass Fail
8	6	Big Restrooms, SEC 22' W and 15' N, 3rd Lift.	135.7	15.3	117.7	43643-5	1	103.8	Pass

Gauge No.: 76726 Daily Standard Counts: 03/24/2026 DS: 2288 MS: 629

Test Methods: ASTM D2922, D3017

Respectfully Submitted,
Millennium Engineers Group, Inc.

Juan Borjon
Juan Borjon, P.E.





Area Offices
 5804 N. Gumwood Ave. Pharr, Texas 78577 956-702-8500
 30745 E. Exp 83 San Benito, Texas 78586 956-300-2500
 5918 McPherson Rd., Ste. 5 Laredo, Texas 78041 956-552-8200

Report On: Soil Densities

Lab No: 43841-1

Project No: 01-25-19143 Acct. No.: HCP4-2019

Report No: 43841-1

Page 1 of 1

Client: Hidalgo County Precinct 4
1051 N. Doolittle
Edinburg, TX 78542

Project: South East Park (Betts/Esparza) Project

Report Date: 03/26/2026

Sample Date: 03/25/2026

Sampled By: Garza, Jose

By Order Of: Edgar Gonzalez

Client PO: 900107

Location: Restrooms

Proctor No	Proctor Date	Optimum Moisture (%)	Maximum Dry Density (pcf)	Color / Description
43643-5	03/05/2026	14.9	113.4	Brown / Sandy Lean Clay

Specification

Specification No.	Compaction, %	Moisture Band	
		Minimum	Maximum
1	98	-2.0	2.0

Material: Select Fill

Test No.	Depth Inches	Location	Wet Density (pcf)	Moisture Content (%)	Dry Density (pcf)	Proctor Number	Spec. No.	Percent Proctor Density	Pass Fail
1	6	Small Restrooms, West Center Area, 9' E and 18' N, 5th Lift.	138.0	14.2	120.8	43643-5	1	106.5	Pass
2	6	Small Restrooms, East Center Area, 7' W and 18' N, 5th Lift.	138.6	14.4	121.2	43643-5	1	106.9	Pass
3	6	Big Restrooms, SWC 16' E and 11' N, 4th Lift.	137.1	13.9	120.4	43643-5	1	106.2	Pass
4	6	Big Restrooms, NEC 13' E and 8' S, 4th Lift.	139.3	15.1	121.0	43643-5	1	106.7	Pass

Gauge No.: 76726 Daily Standard Counts: 03/25/2026 DS: 2288 MS: 695

Test Methods: ASTM D2922, D3017

Respectfully Submitted,
Millennium Engineers Group, Inc.

Juan Borjon
Juan Borjon, P.E.

