


1. ALL EXISTING ELECTRICAL EQUIPMENT INDICATED ON PLANS IS BASED ON INFORMATION FROM CONSTRUCTION DOCUMENTS AND FIELD OBSERVATION OF THE EXISTING BUILDING.
2. "X" INDICATES EXISTING DEVICE TO REMAIN.
3. MAINTAIN FIRE RATING OF ALL WALLS AND FLOORS. PROVIDE FIRE PROOFING FOR ALL WALL AND FLOOR PENETRATIONS PER CODE.
4. COORDINATE WORK WITH OTHER TRADES.
5. CIRCUIT NUMBERS ARE USED FOR DESIGN INTENT TO IDENTIFY EQUIPMENT, CONDUITS, ELECTRICAL CONNECTIONS SHALL VERIFY EXACT CIRCUIT NUMBERS IN THE FIELD.
6. RECEPTABLES AND LOW VOLTAGE DEVICES SHALL BE FLUSH MOUNTED IN PRECAST AND MASONRY WALLS AT ALL POLICE STATIONS.
7. RACEWAYS SHALL BE CONCEALED IN NEW WALLS.
8. INCLUDE RECEPTS FROM TECHNOLOGY PLANS.
9. ALL NON-OMCING TYPE 12-50V, SINGLE PHASE 15 AND 20 AMPERE RECEPTABLES MOUNTED 8'-6" AND BELOW SHALL BE 15 AMPERE.

0,4 Footcandle: 

0,5 Footcandle: 

0,6 Footcandle: 

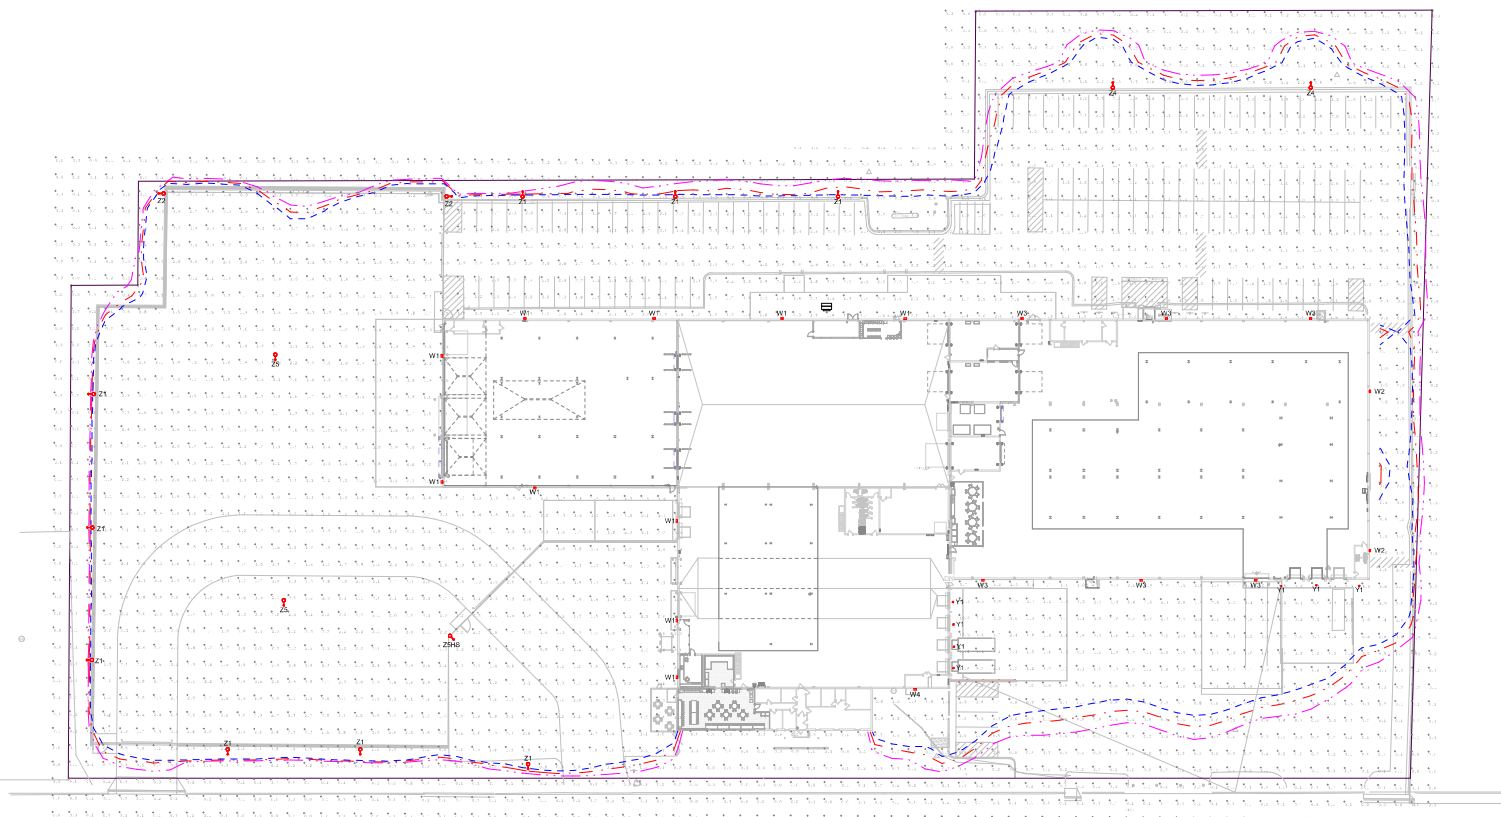

1 SITE PHOTOMETRIC PLAN  
1" = 30'-0"

[illegible]

**E2-01**