Solicitation 1802-217

County Road 200 at Bold Sundown

Bid Designation: Public

Williamson County, Texas

Bid 1802-217
County Road 200 at Bold Sundown

Bid Number	1802-217
Bid Title	County Road 200 at Bold Sundown
Expected Expenditure	**$445,000.00** (This price is expected - not guaranteed)
Bid Start Date	In Held
Bid End Date	Apr 11, 2018 10:30:00 AM CDT
Question & Answer End Date	Apr 6, 2018 10:30:00 AM CDT
Bid Contact	Johnny Grimaldo Purchasing Specialist II 512-**943**-1553 johnny.grimaldo@wilco.org
Contract Duration	**One Time Purchase**
Contract Renewal	Not Applicable
Prices Good for	**365 days**
Pre-Bid Conference	**Apr 3, 2018 10:30:00 AM CDT** **Attendance is optional** **Location: 901 S. Austin Avenue, Georgetown, TX 78626**
Bid Comments	**Williamson County is seeking qualified contractors to widen the existing roadway, which includes grading, drainage improvements, flexible base, HMAC, striping and signing.** **Estimated time of completion is 45 working days to substantial completion, and 20 additional working days to final completion, with an estimated cost of $445,000.** **<u>If entering an electronic bid in BidSync (PREFERRED), the following documents MUST be completed and attached to the First Line Item.</u>** **Completed Bid Form – Enter Total Price in area provided, then download/print/complete bid form and upload to first line item.** **Bid Affidavit - This is a Fill-able form - Complete and Accept.** **Bid Bond - See Details Below.** **<u>The following documents are fillable forms on BidSync - Fill in blanks and accept to apply to the bid.</u>** **Conflict of Interest Form** **References** **Bid Bond - See Details Below.** **If delivering a paper bid instead of electronic, you must provide (2) originals, (1) copy, and (1) USB or CD of all the required documents. All documents must be delivered in a sealed envelope to:** **Williamson County Purchasing** **Attn: Bid #1802-217 County Road 200 at Bold Sundown** **901 South Austin Ave** **Georgetown, TX 78626** **<u>BID BOND REQUIRED</u>: Bidders are not required to use Surety 2000 for your Bid Bond supplier, however; when bidding electronically in BidSync and using Surety 2000, you may import your bid bond directly from the Surety 2000 website.**

To use a different bond provider, you MUST: Scan the completed Bond; download the completed bond to the first line item of this bid with your other required documents or your bid will be disqualified.

All Bids shall be accompanied by either;
A certified cashier's check: payable without recourse to Williamson County and drawn upon a National or State Bank in the amount not less than five percent (5%) of the total maximum bid price;
A bid bond not less than five percent (5%) of the total maximum bid price, from a surety company authorized to do business in the State of Texas.

For unit price contracts, the total maximum bid price shall be estimated and calculated by multiplying the estimated quantities to the unit bid price.

Bid bonds must be attached to the line item of the electronic bid OR submitted in the same sealed envelope with a paper Bid.

Bids requiring a bid bond and submitted without a cashier's check or a bid bond will not be considered.

If you are awarded the bid, please see reference to new State Requirement for Certificate of Interest in Section 3 Bid Instructions/Requirements: #36: Certificate of Interested Parties.

Bonds
Payment and Performance Bond documents are provided in the Bid documents for completion upon award.
Maintenance Bond documents are provided in the Bid documents for completion upon final completion of the work.

LIQUIDATED DAMAGES for failure to substantially complete the work within the allotted time will be applied.
The road-user cost Liquidated Damages will be in accordance with Special Provision 000-001, and are estimated to be $590 per calendar day.

PLAN HOLDERS LISTS
Please note that a bidder adding their name to the Plan-Holders list is voluntary.
The plan-holder's on construction bids allows Prime and Subcontractors to add their names and information to a list of users that are participating in this bid. To add a company to the Plan holder's list, the user will choose either the Subcontractor or the Prime contractor tabs and then click Add my company to this Plan holder's list. This will add the company's contact information to the Plan holder's list for other suppliers on the list to see.

If the user would like to view the suppliers that have been added to the list, they will need to click on the Subscribe button. This will allow the user to view other suppliers that have added their names to the Plan holder's list. Both of these actions will require that the vendor agree to the terms for the action

Contract Administrator for this project is Bob Daigh, Senior Director of Infrastructure or designee, and shall be the Contract Administrator with designated responsibility to ensure compliance with contract requirements, such as but not limited to acceptance, inspection, and delivery. The contract administrator will serve as liaison between Williamson County Commissioners Court and the successful bidder or the Construction Inspector.

Item Response Form

Item	**1802-217--01-01 - Total Bid Price**
Quantity	**1 each**
Unit Price	
Delivery Location	**Williamson County, Texas**
	No Location Specified

Qty 1

Description
Total Bid Price

Item **1802-217--01-02 -** Please attach all documents to this line

Quantity **1 each**

Prices are not requested for this item.

Delivery Location **Williamson County, Texas**

No Location Specified

Qty 1

Description
Please attach all documents to this line

PUBLIC ANNOUNCEMENT AND GENERAL INFORMATION

WILLIAMSON COUNTY PURCHASING DEPARTMENT
SOLICITATION 1802-217
County Road 200 at Bold Sundown

BIDS MUST BE RECEIVED ON OR BEFORE:
Apr 11, 2018 10:30:00 AM CDT

BIDS WILL BE PUBLICLY OPENED:
Apr 11, 2018 10:30:00 AM CDT

Notice is hereby given that sealed Bids for the above-mentioned goods and/or services will be accepted by the Williamson County Purchasing Department. Williamson County uses BidSync to distribute and receive bids. Specifications for this IFB may be obtained by registering at www.bidsync.com.

Williamson County prefers and requests electronic submittal of this Bid.

All electronic bids must be submitted via: www.bidsync.com

Electronic bids are requested, however paper bids will currently still be received, until further notice and may be mailed or delivered to the address listed below.

Bidders are strongly encouraged to carefully read this entire IFB.

All interested Bidders are invited to submit a Bid in accordance with the Instructions and General Requirements, Bid Format, Bid Specifications, and Definitions, Terms and Conditions stated in this IFB.

Please note that a complete package must be submitted choosing one of the above two methods. Split packages submitted will be considered "unresponsive" and will not be accepted or evaluated.

Williamson County will not accept any Bids received after the submittal deadline, and shall return such Bids unopened to the Bidder.

General Information:

- If mailed or delivered in person, Bids and Bid addenda are to be delivered in sealed envelope on or before the submittal deadline, as noted in the Public Announcement and General Information listed above for this IFB, to:

  Williamson County Purchasing Department
  Attn: **BID NAME AND NUMBER**
  901 South Austin Avenue
  Georgetown, Texas 78626

  - Bidders should list the Bid Number, Bid Name, Name and Address of Bidder, and the Date of the Bid opening on the outside of the box or envelope and note "Sealed Bid Enclosed."
  - Bidder should submit one (1) original.
  - Williamson County will NOT be responsible for unmarked or improperly marked envelopes.
  - Williamson County will not accept any responsibility for Bids being delivered by third party carriers.
  - Facsimile transmittals will NOT be accepted.

- Bids will be opened publicly in a manner; however, to avoid public disclosure of contents only the names and of Bidders and prices will be read aloud.

- All submitted questions with their answers will be posted and updated on www.bidsync.com.

- It is the Bidder's responsibility to review all documents in BidSync, including any Addenda that may have been added after the document packet was originally released and posted.

  - Any Addenda and/or other information relevant to the IFB will be posted on www.bidsync.com.

  - The Williamson County Purchasing Department takes no responsibility to ensure any interested Bidder has obtained any outstanding addenda or additional information.

WILLIAMSON COUNTY
1848

WILLIAMSON COUNTY

PROJECT CONSTRUCTION MANUAL

FOR

County Road 200
At
Bold Sundown

SOLICITATION 1802-217

WILLIAMSON COUNTY, TEXAS
PURCHASING DEPARTMENT
901 SOUTH AUSTIN AVENUE
GEORGETOWN, TEXAS 78626

March 2018



TABLE OF CONTENTS

CONTENTS	SECTION
Addenda	1
Invitation for Bids	2
Bid Instructions/Requirements	3
Bid Form, Bid Affidavit, Bidder References, & Conflict of Interest Questionnaire	4
Standard Form of Agreement	5
Wage Rates	6
Performance Bond	7
Payment Bond	8
Maintenance Bond	9
Certificate of Insurance	10
General Conditions of Agreement	11
Special Conditions of Agreement	12
Technical Specifications	13
Plan Drawings	(Bound Separately)
Geotechnical Report	(If Applicable, Bound Separately)

Appendices

Appendix A – Quality Control/Quality Assurance Program

Appendix B – Guide Schedule of Sampling and Testing

Appendix C – AASHTO Accredited Laboratories

SECTION 1
ADDENDA

ADDENDUM NO. __

Date:

Owner: **Williamson County, Texas**

Project Name:

Project No:

This Addendum forms a part of the Contract and clarifies, corrects or modifies the original Construction Documents, dated _____. Acknowledge receipt of this addendum in space provided on Bid Form. Failure to do so may subject bidder to disqualification.

DESCRIPTION OF ADDITION OR CHANGE:

This addendum consists of __ page(s).

_____
Approved by ENGINEER

END

EXAMPLE

SECTION 2
INVITATION FOR BIDS

PUBLIC NOTICE WILLIAMSON COUNTY
INVITATION FOR BIDS

Williamson County Commissioner's Court invites the submission of sealed bids for:

COUNTY ROAD 200 AT BOLD SUNDOWN

Williamson County is seeking qualified contractors to widen the existing roadway, which includes grading, drainage improvements, flexible base, HMAC, striping and signing. Estimated time of completion is 45 working days to substantial completion, and 20 working days to final completion, with an estimated cost of $445,000.00.

Sealed bids will be publicly opened and read aloud in the Williamson County Purchasing Department, 901 South Austin Avenue, Georgetown, Texas on WEDNESDAY, APRIL 11, 2018 AT 10:30 AM.

Bids must be received on or before WEDNESDAY, APRIL 11, 2018 AT 10:30 AM. Bid documents and plans may be viewed and responded to by registering with BIDSYNC at www.bidsync.com.

No fee is required to register with Bidsync as a Williamson County Supplier, or to participate in the County's solicitation process. The receipt of electronic bids will be registered in Bidsync.

The Time-Date Stamp Clock located at the Williamson County Purchasing Department will serve as the official clock for the purpose of verifying the date and time of receipt of Paper Bids.

There will be a Non-Mandatory Pre-Bid Conference on TUESDAY, APRIL 3, 2018 AT 10:30 AM at Williamson County Purchasing Department, 901 South Austin Avenue, Georgetown, Texas.

BID BOND REQUIRED
A Cashier's Check, Certified Check, or acceptable Bidder's Bond in the amount of five percent (5%) of the Bid must accompany each Bid. Performance, Payment and Warranty Bonds will be required as designated in the bidding documents.

The Williamson County Commissioners' Court reserves the right to accept the lowest and best Bid as deemed by the Court, or reject any and/or all bids.

Bidder shall use per unit pricing. Payments will be made by check.

The designated Purchasing Agent for this Bid is Kerstin Hancock, Senior Purchasing Specialist, under the direction of Randy Barker, Purchasing Agent for Williamson County, 512-943-3553.

This notice is issued by order of the Williamson County Commissioners' Court on MARCH 20, 2018; Dan A. Gattis, County Judge.

SECTION 3
BID INSTRUCTIONS/REQUIREMENTS

BID INSTRUCTIONS/REQUIREMENTS

All Bids must be received in the Williamson County Purchasing Department either hardcopy or electronically through BidSync.

Williamson County prefers and requests electronic submittal of this bid.

All electronic bids must be submitted via: www.bidsync.com

All interested Respondents are invited to submit a Bid in accordance with the Instructions and General Requirements, Bid Format, Bid Specifications, and Definitions, Terms and Conditions stated in this BID.

Electronic bids are requested, however paper bids will currently still be received, until further notice and may be mailed or delivered to the address listed below.

Please note that a complete package must be submitted choosing one of the above two methods.

Split packages submitted will be considered "unresponsive" and will not be accepted or evaluated.

If mailed or delivered in person, Bids are to be delivered in sealed envelope on or before the submittal deadline to:

Williamson County Purchasing Department
Attn: **BID NAME AND NUMBER**
901 South Austin Avenue
Georgetown, Texas 78626

Respondents should list the Bid Number, Bid Name, Name and Address of Respondent, and the Date of the Bid opening on the outside of the box or envelope.

Respondent should submit one (1) original; **AND** (2) two copies and (1) CD **OR** (1) USB copy of the Bid.

Williamson County will not accept any Bids received after the submittal deadline.
Williamson County will not accept any responsibility for Bids being delivered by third party carriers. Facsimile transmittals will NOT be accepted.

All questions should be submitted on the Bidsync site. Questions with their answers will be posted and updated on www.bidsync.com.

Any addenda and/or other information relevant to the Bid will be posted on: www.bidsync.com.

ALL BIDS MUST BE SUBMITTED ON THE FORMS PROVIDED IN THIS BID DOCUMENT. (May be replaced with a computer generated printout, if submitted in an identical format to the proposal).

FACSIMILE AND ELECTRONIC MAIL TRANSMITTALS SHALL NOT BE ACCEPTED.

1. All of the items listed are to be on a "per unit" basis, stating a firm price per unit or unit quantity of each item. **This price must be good from the date of Bid opening through the completion of the project. Bids which do not state a fixed price will not be considered.** The Court may award a contract for the period implied or expressly stated in the lowest and best Bid.

2. All of the items listed are to be Free On Board to final destination **(FOB DESTINATION)** with all transportation charges if applicable to be included in the price, unless otherwise specified in the Invitation for Bids. The title and risk of loss of the goods shall not pass to the County until receipt and acceptance takes place at the FOB point.

3. It is understood that the Commissioners Court of Williamson County, Texas, reserves the right to accept or reject any and/or all Bids for any or all materials and/or services covered in this Bid request, and to waive informalities or defects in the Bid or to accept such Bid it shall deem to be in the best interest of Williamson County.

4. Funding: Funds for payment have been provided through the Williamson County budget approved by Commissioners Court for the 2013 Road Bond Program.

5. Late Bid: Bids received after submission deadline will be considered VOID AND UNACCEPTABLE and will be returned to the bidder unopened. Williamson County is

not responsible for lateness or non-delivery of mail, carrier, etc. The date and time stamp of the Williamson County Purchasing Department shall be the official date and time of receipt.

6. Altering Bid: Bidders **cannot alter or amend bid** after submission deadline.

7. Sales Tax: Williamson County is by statute, exempt from the State Sales Tax and Federal Excise Tax.

8. Contract: This Bid, when properly accepted by Williamson County, shall constitute a contract equally binding between the successful bidder and Williamson County. No different or additional terms will become part of this contract.

9. Changes: No oral statement of any person shall modify or otherwise change, or affect the terms, conditions, plans and/or specifications stated in the Bid Package and or Bid Instructions/Requirements.

10. Delivery Times and Locations: The commodity and/or service covered by this Bid shall be as stated in the Bid Package.

11. Payments: The Construction Inspector will manage the Contractor payments. Invoices for the work specified in the Contract Documents will be submitted to the Construction Inspector. Upon satisfactory completion and acceptance of these invoices, the Construction Inspector will forward the invoices to the County via the GEC. County's payment for goods and services shall be governed by Chapter 2251 of the Texas Government Code. An invoice shall be deemed overdue the 31st day after the later of (1) the date County receives the goods under the Contract; (2) the date the performance of the service under the Contract is completed; or (3) the date the Williamson County Auditor receives an invoice for the goods or services. Interest charges for any overdue payments shall be paid by County in accordance with Texas Government Code Section 2251.025. More specifically, the rate of interest that shall accrue on a late payment is the rate in effect on September 1 of County's fiscal year in which the payment becomes due. The said rate in effect on September 1 shall be equal to the sum of one percent (1%); and (2) the prime rate published in the Wall Street Journal on the first day of July of the preceding fiscal year that does not fall on a Saturday or Sunday.

In the event that an error appears in an invoice submitted by Successful Bidder, County shall notify Successful Bidder of the error not later than the twenty first (21st) day after the date County receives the invoice. If the error is resolved in favor of Successful Bidder, Successful Bidder shall be entitled to receive interest on the unpaid balance of the invoice submitted by Successful Bidder beginning on the date that the payment for the invoice became overdue. If the error is resolved in favor of the County, Successful Bidder shall submit a corrected invoice that must be paid in accordance within the time set forth above. The unpaid balance accrues interest as provided by Chapter 2251 of the Texas Government Code if the corrected invoice is not paid by the appropriate date. As a minimum, invoices shall include:

(1) Name, address, and telephone number of Contractor and similar information in the event the payment is to be made to a different address

(2) County contract, Purchase Order, and/or delivery order number

(3) Identification of items or service as outlined in the contract

(4) Quantity or quantities, applicable unit prices, total prices, and total amount

(5) Any additional payment information which may be called for by the Contract

Payment inquiries should be directed to the Williamson County Auditor's Office, Accounts Payable Department:
512-943-1573
accountspayable@wilco.org

12. Conflict of Interest: No public official shall have interest in a contract, in accordance with Vernon's Texas Codes Annotated, Local Government Code Title 5, Subtitle C, Chapter 171. As of January 1, 2006 Vendors are responsible for complying with

Local Government Code Title 5, Subtitle C, Chapter 176. Additional information may be obtained from the County website at the following link: http://www.wilco.org/CountyDepartments/Purchasing/ConflictofInterestDisclosure/tabid/689/language/en-US/Default.aspx. The Williamson County Conflict of Interest Questionnaire is attached as a fillable form. This form must be completed, signed, and submitted with your bid (attached to the first Line Item of this bid) or completed electronically and signed electronically when entering your password in Bidsync.

13. Ethics: The bidder shall not accept or offer gifts or anything of value nor enter into any business arrangement with any employee, official or agent of Williamson County.

14. Minimum Standards for Responsible Bidders: A prospective bidder must affirmatively demonstrate bidder's responsibility. A prospective bidder must meet the following requirements:

    a. have adequate financial resources, or the ability to obtain such resources as required;

    b. be able to comply with the required or proposed delivery schedule;

    c. have a satisfactory record of performance;

    d. be otherwise qualified and eligible to receive an award.

    Williamson County may request representation and other information sufficient to determine bidder's ability to meet these minimum standards listed above.

15. References: Williamson County **REQUIRES** bidder to supply with this Bid, a list of at least **three (3) references** where like services have been supplied by their firm. The Bidder References Form is attached as a fillable form in this bid document. This form must be completed and attached to the first line item on your bid or included with an all paper bid.

16. Bidder shall provide with this Bid response, all documentation required by this Bid. Failure to provide this information may result in rejection of the Bid.

17. Termination for Default: Williamson County reserves the right to enforce the performance of this contract in any manner prescribed by law or deemed to be in the best interest of the County in the event of breach or default of this contract. Non-Performance of the bidder in terms of specifications shall be a basis for the termination of the contract by the County. The County shall not pay for commodities/services which are unsatisfactory. Contractors will be given a reasonable opportunity before termination to correct the deficiencies. This, however, shall in no way be construed as negating the basis for termination for non-performance.

18. Contract Administration: Under this contract, Robert Daigh, Williamson County Sr. Director of Infrastructure or designee, shall be the contract administrator with designated responsibility to ensure compliance with contract requirements, such as but not limited to, acceptance, inspection and delivery. The contract administrator will serve as liaison between Williamson County Commissioners Court and the successful bidder or the Construction Inspector.

19. Purchase Order: Williamson County may generate a purchase order(s) to the successful bidder as products and/or services are required. The purchase order number must appear on all itemized invoices and/or request for payment.

20. Silence of Specifications: The apparent silence of these specifications as to any detail or to the apparent omission from it of a detailed description concerning any point, shall be regarded as meaning that only the best practices are to prevail. All interpretations of these specifications shall be made on the basis of this statement.

21. Contract Times and Liquidated Damages - Bidders must agree to commence work on or before a date to be specified in a written “Notice to Proceed” of the County, and to fully complete the project within the specified time stated in the proposal. Bidders must agree to pay liquidated damages in accordance with Special Provision 000-001 per day to County for

every day past the specified completion date stated in the proposal.

22. BIDS MUST BE: legible and of a quality that can be reproduced.

23. Bid forms that are included in the Bid package shall be used. **CHANGES to Bid forms made by bidders shall DISQUALIFY THE BID.** Exceptions to the Bid forms and or specifications shall be made on an **attachment** to the Bid package.

24. Workers Compensation Coverage Requirements: The Texas Labor Code, §406.096, requires workers' compensation insurance coverage for all persons providing services on a building or construction project for a governmental entity. The rule requires a governmental entity to timely obtain certificates of coverage and retain them for the duration of the project. The rule also sets out the language to be included in bid specifications and in contracts awarded by a governmental entity and the information required to be in the posted notice to employees. The rule is adopted under the Texas Labor Code, §402.061. The information provided below is a result of this rule. By submitting your bid to the county, you are acknowledging that this rule is a part of these bid specifications, and that you will observe and abide by all of the requirements outlined in the rule. You are further agreeing that should your bid or proposal be accepted by the Williamson County Commissioners' Court, the necessary certificates of coverage showing workers' compensation coverage, will be provided to the following name and address, prior to beginning work:

Williamson County Purchasing Department
901 South Austin Avenue
Georgetown, Texas 78626

If you have any questions related to this ruling and/or requirement, you are encouraged to contact either the Williamson County Purchasing Department at (512) 943-1553, or you may call the Texas Workers' Compensation Commission at (512) 804-4000.

A. Definitions: The following words and terms, when used in this provision, shall have the following meanings. Terms not defined in this rule shall have the meaning defined in the Texas Labor Code, if so defined.

(1) Certificate of coverage ("certificate")-A copy of a certificate of insurance, a certificate of authority to self-insure issued by the commission, or a coverage agreement (TWCC-81, TWCC-82, TWCC-83, or TWCC-84), showing statutory workers' compensation insurance coverage for the person's or entity's employees (including those subject to a coverage agreement) providing services on a project, for the duration of the project.

(2) Building or construction – Has the meaning defined in the Texas Labor Code, §406.096(e)(1).

(3) Contractor--A person bidding for or awarded a building or construction project by Williamson County.

(4) Coverage--Workers' compensation insurance meeting the statutory requirements of the Texas Labor Code, §401.011(44).

(5) Coverage agreement--A written agreement on form TWCC-81, form TWCC-82, form TWCC-83, or form TWCC-84, filed with the Texas Workers' Compensation Commission which establishes a relationship between the parties for purposes of the Texas Workers' Compensation Act, pursuant to the Texas Labor Code, Chapter 406, Subchapters F and G, as one of employer/employee and establishes who will be responsible for providing workers' compensation coverage for persons providing services on the project.

(5) Duration of the project - includes the time from the beginning of the work on the project until the contractor's/person's work on the project has been completed and accepted by the governmental entity.

(6) Persons providing services on the project ("subcontractor" in §406.096) - includes all persons or entities performing all or part of the services the contractor has undertaken to perform on the project, regardless of whether that person

contracted directly with the contractor and regardless of whether that person has employees. This includes, without limitation, independent contractors, subcontractors, leasing companies, motor carriers, owner-operators, employees of any such entity, or employees of any entity which furnishes persons to provide services on the project. "Services" include, without limitation, providing, hauling, or delivering equipment or materials, or providing labor, transportation, or other service related to a project. "Services" does not include activities unrelated to the project, such as food/beverage vendors, office supply deliveries, and delivery of portable toilets.

(8) Project--Includes the provision of all services related to a building or construction contract for Williamson County.

B. The contractor shall provide coverage, based on proper reporting of classification codes and payroll amounts and filing of any coverage agreements, which meets the statutory requirements of Texas Labor Code, Section 401.011(44) for all employees of the contractor providing services on the project, for the duration of the project.

C. The Contractor must provide a certificate of coverage to the governmental entity prior to being awarded the contract.

D. If the coverage period shown on the contractor's current certificate of coverage ends during the duration of the project, the contractor must, prior to the end of the coverage period, file a new certificate of coverage with the governmental entity showing that coverage has been extended.

E. The contractor shall obtain from each person providing services on a project, and provide to the governmental entity:

(1) a certificate of coverage, prior to that person beginning work on the project, so the governmental entity will have on file certificates of coverage showing coverage for all persons providing services on the project;

(2) no later than seven (7) days after receipt by the contractor, a new certificate of coverage showing extension of coverage, if the coverage period shown on the current certificate of coverage ends during the duration of the project.

F. The contractor shall retain all required certificates of coverage for the duration of the project and for one year thereafter.

G. The contractor shall notify Williamson County in writing by certified mail or personal delivery, within ten (10) days after the contractor knew or should have known, of any change that materially affects the provision of coverage of any person providing services on the project.

H. The contractor shall post on each project site a notice, in the text, form and manner prescribed by the Texas Workers' Compensation Commission, informing all persons providing services on the project that they are required to be covered, and stating how a person may verify coverage and report lack of coverage.

I. The contractor shall contractually require each person with whom it contracts to provide services on a project, to:

(1) provide coverage, based on proper reporting of classification codes and payroll amounts and filing of any coverage agreements, which meets the statutory requirements of Texas Labor Code, Section 401.011(44) for all of its employees providing services on the project, for the duration of the project;

(2) provide to the contractor, prior to that person beginning work on the project, a certificate of coverage showing that coverage is being provided for all employees of the person providing services on the project, for the duration of the project;

(3) provide the contractor, prior to the end of the coverage period, a new

certificate of coverage showing extension of coverage, if the coverage period shown on the current certificate of coverage ends during the duration of the project;

(4) obtain from each other person with whom it contracts, and provide to the contractor:

(a) a certificate of coverage, prior to the other person beginning work on the project; &

(b) a new certificate of coverage showing extension of coverage, prior to the end of the coverage period, if the coverage period shown on the current certificate of coverage ends during the duration of the project;

(5) retain all required certificates of coverage on file for the duration of the project and for one year thereafter;

(6) notify the governmental entity in writing by certified mail or personal delivery, within ten(10) days after the person knew or should have known, of any change that materially affects the provision of coverage of any person providing services on the project; and

(7) contractually require each person with whom it contracts, to perform as required by paragraphs (1) - (7), with the certificates of coverage to be provided to the person for whom they are providing services.

J. By signing this contract or providing or causing to be provided a certificate of coverage, the contractor is representing to the governmental entity that all employees of the contractor who will provide services on the project will be covered by workers' compensation coverage for the duration of the project, that the coverage will be based on proper reporting of classification codes and payroll amounts, and that all coverage agreements will be filed with the appropriate insurance carrier or, in the case of a self-insured, with the commission's Division of Self-Insurance Regulation. Providing false or misleading information may subject the contractor to administrative penalties, criminal penalties, civil penalties, or other civil actions.

K. The contractor's failure to comply with any of these provisions is a breach of contract by the contractor which entitles the governmental entity to declare the contract void if the contractor does not remedy the breach within ten (10) days after receipt of notice of breach from Williamson County.

25. **PERFORMANCE AND PAYMENT BONDS:** Chapter 262.032 and Chapter 2253.021 of the Texas Government Code governs the requirements for performance bonds and payment bonds for government entities making public work contracts. A performance bond is required if the contract is in excess of $50,000 and is to be made for the full amount of the contract. A payment bond is required if the contract is in excess of $25,000 and is to be made for the full amount of the contract. The bonds are to be executed within ten (10) days after receipt of written notification of award of contract prior to beginning work on the project and must be executed by a corporate surety or sureties in accordance with the Texas Insurance Code. In the event the bond exceeds $100,000.00, the surety must also (1) hold a certificate of authority from the United States secretary of the treasury to qualify as a surety on obligations permitted or required under federal law; or (2) have obtained reinsurance for any liability in excess of $100,000.00 from a reinsurer that is authorized and admitted as are insurer in this state and is the holder of a certificate of authority from the United States secretary of the treasury to qualify as a surety or reinsurer on obligations permitted or required under federal law.

In determining whether the surety or reinsurer holds a valid certificate of authority the County may rely on the list of companies holding certificates of authority as published in the Federal Register covering the date on which the bond is to be executed. If the public works contract is less than $50,000 the performance bond will not be required

as long as the contract provides that payment is not due until the work is completed and accepted by the county. The purpose of a performance bond is for the protection of the government entity and is conditioned on the faithful performance of the work being done in accordance with the plans, specifications and contract documents. The payment bond is for the protection of persons supplying labor and materials to the contractor to ensure payment.

26. **BIDDERS BOND:** All bids shall be accompanied by a certified cashier's check upon a National or State bank in an amount not less than five percent (5%) of the total maximum bid price, payable without recourse to Williamson County, or a bid bond in the same amount from a reliable surety company, as a guarantee that the bidder will enter into a contract and execute performance and payment bonds, as stipulated by item 25 above, within ten (10) days after notice of award of contract to him. Bid guarantees must be submitted in the same sealed envelope with the bid. Bids submitted without check or bid bonds will not be considered.
    Bidders are not required to use Surety 2000 for your Bid Bond supplier, however; when bidding electronically in Bidsync and using Surety 2000, you may import your bid bond directly from the Surety 2000 web site. To use a different bond provider you MUST:

    1. Scan the completed bond
    2. Download the completed bond to the line item of this bid with your other required documents.

    Bid bonds must be attached to the line item of the electronic bid OR submitted in the same sealed envelope with a paper Bid.

27. All bid securities will be returned to the respective bidders within twenty-five (25) days after bids are opened, except those which the County elects to hold until the successful bidder has executed the contract. Thereafter, all remaining securities, including security of the successful bidder, will be returned within sixty (60) days.

28. Prior to submitting any bid, bidders are required to read the plans, specifications, bid, contract and bond forms carefully; to inform themselves by their independent research, test and investigation of the difficulties to be encountered and judge for themselves of the accessibility of the work and all attending circumstances affecting the cost of doing the work and the time required for its completion and obtain all information required to make an intelligent bid.

29. Should the bidder find discrepancies in, or omissions from the plans, specifications, or other documents, or should he/she be in doubt as to their meaning, he/she should notify at once the Project Engineer and may obtain clarification or addendum prior to submitting any bid.

30. In case of ambiguity or lack of clarity in the statement of prices in the bids, the county reserves the right to consider the most favorable analysis thereof, or to reject the bid. Unreasonable (or unbalanced) prices submitted in a bid may result in rejection of such bid or other bids.

31. Award of the contract, if awarded, will be made within sixty (60) days after opening of the bids and no bidder may withdraw his bid within said sixty (60) day period of time unless a prior award is made.

32. Within ten (10) days of written notification of award of the contract, the bidder shall execute and furnish to the County the performance bond, or letter of credit if applicable, and payment bond as required by item 25 above; and the Certificate of Insurance showing coverages in accordance with contract documents. Failure to execute contract, Bonds and Certificate of Insurance shall be just cause for the annulment of the award. In case of the annulment of the award, the bid guarantee shall become the property of Williamson County, not as a penalty, but as a liquidated damage.

33. Any quantities given in any portion of the contract documents, including the plans, are estimates only, and the actual amount of work required may differ somewhat from the estimates. The basis for the payment shall be the actual amount of work done and/or material furnished.

34. **THE TEXAS HAZARD COMMUNICATION ACT**, Chapter 502 of the Health and Safety Code, Sec. 502.006, states that a chemical manufacturer or distributor shall provide appropriate Material Safety Data Sheets (MSDS) to employers who acquire hazardous chemicals in this state with each initial shipment and with the first shipment after a MSDS is updated. The MSDS must conform to the most current requirements of the OSHA standard in 29 CFR 1910.1200. By submitting your bid to the County you are acknowledging that this regulation is a part of this bid and that you will provide appropriate MSDS with each initial shipment and with the first shipment after a MSDS is updated.

35. **THE WILLIAMSON COUNTY HAZARD COMMUNICATION PROGRAM POLICY** Under Revised Texas Hazard Communication Act (THCA) of 1993 states that it is the responsibility of all contractor/sub-contractors who bring hazardous chemicals onto county property to provide appropriate MSDS to the county at the work site. When exposure to a hazardous chemical is expected each contractor/sub-contractor shall be responsible for the appropriate training of their employees. For a copy of the Williamson County Hazard Communication Program Policy contact the Williamson County Unified Road & Bridge System Safety/Training Coordinator at 512/930-3330. By submitting your bid to the County you are acknowledging that this policy is a part of this bid and that you will provide appropriate MSDS to the county work site and provide for appropriate training as applicable.

36. **CERTIFICATE OF INTERESTED PARTIES TEXAS ETHICS COMMISSION (FORM 1295)** As of January 1, 2016, Bidders are responsible for complying with the Texas Government Code Section 2252.908. The law states that the County may not enter into certain contracts with a Bidder unless the Bidder submits a disclosure of interested parties to the County at the time the Bidder submits the signed contract to Williamson County.
    On January 1, 2016, the Texas Ethics Commission made available on its website a new filing application that must be used to file Form 1295. Information regarding how to use the filing application is available on the Texas Ethics Commission website at the following link:
    https://www.ethics.state.tx.us/whatsnew/elf_info_form1295.htm
    The Low Bidder must:
    1. Use the online application to process the required information on Form 1295
    2. Print a copy of the form which will contain a unique certification number
    3. An authorized agent of the Bidder must sign the printed copy of the form
    4. and have the form notarized
    5. the completed Form 1295 and certification of filing must be filed (scanning and emailing form is sufficient) with Williamson County prior to award of the contract by Commissioners Court.

37. Ambiguity, Conflict, or other Errors in the IFB If Bidder discovers any ambiguity, conflict, discrepancy, omission or other error in this IFB, Bidder shall immediately notify Williamson County Purchasing Department of such error in writing and request modification or clarification of the document. Modifications will be made by issuing Addenda. If the Bidder fails to notify Williamson County prior to the date and time fixed for submission of Bids of an error or ambiguity in the IFB known to Bidder, or an error or ambiguity that reasonably should have been known to Bidder, then Bidder shall be deemed to have waived the error or ambiguity or its later resolution. Williamson County may also modify the IFB, no later than 48 hours prior to the date and time fixed for submission of Bids, by issuance of an Addendum. All addenda will be numbered consecutively, beginning with 1.

SECTION 4
BID FORM, BID AFFIDAVIT, BIDDER REFERENCES, & CONFLICT OF INTEREST QUESTIONNAIRE

ALL REQUIRED DOCUMENTS MUST BE FILLED OUT AND SUBMITTED WITH BID

www.bidsync.com

FOLLOWING CONTRACT AWARD REQUIRED DOCUMENTS WILL BE INSERTED IN THIS SECTION

BID FORM
WILLIAMSON COUNTY, TEXAS

PROJECT: **County Road 200 at Bold Sundown** **BIDDER:** _____

Full compensation for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract will be considered as included in the unit prices for the work set forth below, and no separate payment will be made for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract, unless separate payment is expressly provided for therein.

BID ITEM	TECH SPEC[1]	DESCRIPTION	BID QUANTITY	UNIT MEASURE	UNIT COST	AMOUNT BID
1	100-6002	PREPARING RIGHT OF WAY	9.3	STA		$ -
2	110-6001	EXCAVATION (ROADWAY)	2644	CY		$ -
3	132-6003	EMBANKMENT (FINAL)(ORD COMP)(TY B)	388	CY		$ -
4	160-WC02	FURNISHIING & PLACING TOPSOIL (4")	4651	SY		$ -
5	161-WC001	EROSION CONTROL COMPOST (3")	1163	SY		$ -
6	162-WC103	MULCH TOPDRESSING (5")	1163	SY		$ -
7	164-WC04	SEEDING FOR EROSION CONTROL(TEMP)(COOL)(TY 4)	2326	SY		$ -
8	164-WC05	SEEDING FOR EROSION CONTROL(PERM)(WARM)(TY 5)	4651	SY		$ -
9	164-WC10	SEEDING FOR EROSION CONTROL(TEMP)(WARM)(TY 10)	2326	SY		$ -
10	166-6002	FERTILIZER	0.3	TON		$ -
11	168-WC01	VEGETATIVE WATERING	160	MG		$ -
12	169-6001	SOIL RETENTION BLANKETS (CL 1)(TY A)	2180	SY		$ -
13	247-6044	FL BS (CMP IN PLC)(TY A)(GR 4)	1059	CY		$ -
14	310-6001	PRIME COAT (MULTIOPTION)	636	GAL		$ -
15	316-6193	AGGR (TY-D GR-5 SAC-B)	42	CY		$ -
16	316-6413	ASPH (AC-15P, HFRS-2P OR CRS-2P)	2014	GAL		$ -

[1]Refer to the Technical Specifications section for a description of the specific reference number.

BID FORM
WILLIAMSON COUNTY, TEXAS

PROJECT: **County Road 200 at Bold Sundown** **BIDDER:** _____

Full compensation for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract will be considered as included in the unit prices for the work set forth below, and no separate payment will be made for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract, unless separate payment is expressly provided for therein.

BID ITEM	TECH SPEC[1]	DESCRIPTION	BID QUANTITY	UNIT MEASURE	UNIT COST	AMOUNT BID
17	340-6011	D-GR HMA TY-B PG64-22	547	TON		$ -
18	340-6120	D-GR HMA TY-D SAC-B PG70-22	579	TON		$ -
19	340-6246	D-GR HMA TY-D PG64-22(LEVEL-UP)	100	TON		$ -
20	464-6005	RC PIPE (CL III) (24IN)	30	LF		$ -
21	467-6395	SET (TY II) (24 IN) (RCP) (6:1) (P)	4	EA		$ -
21	500-6001	MOBILIZATION	1	LS		$ -
22	502-6001	BARRICADES, SIGNS AND TRAFFIC HANDLING	3	MO		$ -
21	506-6002	ROCK FILTER DAMS(INSTALL)(TY 2)	45	LF		$ -
22	506-6011	ROCK FILTER DAMS(REMOVE)	45	LF		$ -
23	506-6020	CONSTRUCTION EXITS (INSTALL)(TY 1)	224	SY		$ -
24	506-6024	CONSTRUCTION EXITS (REMOVE)	224	SY		$ -
25	506-6040	BIODEG EROSN CONT LOGS(INSTL)(8")	365	LF		$ -
26	506-6043	BIODEG EROSN CONT LOGS(REMOVE)	365	LF		$ -
27	530-6005	DRIVEWAYS (ACP)	51	SY		$ -
28	540-6001	MTL W-BEAM GD FEN(TIM POST)	287.5	LF		$ -
29	542-6001	REMOVE METAL BEAM GUARD FENCE	117	LF		$ -

[1]Refer to the Technical Specifications section for a description of the specific reference number.

BID FORM
WILLIAMSON COUNTY, TEXAS

PROJECT: **County Road 200 at Bold Sundown** **BIDDER:** _____

Full compensation for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract will be considered as included in the unit prices for the work set forth below, and no separate payment will be made for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract, unless separate payment is expressly provided for therein.

BID ITEM	TECH SPEC[1]	DESCRIPTION	BID QUANTITY	UNIT MEASURE	UNIT COST	AMOUNT BID
30	542-6002	REMOVE TERMINAL ANCHOR SECTION	1	EA		$ -
31	544-6001	GUARDRAIL END TREATMENT(INSTALL)	2	EA		$ -
32	544-6003	GUARDRAIL END TREATMENT(REMOVE)	1	EA		$ -
33	644-6001	IN SM RD SN SUP&AM TY 10BWG (1) SA (P)	1	EA		$ -
34	644-6060	INS SM RD SN SUP & AM TY TWT(1)WS(P)	3	EA		$ -
35	644-6076	REMOVE SM RD SN SUP & AM	3	EA		$ -
36	658-6062	INSTL DEL ASSM(D-SW)SZ 1(BRF)GF 2(BI)	6	EA		$ -
37	662-6109	WK ZN PAV MRK SHT TERM(TAB)TY W	64	EA		$ -
38	662-6110	WK ZN PAV MRK SHT TERM(TAB)TY Y	93	EA		$ -
39	666-6003	REFL PAV MRK TY I(W)4"(SLD)(100 MIL)	2359	LF		$ -
40	666-6036	REFL PAV MRK TY I(W)8"(SLD)(100 MIL)	234	LF		$ -
41	666-6042	REFL PAV MRK TY I(W)12"(SLD)(100 MIL)	140	LF		$ -
42	666-6048	REFL PAV MRK TY I(W)24"(SLD)(100 MIL)	391	LF		$ -
43	666-6054	REFL PAV MRK TY I(W)(ARROW)(100 MIL)	2	LF		$ -
44	666-6096	REFL PAV MRK TY I(W)(WORD)(100 MIL)	2	EA		$ -
45	666-6126	REFL PAV MRK TY I(Y)4"(SLD)(100 MIL)	2275	LF		$ -

[1]Refer to the Technical Specifications section for a description of the specific reference number.

BID FORM
WILLIAMSON COUNTY, TEXAS

PROJECT: **County Road 200 at Bold Sundown** **BIDDER:** _____

Full compensation for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract will be considered as included in the unit prices for the work set forth below, and no separate payment will be made for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract, unless separate payment is expressly provided for therein.

BID ITEM	TECH SPEC[1]	DESCRIPTION	BID QUANTITY	UNIT MEASURE	UNIT COST	AMOUNT BID
46	672-6007	REFL PAV MRKR TY I-C	12	EA		$ -
47	672-6009	REFL PAV MRKR TY II-A-A	150	EA		$ -
48	672-6010	REFL PAV MRKR TY II-A-A	151	EA		$ -

NON-BID ITEMS TO BE INCLUDED IN BID AND CONTRACT AMOUNT. DO NOT MAKE CHANGES TO THIS SECTION.

49	999-WC01	FORCE ACCOUNT	10,000.00	DOL	$ 1.00	$ 10,000.00

TOTAL AMOUNT OF BID

_____ **Dollars and** _____ **Cents** $ _____

NOTE: THE COURT MAY EITHER REJECT ALL BIDS OR AWARD A CONTRACT TO THE LOWEST AND BEST BID.

[1]Refer to the Technical Specifications section for a description of the specific reference number.

SECTION 5
STANDARD FORM OF AGREEMENT

STANDARD FORM OF AGREEMENT

STATE OF TEXAS

WILLIAMSON COUNTY

THIS STANDARD FORM OF AGREEMENT (the "Agreement") is by and between WILLIAMSON COUNTY, TEXAS, a political subdivision of the State of Texas (hereinafter called "County") and _____ (hereinafter called "Contractor").

The County and Contractor, in consideration of the mutual covenants hereinafter set forth, agree as follows:

Article 1. Work

Contractor shall complete all Work as specified or indicated in the Contract Documents. The "Project" is generally described as follows:

Project No. 1802-217 – County Road 200 at Bold Sundown

Article 2. Engineer of Record

The Project has been designed by O'Brien Engineering Services, LLC who is hereinafter called the "Engineer of Record" and who is to act as the County's design professional.

Article 3. Contract Time

The Work shall be Substantially Completed in 45 working days (the "Contract Time"). Following Substantial Completion, the Contractor shall proceed expeditiously with adequate forces and shall achieve Final Completion within the time specified in the Special Conditions.

Article 4. Contract Price

County shall pay Contractor for completion of the Work in accordance with the Contract Documents an amount in current funds equal to the sum of the amounts determined pursuant to paragraph 4.1 below (the "Contract Price"):

4.1 For all Unit Price Work, an amount equal to the sum of the established unit price for each separately identified item of Unit Price Work times the estimated quantity of that item as indicated in the Bid Form, and as totaled below:

TOTAL OF ALL UNIT PRICES_____ $_____(dollars)
(insert words)

As provided in the General Conditions, estimated quantities are not guaranteed, and determinations of actual quantities and classification are to be made by the Engineer of Record.

Article 5. Contractor's Representations

In order to induce County to enter into this Agreement, Contractor makes the following representations:

5.1 Contractor has examined and carefully studied the Contract Documents and the other related data identified in the Bidding Documents including the "technical data".

5.2 Contractor has visited the site and become familiar with and is satisfied as to the general, local and site conditions that may affect cost, progress, performance or furnishing of the Work.

5.3 Contractor is familiar with and is satisfied as to all federal, state and local Laws and Regulations that may affect cost, progress, performance and furnishing of the Work.

5.4 Contractor has carefully studied all reports of explorations and tests of subsurface conditions at or contiguous to the site and all drawings of physical conditions in or relating to existing surface or subsurface structures at or contiguous to the site which have been identified. Contractor acknowledges that such reports and drawings are not Contract Documents and may not be complete for Contractor's purposes. Contractor acknowledges that the County and Engineer of Record do not assume responsibility for the accuracy or completeness of information and data shown or indicated in the Contract Documents with respect to Underground Facilities at or contiguous to the site.

5.5 Contractor has correlated the information known to Contractor, information and observations obtained from visits to the site, reports and drawings identified in the Contract Documents and all additional examinations, investigations, explorations, tests, studies and data with the Contract Documents.

5.6 Contractor has given Engineer of Record written notice of all conflicts, errors, ambiguities or discrepancies that Contractor has discovered in the Contract Documents and the written resolution thereof by Engineer of Record is acceptable to Contractor, and the Contract Documents are generally sufficient to indicate and convey understanding of all terms and conditions for performance and furnishing of the Work.

5.7 Contractor represents and agrees that there are no obligations, commitments, or impediments of any kind that will limit or prevent performance of its obligations under the Contract Documents.

5.8 Contractor warrants, represents, and agrees that if (i) it is a corporation or limited liability company, then it is a corporation duly organized, validly existing and in good standing under the laws of the State of Texas, or a foreign corporation or limited liability company duly authorized and in good standing to conduct business in the State of Texas, that it has all necessary corporate power and has received all necessary corporate approvals to execute and deliver this Agreement, and the individual executing the Agreement on behalf of Contractor has been duly authorized to act for and bind Contractor; or (ii) if it is a partnership, limited partnership, or limited liability partnership, then it has all necessary partnership power and has secured all necessary approvals to execute and deliver this Agreement and perform all its obligations under the Contract Documents; and the individual executing this Agreement on behalf of Contractor has been duly authorized to act for and bind Contractor.

5.9 Neither the execution and delivery of this Agreement by Contractor nor the performance of its obligations under the Contract Documents will result in the violation of any provision, if a corporation, of its articles of incorporation or by-laws, if a limited liability company, of its articles of organization or regulations, or if a partnership, by any partnership agreement by which Contractor is bound, or any agreement by which Contractor is bound or to the best of the Contractor's knowledge and belief, will conflict with any order or decree of any court or governmental instrumentality relating to Contractor.

5.10 Except for the obligation of the County to pay Contractor the Contract Price pursuant to the terms of the Contract Documents, and to perform certain other obligations pursuant to the terms and conditions explicitly set forth in the Contract Documents, County shall have no liability to Contractor or to anyone claiming through or under Contractor by reason of the execution or performance of this Agreement. Notwithstanding any obligation or liability of County to Contractor, no present or future partner or affiliate of County or any agent, officer, director, or employee of County, or of the various departments comprising Williamson County, or anyone claiming under County has or shall have any personal liability to Contractor or to anyone claiming through or under Contractor by reason of the execution or performance of this Agreement.

Article 6. Contract Documents

The "Contract Documents," which comprise the entire agreement between the County and Contractor concerning the Work, consist of the following:

6.1 This Standard Form of Agreement

6.2 Performance Bond

6.3 Payment Bond

6.4 Maintenance Bond

6.5 Certificate of Insurance

6.6 Wage Rates

6.7 General Conditions

6.8 Special Conditions

6.9 Technical Specifications

6.10 Plan Drawings

6.11 Addenda numbers _____ to _____, inclusive

6.12 Contractor's Bid Affidavit and Bid Form

6.13 Documentation submitted by Contractor prior to Notice of Award.

6.14 The following which may be delivered or issued after the Effective Date of the Agreement and are not attached hereto: All Written Amendments and other documents amending, modifying or supplementing the Contract Documents pursuant to applicable sections in the General Conditions.

The documents listed in paragraphs 6.2 et seq. above are attached to this Agreement (except as expressly noted otherwise above).

There are no Contract Documents other than those listed above in this Article 6. The Contract Documents may only be amended, modified or supplemented as provided in the General Conditions.

Article 7. Miscellaneous

7.1 Terms used in this Agreement, which are defined in the General Conditions, will have the meanings indicated in the General Conditions.

7.2 No assignment by a party hereto of any rights under or interests in the Contract Documents will be binding on another party hereto without the written consent of the party sought to be bound; and, specifically but without limitation, moneys that

may become due and moneys that are due may not be assigned without such consent (except to the extent that the effect of this restriction may be limited by law), and unless specifically stated to the contrary in any written consent to an assignment no assignment will release or discharge the assignor from any duty or responsibility under the Contract Documents.

7.3 The County and Contractor each binds itself, its partners, successors, assigns and legal representatives to the other party hereto, its partners, successors, assigns and legal representatives in respect to all covenants, agreements and obligations contained in the Contract Documents.

7.4 Any provision or part of the Contract Documents held to be void or unenforceable under any Law or Regulation shall be deemed stricken, and all remaining provisions shall continue to be valid and binding upon the County and Contractor, who agree that the Contract Documents shall be reformed to replace such stricken provision or part thereof with a valid and enforceable provision that comes as close as possible to expressing the intention of the stricken position.

7.5 Each party to this Agreement hereby agrees and acknowledges that venue and jurisdiction of any suit, right, or cause of action arising out of or in connection with this Agreement shall lie exclusively in Williamson County, Texas. Furthermore, this Agreement shall be governed by and construed in accordance with the laws of the State of Texas, excluding, however, its choice of law rules.

7.6 The parties to this Agreement agree that during the performance of the services under this Agreement they will not discriminate against any employee or applicant for employment because of race, color, religion, sex, or national origin. The parties to this Agreement will take affirmative action to ensure that applicants are employed, and that employees are treated during employment, without regard to their race, color, religion, sex or national origin. Such action shall include, but not be limited to the following: employment, upgrading, demotion, or transfer; termination; rates of pay or other forms of compensation, and selection for training, including apprenticeship.

7.7 This Agreement is for the sole and exclusive benefit of the parties hereto, and nothing in this Agreement, express or implied, is intended to confer or shall be construed as conferring upon any other person any rights, remedies or any other type or types of benefits.

7.8 Each party to this Agreement acknowledges that it and its counsel have reviewed this Agreement and that the normal rules of construction are not applicable and there will be no presumption that any ambiguities will be resolved against the drafting party in the interpretation of this Agreement.

7.9 Each party to this Agreement, in the performance of this Agreement, shall act in an individual capacity and not as agents, employees, partners, joint ventures or

associates of one another. The employees or agents of one party shall not be deemed or construed to be the employees or agents of the other party for any purposes whatsoever.

7.10 Nothing in this Agreement shall be deemed to waive, modify or amend any legal defense available at law or in equity to County, its past or present officers, employees, or agents or employees, nor to create any legal rights or claim on behalf of any third party. County does not waive, modify, or alter to any extent whatsoever the availability of the defense of governmental immunity under the laws of the State of Texas and of the United States.

7.11 To the extent, if any, that any provision in this Agreement is in conflict with Tex. Gov't Code 552.001 et seq., as amended (the "Public Information Act"), the same shall be of no force or effect. Furthermore, it is expressly understood and agreed that County, its officers and employees may request advice, decisions and opinions of the Attorney General of the State of Texas in regard to the application of the Public Information Act to any items or data furnished to County as to whether or not the same are available to the public. It is further understood that County's officers and employees shall have the right to rely on the advice, decisions and opinions of the Attorney General, and that County, its officers and employees shall have no liability or obligation to any party hereto for the disclosure to the public, or to any person or persons, of any items or data furnished to County by a party hereto, in reliance of any advice, decision or opinion of the Attorney General of the State of Texas.

7.12 County and Contractor have signed this Agreement in triplicate. One counterpart each has been delivered to the County, Contractor and Engineer of Record. All portions of the Contract Documents have been signed, initialed or identified by County and Contractor or identified by Engineer of Record on their behalf.

7.13 This Agreement and the Contract Documents represent the entire and integrated agreement between the parties hereto and supersedes all prior negotiations, representations, or agreements, either oral or written. This Agreement may be amended only by written instrument signed by each party to this Agreement. NO OFFICIAL, EMPLOYEE, AGENT, OR REPRESENTATIVE OF THE COUNTY HAS ANY AUTHORITY, EITHER EXPRESS OR IMPLIED, TO AMEND THIS CONTRACT, EXCEPT PURSUANT TO SUCH EXPRESS AUTHORITY AS MAY BE GRANTED BY THE WILLIAMSON COUNTY COMMISSIONERS COURT.

This Agreement will be effective on _____, 20_____ (which is the "Effective Date" of the Agreement).

COUNTY_____	CONTRACTOR_____
By:_____	By: _____
Dan A. Gattis, Williamson County Judge	Title: _____
	[CORPORATE SEAL]
Attest_____	Attest_____

SECTION 6
WAGE RATES

WAGE RATES

Contractor must pay all workers not less than the prevailing wage rate for Williamson County, Texas.

General Decision Number: TX180016 01/05/2018 TX16

Superseded General Decision Number: TX20170016

State: Texas

Construction Types: Heavy and Highway

Counties: Atascosa, Bandera, Bastrop, Bell, Bexar, Brazos, Burleson, Caldwell, Comal, Coryell, Guadalupe, Hays, Kendall, Lampasas, McLennan, Medina, Robertson, Travis, Williamson and Wilson Counties in Texas.

HEAVY (excluding tunnels and dams, not to be used for work on Sewage or Water Treatment Plants or Lift / Pump Stations in Bell, Coryell, McClennon and Williamson Counties) and HIGHWAY Construction Projects

Note: Under Executive Order (EO) 13658, an hourly minimum wage of $10.35 for calendar year 2018 applies to all contracts subject to the Davis-Bacon Act for which the contract is awarded and any solicitation was issued) on or after January 1, 2015. If this contract is covered by the EO, the contractor must pay all workers in any classification listed on this wage determination at least $10.35 per hour (or the applicable wage rate listed on this wage determination, if it is higher)for all hours spent performing on the contract in calendar year 2018. The EO minimum wage rate will be adjusted annually. Please note that this EO applies to the above-mentioned types of contracts entered into by the federal government that are subject to the Davis-Bacon Act itself, but it does not apply to contracts subject only to the Davis-Bacon Related Acts, including those set forth at 29 CFR 5.1(a)(2)-(60). Additional information on contractor requirements and worker protections under the EO is available at www.dol.gov/whd/govcontracts.

Modification Number	Publication Date
0	01/05/2018

* SUTX2011-006 08/03/2011

	Rates	Fringes
CEMENT MASON/CONCRETE FINISHER (Paving and Structures)	$ 12.56	
ELECTRICIAN	$ 26.35	
FORM BUILDER/FORM SETTER		

Paving & Curb.....$ 12.94
Structures.....$ 12.87

LABORER
Asphalt Raker.....$ 12.12
Flagger.....$ 9.45
Laborer, Common.....$ 10.50
Laborer, Utility.....$ 12.27
Pipelayer.....$ 12.79
Work Zone Barricade
Servicer.....$ 11.85

PAINTER (Structures).....$ 18.34

POWER EQUIPMENT OPERATOR:
Agricultural Tractor.....$ 12.69
Asphalt Distributor.....$ 15.55
Asphalt Paving Machine.....$ 14.36
Boom Truck.....$ 18.36
Broom or Sweeper.....$ 11.04
Concrete Pavement
Finishing Machine.....$ 15.48
Crane, Hydraulic 80 tons
or less.....$ 18.36
Crane, Lattice Boom 80
tons or less.....$ 15.87
Crane, Lattice Boom over
80 tons.....$ 19.38
Crawler Tractor.....$ 15.67
Directional Drilling
Locator.....$ 11.67
Directional Drilling
Operator.....$ 17.24
Excavator 50,000 lbs or
Less.....$ 12.88
Excavator over 50,000 lbs...$ 17.71
Foundation Drill, Truck
Mounted.....$ 16.93
Front End Loader, 3 CY or
Less.....$ 13.04
Front End Loader, Over 3 CY.$ 13.21
Loader/Backhoe.....$ 14.12
Mechanic.....$ 17.10
Milling Machine.....$ 14.18
Motor Grader, Fine Grade....$ 18.51
Motor Grader, Rough.....$ 14.63
Pavement Marking Machine....$ 19.17
Reclaimer/Pulverizer.....$ 12.88
Roller, Asphalt.....$ 12.78
Roller, Other.....$ 10.50
Scraper.....$ 12.27
Spreader Box.....$ 14.04
Trenching Machine, Heavy....$ 18.48

Servicer.....$ 14.51

Steel Worker
Reinforcing.....$ 14.00
Structural.....$ 19.29

TRAFFIC SIGNAL INSTALLER
Traffic Signal/Light Pole
Worker.....$ 16.00

TRUCK DRIVER
Lowboy-Float.....$ 15.66
Off Road Hauler.....$ 11.88
Single Axle.....$ 11.79
Single or Tandem Axle Dump
Truck.....$ 11.68
Tandem Axle Tractor w/Semi
Trailer.....$ 12.81

WELDER.....$ 15.97

WELDERS - Receive rate prescribed for craft performing operation to which welding is incidental.

==========

Note: Executive Order (EO) 13706, Establishing Paid Sick Leave for Federal Contractors applies to all contracts subject to the Davis-Bacon Act for which the contract is awarded (and any solicitation was issued) on or after January 1, 2017. If this contract is covered by the EO, the contractor must provide employees with 1 hour of paid sick leave for every 30 hours they work, up to 56 hours of paid sick leave each year.

Employees must be permitted to use paid sick leave for their own illness, injury or other health-related needs, including preventive care; to assist a family member (or person who is like family to the employee) who is ill, injured, or has other health-related needs, including preventive care; or for reasons resulting from, or to assist a family member (or person who is like family to the employee) who is a victim of, domestic violence, sexual assault, or stalking. Additional information on contractor requirements and worker protections under the EO is available at www.dol.gov/whd/govcontracts.

Unlisted classifications needed for work not included within the scope of the classifications listed may be added after award only as provided in the labor standards contract clauses(29CFR 5.5 (a) (1) (ii)).

The body of each wage determination lists the classification and wage rates that have been found to be prevailing for the cited type(s) of construction in the area covered by the wage determination. The classifications are listed in alphabetical order of "identifiers" that

indicate whether the particular rate is a union rate (current union negotiated rate for local), a survey rate (weighted average rate) or a union average rate(weighted union average rate).

Union Rate Identifiers

A four letter classification abbreviation identifier enclosed in dotted lines beginning with characters other than "SU" or "UAVG" denotes that the union classification and rate were prevailing for that classification in the survey. Example: PLUM0198-005 07/01/2014. PLUM is an abbreviation identifier of the union which prevailed in the survey for this classification, which in this example would be Plumbers. 0198 indicates the local union number or district council number where applicable, i.e., Plumbers Local 0198. The next number,005 in the example, is an internal number used in processing the wage determination. 07/01/2014 is the effective date of the most current negotiated rate, which in this example is July 1, 2014.

Union prevailing wage rates are updated to reflect all rate changes in the collective bargaining agreement (CBA) governing this classification and rate.

Survey Rate Identifiers

Classifications listed under the "SU" identifier indicate that no one rate prevailed for this classification in the survey and the published rate is derived by computing a weighted average rate based on all the rates reported in the survey for that classification. As this weighted average rate includes all rates reported in the survey, it may include both union and non-union rates. Example: SULA2012-007 5/13/2014. SU indicates the rates are survey rates based on a weighted average calculation of rates and are not majority rates. LA indicates the State of Louisiana. 2012 is the year of survey on which these classifications and rates are based. The next number, 007 in the example, is an internal number used in producing the wage determination. 5/13/2014 indicates the survey completion date for the classifications and rates under that identifier.

Survey wage rates are not updated and remain in effect until a new survey is conducted.

Union Average Rate Identifiers

Classification(s) listed under the UAVG identifier indicate that no single majority rate prevailed for those classifications; however, 100% of the data reported for the classifications was union data. EXAMPLE: UAVG-OH-0010 08/29/2014. UAVG indicates that the rate is a weighted union average rate. OH indicates the state. The next number, 0010 in the example, is an internal number used in producing the wage determination. 08/29/2014 indicates the survey completion date for the classifications and rates under that identifier.

A UAVG rate will be updated once a year, usually in January of each year, to reflect a weighted average of the current negotiated/CBA rate of the union locals from which the rate is based.

WAGE DETERMINATION APPEALS PROCESS

1.) Has there been an initial decision in the matter? This can be:

* an existing published wage determination
* a survey underlying a wage determination
* a Wage and Hour Division letter setting forth a position on a wage determination matter
* a conformance (additional classification and rate) ruling

On survey related matters, initial contact, including requests for summaries of surveys, should be with the Wage and Hour Regional Office for the area in which the survey was conducted because those Regional Offices have responsibility for the Davis-Bacon survey program. If the response from this initial contact is not satisfactory, then the process described in 2.) and 3.) should be followed.

With regard to any other matter not yet ripe for the formal process described here, initial contact should be with the Branch of Construction Wage Determinations. Write to:

Branch of Construction Wage Determinations
Wage and Hour Division
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

2.) If the answer to the question in 1.) is yes, then an interested party (those affected by the action) can request review and reconsideration from the Wage and Hour Administrator (See 29 CFR Part 1.8 and 29 CFR Part 7). Write to:

Wage and Hour Administrator
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

The request should be accompanied by a full statement of the interested party's position and by any information (wage payment data, project description, area practice material, etc.) that the requestor considers relevant to the issue.

3.) If the decision of the Administrator is not favorable, an interested party may appeal directly to the Administrative Review Board (formerly the Wage Appeals Board). Write to:

Administrative Review Board
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

4.) All decisions by the Administrative Review Board are final.

==========

END OF GENERAL DECISION

SECTION 7
PERFORMANCE BOND

PERFORMANCE BOND

STATE OF TEXAS
COUNTY OF _____

KNOW ALL MEN BY THESE PRESENTS: That _____

_____of the City of _____

County of _____, and State of _____, as principal, and

_____

authorized under the laws of the State of Texas to act as surety on bonds for principals, are held and firmly bound unto Williamson County (County), in the penal sum of

_____Dollars

($_____) for the payment whereof, the said Principal and Surety bind themselves, their heirs, administrators, executors, successors, jointly and severally, by these presents:

WHEREAS, the Principal has entered into a certain written Agreement with the County, dated the _____day of _____, 20_____(the "Agreement"), to which the said Agreement, along with the Contract Documents referenced therein are hereby referred to and made a part hereof as fully and to the same extent as if copied at length herein.

NOW, THEREFORE, THE CONDITION OF THIS OBLIGATION IS SUCH, that if the said Principal shall faithfully perform said Agreement and shall in all respects duly and faithfully observe and perform all and singular the covenants, conditions and agreements in and by the Agreement agreed and covenanted by the Principal to be observed and performed, and according to the true intent and meaning of said Agreement and the Contract Documents hereto annexed, then this obligation shall be void; otherwise to remain in full force and effect.

PROVIDED, HOWEVER, that this bond is executed pursuant to the provisions of Chapter 2253 of the Texas Government Code, as amended and all liabilities on this bond shall be determined in accordance with the provisions of said Chapter to the same extent as if it were copied at length herein.

SURETY, for value received, stipulates and agrees that no change, extension of time, alteration or addition to the terms of the Agreement or to the work performed thereunder, or to the Contract Documents referenced therein, shall in anyway affect the obligations on this bond, and it does hereby waive notice of such change, extension of time, alteration or addition to the terms on the Agreement, or to the work to be performed thereunder.

IN WITNESS WHEREOF, the said Principal and Surety have signed and sealed this instrument this _____ day of _____, 20___.

_____	_____
PRINCIPAL	SURETY
_____	_____
SIGNATURE	SIGNATURE
_____	_____
NAME & TITLE	NAME & TITLE
_____	_____
ADDRESS	ADDRESS
_____	_____
(_____) _____	(_____) _____
PHONE NUMBER	PHONE NUMBER

The name and address of the Resident Agency of Surety is:

_____

_____

(_____) _____	_____
PHONE NUMBER	SIGNATURE OF LICENSED LOCAL RECORDING AGENT appointed to countersign on behalf of Surety (Required by Art. 21.09 of the Insurance Code)

****

I,_____, having executed Bonds
SIGNATURE

for _____ do hereby affirm I have
NAME OF SURETY

verified that said Surety is now certified with Authority from either: (a) the Secretary of the Treasury of the United States if the project funding includes Federal monies; or (b) the State of Texas if none of the project funding is from Federal sources; and further, said Surety is in no way limited or restricted from furnishing Bond in the State of Texas for the amount and under conditions stated herein.

SECTION 8
PAYMENT BOND

PAYMENT BOND

STATE OF TEXAS
COUNTY OF _____

KNOW ALL MEN BY THESE PRESENTS: That _____

_____of the City of _____

County of _____, and State of _____, as Principal (hereinafter referred to as the "Principal"), and

_____
authorized under the laws of the State of Texas to act as Surety on bonds for principals (hereinafter referred to as the "Surety"), are held and firmly bound unto Williamson County, (hereinafter referred to as the "County"), in the penal sum of

_____Dollars

($_____) for the payment whereof, the said Principal and Surety bind themselves, their heirs, administrators, executors, successors and assigns, jointly and severally, by these presents:

WHEREAS, the Principal has entered into a certain written agreement with the County, dated the _____ day of _____, 20_____, to _____

_____ (hereinafter referred to as the "Agreement"), which said Agreement and the Contract Documents incorporated therein are hereby referred to and made a part hereof as fully and to the same extent as if copied at length herein.

NOW, THEREFORE, THE CONDITION OF THIS OBLIGATION IS SUCH, that if the said Principal shall pay all claimants supplying labor and material to him or a subcontractor in the prosecution of the Work provided for in said Agreement, then, this obligation shall be void; otherwise to remain in full force and effect.

PROVIDED, HOWEVER, that this bond is executed pursuant to the provisions of Chapter 2253 of the Texas Government Code, as amended and all liabilities on this bond shall be determined in accordance with the provisions of said Chapter to the same extent as if it were copied at length herein.

SURETY, for value received, stipulates and agrees that no change, extension of time, alteration or addition to the terms of the Agreement or to the Work performed thereunder, or to the other Contract Documents accompanying the same, shall in anyway affect its obligation on this bond, and it does hereby waive notice of such change, extension of time, alteration or addition to the terms of the Agreement, or to the work to be performed thereunder or to the other Contract Documents accompanying the same.

IN WITNESS WHEREOF, the said Principal and Surety have signed and sealed this instrument this _____ day of _____, 20___.

_____	_____
PRINCIPAL	SURETY
_____	_____
SIGNATURE	SIGNATURE
_____	_____
NAME & TITLE	NAME & TITLE
_____	_____
ADDRESS	ADDRESS
_____	_____
(_____) _____	(_____) _____
PHONE NUMBER	PHONE NUMBER

The name and address of the Resident Agency of Surety is:

_____

_____

(_____) _____	_____
PHONE NUMBER	SIGNATURE OF LICENSED LOCAL RECORDING AGENT appointed to countersign on behalf of Surety (Required by Art. 21.09 of the Insurance Code)

SECTION 9
MAINTENANCE BOND

MAINTENANCE BOND

KNOW ALL MEN BY THESE PRESENTS: That _____
(NAME OF CONTRACTOR)

_____

as principal, hereinafter called "CONTRACTOR" and _____

_____
(NAME OF SURETY)

a corporation organized under the laws of _____
as Surety, hereinafter called "SURETY", do hereby expressly acknowledge themselves to be held and bound to pay unto WILLIAMSON COUNTY as Obligee, a political subdivision of the State of Texas, hereinafter called "COUNTY", the sum of (20% of total construction contract amount)

_____
(INSERT WORDS)
_____ Dollars ($_____) for the payment of which sum well and truly to be made unto said COUNTY and its successors, said principal and sureties do hereby bind themselves, their assigns, and successors jointly and severally.

This obligation is conditioned, however, that whereas said CONTRACTOR has by written Agreement dated _____ , 20 _____ , entered into an agreement with said COUNTY to build and construct _____

_____

which said Agreement and the Contract Documents therein mentioned and adopted by the COUNTY are hereby expressly made a part thereof as though the same were written and embodied herein.

WHEREAS, under the terms and conditions of the Agreement, specifications and other Contract Documents, it is provided that the CONTRACTOR shall maintain and keep in good repair the Work constructed and/or equipment furnished by it as contemplated by the plan drawings, specifications, and other Contract Documents, and perform for a period of 2 years from the date of acceptance as shown on the "Certificate of Completion" issued by the ENGINEER, or the date of Final Payment by the COUNTY if a separate Certificate of Completion is not issued, all necessary repairs, reconstruction and renewal of any part of said construction, and to furnish the labor and materials to make good and to repair any defective condition growing out of or on account of the breakage or failure of any substance or the improper function of any part of the construction work. The CONTRACTOR shall reimburse the COUNTY for the costs of all engineering and special services required to be furnished by the COUNTY which are directly attributable to the restoration of the constructed work. Said maintenance contemplates the complete restoration of the constructed work to a functional use during the said period as set forth above. It is the intended purpose of this section to require the correction of all defective conditions resulting from materials furnished or work and labor performed by the CONTRACTOR under the conditions prescribed by the Agreement, plans and specifications and other Contract Documents; and in case the CONTRACTOR shall fail or refuse to commence and actively pursue such corrections within ten (10) days after proper written notifications have been furnished to it by the COUNTY, it is agreed that the COUNTY may do said work and supply such materials and the said CONTRACTOR and SURETY herein shall be liable for the payment of all costs thereby incurred.

NOW THEREFORE, if the said CONTRACTOR shall keep and perform its said agreement to maintain said work and keep the same in good repair for the said maintenance period as provided above, then these presents shall be null and void and have no further effect, but if default shall be made by the

CONTRACTOR in the performance of its Agreement to maintain and repair said work, then these presents shall have full force and effect and the COUNTY shall have and recover from the said CONTRACTOR and its sureties damages in the premises, as provided, and it is further understood and agreed that this obligation shall be a continuing one against the principal and sureties hereon, and that successive recoveries may be had hereon for successive breaches until the full amount shall have been exhausted; and it is further understood that the obligation herein to maintain said work shall continue throughout said maintenance period, and the same shall not be changed, diminished, or in any manner affected from any cause during said time.

IN WITNESS WHEREOF, this instrument is executed this _____ day of _____, 20 ____

_____ _____

PRINCIPAL PHONE NO.

_____

SIGNATURE (SEAL)

_____ _____

NAME & TITLE WITNESS OR ATTEST TO SEAL

_____ _____

SURETY PHONE NO.

_____

SIGNATURE (SEAL)

_____ _____

NAME & TITLE WITNESS OR ATTEST TO SEAL

_____

SIGNATURE OF LICENSED LOCAL RECORDING AGENT
appointed to countersign on behalf of Surety

SECTION 10
CERTIFICATE OF INSURANCE

CERTIFICATE OF INSURANCE

TO: DATE: _____

_____ Project No.: _____
(COUNTY)

_____ Type of _____

_____ Project: _____
(ADDRESS)

THIS IS TO CERTIFY THAT _____
(Name and address of insured)

is, at the date of this certificate, insured by this Company with respect to the business operations hereinafter described for the types of Insurance and in accordance with the provisions of the standard policies used by this Company, and further hereinafter described. Exceptions to the standard policy noted on reverse side hereof.

TYPE OF INSURANCE	POLICY NO.	EFFECTIVE	EXPIRES	LIMITS OF LIABILITY	
Workmen's Compensation					
				1 Person	$
Public Liability				1 Accident	$
Contingent				1 Person	$
Liability				1 Accident	$
Property Damage					
Builder's Risk					
Automobile					
Other					

The foregoing Policies (do) (do not) cover all sub-contractors.

Locations Covered: _____

Descriptions of Operations Covered: _____

The above policies either in the body thereof or by appropriate endorsement provide that they may not be changed or canceled by the insurer in less than five days after the insured has received written notice of such change or cancellation.

Where applicable local laws or regulations require more than five days actual notice of change or cancellation to the assured, the above policies contain such special requirements, either in the body thereof or by appropriate endorsement thereto attached.

_____
(Name of Insurer)

By: _____

Phone No. (___) _____ Title: _____

SECTION 11
GENERAL CONDITIONS OF AGREEMENT

Table of Contents

1. Definition of Terms
1.01 The Agreement
1.02 County
1.03 Department
1.04 Contractor
1.05 Engineer
1.06 General Engineering Consultant (GEC)
1.07 Construction Observer
1.08 Construction Representative
1.09 Engineer of Record
1.10 Contract Documents
1.11 Subcontractor
1.12 Sub-Subcontractor
1.13 Written Notice
1.14 Work
1.15 Extra Work
1.16 Working Day
1.17 Calendar Day
1.18 Substantially Completed
1.19 Notice of Substantial Completion
1.20 Certificate of Completion
1.21 Certificate of Acceptance
1.22 Project
1.23 Contract Time
1.24 Contract Price

2. Responsibilities of the Engineer and the Contractor
2.01 County-Observer Relationship
2.02 Professional Observation by the Construction Observer
2.03 Payments for Work
2.04 Initial Determinations
2.05 Objections
2.06 Lines and Grades
2.07 Contractor's Duty and Superintendence
2.08 Contractor's Understanding
2.09 Character of Workers
2.10 Shop Drawings
2.11 Preliminary Approval
2.12 Defects and Their Remedies
2.13 Changes and Alterations

3. General Obligations and Responsibilities

3.01 Keeping of Plans and Specifications Accessible and Keeping a Superintendent on the Project Site
3.02 Ownership of Documents
3.03 Adequacy of Design
3.04 Contractor's Responsibility for Work
3.05 Protection Against Accident to Employees and the Public
3.06 Performance and Payment Bonds
3.07 Protection of Adjoining Property
3.08 Protection Against Claims of Subcontractors, Laborers, Materialmen and Furnishers of Machinery, Equipment and Supplies
3.09 Protection Against Royalties or Patented Invention
3.10 Laws and Ordinances
3.11 Assignment and Subletting
3.12 Indemnification
3.13 Insurance
3.14 Final Clean-up

4. Prosecution and Progress

4.01 Time and Order of Completion
4.02 Extension of Time
4.03 Hindrances and Delays

5. Measurement and Payment

5.01 Quantities and Measurements
5.02 Estimated Quantities
5.03 Price of Work
5.04 Partial Payments
5.05 Punch List
5.06 Final Completion and Acceptance
5.07 Final Payment
5.08 Payments Withheld
5.09 Delayed Payments

6. Extra Work and Claims

6.01 Change Orders
6.02 Minor Changes
6.03 Extra Work
6.04 Time of Filing Claims
6.05 Continuing Performance

7. Abandonment of Contract
7.01 Abandonment by Contractor
7.02 Abandonment by the County

8. Subcontractors
8.01 Award of Subcontracts for Portions of the Work
8.02 Subcontractual Relations
8.03 Payments to Subcontractors

9. Protection of Persons and Property
9.01 Safety Precautions and Programs
9.02 Safety of Persons and Property
9.03 Location and Protection of Utilities

10. Termination
10.01 Termination by the County for Cause
10.02 Termination for Convenience
10.03 Obligations of Contractor Following Termination

11. Inspection and Audit

General Conditions of Agreement

1. Definition of Terms

For purposes of the Contract Documents, the following terms shall have the meanings set forth herein:

1.01 The Agreement

The term the "Agreement" shall mean Standard Form of Agreement by and between County and Contractor relating to the Work and the construction of the Project.

1.02 County

Williamson County, Texas, being a political subdivision of the State of Texas, is the entity identified in the Agreement and hereinafter referred to as the "County." Nothing contained in the Contract Documents shall create any contractual or agency relationship between any parties other than the County and the Contractor.

1.03 Department

The "Department" shall mean the Texas Department of Transportation (TxDOT).

1.04 Contractor

The term the "Contractor" shall mean the successful bidder that enters into the Agreement with the County for the construction of the Work and the Project defined by the Contract Documents.

1.05 Engineer

The term the "Engineer" shall mean the County Engineer or the authorized representative of the County Engineer.

1.06 General Engineering Consultant (GEC)

The term the "General Engineering Consultant" or "GEC" shall mean the consulting engineering firm representing and assisting the County in the design, review, and coordination of the design and construction phases of the Project. The GEC shall be responsible for the construction oversight of the Project.

1.07 Construction Observer

The "Construction Observer" or the "Observer" shall mean the County's employee or a contracted consultant who performs construction engineering and inspection services for the Project.

1.08 Construction Representative

The "Construction Representative" shall mean the GEC's designated field representative

during construction of the Project which shall provide for coordination and assistance of the construction observation effort.

1.09 Engineer of Record

The term "Engineer of Record" shall mean the County's design professional, who shall provide professional engineering design services for the Project.

1.10 Contract Documents

The "Contract Documents" shall consist of the Special Conditions, Notice for Bidders, Proposal, the fully executed Agreement, Performance and Payment Bonds, Maintenance Bond, Special Bonds (when required), General Conditions, Technical Specifications or Specifications, Plans and all modifications thereof incorporated in any such documents before the execution of the Agreement and all modifications that are made, in accordance with the Contract Documents, following the execution of the Agreement.

The Contract Documents are complementary, and what is called for by any one shall be as binding as if called for by all. In case of conflict between any of the Contract Documents, priority of interpretation shall be in the following order: Fully Executed Agreement, Performance and Payment Bonds, Maintenance Bond, Special Bonds (if any), Proposal, General Conditions, Special Conditions, Technical Specifications or Specifications, and Plans.

1.11 Subcontractor

The term "Subcontractor", as employed herein, includes only those having a direct contract with the Contractor. It includes one who furnishes material worked to special design according to the plans or specifications of this work, but does not include one who merely furnishes material not so worked.

1.12 Sub-Subcontractor

The term "Sub-Subcontractor" means one who has a direct or indirect contract with a Subcontractor to perform any of the Work at the site. It includes one who furnishes material worked to a special design according to the plans or specifications of this work, but does not include one who merely furnishes material not so worked.

1.13 Written Notice

Written notice shall be deemed to have been duly served if delivered in person to the individual or to an officer of the entity for whom it is intended, or if delivered to or sent by registered mail to the last business address known to it who gives the notice.

1.14 Work

The Contractor shall provide and pay for all materials, machinery, equipment, tools, superintendence, labor, services, insurance, and all water, light, power, fuel, transportation and other facilities necessary for the execution and completion of the work covered by the Contract Documents (collectively known as the "Work"). Unless otherwise specified, all materials shall be new and both workmanship and materials shall be of a good quality. The

Contractor shall, if required, furnish satisfactory evidence as to the kind and quality of materials. Materials or work described in words which, when so applied, have a well-known technical or trade meaning shall be held to refer to such recognized standards.

1.15 Extra Work

The term "Extra Work" as used in the Contract Documents shall be understood to mean and include all work that may be required by the County to be done by the Contractor to accomplish any change, alteration or addition to the Work shown upon the plans, or reasonably implied by the specifications, and not covered by the Contractor's Proposal, except as provided under Section 2.13 "Changes and Alterations" herein.

1.16 Working Day

The term "Working Day" is defined as any day not including Saturdays, Sundays or any legal holidays, in which weather or other conditions, not under the control of the Contractor, will permit construction of the principal units of the Work for a period of not less than seven (7) hours between 7:00 a.m. and 6:00 p.m.

1.17 Calendar Day

The term "Calendar Day" is defined as any day of the week or month, no days being excepted.

1.18 Substantially Completed

The term "Substantially Completed" or "Substantial Completion" shall be understood to mean that all Project Work (or the work for a specified phase of the Project) requiring lane or shoulder closures or obstructions is completed, and traffic is following the lane arrangement as shown on the plans for the finished roadway (or the specified phase of work). Additionally, all pavement construction, resurfacing, traffic control devices, and pavement markings shall be in their final position (or as called for on the plans for the specified phase of work) at such time; provided, however, the Engineer may make an exception as to the permanent pavement markings being in their final position provided that, in the Engineer's sole discretion, the lack of markings does not cause a disruption to traffic flow or an unsafe condition for the traveling public, and work zone pavement markings are in place.

1.19 Notice of Substantial Completion

Notice issued to the Contractor by the Observer or County's Representative acknowledging Substantial Completion of the Project, signifying the end of time charges.

1.20 Certificate of Completion

Certificate issued to the Contractor by the Observer acknowledging "Final Completion" of the Project, as determined by completion of the Punch List, from which time the warranty period for the Project shall begin. The issuance of the Certificate of Completion shall serve as evidence of "Final Completion" and such certificate shall relieve the Contractor of ownership responsibilities for the Project, except for repair of damage caused by the Contractor or by the Contractor's operations to existing facilities or completed and substantially accepted work.

1.21 Certificate of Acceptance

Certificate issued to the Contractor by the County acknowledging final acceptance and purchase of the Project.

1.22 Project

The "Project" shall mean and include the Project defined, described and set forth in the Agreement.

1.23 Contract Time

The "Contract Time" shall mean the amount of time in which the Work shall be Substantially Completed. The number of days allotted for the Contract Time shall be specifically set forth in the Agreement.

1.24 Contract Price

The "Contract Price" shall mean the amount that the County shall pay the Contractor for completion of the Work in accordance with the Contract Documents. The specific amount of the Contract Price shall be determined pursuant to the terms of the Contract Documents.

2. Responsibilities of the Engineer and the Contractor

2.01 County-Observer Relationship

The Observer will be the County's contracted consultant during construction. The duties, responsibilities and limitations of authority of the Observer as the County's representative during construction are as set forth in the Contract Documents and/or the Agreement for Construction Engineering and Inspection Services and shall not be extended or limited without written consent of the County or the Observer. The Observer will advise and consult with the County and the GEC, and all of the County's instructions to the Contractor shall be issued through the Observer.

2.02 Professional Observation by the Construction Observer

The Observer shall be on the jobsite when work is being performed to provide construction engineering inspections of the Work performed by the Contractor. In addition to performing material testing on behalf of the County, the Observer shall review the progress of the executed Work and to determine if such Work meets the essential performance and design features and the technical and functional engineering requirements of the Contract Documents; provided and except, however, that the Observer shall not be responsible, directly or indirectly, for the Contractor's construction means, methods, techniques, sequences, quality, procedures, programs, safety precautions or lack of same incident thereto or in connection therewith. Notwithstanding any other provision of the Contract Documents, the Engineer and the Observer shall not be responsible or liable for any acts, errors, omissions or negligence of the Contractor, any Subcontractor or any of the Contractor's or Subcontractor's agents, servants or employees or any other person, firm or corporation performing or attempting to perform any of the Work.

2.03 Payments for Work

The Observer shall review the Contractor's applications for payment and supporting data, determine the amount owed to the Contractor and recommend, in writing to the GEC for review, payment to the Contractor in such amounts; such recommendation of payment to the Contractor constitutes a representation to the County of the Observer's professional judgment that the Work has progressed to the point indicated to the best of its knowledge, information and belief, but such recommendation of an application for payment to the Contractor shall not be deemed as a representation by the Observer that the Observer has made any examination to determine how or for what purpose the Contractor has used the monies paid on account of the Contract Price.

2.04 Initial Determinations

The Observer initially shall determine all claims, disputes and other matters in question between the Contractor and the County relating to execution or progress of the Work or interpretation of the Contract Documents. The Observer's decision shall be rendered in writing to the GEC for review within a reasonable time, which shall not be construed to be less than ten (10) days.

2.05 Objections

In the event the Observer renders any decision which, in the opinion of either party hereto, is not in accordance with the meaning and intent of the Contract Documents, either party may file with the Observer its written objection to the decision within thirty (30) days of such decision by the Observer, and by such action may reserve the right to submit the question so raised to litigation as hereinafter provided.

2.06 Lines and Grades

Unless otherwise specified, all lines and grades shall be furnished by the Contractor at its own expense. Whenever necessary, construction work shall be suspended to permit performance of this work, but such suspension will be as brief as practicable and the Contractor shall be allowed no extra compensation therefore.

2.07 Contractor's Duty and Superintendence

The Contractor shall give adequate attention to the faithful prosecution and completion of the Work subject of the Contract Documents and shall keep on the Project site, at all times during its progress, a competent Superintendent and any necessary assistants to supervise and direct the Work. The Superintendent shall represent the Contractor in its absence and all directions given to the Superintendent shall be as binding as if given to the Contractor.

The Contractor is and at all times shall remain an independent contractor, solely responsible for the manner and method of completing its work under the Contract Documents, with full power and authority to select the means, method and manner of performing such work, so long as such methods do not adversely affect the completed improvements, the County and the Observer being interested only in the result obtained and conformity of such completed improvements with the Contract Documents.

Likewise, the Contractor shall be solely responsible for the safety of itself, its employees and other persons, as well as for the protection and safety of the improvements being erected and its property or any other person's property, as a result of its operations under the Contract Documents. Engineering construction drawings and specifications, as well as any additional information concerning the Work to be performed passing from or through the Observer, shall not be interpreted as requiring or allowing the Contractor to deviate from the Contract documents, the plans and specifications; the intent of such drawings, specifications and any other such information being to define with specificity the agreement of the parties as to the Work the Contractor is to perform.

Any review of work in process, or any visit or observation and inspection during construction, or any clarification of plans and specifications, by the Observer or the County, or any agent, employee, or representative of either of them, whether through personal observation or inspection on the Project site or by means of approval of shop drawings for temporary construction or construction processes, or by other means or methods, is agreed by the Contractor to be for the purpose of observing the extent and nature of work completed or being performed, as measured against the drawings and specifications constituting the Contract Documents, or for the purpose of enabling the Contractor to more fully understand the plans and specifications so that the completed construction work will conform thereto, and shall in no way relieve the Contractor from full and complete responsibility for the proper performance of its work on the Project, including but not limited to the propriety of means and methods of the Contractor in performing in accordance with the Contract Documents, and the adequacy of any designs, plans or other facilities for accomplishing such performance. Deviation by the Contractor from plans and specifications that may have been in evidence during any such visitation or observation by the Observer, the Engineer, or any of their representatives, whether called to the Contractor's attention or not, shall in no way relieve the Contractor from its responsibility to complete all work in accordance with the Contract Documents.

2.08 Contractor's Understanding

It is understood and agreed that the Contractor has, by careful examination, satisfied itself as to the nature and location of the Work, the conformation of the ground, the character, quality and quantity of the materials to be encountered, the character of equipment and facilities needed preliminary to and during the prosecution of the Work, the general and local conditions, and all other matters which can in any way affect the Work under the Contract Documents.

2.09 Character of Workers

The Contractor agrees to employ only orderly and competent workers, skillful in the performance of the type of work required under the Contract Documents, to do the Work; and agrees that whenever the Observer shall inform it in writing that any workers on the Work are, in its opinion, incompetent, unfaithful or disorderly, or refuse instructions from the Observer in the absence of the Superintendent, such worker shall be discharged from the Work and shall not again be employed on the Work without the Observer's written consent. No illegal alien may be employed by any Contractor for work on this Project, and a penalty

of $500.00 per day will be assessed for each day and for each illegal alien who works for the Contractor at this Project.

2.10 Shop Drawings

The Contractor shall submit to the Observer, with such promptness as to cause no delay in its own work or in that of any other contractor, a minimum of four (4) stamped/reviewed copies, unless otherwise specified, of all shop and/or setting drawings and schedules required for the work of the various trades, and the Engineer of Record shall pass upon them with reasonable promptness, making desired corrections. Note: A single copy of the reviewed drawings shall be retained by the reviewer, the County, and the County's Representative for their records. The Contractor may not submit more than four different shop drawing plans for review in any one week. The Engineer of Record shall return the shop drawings to the Contractor, via the GEC, within three (3) weeks of its having received them, with appropriate comments. The Contractor shall make any corrections required by the Engineer of Record, file with it two (2) corrected copies and furnish such other copies as may be needed. The Engineer of Record's approval of such drawings or schedules shall not relieve the Contractor from responsibility for deviations from drawings or specifications, unless the Contractor has in writing called the Engineer of Record's attention to such deviations at the time of submission, nor shall it relieve Contractor from responsibility for errors of any sort in shop drawings or schedules. It shall be the Contractor's responsibility to fully and completely review all shop drawings to ascertain their effect on its ability to perform the required work in accordance with the Contract Documents and within the time for completion thereof. Any shop drawings which are required for temporary supports must be signed and sealed by an Engineer registered in the State of Texas.

Such review by the Engineer of Record shall be for the sole purpose of determining the sufficiency of said shop drawings or schedules to result in finished improvements in conformity with the plans and specifications, and shall not relieve the Contractor of its duties and obligations, as an independent contractor, set forth in the Contract Documents. It is hereby expressly understood and agreed that the Engineer of Record does not assume any duty to pass upon the propriety or adequacy of such drawings or schedules, or any means or methods reflected thereby, in relation to the safety of either person or property during the Contractor's performance hereunder.

2.11 Preliminary Approval

The Observer shall not have the power to waive the obligations of the Contract Documents for the furnishing by the Contractor of good material, and of its performing good work as herein described, and in full accordance with the Contract Documents. No failure or omission of the Observer to discover, object to or condemn any defective work or material shall release the Contractor from the obligations to fully and properly perform in full accordance with the Contract Documents, including without limitation, the obligation to at once tear out, remove and properly replace any defective work or material at any time prior to final acceptance upon the discovery of said defective work or material; provided, however, that the Observer shall, upon request of the Contractor, inspect and accept or reject any material furnished, and in the event the material has been once accepted by the Observer,

such acceptance shall be binding on the County unless it can be clearly shown that such material furnished does not meet the specifications for this work.

Any questioned work may be ordered to be taken up or removed for re-examination by the Observer, prior to final acceptance, and if found not in accordance with the plans and/or specifications for said work, all expenses relating to the removing, re-examination and replacement shall be solely borne by the Contractor. Otherwise, if the questioned work is found to be in accordance with the plans and/or specifications for said work, the expense thus incurred shall be allowed as Extra Work and shall be paid for by the County; provided, however, where inspection or approval is specifically required by the specifications prior to performance of certain work, should the Contractor proceed with such work without requesting prior inspection or approval, the Contractor shall bear all expense of taking up, removing, and replacing this work if so directed by the Observer.

2.12 Defects and Their Remedies

It is further agreed that if the Work or any part thereof, or any material brought on the site of the Work for use in the Work or selected for the same, shall be deemed by the Observer as unsuitable or not in conformity with the Contract Documents, or the intent thereof, the Contractor shall, after receipt of notice thereof from the Observer, forthwith remove such material and rebuild or otherwise remedy such work so that it shall be in full accordance with the Contract Documents.

2.13 Changes and Alterations

The Contractor further agrees that the County may make such changes and alterations as the County may see fit in the line, grade, form, dimensions, plans or materials for the Work herein contemplated, or any part thereof, either before or after the beginning of the construction, without affecting the validity of the Contract Documents.

If such changes or alterations diminish the quantity of the Work to be done, they shall not constitute the basis for a claim for damages or anticipated profits on the Work that may be dispensed with, except as provided for unit price items under Section 5 “Measurement and Payment”. If the amount of work is increased, and the Work can fairly be classified under the specifications, such increase shall be paid for according to the quantity actually done and at the unit price, if any, established for such work under the Contract Documents, except as provided for unit price items under Section 5 “Measurement and Payment”. Otherwise, such additional work shall be paid for as provided under Extra Work. In the event the County makes such changes or alterations as shall make useless any work already done or material already furnished or used in said work, then the County shall compensate the Contractor for any material or labor so used, and for any actual loss occasioned by such change, due to actual expense incurred in preparation for the Work as originally planned.

3. General Obligations and Responsibilities

3.01 Keeping of Plans and Specifications Accessible and Keeping a Superintendent on the Project Site

The Contractor shall keep one (1) copy of the plans and specifications constantly accessible on the Work, with the latest revisions noted thereon. The Contractor shall give the Work its constant attention to facilitate the progress thereof and shall cooperate with the Construction Observer in every way possible. The Contractor shall designate, to the Construction Observer in writing, the name of a Superintendent, employed by the firm, regardless of how much of the Work may be sublet. The Superintendent will be available at all time. In the event a competent superintendent is not available, the Construction Observer may suspend work until one is available.

3.02 Ownership of Documents

All drawings, specifications and copies thereof furnished by the Engineer of Record shall not be reused on other work, and, with the exception of the signed contract sets, are to be returned to the Engineer of Record on request, at the completion of the work. All models, drawings, specifications and copies thereof are the property of the County.

3.03 Adequacy of Design

It is understood that the County believes it has employed competent engineers and designers. It is therefore agreed that the County and Engineer shall be responsible for the adequacy of the design, sufficiency of the Contract Documents, the safety of the structure and the practicability of the operations of the completed project provided that the Contractor has complied with the requirements of the said Contract Documents, all approved modifications thereof, and additions and alterations thereto approved in writing by the County. The burden of proof of such compliance shall be upon the Contractor to show that it has complied with the said requirements of the Contract Documents, approved modifications thereof, and all approved additions and alterations thereto.

The paper copies of the Contract Documents are considered to be the official contract documents. Any request by the Contractor and use thereof of electronic or digital information, including engineering design and survey files, shall be at the sole risk and legal responsibility of the Contractor. Neither the County nor the Engineer of Record makes any warranty or representation as to the compatibility of the files provided with other software programs, nor shall they be held responsible for subsequent uses of the data by the Contractor or anyone who may obtain the data from the Contractor. **THE CONTRACTOR SHALL, TO THE FULLEST EXTENT PERMITTED BY LAW, INDEMNIFY AND HOLD THE COUNTY ITS AGENTS, EMPLOYEES, OR REPRESENTATIVES AND THE ENGINEER OF RECORD HARMLESS FROM ANY AND ALL CLAIMS, SUITS, LIABILITY, DEMANDS OR COSTS ARISING OUT OF OR RESULTING FROM SUCH USE.** Because data stored on electronic media can deteriorate undetected or be modified undetected, neither the County nor the Engineer of Record can be held liable for the completeness or correctness of the electronic data once in possession of the Contractor.

3.04 Contractor's Responsibility for Work

Until the issuance of the Certificate of Completion for the Project, the Contractor shall have the charge and care thereof and shall take every precaution against injury or damage to any part thereof by the action of the elements or from any other cause, whether arising from the execution or from the non execution of the Work.

In case of suspension of work for any cause, the Contractor shall be responsible for the preservation of all materials. The Contractor shall provide suitable drainage of the roadway in good and passable condition until Final Completion, except as outlined below for opening the roadway to traffic.

Whenever, in the opinion of the Observer, any roadway or portion thereof is in suitable condition for travel, it shall be opened to traffic; provided, however, such opening shall not be held to be, in any way, the final acceptance of the roadway or any part thereof or be held as a waiver of any of the provisions of the Contract Documents. Where it is considered by the Observer to be in the public interest and so ordered in writing by the Observer, any Substantially Completed roadway or portion thereof may be opened to traffic as follows:

(1) When both required by plans, job sequence or the approved traffic control plan, and when the County accepts responsibility for maintaining such portion of the roadway opened to traffic.
(2) When work is suspended for a period of time at the convenience of the County, the County will assume the responsibility for maintaining the entire roadway during the period of suspension; or
(3) When the roadway or portion thereof is opened to traffic during construction operations at the convenience of the County, the County will assume responsibility for the maintenance of the traveled way and shoulders during the period in which it is opened to traffic.

The County, in assuming responsibility for maintenance under this provision, may require the Work to be done in accordance with Section 6, "Extra Work and Claims".

Except for damage by the Contractor or damage caused by the Contractor's operations, the Contractor will not be responsible for repair of damage to existing facilities or damage to completed and accepted work such as guard fence, bridge wings, railing, illumination assemblies, underpass structure, traffic barriers, delineator assemblies, signs, sign bridges, changeable message signs, vehicle impact attenuators (crash cushions and guardrail end treatments) and traffic signals, where such damage is caused by (a) motor-vehicle, seacraft or aircraft that are not being operated by Contractor; (b) railroad-train collision (c) vandalism: (d) Acts of God, such as earthquake, tidal wave, tornado, hurricane, or other cataclysmic phenomena of natures: or (e) Acts of Governmental Authorities.

Upon completion of all work provided for in the Contract Documents for any individual limits, control or project, the Observer may make an inspection, and if the Work is found to be satisfactory, the Contractor will be released from further maintenance on that portion of

the Work, except for damage caused by the Contractor or its operations. Such partial acceptance must be made in writing and shall in no way void or alter any terms of the Contract Documents. Other specific units of the Project will be accepted on an individual basis when shown on the plans or as approved, in writing, by the Observer.

3.05 Protection Against Accident to Employees and the Public

The Contractor shall at all times exercise reasonable precautions for the safety of employees and others on or near the Work and shall comply with all applicable provisions of federal, state, and municipal safety laws and building and construction codes. All machinery and equipment and other physical hazards shall, except where incompatible with federal, state, or municipal laws or regulations, be guarded in accordance with the "Manual of Accident Prevention in Construction" of the Associated General Contractors of America. The Contractor shall provide such machinery guards, safe walkways, ladders, bridges, gangplanks, and other safety devices. The safety precautions actually taken and their adequacy shall be the sole responsibility of the Contractor, acting at its discretion as an independent contractor.

Within 24 hours after Contractor becomes aware of the occurrence of any accident or other event which results in, or might result in, injury to the person or property of anyone, whether or not it results from or involves any action or failure to act by the Contractor or any employee or agent of the Contractor and which arises in any manner from the performance of the Work, the Contractor shall send a written report of such accident or other event to the County and the Observer, setting forth a full and concise statement of the facts pertaining thereto. Such statement shall include a written recordation of the location of the event and the circumstances surrounding the event through photographs, interviewing witnesses, obtaining of medical reports and other documentation that defines the event. The Contractor shall also provide to the County a copy of any and all accident reports received from safety officials or agencies. Copies of such documentation shall be provided to the County and the Observer for their records. The Contractor shall also immediately send the County and the Observer a copy of any summons, subpoena, notice, or other documents served upon the Contractor, its agents, employees, or representatives, or received by it or them, in connection with any matter before any court arising in any manner from the Contractor's performance of the Work.

3.06 Performance and Payment Bonds

Unless otherwise specified, it is further agreed by the parties to the Contract Documents that the Contractor will execute separate performance and payment bonds, each in the sum of one hundred (100%) percent of the total Contract Price, on forms acceptable to County, guaranteeing faithful performance of the Work and the fulfillment of any guarantee required, and further guaranteeing payment to all persons supplying labor and materials or furnishing Contractor with any equipment in the execution of the Work subject of the Contract Documents. It is agreed that the Contractor shall have no rights under the Contract Documents until such performance and payment bonds are furnished to and approved by the County.

Unless otherwise specified, the cost of the premium for the performance and payment bonds shall be included in the price bid by the Contractor for the Work subject of the Contract Documents, and no extra payment for such bonds will be made by the County.

Each bond shall be executed by a corporate surety or corporate sureties, with an A.M. Best rating of "B" or better, duly authorized to do business and to issue surety bonds in the State of Texas. If any surety upon any bond furnished in connection herewith becomes insolvent, or otherwise not authorized to do business in this state, the Contractor shall promptly furnish equivalent security to protect the interests of the County and of persons supplying labor, materials and equipment in the prosecution of the Work subject of the Contract Documents. Furthermore, the surety company underwriting the bonds must be acceptable to the County.

Each bond shall be accompanied by a valid Power of Attorney (issued by the surety company and attached, signed and sealed, with the corporate embossed seal, to the bond) authorizing the agent who signs the bond to commit the company to the terms of the bond, and stating on the face of the Power of Attorney the limit, if any, in the total amount for which such agent is empowered to issue a single bond.

3.07 Protection of Adjoining Property

The Contractor shall take proper means to protect the adjacent or adjoining property or properties, in any way encountered, which might be injured or seriously affected by any process of construction to be undertaken pursuant to the Contract Documents, from any damage or injury by reason of said process of construction; and the Contractor shall be liable for any and all claims for such damage on account of its failure to fully protect all adjoining property. **THE CONTRACTOR AGREES TO INDEMNIFY, SAVE AND HOLD HARMLESS THE COUNTY, THE OBSERVER THE GEC AND THE ENGINEER OF RECORD, AS WELL AS ANY OF THEIR AGENTS, REPRESENTATIVES, OFFICERS OR EMPLOYEES AGAINST ANY CLAIM OR CLAIMS FOR DAMAGES DUE TO ANY INJURY TO ANY ADJACENT OR ADJOINING PROPERTY, ARISING OR GROWING OUT OF THE PERFORMANCE OF THE WORK, BUT ANY SUCH INDEMNITY SHALL NOT APPLY TO ANY CLAIM OF ANY KIND ARISING SOLELY OUT OF THE EXISTENCE OR CHARACTER OF THE WORK.**

3.08 Protection Against Claims of Subcontractors, Laborers, Materialmen and Furnishers of Machinery, Equipment and Supplies

THE CONTRACTOR AGREES THAT IT WILL INDEMNIFY, DEFEND AND SAVE HARMLESS THE COUNTY, THE OBSERVER, THE GEC AND THE ENGINEER OF RECORD, AS WELL AS ANY OF THEIR AGENTS, REPRESENTATIVES, OFFICERS OR EMPLOYEES FROM ALL CLAIMS GROWING OUT THE LAWFUL DEMANDS OF SUBCONTRACTORS, LABORERS, WORKERS, MECHANICS, MATERIALMEN AND FURNISHERS OF MACHINERY, MACHINERY PARTS, EQUIPMENT, POWER TOOLS, AND ALL SUPPLIES, INCLUDING COMMISSARY, INCURRED IN THE FURTHERANCE OF THE PERFORMANCE OF THE WORK SUBJECT OF THE CONTRACT DOCUMENTS. When so desired by the County, the Contractor shall furnish satisfactory evidence that all obligations of the nature hereinabove designated have been paid, discharged or waived. If the Contractor fails to furnish such evidence to County's complete satisfaction, then the County may either pay directly any unpaid bills of which the County has written notice of, or may withhold from

the Contractor's unpaid compensation a sum of money deemed reasonably sufficient to liquidate any and all such lawful claims. When satisfactory evidence is furnished that all liabilities have been fully discharged, payments to the Contractor shall be resumed in full in accordance with the terms of the Contract Documents, but in no event shall the provisions of this sentence be construed to impose any obligation upon the County by either the Contractor or its surety.

3.09 Protection Against Royalties or Patented Invention

The Contractor shall pay all royalties and license fees, and shall provide for the use of any design, device, material or process covered by letter patent or copyright by suitable legal agreement with the patentee or owner. **THE CONTRACTOR SHALL DEFEND ALL SUITS OR CLAIMS FOR INFRINGEMENT OF ANY PATENT OR COPYRIGHT RIGHTS AND SHALL INDEMNIFY AND SAVE HARMLESS THE COUNTY, THE OBSERVER THE GEC AND THE ENGINEER OF RECORD, AS WELL AS ANY OF THEIR AGENTS, REPRESENTATIVES, OFFICERS OR EMPLOYEES FROM ANY LOSS ON ACCOUNT THEREOF, EXCEPT THAT THE COUNTY SHALL DEFEND ALL SUCH SUITS AND CLAIMS AND SHALL BE RESPONSIBLE FOR ALL SUCH LOSS WHEN A PARTICULAR DESIGN, DEVICE, MATERIAL OR PROCESS OR THE PRODUCT OF A PARTICULAR MANUFACTURER OR MANUFACTURERS IS SPECIFIED OR REQUIRED BY THE COUNTY; PROVIDED, HOWEVER, IF CHOICE OF ALTERNATE DESIGN, DEVICE, MATERIAL OR PROCESS IS ALLOWED TO THE CONTRACTOR, THEN THE CONTRACTOR SHALL INDEMNIFY AND SAVE THE COUNTY HARMLESS FORM ANY LOSS ON ACCOUNT THEREOF.** If the material or process specified or required by the County is known by the Contractor to be an infringement, the Contractor shall be responsible for such loss unless it promptly gives such information to the County.

3.10 Laws and Ordinances

The Contractor shall at all times observe and comply with all federal, state and local laws, ordinance and regulations, which in any manner affect the Contract Documents or the Work, and **SHALL INDEMNIFY AND SAVE HARMLESS THE COUNTY, THE OBSERVER THE GEC AND THE ENGINEER OF RECORD, AS WELL AS ANY OF THEIR AGENTS, REPRESENTATIVES, OFFICERS OR EMPLOYEES AGAINST ANY CLAIM ARISING FROM THE VIOLATION OF ANY SUCH LAWS, ORDINANCES, AND REGULATIONS WHETHER BY THE CONTRACTOR OR ITS EMPLOYEES, EXCEPT WHERE SUCH VIOLATIONS ARE CALLED FOR BY THE PROVISIONS OF THE CONTRACT DOCUMENTS.** If the Contractor observes that the plans and specifications are at variance therewith, it shall promptly notify the Observer, in writing, and any necessary changes shall be prepared as provided in the Contract Documents for changes in the Work. If the Contractor performs any work knowing it to be contrary to such laws, ordinances, rules and regulations, and without such notice to the Observer, the Contractor shall bear all costs arising therefrom.

In case the County is a body politic and corporate, the law from which it derives its powers, insofar as the same regulates the objects for which, or the manner in which, or the conditions under which the County may enter into contract, shall be controlling and shall be considered as part of the Contract Documents to the same effect as though embodied herein.

3.11 Assignment and Subletting

The Contractor further agrees that it will retain personal control and will give its personal attention to the fulfillment of the Work strictly in accordance with the Contract Documents and that Contractor will not assign, by Power of Attorney or otherwise, or sublet any right or interest it may have under the Contract Documents without the written consent of the Observer, and that no part or feature of the Work will be sublet to anyone objectionable to the Observer or the County. The Contractor further agrees that the subletting of any portion or feature of the Work, or materials required in the performance of the Work, shall not relieve the Contractor from its full obligations to the County as provided in the Contract Documents.

3.12 Indemnification

THE CONTRACTOR SHALL DEFEND, INDEMNIFY AND HOLD HARMLESS THE COUNTY, THE OBSERVER, THE GEC AND THE ENGINEER OF RECORD AND THEIR RESPECTIVE OFFICERS, AGENTS AND EMPLOYEES, FROM AND AGAINST ALL DAMAGES, CLAIMS, LOSSES, DEMANDS, SUITS, JUDGMENTS AND COSTS, INCLUDING REASONABLE ATTORNEYS' FEES AND EXPENSES, ARISING OUT OF OR RESULTING FROM THE PERFORMANCE OF THE WORK, PROVIDED THAT ANY SUCH DAMAGE, CLAIM, LOSS, DEMAND, SUIT, JUDGMENT, COST OR EXPENSE:

(1) IS ATTRIBUTABLE TO BODILY INJURY, SICKNESS, DISEASE OR DEATH OF ANY PERSON INCLUDING CONTRACTOR'S EMPLOYEES AND ANY SUBCONTRACTOR'S EMPLOYEES AND ANY SUB-SUBCONTRACTOR'S EMPLOYEES, OR TO INJURY TO OR DESTRUCTION OF TANGIBLE PROPERTY INCLUDING CONTRACTOR'S PROPERTY (OTHER THAN THE WORK ITSELF) AND THE PROPERTY OF ANY SUBCONTRACTOR OF SUB-SUBCONTRACTOR INCLUDING THE LOSS OF USE RESULTING THEREFROM; AND,

(2) IS CAUSED IN WHOLE OR IN PART BY ANY INTENTIONAL OR NEGLIGENT ACT OR OMISSION OF THE CONTRACTOR, ANY SUBCONTRACTOR, ANY SUB-SUBCONTRACTOR OR ANYONE DIRECTLY OR INDIRECTLY EMPLOYED BY ANY ONE OF THEM OR ANYONE FOR WHOSE ACTS ANY OF THEM MAY BE LIABLE.

THE OBLIGATION OF THE CONTRACTOR UNDER THIS PARAGRAPH SHALL NOT EXTEND TO THE LIABILITY OF THE OBSERVER, THE ENGINEER, THE GEC, THE ENGINEER OF RECORD THEIR AGENTS OR EMPLOYEES ARISING OUT OF THE PREPARATION OF MAPS, PLANS, REPORTS, SURVEYS, CHANGE ORDERS, DESIGNS OR SPECIFICATIONS, OR THE APPROVAL OF MAPS, PLANS, REPORTS, SURVEYS, CHANGE ORDERS, DESIGNS OR SPECIFICATIONS OR THE ISSUANCE OF OR THE FAILURE TO GIVE DIRECTIONS OR INSTRUCTIONS BY THE OBSERVER, ITS AGENTS OR EMPLOYEES, PROVIDED SUCH IS THE SOLE CAUSE OF THE INJURY OR DAMAGE.

IN ANY AND ALL CLAIMS AGAINST THE COUNTY, THE OBSERVER THE GEC OR THE ENGINEER OF RECORD OR ANY OF THEIR AGENTS OR EMPLOYEES BY ANY EMPLOYEE OF THE CONTRACTOR, ANY SUBCONTRACTOR, ANY SUB-SUBCONTRACTOR, ANYONE DIRECTLY OR INDIRECTLY EMPLOYED BY ANY OF THEM, OR ANYONE FOR WHOSE ACTS ANY OF THEM MAY BE LIABLE, THE INDEMNIFICATION OBLIGATION UNDER SECTION 3.12 SHALL NOT BE

LIMITED IN ANY WAY BY ANY LIMITATION ON THE AMOUNT OR TYPE OF DAMAGES, COMPENSATION OR BENEFITS PAYABLE BY OR FOR THE CONTRACTOR OR ANY SUBCONTRACTOR OR SUB-SUBCONTRACTOR UNDER WORKERS' COMPENSATION ACTS, DISABILITY BENEFIT ACTS OR OTHER EMPLOYEE BENEFIT ACTS.

3.13 Insurance

The Contractor at its own expense shall purchase, maintain and keep in force such insurance as will protect Contractor from claims set forth below which may arise out of or result from the Contractor's operations under the Contract Documents, whether such operations be by itself or by any Subcontractor or by anyone directly or indirectly employed by any of them, or by anyone for whose acts any of them may be liable.

(1) Workman's compensation claims, disability benefits and other similar employee benefit acts;

(2) Claims for damages because of body injury, occupational sickness or disease, or death of its employees, and claims insured by usual bodily injury liability coverages;

(3) Claims for damages because of bodily injury, sickness or disease, or death of any person other than its employees, and claims insured by usual bodily injury liability coverages; and

(4) Claims for damages because of injury to or destruction of tangible property, including loss of use resulting therefrom.

CERTIFICATE OF INSURANCE. Before commencing any of the Work, Contractor shall file with the County valid Certificates of Insurance acceptable to the County and the Observer. Such Certificates shall contain a provision that coverages afforded under the policies will not be canceled until at least thirty (30) days prior written notice has been given to the County.

The Contractor shall also file with the County valid Certificates of Insurance covering all Sub-contractors of the Contractor.

3.14 Final Clean-up

Upon the completion of the Work and before acceptance and Final Payment will be made, the Contractor shall clean and remove from the site of the Work all surplus and discarded materials, temporary structures and debris of every kind. The Contractor shall leave the site of the Work in a neat and orderly condition at least equal to that which originally existed. Surplus and waste materials removed from the site of the Work shall be disposed of at locations that are both satisfactory to the Observer and in accordance with the laws pertaining to the disposal of such surplus, debris and waste materials.

In the event the Contractor fails or refuses to clean and remove surplus materials and debris as provided above, the County or the Observer may do so, or cause same to be done, at the

Contractor's expense, and the reasonable cost thereof shall be deducted from any amounts that are owing to the Contractor.

4. Prosecution and Progress

4.01 Time and Order of Completion

It is the meaning and intent of the Contractor Documents, unless otherwise specifically provided, that the Contractor shall be allowed to prosecute its work at such times and seasons, in such order of precedence, and in such manner as shall be most conducive to the economy of construction; provided, however, that the order and the time of prosecution shall be such that the Work shall be substantially completed, as a whole and in part, in accordance with the Contract Documents and within the time of completion designated in the Contractor's bid or proposal; provided, however, when the County is having other work done on the same Project or an adjoining project, either by contract or by its own force, the Observer may direct the time and manner of constructing the Work done under the Contract Documents, so that conflict will be avoided and the construction of the various works and projects being performed for the County shall be harmonized.

Unless otherwise specified, the Contractor shall plan to begin work 10 calendar days from the authorization date to begin work as designated by the Notice to Proceed.

The Contractor shall submit, at such times as may reasonably be requested by the Observer, schedules which shall show the order in which the Contractor proposes to carry on the Work, the dates at which the Contractor will start the several parts of the Work, and estimated dates of completion of the several parts.

Nighttime work is allowed only when shown on the plans or directed or allowed by the Engineer. Nighttime work is defined as work performed from 30 min. after sunset to 30 min. before sunrise.

4.02 Extension of Time

Should the Contractor be delayed in the completion of the Work by any act or neglect of the County, the Observer or the Engineer of Record, or of any employee of either, or by other contractors employed by the County, or by changes ordered in the Work, or by strikes, lockouts, fires, and unusual delays by common carriers, or unavoidable cause or causes beyond the Contractor's control, or by any cause which the Observer shall decide justifies the delay, then an extension of time shall be allowed for completing the Work, sufficient to compensate for the delay, the amount of the extension to be determined by the Observer; provided, however, before the Observer may decide whether or not to allow such an extension of time, the Contractor must tender a prompt written request for an extension of time wherein the Contractor shall give the Observer a written description of the cause of such delay. Adverse weather conditions will not be justification for extension of time on "Calendar Days" contracts.

4.03 Hindrances and Delays

No claims shall be made by the Contractor for damages resulting from hindrances or delays from any cause (except where the Work is stopped by order of and for the convenience of the County) during the progress of any portion of the Work embraced in the Contract Documents. In case said work shall be stopped by the act of the County, then such expense, as in the sole judgment of the Observer is caused by such stoppage of said work, shall be paid by the County to the Contractor.

5. Measurement and Payment

5.01 Quantities and Measurements

No extra or customary measurements of any kind will be allowed. Rather the actual measured and/or computed length, area, solid contents, number and weight only shall be considered, unless otherwise specifically provided otherwise in the Contract Documents.

5.02 Estimated Quantities

The Contract Documents are intended to show clearly all work to be done and material to be furnished hereunder. Where the estimated quantities are shown for the various classes of work to be done and material to be furnished under the Contract Documents, they are approximate and are to be used only as a basis for estimating the probable cost of the Work and for comparing the proposals offered for the Work. It is understood and agreed that the actual amount of work to be done and material to be furnished under the Contract Documents may differ somewhat from these estimates.

Plans quantities may or may not represent the exact quantity of work performed or material moved, handled, or placed during the execution of the Work. For plans quantity measurement items, the estimated bid quantities are designated as final payment quantities, unless revised by the governing specifications. If the actual quantity measured as outlined under “Measurement” varies by more than 5% (or as stipulated under “Measurement” for specific Items) from the total estimated quantity for an individual Item originally shown in the Contract Documents, an adjustment may be made to the quantity of authorized work done for payment purposes. The party requesting the adjustment will provide field measurements and calculations showing the revised quantity. When approved, this revised quantity will constitute the final quantity for which payment will be made. Payment for revised quantity will be made at the unit price bid for that Item, except as provided for in the Contract Documents. When quantities are revised by a change in design approved by the County, by change order, or to correct an error on the plans, the plans quantity will be increased or decreased by the amount involved in the change, and the 5% variance will apply to the new plans quantity.

Where payment is based on the unit price method, the Contractor agrees that it will make no claim for damages, anticipated profits or otherwise on account of any differences which may be found between the quantities of work actually done, the material actually furnished under the Contract Documents and the estimated quantities contemplated and contained in the proposal; provided, however, that in case the actual quantity of any major item should

become as much as twenty-five percent (25%) more than or twenty-five percent (25%) less than the estimated or contemplated quantity for such items, then either party to the Agreement, upon demand, shall be entitled to revised consideration upon the portion of the Work above or below twenty-five percent (25%) of the estimated quantity.

A "Major Item" shall be construed to be any individual bid item incurred in the proposal that has a total cost equal to or greater that five percent (5%) of the total contract cost, computed on the basis of the proposal quantities and the contract unit prices.

Any revised consideration is to be determined by agreement between the parties, otherwise by the terms of the Contract Documents, as provided under Section 6.03 "Extra Work".

5.03 Price of Work

In consideration of the furnishing of all the necessary labor, equipment and material, and the completion of all of the Work by the Contractor, and on the completion of all of the Work and on the delivery of all material in full conformity with the specifications and stipulations contained in the Contract Documents, the County agrees to pay the Contractor the Contract Price that is set forth in the Agreement. The Contractor hereby agrees to receive such Contract Price in full for furnishing all material and all labor required for the Work, also for all expense incurred by Contractor, and for well and truly performing the same and the whole thereof in the manner with and in accordance to the Contract Documents.

5.04 Partial Payments

On or before the first Wednesday of each month, the Contractor shall submit to the Observer a statement showing the total value of the Work performed up to and including the last day of the preceding month. The statement shall also include the value of all sound materials delivered on the job site and to be included in the Work and all partially completed work whether bid as a lump sum or a unit item which, in the opinion of the Observer, is acceptable. The Observer shall either examine and approve by signature or modify and approve such modified statement.

The County shall then pay the Contractor, within 30 days of the statement submittal, the total amount of the approved statement, less ten percent (10%) of the amount thereof, which ten percent (10%) shall be retained until Final Payment, and further less all previous payments and all further sums that may by retained by the County under the terms of the Contract Documents and/or under state or federal law. It is understood, however, that in case the whole work be near to completion and some unexpected and unusual delay occurs due to no fault or neglect on the part of the Contractor, then the County may, upon written recommendation of the Observer, pay a reasonable and equitable portion of the retained percentage to the Contractor; or the Contractor, at the County's option, may be relieved of the obligation to fully complete the Work and, thereupon, the Contractor shall receive payment of the balance due Contractor under the contract subject to the terms and conditions stated in the Contract Documents.

(1) When work progress is fifty percent (50%) complete, as determined by the value of the work completed to date against the original or revised contract amount, whichever is greater, the County may reduce the amount retained to five percent (5%) of the value of all work satisfactorily complete to date, including the value paid for materials on hand, provided, in the sole opinion of the Observer, the Contractor is making satisfactory progress toward completion of the project in a timely manner and there is no other cause to retain a greater percentage.
(2) Upon issuance of the NOTICE OF SUBSTANTIAL COMPLETION and agreement to final project quantities, the percent retained may be further reduced, at the discretion of the Engineer and the Observer, to two percent (2%) of the total value of all work completed to date. This amount shall be retained until Final Payment and close out of the project.

5.05 Punch List

The Contractor shall notify the Observer in writing when, in the Contractor's opinion, the Work has been "Substantially Completed" and when so notifying the Observer, the Contractor shall furnish to the Observer, in writing, a detailed list of unfinished work, also known as the Punch List. The Observer will review the Punch List and will add any items that the Contractor failed to include on said list. The fact that a structure or facility has been "Substantially Completed" shall not excuse the Contractor from performing all of the Work undertaken, whether such work is of a minor or major nature. Furthermore, the Contractor shall remain obligated to fully complete the Work and perform its obligations under the Contract Documents after the Work has been Substantially Completed.

5.06 Final Completion and Acceptance

The Contractor shall have a specified time period for completion of the Punch List items, as set forth in Section XI of the Special Conditions, "Completion of Work on Time." Within ten (10) days after the Contractor has given the Observer written notice that the Punch List has been completed, the Observer shall inspect the Work and within said time, if the Work is found to be completed in accordance with the Contact Documents, the Observer shall issue to the Contractor its Certificate of Completion. In the event the Punch List has not been completed, the Observer shall advise the Contractor, in writing, of the Observer's basis for deeming the Punch List incomplete. Following the Contractor's receipt of the Observer's notice that the Punch List is incomplete, the Contractor shall complete the remaining items prior to the expiration of the above referenced specified time period for completion of the Punch List items. Upon satisfactory completion of the Punch List and the issuance of the Certificate of Completion, it shall be the Contractor's responsibility to submit the contract close-out documents, which shall include the record drawings, maintenance bond and Affidavit of All Bills Paid, and thereupon it shall be the duty of the County to issue a Certificate of Acceptance (Final Acceptance) to the Contractor.

5.07 Final Payment

Upon the issuance of the Notice of Substantial Completion, the Observer shall proceed to make final measurements and prepare final statement for the value of all work performed and materials furnished under the terms of the Contract Documents and shall certify same to the

County, and, then, Final Payment shall be made to the Contractor. At the County's sole discretion, this payment may include payment for work remaining to be performed in association with the removal of temporary erosion controls or the establishment of permanent stabilization measures. On or after the 30th day, and before the 35th day after the date of the Certificate of Acceptance, the balance due the Contractor under the terms of the Contract Documents shall be paid. Neither the Certificate of Acceptance nor the Final Payment, nor any provision in the Contract Documents, shall relieve the Contractor of the obligation for fulfillment of any warranty which may be required.

5.08 Payments Withheld

The County may, on account of subsequently discovered evidence, withhold or nullify the whole or part of any certificate to such extent as may be necessary to protect itself from loss on account of:

(a) Defective work not remedied or other obligations hereunder not completed.
(b) Claims filed or reasonable evidence indicating the probable or potential filing of claims.
(c) Failure of the Contractor to make payments properly to Subcontractors or for material or labor.
(d) Damage to the County or another contractor's work, material or equipment.
(e) Reasonable doubt that the Work can be completed for the unpaid balance of the contract amount or Contract Price.
(f) Reasonable indication that the Work will not be completed within the contract time.
(g) Other causes affecting the performance of the Work subject of the Contract Documents.

When the above grounds are removed or the Contractor provides a surety bond satisfactory to the County, which will protect the County in the amount withheld, payment shall be made for amounts withheld because of them.

5.09 Delayed Payments

Should the County fail to make payment to the Contractor of the sum named in any partial or final statement, when such payment is due, then the County shall pay to the Contractor, in addition to the sum shown as due by such statement, interest thereon in accordance with Texas Government Code Section 2251.025. More specifically, the rate of interest that shall accrue on a late payment is the rate in effect on September 1 of County's fiscal year in which the payment becomes due. The said rate in effect on September 1 shall be equal to the sum of one percent (1%); and (2) the prime rate published in the Wall Street Journal on the first day of July of the preceding fiscal year that does not fall on a Saturday or Sunday. County's payment of the amount due plus said interest shall fully liquidate any injury to the Contractor growing out of such delay in payment. It is expressly agreed that delay by the County in making payment to the Contractor of the sum named in any partial or final statement shall not constitute, on the part of the County, a breach under the Contract Documents, nor shall it serve as an abandonment by the County. Furthermore, any delay by the County in making payment to the Contractor of the sum named in any partial or final statement shall not, to any

extent or for any time, relieve the Contractor of its obligations to fully and completely perform pursuant to the terms of the Contract Documents.

6. Extra Work and Claims

6.01 Change Orders

Without invalidating the Agreement or any terms of the Contract Documents, the County may, at any time or from time to time, order additions, deletions or revisions to the Work. Any such additions, deletions or revisions to the Work may only be effectuated and authorized by written Change Order. The said written Change Order shall be prepared by the GEC for execution by the County and the Contractor. The Change Order shall set forth the basis for any change in Contract Price, as hereinafter set forth in Section 6.03, Extra Work, and for any change in contract time which may result from the change.

In the event the Contractor shall refuse to execute a Change Order which has been prepared by the GEC and executed by the County, the GEC may, in writing, instruct the Contractor to proceed with the Work as set forth in the Change Order and the Contractor shall thereafter proceed with such work. The Contractor may make claim against the County for Extra Work involved under the Change Order, as hereinafter provided.

6.02 Minor Changes

The Observer may authorize minor changes in the Work which are not inconsistent with the overall intent of the Contract Documents and which do not involve an increase in Contract Price. If the Contractor believes that any minor change or alteration authorized by the Observer involves Extra Work which entitles it to an increase in the Contract Price, the Contractor shall make written request to the Observer for a written Field Order. For purposes of this section, a "Field Order" shall mean the Contractor's cost proposal for the Extra Work that the Contractor believes would increase the Contract Price.

In such case, the Contractor, by copy of its communication to the Observer or by separate writing, shall advise the County of its request to the Observer for a written Field Order. The Contractor's notice to the County shall inform the County that the work subject of the written Field Order may result in an increase in the Contract Price.

Any request by the Contractor for a change in Contract Price shall be made prior to commencing the work covered by the proposed change.

6.03 Extra Work

It is agreed that the basis of compensation to the Contractor for work either added or deleted by a change order or for which a claim for Extra Work is made shall be determined by the unit prices upon which the Work and Project was bid to the extent such work can be fairly classified within the various work item descriptions. For work that cannot be fairly classified within the said various work item descriptions, the basis of compensation to the Contractor

for work either added or deleted by a change order or for which a claim for Extra Work is made shall be determined by one or more of the following methods:

Method (A)
By agreed unit prices; or

Method (B)
By agreed lump sum; or

Method (C)
If neither Method (A) nor Method (B) is agreed upon before the Extra Work is commenced, then the Contractor shall be paid the "actual field cost" of the Work, plus fifteen percent (15%).

In the event said Extra Work is performed and paid for under Method (C), then the provisions of this paragraph shall apply and the "actual field cost" is hereby defined to include the cost to the Contractor of all workmen, such as foremen, timekeepers, mechanics and laborers, and materials, supplies, trucks, rentals on machinery and equipment, for the time actually employed or used on such Extra Work, plus actual equipment, for the time actually employed or used on such Extra Work, plus actual transportation charges necessarily incurred, together with all power, fuel, lubricants, water and similar operating expenses, also all necessary incidental expenses incurred directly on account of such Extra Work, including Social Security, Old Age Benefits and other payroll taxes, and a rateable proportion of premiums on performance and payment bonds and maintenance bonds, public liability and property damage and workers' compensation, and all other insurance as may be required by any law or ordinance, or directed or agreed to by the County. The Observer may direct the form in which accounts of the "actual field cost" shall be kept and the records of these accounts shall be made available to the Observer. The Observer or the County may also specify, in writing before the Extra Work commences, the method of doing the Extra Work and the type and kind of machinery and equipment to be used; otherwise these matters shall be determined by the Contractor. Unless otherwise agreed upon, the prices for the use of machinery and equipment shall be determined by using one hundred percent (100%), unless otherwise specified, of the latest schedule of Equipment ownership Expense adopted by the Associated General Contractors of America. Where practicable the terms and prices for the use of machinery and equipment shall be incorporated in the written Extra Work order. The fifteen percent (15%) of the "actual field cost" to be paid the Contractor shall cover and compensate Contractor for its profit, overhead, general superintendence and field office expense, and all other elements of cost and expense not embraced within the "actual field cost" as herein defined, save that where the Contractor's camp or field office must be maintained primarily on account of such Extra Work; then the cost to maintain and operate the same shall be included in the "actual field cost."

No claim for Extra Work of any kind will be allowed unless ordered, in writing, by the Observer. In case any orders or instructions, either oral or written, appear to the Contractor to involve Extra Work for which Contractor should receive compensation or an adjustment in

the construction time, Contractor shall make written request to the Observer for written order authorizing such Extra Work. Should a difference of opinion arise as to what does or does not constitute Extra Work, or as to the payment therefor, and the Observer insists upon its performance, the Contractor shall proceed with the Work after making written request for written order and shall keep an accurate account of the "actual field cost" thereof, as provided under Method (C).

6.04 Time of Filing Claims

The County and Contractor hereby agree and acknowledge that all questions of dispute or adjustment presented by the Contractor shall be in writing and filed with the Observer within thirty (30) days after the Observer has given any directions, order or instruction to which the Contractor desires to take exception. The Observer shall reply within thirty (30) days to such written exceptions by the Contractor and render the Observer's final decision in writing. In case the Contractor should appeal from the Observer's decision, the Contractor may file with the County its objection. It is further agreed that the acceptance by the Contractor of the Final Payment shall serve as a bar to any claims that the Contractor may have for matters arising prior to or after the Contractor's acceptance of the Final Payment.

6.05 Continuing Performance

The Contractor shall continue performance of the Work during all disputes or disagreements with the County. The production or delivery of goods, the furnishing of services and the construction of projects or facilities shall not be delayed, prejudiced or postponed pending resolution of any disputes or disagreements, except as the County may otherwise agree in writing.

7. Abandonment of Contract

7.01 Abandonment by Contractor

In case the Contractor should abandon and fail or refuse to resume work within ten (10) days after written notification from either the County or the Observer, or if the Contractor fails to comply with the orders of the Observer when such orders are consistent with the Contract Documents, then and in such case where performance bonds exist, the appropriate sureties on these bonds shall be provided with a notice of abandonment and notice for completion whereby (i) the sureties are notified of the Contractor's abandonment or Contractor's failure or refusal to resume work; and (ii) the sureties are directed to complete the Work. A copy of the notice of abandonment and notice for completion shall be delivered to the Contractor.

After receiving a copy of the above described notice of abandonment and notice for completion, the Contractor shall not remove from the Project any machinery, equipment, tools, materials or supplies that then currently exist on the Project site, but the same, together with any materials and equipment under contract for the Work, may be held for use on the Project by the County or the surety on the performance bond, or another contractor in completion of the Work; and the Contractor shall not receive any rental or credit therefor (except when used in connection with Extra Work, where credit shall be allowed as provided for under Section 6, Extra Work and Claims, herein), it being understood that the use of such

equipment and materials will ultimately reduce the cost to complete the Work and be reflected in the final settlement.

Where there is no performance bond provided or in case the surety should fail to commence compliance within ten (10) days after service of the herein above provided notice of abandonment and notice for completion, then the County may provide for completion of the Work in either of the following elective manners:

(1) The County may thereupon employ such force of men and use such machinery, equipment, tools, materials and supplies as the County may deem necessary to complete the Work and charge the expense of such labor, machinery, equipment, tools, materials and supplies to the Contractor, and expense so charged shall be deducted and paid by the County out of such monies as may be due, or that may thereafter at any time become due to the Contractor under and by virtue of the Contract Documents. In case such expense is less than the sum which would have been payable under the Contract Documents if the same had been completed by the Contractor, then the Contractor shall receive the difference. In case such expense is greater than the sum which would have been payable under the Contract Documents if the same had been completed by the Contractor, then the Contractor and/or its surety shall pay the amount of such excess to the County, or

(2) The County, under sealed bids, after five (5) days notice published one or more times in a newspaper having general circulation in the area of the location of the Project, may let a contract for the completion of the Work under substantially the same terms and conditions which are provided in the Contract Documents. In case there is any increase in cost to the County under the new contract as compared to what would have been the cost under the Contract Documents, such increase shall be charged to the Contractor and the surety shall be and remain bound therefor. However, should the cost to complete any such contract prove to be less than what would have been the cost to complete under the Contract Documents, the Contractor and/or its surety shall be credited therewith.

When the Work shall have reached Final Completion, the Contractor and its surety shall be so notified and Certificates of Completion and Acceptance, as provided in Section 5.06 herein above, shall be issued. A complete itemized statement of the contract accounts, certified by the Observer as being correct, shall then be prepared and delivered to the Contractor and its surety, whereupon the Contractor and/or its surety, or the County as the case may be, shall pay the balance due as reflected by said statement within fifteen (15) days after the date of such Certificate of Completion.

In the event the statement of accounts shows that the cost to complete the Work is less than that which would have been the cost to the County had the Work been completed by the Contractor under the terms of the Contract Documents, or when the Contractor and/or its surety shall pay the balance shown to be due by them to the County, then all machinery, equipment, tools, materials or supplies left on the site of the Project shall be turned over to the Contractor and/or its surety.

Should the cost to complete the Work exceed the exceed the amount the County would have been obligated to pay the Contractor had the Work been completed by the Contractor under the terms of the Contract Documents, and should the Contractor and/or its surety fail to pay the amount due the County within the time designated hereinabove, and should there remain any machinery, equipment, tools, materials or supplies on the site of the Project, notice thereof, together with an itemized list of such equipment and materials, shall be mailed to the Contractor and its surety at the respective addresses designated in the Contract Documents. After properly tendering such notice, such property shall be held at the risk of the Contractor and its surety subject only to the duty of the County to exercise ordinary care to protect such property. After fifteen (15) days from the date of said notice, the County may sell such machinery, equipment, tools, materials or supplies and apply the net sum derived from such sale to the credit of the Contractor and its surety. Such sale may be made at either public or private sale, with or without notice, as the County may elect. The County shall release, to their proper owners, any machinery, equipment, tools, materials, or supplies, which remain on the Project and which belong to persons other than the Contractor or its surety. The books on all operations provided herein shall be opened to the Contractor and its surety.

7.02 Abandonment by the County

In the event that the County should fail, within ten (10) days after receiving written notification from the Contractor, to comply with the terms of the Contract Documents, then the Contractor may suspend or wholly abandon the Work, and may remove therefrom all machinery, tools and equipment, and all materials on the Project site that have not been included in payments to the Contractor and have not been wrought into the Work. Thereupon, the Observer shall make an estimate of the total amount earned by the Contractor, which estimate shall include the value of all work actually completed by said Contractor (at the prices stated in the Contract Documents), the value of all partially completed work at a fair and equitable price, and the amount of all Extra Work performed at the prices agreed upon, or provided for by the terms of the Contract Documents. The Observer shall then make a final statement of the balance due the Contractor by deducting from the above estimate all previous payments by the County and all other sums that may be retained by the County under the terms of the Agreement and the Contract Documents and the Observer shall certify same to the County who shall pay to the Contractor on or before thirty (30) days after the date of the Observer's certification.

8. Subcontractors

8.01 Award of Subcontracts for Portions of the Work

Unless otherwise specified in the Contract Documents or in the Instructions to Bidders, the Contractor, as soon as practicable after the award of the contract, shall furnish to the Observer, in writing for acceptance by the County, a list of the names of the Subcontractors proposed for the principal portions of the Work. The Observer shall promptly notify the Contractor, in writing, if the County, after due investigation, has objection to any Subcontractor on such list and does not accept such Subcontractor.

The Contractor shall not contract with any Subcontractor or any person or organization (including those who are to furnish materials or equipment fabricated to a special design) proposed for portions of the Work designated in the Contract Documents or in the Instructions to Bidders or, if none is so designated, with any Subcontractor proposed for the principal portions of the Work who has been rejected by the County. The Contractor will not be required to contract with any Subcontractor or person or organization against whom the Contractor has a reasonable objection.

If the County refuses to accept any Subcontractor or person or organization on a list submitted by the Contractor in response to the requirements of the Contract Documents or the Instructions to Bidders, the Contractor shall submit an acceptable substitute and the Contract Price shall be increased or decreased by the difference in cost occasioned by such substitution and an appropriate change order shall be issued; however, no increase in the Contract Price shall be allowed for any such substitution unless the Contractor has acted promptly and responsively in submitting for acceptance any list or lists of names as required by the Contract Documents or the Instructions to Bidders.

If the County requires a change of any proposed Subcontractor or person or organization previously accepted by them, the Contract Price shall be increased or decreased by the difference in cost occasioned by such change and an appropriate change order shall be issued.

The Contractor shall not make any substitution for any Subcontractor or person or organization that has been accepted by the County, unless the substitution is acceptable to the County.

8.02 Subcontractual Relations

All work performed for the Contractor by a Subcontractor shall be pursuant to an appropriate written agreement between the Contractor and the Subcontractor (and where appropriate between Subcontractors and Sub-subcontractors) which shall contain provisions that:

(1) preserve and protect the rights of the County, the Observer, the GEC and the Engineer of Record under the contract with respect to the Work to be performed under the subcontract so that the subcontracting thereof will not prejudice such rights;
(2) require that such work be performed in accordance with the requirements of the Contract Documents;
(3) require submission to the Contractor of the applications for payment under each subcontract to which the Contractor is a party, in reasonable time to enable the Contractor to apply for payment in accordance with the Contract Documents;
(4) require that all claims for additional costs, extensions of time, damages for delays or otherwise with respect to subcontracted portions of the Work shall be submitted to the Contractor (via any Subcontractor or Sub-subcontractor where appropriate) in sufficient time so that the Contractor may comply in the manner provided in the Contract Documents for like claims by the Contractor upon the County;
(5) obligate each subcontractor specifically to consent to the provisions of this section.

A copy of all such signed subcontract agreements shall be filed by the Contractor with the Observer before the Subcontractor shall be allowed to commence work.

8.03 Payments to Subcontractors

The Contractor shall pay each Subcontractor, upon receipt of payment from the County, an amount directly based upon the value of the Work performed and allowed to the Contractor on account of such Subcontractor's work, less the percentage retained from payments to the Contractor. The Contractor shall also require each Subcontractor to make similar payments to its subcontractors.

If the Observer fails to approve a payment for any cause which is the fault of the Contractor and not the fault of a particular Subcontractor, the Contractor shall pay the Subcontractor, on demand made at any time after the Certificate for Payment should otherwise have been issued, for its work to the extent completed, less the retained percentage, if any.

The Observer may, on request and at its discretion, furnish to any Subcontractor, if practicable, information regarding percentages of completion certified to the Contractor on account of work done by such Subcontractors.

Neither the County, the Observer nor the Engineer shall have any obligation to pay or to see to the payment of any monies to such Subcontractor except as may otherwise be required.

9. Protection of Persons and Property

9.01 Safety Precautions and Programs

The Contractor shall be responsible for initiating, maintaining and supervising all safety precautions and programs in connection with the Work.

9.02 Safety of Persons and Property

The Contractor shall take all reasonable precautions for the safety of, and shall provide all reasonable protection to prevent damage, injury, or loss to:

(1) all employees on the Work and all other persons who may be affected thereby:
(2) all the Work and all materials and equipment to be incorporated therein, whether in storage or off the site, under the care, custody or control of the Contractor or any of its Subcontractors or Sub-subcontractors; and
(3) other property at the site or adjacent thereto, including trees, shrubs, lawns, walks, pavements, fences, roadways, structures and utilities not designated for removal, relocation or replacement in the course of construction.

The Contractor shall comply with all applicable laws, ordinances, rules, regulations and lawful orders of any public authority having jurisdiction for the safety of persons or property or to protect them from damage, injury or loss. Contractor shall erect and maintain, as required by existing conditions and progress of the Work, all reasonable safeguards for safety

and protection, including posting danger signs and other warnings against hazards, promulgating safety regulations and notifying owners and users of adjacent utilities.

When the use or storage of explosives or other hazardous materials or equipment is necessary for the execution of the Work, the Contractor shall exercise the utmost care and shall carry on such activities under the supervision of properly qualified personnel.

All blasting, including methods of storing and handling explosives and highly inflammable materials, shall conform to federal, state, local laws and ordinances.

The following is a list of requirements in addition to federal, state, and local laws and ordinances:

(1) The Contractor shall furnish the County with a Certificate of Blasting Insurance in the amount of $300,000.00 for each contract, at least twenty-four (24) hours prior to using explosives. A blasting permit must be obtained from the appropriate jurisdictions at least five (5) days prior to use of explosives. If blasting is covered under the Contractor's General Insurance Certificate for each contract, a separate blasting certificate will not be required.
(2) The following public utility companies and departments will be notified by the Contractor, on every occasion, at least twenty-four (24) hours prior to the use of explosives: Water and Wastewater, Electric, Gas, Telephone and the County Engineering Department.
(3) Explosive materials to be used shall be limited to blasting agents and dynamite, unless prior approval of other materials is obtained in writing from the Engineering Department.
(4) During blasting, all reasonable precautions shall be taken to protect pedestrians, passing vehicles, and public or private property. Blasting mats or protective cover shall be used when required by the Observer, the permit, or by safe blasting practices.
(5) All explosives shall be stored in accordance with all applicable laws and codes.
(6) The Engineer or its representative shall have the right to limit the use of explosives and/or blasting methods which in its opinion are dangerous to the public or nearby property of any kind.
(7) The Contractor, at its expense, shall promptly repair or replace all items known to be damaged as a result of blasting. All claims of damage shall be investigated by the County or by consulting firms approved by the County.
(8) The Contractor shall maintain accurate records throughout the blasting operations showing the type explosive used, number of holes, pounds per hole, depth of hole, total pounds per shot, delays used, date and time of blast and initials of the Observer. The Contractor is fully responsible for all claims resulting from its blasting operation.

All damage or loss to any property referred to in this article caused, in whole or in part, by the Contractor, any Subcontractor, any Sub-subcontractor, or anyone directly or indirectly employed by any of them, or by anyone for whose acts any of them may be liable, shall be

remedied by the Contractor, except damage or loss attributable solely to faulty drawings or specifications or solely to the acts or omissions of the County its agents, employees, or representatives or anyone employed by either of them, and not attributable in any degree to the fault or negligence of the Contractor.

The Contractor shall designate a responsible member of its organization at the site whose duty shall be the prevention of accidents. This person shall be the Contractor's superintendent unless otherwise designated in writing by the Contractor to the County.

9.03 Location and Protection of Utilities

Notwithstanding any other provision of the Contract Documents, the Contractor shall be solely responsible for the location and protection of any and all public utility lines and utility customer service lines in the Project area. The Contractor shall exercise due care to locate and to mark, uncover or otherwise protect all such lines in the construction zone and any of the Contractor's work or storage areas. Upon request, the County shall provide such information as it has about the location and grade of water, sewer, gas, and telephone and electric lines and other utilities in the Work area but such information shall not relieve or be deemed to be in satisfaction of the Contractor's obligation hereunder, which shall be primary and nondelegable. Any such lines damaged by the Contractor's operations shall be immediately repaired by the Contractor or it shall cause such damage to be repaired at its expense.

10. Termination

10.01 Termination by the County for Cause

Conditions for termination are as follows:

(A) Without prejudice to any other legal or equitable right or remedy which it would otherwise possess hereunder or as a matter of law, the County shall be entitled, by giving Contractor five (5) days prior written notice, to terminate the Agreement in its entirety at any time:

(1) If the Contractor becomes insolvent, voluntarily files for bankruptcy, is the subject of an involuntary petition for bankruptcy commenced by its creditors, makes a general assignment for the benefit of creditors or becomes the subject of any other proceeding commenced under any statute or law for the relief of debtors; or

(2) If a receiver trustee or liquidator of any of the property or income of Contractor shall be appointed; or

(3) If Contractor:

(a) Shall fail to prosecute the Work or any part thereof with diligence necessary to insure its progress and completion as prescribed by the time schedules; and shall fail to take such steps to remedy such default within ten (10) days after written notice thereof from the County; or

(4) If Contractor:

(a) Shall commit a default under any of the terms, provisions, conditions, or covenants contained in the Contract Documents; and

(b) Shall fail to take such steps to remedy such default within ten (10) days after written notice thereof from the County.

(B) In the event of County's termination for cause, Contractor shall only be paid its reimbursable costs incurred prior to the effective date of the termination notice and shall not be entitled to receive any further fixed fee payments hereunder and shall be further subject to any claim the County may have against Contractor under other provisions of the Contract Documents or as a matter of law, including the refund of any overpayment of reimbursable costs and/or fixed fee.

(C) If the Agreement is terminated for cause, the County shall have the right, but shall not be obligated, to complete the Work itself or by others; and to this end, the County shall be entitled to take possession of and use such equipment and materials as may be on the Project site, and to exercise all rights, options, and privileges of Contractor under its subcontracts, purchase orders, or otherwise; and Contractor shall promptly assign such rights, options and privileges to the County. If the County elects to complete the Work itself or by others, pursuant to the foregoing, the Contractor will reimburse the County for all costs incurred by the County (including, without limitation, applicable, general, and administrative expenses, and field overhead, and the cost of necessary equipment, materials, and field labor) in correcting work by Contractor which fails to meet contract requirements.

Nothing contained in the preceding sections shall require the County to pay for any of the Work which is unsatisfactory, as determined by the Observer or which is not submitted in compliance with the terms of the Contract Documents. The County shall not be required to make any payments to Contractor when Contractor is in default under the Contract Documents.

This Article shall not constitute a waiver of any right, at law or at equity, which the County may have if Contractor is in default, including the right to bring legal action for damages or to force specific performance of the terms and conditions of the Contract Documents.

10.02 Termination for Convenience

In connection with the Work outlined in the Contract Documents, it is agreed and fully understood by Contractor, that the County may cancel or indefinitely suspend further work hereunder or terminate the Agreement for the convenience of the County, upon fifteen (15) days written notice to Contractor. In the event the County terminates the Agreement for convenience, it is hereby understood and acknowledged by the Contractor that immediately upon receipt of the County's notice of termination, all work and labor being performed under the Contract Documents shall cease. Contractor shall invoice the County for all work satisfactorily completed and shall be compensated in accordance with the terms of the Contractor Documents for work accomplished prior to the receipt of said notice. No amount shall be due for lost or anticipated profits. However, no cost incurred after the effective date of the notice of termination shall be treated as reimbursable costs unless it relates to carrying out the un-terminated portion or taking closeout measures.

10.03 Obligations of Contractor Following Termination

After receipt of a notice of termination, whether such termination be for cause or convenience, Contractor shall, in good faith and to the best of its ability, do all things necessary to assure the efficient proper closeout of the terminated work (including the protection of County property). Among other things, the Contractor shall, except as otherwise directed or approved by the County:

(1) Stop the Work on the date and to the extent specified in the notice of termination.
(2) Place no further orders for subcontracts for services, equipment or materials, except as may be necessary for completion of such portion of the Work as is not terminated.
(3) Terminate all orders and subcontracts to the extent that they relate to the performance of the Work terminated by the notice of termination.
(4) Assign to the County, in the manner and to the extent directed by it, all right title, and interest of Contractor under the orders or subcontracts so terminated; in which case, the County shall have the right to settle or pay any or all claims arising out of such termination of such orders and/or subcontracts.
(5) With the approval of the County, settle all outstanding liabilities and all claims arising out of such termination or orders and subcontracts.
(6) Deliver to the County, all documents, property, plans, field surveys, maps, cross sections and other data, designs and work related to the Project, which shall become the property of the County upon termination. The delivery of such items shall be made in a reasonably organized form, without restriction on future use. Should the County subsequently contract with a new contractor for continuation of services on the Project subject of the Contract Documents, Contractor shall cooperate in providing information to the County and the new contractor.

11. Inspection and Audit

Contractor's records shall be subject to audit and such records shall include, but not be limited to accounting records, written policies and procedures; subcontract files (including proposals of successful and unsuccessful bidders, bid recaps, etc.); original estimates; estimating work sheets; correspondence; change order files (including documentation covering negotiated settlements); back charge logs and supporting documentation; general ledger entries detailing cash and trade discounts earned, insurance rebates and dividends; and any other Contractor records which may have a bearing on matters of interest to the County in connection with the contractor's work for the County. All of the foregoing, hereinafter referred to as "records," shall be open to inspection and subject to audit and/or reproduction by County or its authorized representative to the extent necessary to adequately permit evaluation and verification of:

(a) Contractor compliance with the Contract Documents,
(b) compliance with County's business ethics policies,
(c) compliance by other contractors or subcontractors with contracts with County or Contractor, and
(d) compliance with provisions for pricing change orders, invoices or claims submitted by the Contractor or any of its payees.

Other specific records subject to audit include all information, materials and data of every kind and character such as documents, subscriptions, recordings, computerized information, agreements, purchase orders, leases, contracts, commitments, arrangements, notes, daily diaries, superintendent reports, drawings, receipts, vouchers and memoranda, and any and all other agreements, sources of information that may, in County's judgment, have any bearing on or pertain to any matters, rights, duties or obligations under or covered by the Contract Documents. Such records subject to audit shall also include those records necessary to evaluate and verify direct and indirect costs, (including overhead allocations) as they may apply to costs associated with this Project. In those situations where Contractor's records have been generated from computerized data (whether mainframe, mini-computer, or PC based computer systems), Contractor agrees to provide County's representatives with extracts of data files in computer readable format on data disks or suitable alternative computer data exchange formats.

The County or its designee shall be entitled to audit all of the Contractor's records for a period of three (3) years after final payment or a longer period if required by law.

Contractor shall require all payees (including those entering into lump sum subcontracts and lump sum major material purchase orders), to comply with the provisions of this article by insertion of the requirements hereof in a written contract agreement between Contractor and payee. Requirements to include flow-down audit provisions in contracts with payees will apply to Subcontractors, Sub-Subcontractors, material suppliers, etc. when working under any type of contract including lump sum agreement, unit price agreements, time and material agreements, cost plus agreements, or other agreements. Contractor will cooperate fully and will cause all payees to cooperate fully in furnishing or in making available to County from time to time whenever requested in an expeditious manner any and all such information, materials and data required by this section.

County's agent or its authorized representative shall have access to the Contractor's facilities, shall be allowed to interview all current or former employees to discuss matters pertinent to the performance of the Work, shall have access to all necessary records, and shall be provided adequate and appropriate work space, in order to conduct audits in compliance with this section.

SECTION 12
SPECIAL CONDITIONS OF AGREEMENT

Table of Contents

I. County
II. Program Manager
III. General Engineering Consultant (GEC)
IV. The Construction Observer
V. Engineer of Record
VI. Insurance
VII. Record ("As-Built") Drawings
VIII. Limit of Financial Resources
IX. Limits of Work and Payment
X. State Sales Tax
XI. Completion of Work on Time
XII. Layout and Construction Stakes
XIII. Safety
XIV. Maintenance Bond Term & Amount
XV. Safety Restrictions - Work Near High Voltage Lines
XVI. Erosion Control
XVII. Discovery of Hazardous Materials
XVIII. Submittals – Certificate of Compliance
XIX. Unavailability of Materials
XX. Traffic Control
XXI. Temporary Traffic Handling Devices
XXII. Roadway Signs
XXIII. Project Signs
XXIV. Permits
XXV. Landscape Restoration
XXVI. Existing Fencing
XXVII. Easements
XXVIII. Limits of Contractor's Operation
XXIX. Maintenance of Pedestrian Walkways
XXX. Spoil
XXXI. Materials Testing
XXXII. Pre-Construction Conference
XXXIII. Weight Tickets
XXXIV. Confined Space Entry Program
XXXV. Tree and Plant Protection
XXXVI. Prosecution and Progress
XXXVII. Sanitary Provisions
XXXVIII. Work Near Railroads

SPECIAL CONDITIONS

I. County

Williamson County, a political subdivision of the State of Texas, acting through its County Judge, or his designee, agents or employees, whom Contractor has entered into the Agreement and for whom the Work is to be performed, is referred to as "County". The County shall be contacted through its Purchasing Department for contract related subjects and through the County Engineer's office for design and construction related subjects:

Purchasing Department	County Engineer
Williamson County	Williamson County
901 South Austin Avenue	3151 SE Inner Loop
Georgetown, TX 78626	Georgetown, TX 78626

II. Program Manager

Prime Strategies, Inc. is the County's Program Manager for the Project. The Program Manager represents the County and oversees the planning, design, review, and coordination of the design and construction phases of the Project.

III. General Engineering Consultant (GEC)

HNTB Corporation is the consulting engineering firm representing and assisting the County in the design, review, and coordination of the design and construction phases of the project, including oversight of the construction engineering and inspection services performed on the Project.

IV. The Construction Observer

Williamson County or Representative is the "Construction Observer" referred to herein and in the Contract Documents. The Construction Observer will be responsible for performing construction observation services on the Project.

V. Engineer of Record

O'Brien Engineering Services, LLC is the County's design professional, who shall provide professional engineering services as defined in the Texas Government Code Chapter 2254, Subchapter A, and referred to as the " Engineer of Record" in the "General Conditions of Agreement" contained in the Contract Documents. Nothing contained in the Contract Documents shall create any contractual or agency relationship between the Engineer of Record and the Contractor.

VI. Insurance

The Contractor will carry Workmen's Compensation Insurance, Public Liability and Property Damage Insurance, and Automobile Insurance sufficient to provide adequate protection against damage claims which may arise from operations under the Contract Documents, in compliance with the following:

Contractors Insurance: Without limiting any of the other obligations or liabilities of the Contractor, during the term of the Agreement and prior to Final Completion, the Contractor and each subcontractor, at their own expense, shall purchase and maintain the herein stipulated minimum insurance with companies duly approved to do business in the State of Texas and satisfactory to the County. Certificates of each policy shall be delivered to the County before any work is started, along with a written statement from the issuing company stating that said policy shall not be canceled, non-renewed or materially changed without 30 days advance written notice being given to the County. Prior to the effective date of cancellation, Contractor must deliver to the County a replacement certificate of insurance or proof of reinstatement. A model Certificate of Insurance is illustrated herein. Coverage shall be of the following types and not less than the specified amounts:

(a) workers' compensation as required by Texas law, with the policy endorsed to provide a waiver of subrogation as to the County; employer's liability insurance of not less than $500,000 for each accident, $500,000 disease--each employee, $500,000 disease-policy limit.

(b) commercial general liability insurance, including independent contractor's liability, completed operations and contractual liability covering, but not limited to, the liability assumed under the indemnification provisions of the Contract Documents, fully insuring Contractor's (or subcontractor's) liability for injury to or death of County's employees and third parties, extended to include personal injury liability coverage with damage to property of third parties, with minimum limits as set forth below:

General Aggregate	$1,000,000
Operations Aggregate	$1,000,000
Personal and Advertising Injury	$600,000
Each Occurrence	$600,000
Fire Damage (any one fire)	$50,000
Medical Expense (any one person)	$5,000

The policy shall include coverage extended to apply to completed operations, asbestos hazards (if this project involves work with asbestos) and XCU (explosion, collapse and underground) hazards. The completed operations coverage must be maintained for a minimum of one year after Final Completion and acceptance of the Work, with evidence of same filed with County.

(c) comprehensive automobile and truck liability insurance, covering owned, hired and non-owned vehicles, with a combined bodily injury and property damage minimum limit of $600,000 per occurrence; or separate limits of $250,000 for bodily injury (per person), $500,000 bodily injury (per accident) and $100,000 for property damage. Such insurance shall include coverage for loading and unloading hazards.

"Umbrella" Liability Insurance: The Contractor shall obtain, pay for and maintain umbrella liability insurance during the contract term, insuring Contractor for an amount of not less than $1,000,000 per occurrence combined limit for bodily injury and property damage that follows form and applies in excess of the primary liability coverages required herein above. The policy shall provide "drop down" coverage where underlying primary insurance coverage limits are insufficient or exhausted. County and Project Engineer shall be named as additional insured.

Policy Endorsements and Special Conditions

(a) Each insurance policy to be furnished by Contractor shall include the following conditions by endorsement to the policy:

(1) name the County, the Program Manager, the County's Representatives, the GEC, the Construction Observer and the Engineer of Record as an additional insured as to all applicable coverage;
(2) each policy shall require that 30 days prior to the cancellation, non-renewal or any material change in coverage, a notice thereof shall be given to County by certified mail.
(3) the term "County" shall include all authorities, boards, bureaus, commissions, divisions, departments and offices of the County and individual members, employees and agents thereof in their official capacities, and/or while acting on behalf of the County;
(4) the "Program Manager" represents and assists the County in the planning, design, review, and coordination of the design and construction phases of the project.
(5) the policy phrase "other insurance" shall not apply to the County where the County is an additional insured on the policy; and
(6) all provisions of the Contract Documents concerning liability, duty and standard of care together with the indemnification provision, shall be underwritten by contractual liability coverage sufficient to include such obligations within applicable policies.

(b) Insurance furnished by the Contractor shall also be in accordance with the following requirements:
(1) any policy submitted shall not be subject to limitations, conditions or restrictions deemed inconsistent with the intent of the insurance requirements to be fulfilled by Contractor. The County's decision thereon shall be final;
(2) all policies are to be written through companies duly licensed to transact that class of insurance in the State of Texas; and
(3) all liability policies required herein shall be written with an "occurrence" basis coverage trigger.

(c) Contractor agrees to the following:
(1) Contractor hereby waives subrogation rights for loss or damage to the extent same are covered by insurance. Insurers shall have no right of recovery or subrogation against the County, it being the intention that the insurance policies shall protect all

parties to the Agreement and be primary coverage for all losses covered by the policies;

(2) companies issuing the insurance policies and Contractor shall have no recourse against the County for payment of any premiums or assessments for any deductibles, as all such premiums and deductibles are the sole responsibility and risk of the Contractor;

(3) approval, disapproval or failure to act by the County regarding any insurance supplied by the Contractor (or any subcontractors) shall not relieve the Contractor of full responsibility or liability for damages and accidents as set forth in the contract documents. Neither shall the bankruptcy, insolvency or denial of liability by the insurance company exonerate the Contractor from liability; and

(4) no special payments shall be made for any insurance that the Contractor and subcontractors are required to carry; all are included in the contract price and the contract unit prices.

Any of such insurance policies required under the Contract Documents may be written in combination with any of the others, where legally permitted, but none of the specified limits may be lowered thereby.

The Contractor shall furnish the County with satisfactory proof that it has provided adequate insurance coverage in amounts and by approved carriers as required by the Contract Documents.

VII. Record ("As-Built") Drawings

The Contractor shall mark all changes and revisions on all of its copies of the working drawings during the course of the Project as they occur. Upon completion of the Project and prior to Final Acceptance and Payment, the Contractor shall submit to the Construction Observer one set of its working drawings, dated and signed by the Contractor and its project superintendent and labeled as "As-Built", that shows all changes and revisions outlined above and that shows field locations of all above ground appurtenances including, but not limited to valves, fire hydrants and manholes. These as-built drawings shall be forwarded to the GEC and then to the County and become the property of the County. Each appurtenance shall be located by at least two (2) horizontal distances measured from existing, easily identifiable, immovable appurtenances such as fire hydrants or valves. Property pins can be used for as-builts tie-ins provided no existing utilities as previously described are available. Costs for delivering as-built drawings shall be subsidiary to other bid items.

VIII. Limit of Financial Resources

The County has a limited amount of financial resources committed to this Project; therefore, it shall be understood by Contractor that the County may be required to change and/or delete any items which it may feel is necessary to accomplish all or part of the scope of work within its limit of financial resources. Contractor shall be entitled to no claim for damages or anticipated profits on any portion of work that may be omitted. At any time during the duration of the Project, the County reserves the right to omit any

work from the Contract Documents. Unit prices for all items previously approved in the Contract Documents shall be used to delete or add work per change order.

IX. Limits of Work and Payment

It shall be the obligation of the Contractor to complete all work included in the Contract Documents, so authorized by the County, as described in the Contract Documents and Technical Specifications. Any question arising as to the limits of work shall be left up to the interpretation of the Engineer and/or Observer.

X. State Sales Tax

On a contract awarded by a governmental entity for the construction of a publicly-owned improvement in a street right-of-way or other easement which has been dedicated to the public and to the an Organization which qualifies for exemption pursuant to the provisions of Article 20.04 (F) of the Texas Limited Sales, Excise and Use Tax Act, the Contractor can probably be exempted in the following manner:

> The Contractor may buy tax-free any materials incorporated into the project by issuing a resale certificate in lieu of paying the sales tax at the time of purchase. The Contractor may then accept an exemption certificate from the City for the materials.

Even with a separated contract, the rental of equipment and the purchase of items which do not ultimately become part of the physical structure will still be subject to state and local sales taxes.

XI. Completion of Work on Time

The Contractor agrees that time is of the essence and that the definite value of damages which would result from delay would be incapable of ascertainment and uncertain, so that for each day of delay beyond the number of days herein agreed upon for the Substantial Completion of the Work specified in the Contract Documents and contracted for, after due allowance for such extension of time as is provided for under the provisions of Section 4.02 of the General Conditions, the County may withhold permanently from the Contractor's total compensation, not as penalty but as liquidated damages, the sum as specified in Special Specification 000-001 per calendar day.

Furthermore, it is agreed by the Contractor that the time period between Substantial Completion and Final Completion shall be no longer than **20** working days. This separate time period shall be for completion of the Punch List, as set forth in Section 5.06 of the General Conditions, Final Completion and Acceptance. In the event that Contractor fails to attain Final Completion on or before the expiration of the above said time period, the Contractor shall be subject to the remedies set forth in the Contract Documents. More specifically, the Contractor shall be subject to the terms set forth under Section 7.01 of the General Conditions, Abandonment by the Contractor. In addition to exercising its rights and remedies under the Contract Documents, the County may also exercise any remedy that may be available to it under the law or in equity.

XII. Layout and Construction Stakes

All construction staking shall be performed by the Contractor at the Contractor's expense.

XIII. Safety

The Contractor must use methods of construction that meet or exceed Occupational Safety and Health Administration Standards and any other local, state or federal regulations for safety that are in effect. The Contractor will have a trench safety plan prepared and sealed by Contractor's registered professional engineer.

XIV. Maintenance Bond Term & Amount

The required Maintenance Bond amount for this Project shall be twenty percent (20%) of the total amount bid and the bond period shall be two years from date of acceptance of completion, as noted on the Certificate of Completion.

XV. Safety Restrictions - Work Near High Voltage Lines

The following procedures shall be followed for work near high voltage lines on the Project.

(a) A warning sign not less than five (5) inches by seven (7) inches, painted yellow with black letters that are legible at twelve (12) feet shall be placed inside and outside vehicles such as cranes, derricks, power shovels, drilling rigs, pile drivers, hoisting equipment or similar apparatus. The warning sign shall read as follows: "Warning-Unlawful to Operate This Equipment Within Six Feet of High Voltage Lines".

(b) Equipment that may be operated with ten (10) feet of high voltage lines shall have an insulating cage guard around the boom or arm (except backhoes or dippers), and insulator links on the lift hook connections.

(c) When necessary to work within six (6) feet of high voltage electrical lines, notify the power company. The electric company will erect temporary mechanical barriers, de-energize the line, or raise or lower the line. All such work done by the power company shall be at the expense of the contractor. The contractor shall maintain an accurate log of all such calls to the electric company.

(d) No person shall work within six (6) feet of high voltage lines without protection measures having been taken as outlined in Paragraph C.

XVI. Erosion Control

Contractor shall comply with all laws prohibiting the pollution of any lake, stream, river, or wetland by the dumping of any refuse, rubbish, dredge material, or debris therein.

The Contractor will file the Notice of Intent (NOI) and the Notice of Termination (NOT) as the Project's operator. All required Permits and Notices shall be posted by the Contractor at the Project site.

Contractor shall apply temporary and/or permanent erosion and sedimentation controls, as specified in the plans or directed to disturbed roadside areas, fifteen feet and beyond from road pavement, prior to initiating road base operations. Following asphalt paving of road pavement, apply temporary and/or permanent erosion and sedimentation controls to remaining disturbed areas, as specified in the plans or as directed.

Contractor shall be responsible for the maintenance of all temporary and permanent water quality and erosion control measures proposed under the Storm Water Pollution Prevention Plan (SWPPP) or the Water Pollution Abatement Plan (WPAP) for the duration of the Project construction. Upon completion of construction and before the Construction Observer issues the Certificate of Completion, Contractor shall be responsible for the removal of all temporary measures and the cleaning and resetting of all permanent measures. All costs associated with this work shall be considered subsidiary to other bid items and no additional compensation shall be allowed.

Contractor shall take special precautions during all periods of heavy rainfall and at all locations where storm water, groundwater and/or mud and debris may enter the sewer systems. All mud, stones, and debris that enter the sewer systems due to Contractor's operations, or Contractor's neglect, shall be cleaned from the system by Contractor. It shall be Contractor's responsibility to see that such storm water, groundwater and debris do not enter the sewer system. All costs for such work shall be merged in the unit prices bid and no additional compensation shall be allowed.

If it is necessary in the prosecution of the Work to interrupt existing surface drainage, sewers, or under drainage, temporary drainage shall be provided until permanent drainage work is completed. The construction of all temporary drainage installations shall be considered as incidental to the construction of the Work. Drainage ways shall be kept clear or other satisfactory provisions made for drainage.

Contractor shall be responsible for and shall take all reasonable and necessary precautions to preserve and protect all existing tile drains, sewers, and other subsurface drains, or parts thereof, which may be continued in service without

change. Contractor shall repair, at its own expense, any and all damage to such facilities resulting from negligence or carelessness on the part of its operations.

The Construction Observer shall be responsible for the monitoring and inspection of the erosion control measures by completion of the Construction Pollution Prevention Plan Inspection and Maintenance Report, as required for coverage under the Texas Pollutant Discharge Elimination System (TPDES) General Construction Permit (TXR150000).

XVII. Discovery of Hazardous Materials

If, during the course of the Work, the existence of hazardous material, including asbestos containing material, is observed in the work area, the Contractor shall immediately notify the County in writing. The Contractor shall not perform any work pertinent to the hazardous material prior to receipt of special instructions from the County. Asbestos containing material includes transit pipe.

XVIII. Submittals – Certificate of Compliance

The Contractor shall submit to the Construction Observer a Certificate of Compliance from the manufacturer and/or supplier of each and every specified material or manufactured equipment item. The said certificate shall state that the material or the item of equipment to be furnished has been manufactured with materials in accordance with the applicable sections of all required codes, specifications, and standards as required by the specifications.

XIX. Unavailability of Materials

If the Contractor is unable to furnish or use any of the materials or equipment specified because of any order by a governmental agency limiting the manufacture or use, or because of the supply situation in the general market for such material or equipment, the Contractor shall offer substitutes therefor. The substitutes shall be suitable for the purpose, considering the factors of quality, serviceability, appearance, and maintenance. No substitute shall be used until the Engineer has approved it.

No consideration will be given to the use of substitutes on account of market conditions unless the Contractor demonstrates that, for the item in question, the Contractor placed its order without delay, that it has shown due diligence in attempting to locate the item as specified, and that the unavailability is due to market conditions in general throughout the particular industry.

If substitutes are used in the Work, the compensation to be paid to the Contractor shall be subject to review and adjustment. As a general principle, if the Engineer shall determine that the substitute will be less satisfactory, the Contractor shall allow a credit to the County; only under unusual circumstances shall there be an increase in compensation to the Contractor on account of substitution. The basis upon which the amount of price and adjustments will be founded shall be the cost of the appropriate items at the time the bids for the Project were opened.

XX. Traffic Control

Access shall be provided for residents and emergency vehicles at all times. When it becomes necessary to restrict access, the Contractor shall notify all applicable agencies (i.e. Fire Department, E.M.S., Public Works, etc.) a minimum of five (5) working days in advance of the proposed restrictions. At the end of each day, two lanes of traffic shall be opened to the public, unless otherwise stated in the Contract Documents.

XXI. Temporary Traffic Handling Devices

The Contractor shall furnish, erect and maintain all necessary barricades, lights, warning signs and temporary pavement markings as shown on the Plans and/or in accordance with the Texas Manual on Uniform Traffic Control Devices and with the Specifications in the Contract Documents. In addition, the Contractor shall provide flag-persons and take necessary precautionary measures for the protection of persons, property and the Work, when deemed necessary by the County or the Construction Observer.

The Construction Observer shall be responsible for the monitoring and inspection of the traffic control measures by completion of the Traffic Control Devices Inspection Report (TCDIR), and the Contractor shall be responsible for compliance with the terms of the TCDIR procedures.

XXII. Roadway Signs

All permanent and temporary roadway signage designated in the Contract Documents shall be in accordance with the Texas Manual on Uniform Traffic Control Devices.

XXIII. Project Signs

The Contractor shall erect at the site of construction, and maintain during construction, signs satisfactory to the County identifying the Project and indicating that the government is participating in the development of the Project. The project signs must be temporary signs, mounted in such a way that they can be moved and do not pose a safety issue. Two project signs will be required for the Project. The two said signs shall be 8' X 4' and made out of white 10 mm corrugated plastic with pressure sensitive vinyl lettering or approved equivalent to include: Road Bond Program, Your County Tax Dollars at Work!, with the Williamson County Seal, the Project’s name, and a brief description relating to the estimated date of completion, website address and the appropriate Williamson County Commissioner's name and precinct number. Furnishing, installing and maintaining these signs shall be considered subsidiary to Item 502, “Barricades, Signs and Traffic Handling”. The Contractor may use any manufacturer; however, the manufacturer must meet Williamson County standards.

XXIV. Permits

The Contractor shall be responsible for obtaining any and all required construction permits. Contractor agrees to comply with all conditions of the

permits and to maintain copies of the permits at the site at all times while the Work is in progress. The County shall be responsible for obtaining Section 404 permits from the U.S. Army Corps of Engineers as part of the Project design. When Contractor-initiated changes in the construction method changes the impacts to waters of the U.S., Contractor shall be responsible for obtaining new or revised Section 404 permits.

XXV. Landscape Restoration

If not designated as a specific pay item in bid package, the Contractor shall take the means necessary to protect all trees, shrubbery and sod. Protection, removal and replacement of existing landscaping will be in accordance with the Contract Documents.

XXVI. Existing Fencing

All fences encountered during construction within the right-of-way (ROW) shall be removed by the Contractor under "Preparing Right-of-Way." Permanent fencing, designating the ROW, will be provided by others, unless otherwise shown in the Contract Documents. The Contractor will be required to coordinate preparing ROW operations and fence removal and installations with the landowners as needed.

XXVII. Easements

Any easements, both temporary and permanent, required for the Project will be provided by the County as shown in the Contract Documents. Other easements required or desirable by the Contractor shall be arranged by the Contractor at its sole expense. The easements shall be cleaned after use and restored to their original conditions, or better by the Contractor. In the event additional work is required by the Contractor, it shall be the Contractor's responsibility to obtain written permission from the property owners involved for the use of additional property required. No additional payment will be allowed for this item.

XXVIII. Limits of Contractor's Operation

The Contractor shall limit construction operations to within the ROW or the easement unless otherwise directed by the County or its authorized representative.

XXIX. Maintenance of Pedestrian Walkways

The Contractor will be required to maintain clear walkways for pedestrians during construction in a manner to provide access in the most convenient and safest manner consistent with essential construction operations. Specifically, the following will be enforced.

Pedestrian traffic may be blocked at a location where work is actually in progress. Signs, barricades, and warning devices must be placed at nearest crosswalks approaching the construction site from every direction advising pedestrians of the blockage and advising them to use alternate routes.

Access to doorways and pedestrian entrances must be maintained at all times during hours that access is needed by business. Paving by sections or providing temporary access may be required.

No more than one corner of any intersection may be under construction at any one time. Work must be completed and opened for use by pedestrians before starting work on any other corner of an intersection.

The Contractor will be expected to diligently pursue construction from start to completion at every location to avoid prolonged and unnecessary disruptions to pedestrian traffic.

This work shall be considered incidental and not a separate pay item, unless provided otherwise in the Contract Documents.

XXX. Spoil

All excavated material unfit for backfill, waste material accumulated on the job, and any material surplus to that needed in the prosecution of the Work shall be removed from the site by the Contractor and properly and legally disposed of at its expense, unless otherwise directed by the Observer. **THE CONTRACTOR SHALL INDEMNIFY AND SAVE HARMLESS THE COUNTY, ALL OF ITS OFFICERS, AGENTS, AND EMPLOYEES FROM ALL SUITS, ACTIONS, OR CLAIMS OF ANY CHARACTER RESULTING FROM ITS ARRANGEMENTS FOR THE DISPOSAL OF SPOIL.** This shall be incidental and not a separate pay item.

XXXI. Materials Testing

Quality Control testing of all materials, construction items or products incorporated in the work shall be performed by the Contractor at the Contractor's expense, and shall be performed in accordance with the Quality Control (QC) / Quality Assurance (QA) program outlined in Appendix A.

Quality Assurance sampling and testing for acceptance may be required for quality assurance of used materials as directed by the Construction Observer or the County. The cost of such tests will be incurred by the County and coordinated by the Construction Observer through funds made available to the Construction Observer under his/her agreement with the County for the professional services related to construction engineering and inspection on the Project.

The Contractor shall furnish for review by the Construction Observer, not later than 10 days after receipt of notice to proceed, a Quality Control Plan consisting of plans, procedures, and organization necessary to produce an end product which complies with the contract documents. The Contractor will be allowed the latitude to develop standards of control subject to approval by the County. As a minimum, the plan shall include description of the type and frequency of

inspection staffing, materials handling and control, and testing deemed necessary to measure and control quality as specified by the contract documents.

XXXII. Pre-Construction Conference

Before the Project work order is issued, a pre-construction conference shall be held with representatives of the County and the Contractor. The Contractor shall plan to submit a schedule of operations at the pre-construction conference, unless otherwise notified. See Section XXXVI-Prosecution and Progress for additional construction schedule requirements.

XXXIII. Weight Tickets

The Contractor will be responsible for providing asphalt and aggregate tickets for quantity verifications on all asphaltic concrete used for the Project.

XXXIV. Confined Space Entry Program

It shall be the responsibility of the Contractor to implement and maintain a variable "Confined Space Entry Program" which must meet OSHA requirements for all its employees and subcontractors at all times during construction. OSHA defines all active sewer manholes, regardless of depth, as "permit required confined spaces". Contractors shall submit an acceptable "Confined Space Entry Program" for all applicable manholes and maintain an active file for these manholes. The cost of complying with this program shall be subsidiary to the pay items involving work in confined spaces.

XXXV. Tree and Plant Protection

Scope: Provide complete protection and maintenance of existing trees, shrubs, and grass areas designated to remain within construction limits and/or right-of-way.

Coordination: Coordinate protection of existing trees, shrubs and grass areas with other trades so as to prevent damage to these items.

Payment for Damages: If existing trees, shrubs or grass areas are destroyed, killed or badly damaged as a result of construction observations, Contract sum will be reduced by the amount of assessed damages. Damages will be evaluated by the Construction Observer, using the following:

Trees: International Shade Tree Conference Standards and following formula – measurement of a cross section of tree trunk will be made at a point 2 feet above existing grade level to determine cross section area in square inches. Assessment for damage will be $27.00 per square inch.

Shrubs and Grass Areas: An initial fine of $1,000 shall be imposed for any unauthorized disturbance within the boundaries of the shrub and grass areas to remain within the right-of-way and outside the limits of disturbance. This

disturbance includes but is not limited to: parking or intrusion of equipment or vehicles; storage of any materials, and any unauthorized damage and/or removal of vegetation. In addition to the initial fine, a base fine of $8.00 for every square foot of area of damaged vegetation within any areas designated to remain on the plans shall be imposed. The areas covered under this section include but are not limited to: areas designated to remain or no-work areas. In determining the amount of fine, the Construction Observer shall consider the degree and extent of harm caused by the violation, the cost of rectifying the damage, and whether the violation was committed willfully.

Materials: Tree Protection lumber dimensions shall be 4X4 and 2X4 sizes.

Protection: The Contractor shall protect existing trees, shrubs, and grass areas within construction limits from the following damage:

(1) Compaction of root area by equipment, vehicles or material storage;
(2) Trunk damage by moving equipment material storage, nailing or bolting;
(3) Strangling by tying ropes or guy wires to trunks or large branches;
(4) Poisoning by pouring solvents, gas, paint or other chemicals on or around trees and roots;
(5) Cutting of roots by excavating or ditching;
(6) Damage of branches by improper pruning;
(7) Drought from failure to water or by cutting or changing normal drainage pattern past roots;
(8) Changes of soil pH factor by disposal of lime base materials such as concrete or plaster;
(9) Do not cut roots 1-1/2” in diameter or over. Excavation and earthwork within drip line of trees shall be done by hand.

Install barricade protection around trees and shrubs, constructed of 4X4 posts and 2X4 stringers top and bottom. Install protection prior to demolition or excavation operations. Leave protection until construction operations are essentially complete.

Maintenance:

(1) Water trees and shrubs within construction limits as required to maintain their health during course of construction operations.
(2) Pruning will be performed by County.

XXXVI. Prosecution and Progress

At the pre-construction meeting, the Contractor shall submit for acceptance a schedule of all planned work activities and sequences that is intended to be followed in order to both substantially and fully complete the Work within the

allotted time periods (the "Project Schedule"). The purpose of the County requiring the Project Schedule shall be to:

(1) Ensure adequate planning during the prosecution and progress of the work in accordance with the allowable number of working/ calendar days and all milestones;
(2) Assure coordination of the efforts of the Contractor, County, Program Manager, Construction Observer, utilities and others that may be involved in the Project;
(3) Assist the Contractor, County, Program Manager and Construction Observer in monitoring the progress of the Work and evaluating proposed changes to the Contract Documents; and
(4) Assist the County, Program Manager and Construction Observer in administering the time requirements set forth in the Contract Documents.

A Type B Schedule will be required on all projects. Following is the schedule requirements:

Type B Schedule:

The Contractor shall create and maintain a Critical Path Method (CPM) Project Schedule showing the manner of prosecution of work that it intends to follow in order to both substantially and fully complete the Work within the allotted time periods. The Project Schedule shall employ computerized CPM for the planning, scheduling and reporting of the work as described in this specification. The CPM Project Schedule shall be prepared using the Precedence Diagram Method (PDM). No direct compensation will be allowed for fulfilling these requirements, as such work is considered subsidiary to the various bid items of the Project.

(1) Personnel. The Contractor shall provide an individual, referred to hereinafter as the Scheduler, to create and maintain the CPM schedule. He or she shall be proficient in CPM analysis and shall be able to perform required tasks on the software. The Scheduler shall be made available for discussion or meetings when requested by the County, Construction Observer or Program Manager.

(2) Schedule. The Project Schedule shall show the sequence and interdependence of activities required for complete performance of the work. The Contractor shall be responsible for assuring all work sequences are logical and show a coordinated plan of the Work.

Each activity on the schedule shall be described by: An activity number utilizing an alphanumeric designation system tied to the traffic control

plans, and that is agreeable to the County, Program Manager, or Construction Observer; concise description of the Work represented by the activity; and activity durations in whole working days with a maximum of twenty (20) working days. Durations greater than twenty (20) working days may be used for non-construction activities (mobilization, submittal preparation, curing, etc.), and other activities mutually agreeable between the Contractor and County, Program Manager or Construction Observer. The Contractor shall provide a legend for all abbreviations. The activities shall be coded so that organized plots of the schedule may be produced. Typical activity coding includes: Traffic control phase, location and work type.

The activity durations shall be based on the quantity for the individual work activity divided by a production rate. An estimated production rate for each activity shall also be shown.

The Contractor shall plan and incorporate major resources into the schedule. Major resources are defined as crews and equipment that constrain the Contractor from pursuing available work. The resources shall accurately represent the Contractor's planned equipment and manpower to achieve the productivity rates specified above.

Seasonal weather conditions shall be considered and included in the CPM schedule for all work influenced by temperature and/or precipitation. Seasonal weather conditions shall be determined by an assessment of average historical climatic conditions. Average historical weather data is available through the National Oceanic and Atmospheric Administration (NOAA). These effects will be simulated through the use of work calendars for each major work type (i.e., earthwork, concrete paving, structures, asphalt, drainage, etc.) Project and work calendars should be updated each month to show days actually able to work on the various work activities.

“Total float” is defined as the amount of time between the early start date and the late start date, or the early finish date and the late finish date, for each and every activity in the schedule. Float time in the schedule is a shared commodity between the County and the Contractor.

Only responsible delays in activities that affect milestone dates or the Project’s completion date, as determined by CPM analysis, will be considered for a time extension.

The schedule shall show the sequence and interdependence of activities required for complete performance of the work. The schedule shall be prepared and maintained in accordance with the scheduling requirements stated in this Section and shall include two (2) organized plots with the

activities logically grouped using the activity coding. The Contractor shall also provide an electronic copy of the schedule via e-mail.

The schedule shall encompass the time from the start of the Contract Time to the Project's Final Completion. The longest path through the schedule shall be readily discernable on the plot of the schedule.

(3) Joint Review, Revision and Acceptance. Within twenty (20) calendar days of receipt of the Contractor's proposed schedule, the County or its authorized agents shall evaluate the schedule for compliance with this specification, and notify the Contractor of the findings. If the County or its authorized personnel request a revision or justification, the Contractor shall provide a satisfactory revision or adequate justification to the satisfaction of the Construction Observer or County authorized personnel within seven (7) calendar days.

If the Contractor submits a CPM schedule for acceptance which is based on a sequence of work not in the Contract Documents, then the Contractor shall notify the County or its authorized entities in writing, separate from the schedule submittal.

The County's review and acceptance of the Contractor's Project Schedule is for conformance to the requirements of the Contract Documents only. Review and acceptance by the County or other authorized personnel of the Contractor's Project Schedule does not relieve the Contractor of any of its responsibility for the Project Schedule, or of the Contractor's ability to meet interim milestone dates (if specified) and the Final Completion date, nor does such review and acceptance expressly or by implication warrant, acknowledge or admit the reasonableness of the logic, durations, manpower or equipment loading of the Contractor's Project Schedule. In the event the Contractor fails to define any element of work, activity or logic and the County's review does not detect this omission or error, such omission or error, when discovered by the Contractor or County and its authorized personnel, shall be corrected by the Contractor at the next monthly schedule update and shall not affect the project completion date.

(4) Updates. The Project Schedule shall be updated on a monthly basis and shall be required as a basis for the pay application approval. The Project Schedule update shall be submitted with the pay application. The Contractor shall meet with the Construction Observer or County authorized personnel each month at a scheduled update meeting to review actual progress made through the data date of the schedule update. The review of progress will include dates activities actually started and/or completed, and the percentage of work completed or remaining duration on each activity started and/or completed. The percentage of work complete shall be calculated by utilizing the quantity and productivity rate

information. The Project Schedule update shall include one (1) copy of the following information:

a) Electronic copy of the updated schedule including revisions and changes via e-mail.
b) One (1) logically organized plot of the schedule update if requested by the County or its authorized personnel.

(5) Project Schedule Revisions. If the Contractor desires to make major changes in the Project Schedule, the Contractor shall notify the County or Construction Observer in writing. The written notification shall include the reason for the proposed revision, what the revision is comprised of, and how the revision was incorporated into the schedule. In addition to the written notification of the revision, the Contractor shall provide an electronic copy and one logically organized plot of the schedule including the revision if requested by the County or Construction Observer.

Major changes are hereby defined as those that may affect compliance with the requirements of the Contract Documents or those that change the critical path. All other changes may be accomplished through the monthly updating process.

(6) Time Impact Analysis. The Contractor shall notify the County or Construction Observer when an impact may justify an extension of Contract Time or adjustment of milestone dates. This notice shall be made in writing as soon as possible, but no later than the end of the next estimate period after the commencement of an impact or the notice for a change is given to the Contractor. Not providing notice to the County or Construction Observer by the end of the next estimate period will indicate the Contractor's approval of the time charges as shown on that time statement. Future consideration of that statement will not be permitted and the Contractor forfeits its right to subsequently request a time extension or time suspension unless the circumstances are such that the Contractor could not reasonably have knowledge of the impact by the end of the next estimate period.

When changes are initiated or impacts are experienced, the Contractor shall submit to the County or Construction Observer a written time impact analysis describing the influence of each change or impact.

A time impact analysis is an evaluation of the effects of changes in the construction sequence, contract, plans, or site conditions on the Contractor's plan for constructing the Project, as represented by the Project Schedule. The purpose of the time impact analysis is to determine if the overall Project has been delayed, and if necessary, to provide the Contractor and the County a

basis for making adjustments to the time allotted for Substantial Completion and Final Completion.

A time impact analysis shall consist of one or all of the steps listed below.

Step 1. Establish the status of the Project before the impact using the most recent Project Schedule update prior to the impact occurrence.

Step 2. Predict the effect of the impact on the most recent Project Schedule update prior to the impact occurrence. This requires estimating the duration of the impact and inserting the impact into the schedule update. The Contractor shall demonstrate how the impact was inserted into the schedule showing the added or modified activities and the added or modified relationships. Any other changes made to the schedule including modifications to the calendars or constraints shall be noted.

Step 3. Track the effects of the impact on the schedule during its occurrence. Note any changes in sequencing, and mitigation efforts.

Step 4. Compare the status of the Work prior to the impact (Step 1) to the prediction of the effect of the impact (Step 2), and to the status of the work during and after the effects of the impact are over (Step 3). Note that if an impact causes a lack of access to a portion of the Project, the effects of the impact may extend to include a reasonable period for remobilization.

The time impact analysis shall include an electronic copy of the complete schedule prepared in Step 2. If the Project Schedule is revised after the submittal of a time impact analysis but prior to its approval, the Contractor shall promptly indicate in writing to the County or Construction Observer the need for any modification to its time impact analysis.

Only one (1) copy of each time impact analysis shall be submitted within fourteen (14) calendar days after the completion of an impact. The County or Construction Observer may require Step 1 and Step 2 of the time impact analysis be submitted at the commencement of the impact, if needed to make a decision regarding the suspension of Contract Time.

Approval or rejection of each time impact analysis by the County, Construction Observer or Program Manager shall be made within fourteen (14) calendar days after receipt unless subsequent meetings and negotiations are necessary.

The time impact analysis shall be incorporated into and attached to any relevant change order(s) and/or supplemental agreement(s).

XXXVII. Sanitary Provisions

Provide and maintain adequate, neat, and sanitary toilet accommodations for employees, including County employees and representatives, in compliance with the requirements and regulations of the Texas Department of Health or other authorities having jurisdiction.

XXXVIII. Work Near Railroads

(A) General.

If the work crosses or is in close proximity to a railroad, do not interfere with the use or operation of the railroad company's trains or other property. Assign responsible supervisory personnel to ensure that tracks and adjacent areas are clear of debris, road materials, and equipment. It is the Contractor's responsibility to contact the railroad to determine the railroad's requirements for work within the railroad right of way and to comply with the requirements. The County will not reimburse the Contractor for any cost associated with these requirements. If the work requires construction within 25 ft. horizontally of the near rail or if the tracks may be subject to obstruction due to construction operations, notify the Engineer and the Railroad Company at least 3 days before performing work. The railroad company will provide flaggers during this work. If railroad flaggers will be needed longer than 2 consecutive days, request them at least 30 days before performing work within the railroad right of way. Flaggers provided by the railroad company will be paid for by the County. Do not store material or equipment in the Railroad's right of way within 15 ft. of the centerline of any track. Do not place any forms or temporary falsework within 8.5 ft. horizontally from the centerline or 22 ft. vertically above the top of rails of any track, unless otherwise shown in the Contract Documents.

(B) Temporary Crossings.

If a temporary crossing is needed, obtain permission from the railroad company before crossing the tracks. Execute the "Agreement for Contractor's Temporary Crossing" if required by the Railroad Company. The Contractor shall ensure that the tracks are left clear of equipment and debris that would endanger the safe operation of railroad traffic. Provide a crossing guard on each side of the crossing to direct equipment when hauling across the tracks. The Contractor shall stop construction traffic a safe distance away from the crossing upon the approach of railroad traffic. Work for temporary crossings will not be paid for directly, but shall be subsidiary to items of the Work subject of the Contract Documents. Work performed by the Railroad Company for the temporary crossing, except flaggers, will be at the Contractor's expense.

SECTION 13
TECHNICAL SPECIFICATIONS

Williamson County
Project: CR200 at Bold Sundown

GENERAL NOTES: April 21, 2017 Version

Basis of Estimate

Item	Description	**Rate	Basis	Quantity
160	**Furnishing and Placing Topsoil (4")**	1 CY/9 SY	4651 SY	517 CY
161	**Erosion Control Compost (3")**	1 CY/12 SY	1163 SY	97 CY
162	**Mulch Topdressing (5")**	1 CY/7 SY	1163 SY	166 CY
164	**Seed for Erosion Control** (Item 164) (Temp) (Cool) (TY 4) (Item 164) (Perm) (Warm) (TY 5) (Item 164) (Temp) (Warm) (TY 10)	 4840 SY/AC 4840 SY/AC 4840 SY/AC	 2326 SY 4651 SY 2326 SY	 0.48 AC 0.96 AC 0.48 AC
166	**Fertilizer (13-13-13)**	1/8 LB/SY	4651 SY	0.3 TON
168	**Vegetative Watering** (Item 162) (Item 164) (Temp) (Item 164) (Temp) (Item 164) (Perm)	 20 GAL/SY 10 GAL/SY 10 GAL/SY 20 GAL/SY	 1163 SY 2326 SY 2326 SY 4651 SY	 23 MG 23 MG 23 MG 91 MG
**204	**Sprinkling** (Dust) (Item 132) (Item 247)	 30 GAL/CY 30 GAL/CY 30 GAL/CY	 2597 CY 388 CY 1059 CY	 77910GAL 11640GAL 31770GAL
**210	**Roll (Flat Wheel)** (Item 247) (Item 316)	 1 HR/200 TON 1 HR/6000 SY	 1430 TON 4924 SY	 8 HR 1 HR
**210	**Roll (Tamping)** (Item 132)	 1 HR/200 CY	 388 CY	 2 HR
**210	**Roll (Heavy Tamp)** (Item 132)	 1 HR/200 CY	 388 CY	 2 HR
**210	**Roll (Lt Pneu Tire)** (Item 132) (Item 247) (Item 316) (Seal Coat)	 1 HR/500 CY 1 HR/200 TON 1 HR/6000 SY	 388 CY 1430 TON 4924 SY	 1 HR 8 HR 1 HR
247	**FL BS (CMP IN PLC)** (TY A GR 4)	 27 CF/CY	 1059 CY	 1059 CY
310	**Prime Coat (Multi-Option)**	0.20 GAL/SY	3178 SY	636 GAL

Williamson County
Project: CR200 at Bold Sundown

Item	Description	**Rate	Basis	Quantity
		Total		
316	**Surface Treatments** **Seal Coat:** Asphalt Aggregate (TY-D G-5 SAC-B)	 0.40GAL/SY 1 CY/120 SY	 4924 SY 4924 SY	 2014 GAL 42 CY
340	**Dense-Graded Hot-Mix Asphalt** TY B PG 64-22 TY D SAC-B PG 70-22 TY D PG 64-22(LEVEL-UP)	 115 LB/SY/IN 115 LB/SY/IN 115 LB/SY/IN	 3168 SY 5035 SY 1851SY	 547 TON 579 TON 100 TON

** For Informational Purposes Only

Williamson County
Project: CR200 at Bold Sundown

MODIFIED STANDARDS

The following standard detail sheet or sheets have been modified:

NONE

GENERAL

References to manufacturer's trade name or catalog numbers are for the purpose of identification only. Similar materials from other manufacturers are permitted if they are of equal quality, comply with the specifications for this project, and are approved.

If work is performed at Contractor's option, when inclement weather is impending, and the work is damaged by subsequent precipitation, the Contractor is responsible for all costs associated with replacing the work, if required.

The roadbed shall be free of organic material prior to placing any section of the pavement structure.

Equip all construction equipment used in roadway work with highly visible omnidirectional flashing warning lights.

Provide a smooth, clean saw-cut along the existing asphalt pavement structure, as directed. Consider subsidiary to the pertinent Items.

Supply litter barrels in enough numbers at locations as directed to control litter within the project. Consider subsidiary to pertinent Items.

Use a self-contained vacuum broom to sweep the roadway and keep it free of sediment as directed. The contractor will be responsible for any sweeping above and beyond the normal maintenance required to keep fugitive sediment off the roadway as directed by the Construction Observer.

Protect all areas of the right of way, which are not included in the actual limits of the proposed construction areas, from disturbance. Restore any area disturbed because of the Contractor's operations to a condition as good as, or better than, before the beginning of work at no cost to the state.

Damage to existing pipes and SETs due to Contractor operations shall be repaired at Contractor's expense.

All locations used for storing construction equipment, materials, and stockpiles of any type, within the right of way, will be as directed. Use of right of way for these purposes will be restricted to those locations where driver sight distance to businesses and side street intersections is not obstructed and at other locations where an unsightly appearance will not exist. The Contractor will not have exclusive use of right of way but will cooperate in the use of the right of way with the city/county and various public utility companies as required.

Williamson County
Project: CR200 at Bold Sundown

The Project Superintendent will be capable of speaking English and will be available to contact at all times when work is being performed, including subcontractor work. The Superintendent will be available and on-call 24 hours a day.

Coordinate and obtain approval from the Construction Observer for all bridgework over existing roadways.

Measure all minimum vertical clearances for all structures (including, but not limited to, signal mast arms, span wires, and overhead sign bridge structures) within the limits of the project for all roadway alignments in all directions of travel. Coordinate with the Construction Observer to take these measurements and obtain prior to opening roadways to traffic unless otherwise approved. The Construction Observer will report all minimum vertical clearance information on State maintained roadways to the Austin District Permit Office.

Use materials from prequalified material producers list as shown on the Texas Department of Transportation (TxDOT) – Construction Division's (CST) materials producers list. Refer to TxDOT's website for list of pre-qualified manufacturers. No substitutions will be allowed for materials found on the list. Submit list of approved suppliers/materials from TxDOT website to show items are TxDOT approved. Submit this list with request for material approval.

When any abandoned well is encountered, cease construction operations in this area and notify the Engineer who will coordinate the proper plugging procedures. A water well driller licensed in the State of Texas must be used to plug a well.

Erosion control and stabilization measures must be initiated immediately in portions of the site where construction activities have temporarily ceased and will not resume for a period exceeding 14 calendar days. Track all exposed soil, stockpiles, and slopes. Tracking consists of operating a tracked vehicle or equipment up and down the slope, leaving track marks perpendicular to the direction of the slope. Re-track slopes and stockpiles after each rain event or every 14 days, whichever occurs first. This work is subsidiary.

Perform maintenance of vehicles or equipment at designated maintenance sites. Keep a spill kit on-site during fueling and maintenance. This work is subsidiary.

Maintain positive drainage for permanent and temporary work for the duration of the project. Be responsible for any items associated with the temporary or interim drainage and all related maintenance. This work is subsidiary.

Suspend all activities near any significant recharge features, such as sinkholes, caves, or any other subterranean openings that are discovered during construction or core sampling. Do not proceed until the designated Geologist or TCEQ representative is present to evaluate and approve remedial action.

Locate aboveground storage tanks kept on-site for construction purposes in a contained area as to not allow any exposure to soils. The containment will be sized to capture 150% of the total capacity of the storage tanks.

Williamson County
Project: CR200 at Bold Sundown

Project Specific Location (PSL) in USACE Jurisdictional Area.
Do not initiate activities in a PSL associated with a U.S. Army Corps of Engineers (USACE) jurisdictional area that have not been previously evaluated by the USACE as part of the permit review of this project. Such activities include, but are not limited to, haul roads, equipment staging areas, borrow and disposal sites. Associated defined here means materials are delivered to or from the PSL. The jurisdictional area includes all waters of the U.S. including wetlands or associated wetlands affected by activities associated with this project. Special restrictions may be required for such work. Consult with the USACE regarding activities, including PSLs that have not been previously evaluated by the USACE. Provide the Department with a copy of all USACE coordination and approvals before initiating activities.

Proceed with activities in PSLs that do not affect a USACE jurisdictional area if self-determination has been made that the PSL is non-jurisdictional or proper clearances have been obtained in USACE jurisdictional areas or have been previously evaluated by the USACE as part of the permit review of this project. Document any determinations that PSL activities do not affect a USACE jurisdictional area. Maintain copies of PSL determinations for review by the Department or any regulatory agency. The Contractor must document and coordinate with the USACE, if required, before any excavation material hauled from or embankment material hauled into a USACE jurisdictional area by either (1) or (2) below.

1. Restricted Use of Materials for the Previously Evaluated Permit Areas. When an area within the project limits has been evaluated by the USACE as part of the permit process for this project:
    a. suitable excavation of required material in the areas shown on the plans and cross sections as specified in Standard Specification Item 110, Excavation is used for permanent or temporary fill within a USACE jurisdictional area;
    b. suitable embankment from within the USACE jurisdictional area is used as fill within a USACE evaluated area;
    c. Unsuitable excavation or excess excavation that is disposed of at an approved location within a USACE evaluated area.
2. Contractor Materials from Areas Other than Previously Evaluated Areas. Provide the Department with a copy of all USACE coordination and approvals before initiating any activities in a jurisdictional area within the project limits that has not been evaluated by the USACE or for any off right of way locations used for the following, but not limited to, haul roads, equipment staging areas, borrow and disposal sites:
    a. Standard Specification Item 132, Embankment is used for temporary or permanent fill within a USACE jurisdictional area;
    b. Unsuitable excavation or excess excavation that is disposed of outside a USACE evaluated area.

Work over or near Bodies of Water (Lakes, Rivers, Ponds, Creeks, etc.).
Keep on site a universal spill kit adequate for the body of water and the work being performed. No debris is allowed to fall into a body of water. Debris that falls into the water must be removed at the end of each work day. Debris that falls into the floodway must be removed at the end of each work week or prior to a rain event. This work is subsidiary.

DSHS Asbestos and Demolition Notification.

Williamson County
Project: CR200 at Bold Sundown

Migratory Birds and Bats.
Migratory birds may be nesting within the project limits and concentrated on roadway structures such as bridges and culverts. Remove all old and unoccupied migratory bird nests from any structures, trees, etc. between September 1st and January 31st. Prevent migratory birds from re-nesting between February 1st and August 31st.

All methods used for the removal of unoccupied bird nests and the prevention of re-nesting must be approved by the Construction Observer well in advance of the planned use.

In the event that any active nests are encountered on-site during construction, all construction activity within the immediate vicinity of the nest must cease immediately. Contact the Construction Observer to determine how to proceed.

Bats may roost within the project limits under bridges, in culverts, in large hollow trees, in dead standing trees, and in trees with shaggy bark. Maternity colonies may occur from April 1st through August 31st. If bats are present, ensure bats are not harmed. Exclusion protocols for known colonies should be followed well in advance of commencement of construction activities. Exclusion measures by qualified individuals are used to relocate existing colonies, except from April 1st through August 31st when such measures may separate mothers and pups. Exclusion measures are also the means of preventing establishment of new colonies and re-establishment of relocated colonies.

No extension of time or compensation payment will be granted for a delay or suspension of work caused by migratory birds or bats. This work is subsidiary.

ITEM 100 – PREPARING RIGHT OF WAY
Do not burn brush, unless otherwise approved.

Trim vegetation around signs and other obstructions. Consider subsidiary to pertinent Items.

Use hand methods or other means to remove objectionable material and obstructions, if doing work by mechanical methods is impractical. Consider subsidiary to the pertinent Items.

ITEM WC101 – SOIL RIPPING
Soil Ripping, as required for all projects in Special Specification WC101, shall be accomplished using the following values:

Spacing for slopes between 3:1 and 4:1, groves should be 16 inches on center.

For slopes flatter than 4:1, groves should be 12 inches on center.

Depth of compacted soils should be ripped to a depth of 18 inches. When embankment stabilization is a concern, ripping depth can be reduced to 12 inches.

Williamson County
Project: CR200 at Bold Sundown

ITEM 110 & 132 – EXCAVATION & EMBANKMENT

Unsuitable material encountered in a cut or fill section will be considered waste. The Construction Observer will define unsuitable material. Material, which the Contractor might deem to be unsatisfactory or unsuitable, due to moisture content, will not be considered unsuitable material, unless otherwise approved.

Obtain approval of all compaction equipment prior to all backfilling and embankment operations.

ITEM 132 – EMBANKMENT

The underlying layer or existing subgrade must be prepared and inspected prior to placement of the embankment. Proof roll the pavement area according to Item 216 prior to placement of embankment or subsequent layers. Payment for proof rolling will be subsidiary to the various bid Items of the contract.

Correct unstable material (e.g. dry, wet, loose, etc.) to a depth of six (6) inches below existing grade. This work will be considered subsidiary to pertinent bid Items. Drying required deeper than six (6) inches below existing grade will be paid for in accordance with Item 6.03, "Extra Work." However, there will be no payment to correct failures in the subgrade areas that were constructed under this contract.

ITEM 132 – EMBANKMENT TY C

The Construction Observer must approve the embankment material before use on the project.

Existing material located within the project limits may be used as embankment if it meets specifications shown on the plans and if approved by the Construction Observer.

If delivery from offsite source is necessary, furnish embankment with a PI of less than 25 that does not contain sulfate contents greater than 3000 ppm.

Meet the following select embankment (TY C) requirements when used as subgrade directly beneath flexible and/ or rigid pavement sections to depths specified in the typical section.

Embankment Material Requirements – Item 132 [TY C)

Item	Description	(Percent Retained-Sieve)					LL Max.	PI Max.	PI Min.
		1¾"	7/8"	3/8"	#4	#40			
132	Embankment (Density Control) (TY C1)	0-10	10-20	-	45-75	60-85	45	20	6
132	Embankment (Ordinary Compaction) (TY C2)	0-10	10-20	-	45-75	50-85	55	25	8

Stockpile imported TY C embankment at an approved location until it meets all testing requirements. The stockpile must be between 500 CY and 5000 CY and must not exceed a height of 15 ft. It is the Contractor's responsibility to identify and notify the Construction Observer of the location of the borrow source to allow time for testing and approval to avoid delay to the project. Allow a minimum of five (5) working days for testing.

Williamson County
Project: CR200 at Bold Sundown

ITEM 134 – BACKFILLING PAVEMENT EDGES
For TY A backfill, furnish flexible base meeting the requirement as specified in the plans, in accordance to Item 247. Compressive strengths for Item 247 flexible base are waived when supplied for this item. In lieu of flexible base, RAP may be supplied for TY A backfill. RAP must be 100% passing a 2½ inch sieve in accordance to Tex-110-E. Compact using a light pneumatic roller. Install at 3:1 slope and tie into existing terrain. Apply SS-1 to front slope at a rate of 0.12 GAL/SY, after compaction is complete.

ITEM 160 – TOPSOIL
No sandy loam allowed. Obtain approval of the actual depth of the topsoil sources for both on-site and off-site sources.

ITEM 169 – SOIL RETENTION BLANKETS
Use materials from prequalified material producers list as shown on the Texas Department of Transportation (TxDOT) – Construction Divisions (CST) materials producers list. Refer to TxDOT's website for list of pre-qualified manufacturers. Direct all questions to the Maintenance Division, Vegetation Management Section, 125 E. 11th Street, Austin, TX 78701-2483.

ITEM 204 – SPRINKLING
Apply water for dust control as directed. When dust control is not being maintained, cease operations until dust control is maintained. Consider subsidiary to the pertinent Items.

ITEM 216 – PROOF ROLLING
Correct and perform "Proof Rolling" retest at the Contractor's expense, to the satisfaction of the Construction Observer, when initial "Proof Rolling" yields a failing result.

ITEM 247 – FLEXIBLE BASE
Furnish Type A material.

Furnish flexible base meeting Grade 4 requirements.

The following table will govern the acceptance of compaction on base courses, when compacted in multiple courses. Compaction requirements are in percent of maximum dry density as determined by (Tex-113-E). When compacting in a single course, compact to at least 100% of maximum dry density as determined by Tex-113-E.

Item	Material	All Roadways	
		Lift	Min. Density
247	FL BS (CMP IN PLC)	1st of 2 lifts 2nd of 2 lifts (final lift)	95% 98% 100%

Williamson County
Project: CR200 at Bold Sundown

Table 1
Flexible Base Material Requirements

Property	Test Method	Grade 4
Master gradation sieve size	Tex-110-E	**% Retained**
2½ in.		0
1¾ in.		0
7/8 in.		10-35
3/8 in.		30-50
No. 4		45-65
No. 40		70-90
No. 200		87-95
Liquid Limit, % Max.[1]	Tex-104-E	35
Plasticity Index, Max.[1]	Tex-106-E	10
Wet ball mill, % Max.	Tex-116-E	40
Wet ball mill, % Max. increase passing the No. 40 sieve		20
Min. compressive strength, psi	Tex-117-E	
Lateral pressure 0 psi		–
Lateral pressure 3 psi		90
Lateral pressure 15 psi		175

1. Determine plastic index in accordance with Tex-107-E (linear shrinkage) when liquid limit is unattainable as defined in Tex-104-E.

Correct subgrade (e.g. unstable areas, soft spots, etc.) prior to placing Flex Base. Consider subsidiary to the pertinent Items.

Complete all subgrade, ditches, slopes, and place all drainage structures to conform to required lines, grades, and cross-sections, as shown and directed, prior to the placement of Flex Base.

For Flex Base placed over the box culverts, do not use a Vibratory Roller to compact the material.

ITEM 300 – ASPHALTS, OILS, AND EMULSIONS
Asphalt season starts May 1st and ends September 15th.

PPA and REOBs are not allowed.

ITEM 300 – ASPHALTS, OILS, AND EMULSIONS (NON-TRACKING TACK COAT)
Spray a test strip of tack coat at a location on or near the project as directed. Consult the manufacturer for the recommended application rate. Allow the strip to cure for the maximum time specified. Drive over the test strip with equipment to simulate the effect of paving equipment. There should be no evidence tracking or picking up of the tack coat on the wheels of the equipment.

The Construction Observer shall verify the bond strength as directed.

Williamson County
Project: CR200 at Bold Sundown

ITEMS 310, 316, 340
Perform work during good weather, unless otherwise directed. If work is performed at Contractor's option, when inclement weather is impending, and the work is damaged by subsequent precipitation, the Contractor is responsible for all costs associated with replacing the work, if required.

ITEM 310 – PRIME COAT
Apply blotter material to all driveways and intersections.

Multi-option bituminous material is allowed.

Provide Construction Observer with current Distributer Certification confirming calibration of asphalt measurement equipment.

Distribute prime coat smoothly and evenly at the rate of 0.2 gallons per square yard.

Apply Prime to finished flex base surface at the rate shown in the plans. Hot mix can be applied to the primed surface of flex base after the prime has penetrated and cured for a minimum of 36 hours depending on weather conditions or as approved by the Construction Observer. Provide the Construction Observer with a copy of the asphalt deliver ticket prior to application.

Apply blotter material to all driveways and intersections. This work is subsidiary. When Multi Option is allowed, provide MC 30, EC 30, or AE-P. MC 30 is not allowed in Travis County.

ITEM 316 – SEAL COAT
Do not apply asphalt within 1½ hours of sunset, or later, unless otherwise directed.

Grade 4 and 5 Type D or Type E is allowed as AGGR (MULTI OPTION) for an underseal.

Ensure that all underseal surface treatment operations are covered by HMACP before exposing to traffic, including construction traffic.

Use paper or other approved material at the beginning and end of each shot so that the transverse joint is straight and prevents overlap of asphalt shots.

Any areas with excessive asphalt or aggregate will be removed.

The Contractor is required to provide recommendations to the Construction Observer on adjusting aggregate and asphalt rates, when the road conditions, material properties or construction methods change.

Furnish medium pneumatic-tire rollers in accordance with Item 210, "Rolling." Roll before opening to traffic.

Surface all transitions, tapers, climbing lanes and intersections to the limits as directed.

Williamson County
Project: CR200 at Bold Sundown

Keep all traffic, including construction traffic, off freshly placed surface treatment, as directed.

Provide Construction Observer with current Distributer Certification confirming calibration of asphalt measurement equipment.

Provide Construction Observer with a copy of the shipping ticket for the asphalt prior to application. Contractor must sample asphalt, in accordance to the applicable item. Label the sample can with date and project numbers. Samples must be stored where they are readily available to the County representative at the plant. The Contractor will be responsible for supplying storage for all samples until the project achieves substantial completion or otherwise directed.

Removal and proper disposal off the ROW of audible/profile markings, reflectorized markings, and raised markers is subsidiary.

ITEM 320 – EQUIPMENT FOR ASPHALT CONCRETE PAVEMENT
Use of motor grader is not allowed

ITEMS 340 (HMACP Testing)
The Contractor must sample asphalt binder, in accordance to the applicable item. Label the sample can with the corresponding CSJ, lot, and sub-lot numbers.

Samples must be stored in a common area where they are readily available to the County's representative at the plant. The Contractor will be responsible for supplying storage for all samples. Retain all asphalt samples until hot mix production is complete or directed otherwise.

When directed, the Contractor is responsible for disposal of all asphalt binder samples, in accordance to Local, State, and Federal regulations.

[Hot Mix Asphaltic Concrete (HMAC) Core Holes]
Refill and compact all HMAC core holes to the same elevation as the adjacent roadway. Use hot mix of the type being used in the project to fill core holes. As an alternative a high performance cold patching mix such as Rapid Cure Patching Mix meeting the requirements of DMS-9203 or Medium Cure Patching mix made with SCM meeting requirements of DMS-9202. Consider this work subsidiary to the pertinent Items.

Mill a transverse butt joint to transition from the new ACP to the existing surface tie-in. Make the transition a minimum of 50 feet H: 1 inch V slope ratio of newly placed ACP. Make the temporary joint, at the tie-in, a minimum of a 10 feet longitudinally and covering the entire width. Saw-cut existing pavement as directed. Prior to milling, core the existing pavement to determine its thickness. Do not proceed with milling until directed. Consider this work subsidiary to the pertinent Items.

Contractor to submit for approval a current mix design (less than 6 months old) to the Construction Observer that meets the following requirements prior to use on the project.

Williamson County
Project: CR200 at Bold Sundown

PPA and REOBS are not allowed.

Aggregates used on shoulders and ramps are required to meet SAC requirements.

Target laboratory molded density is 97% for all mixtures for Texas Gyratory Compactor (TGC) mixture designs.

When using Superpave Gyratory Compactor (SGC) to design mixtures, submit the SGC mix design to the Construction Observer for approval.

When using substitute binders, mold specimens for mix design and production at the temperature required for the substitute binder used to produce the HMA.

All mixtures must meet the Hamburg requirement as stated in the table below.

High-Temperature Binder Grade	**Test Method**	**Hamburg Wheel Test Requirements [1]**		
		Minimum # of Passes	**Maximum Rut Depth (mm)[2]**	**Minimum Rut Depth (mm)[2,3]**
PG 64 or lower	Tex-242-F	7,000	12.5	3
PG 70	Tex-242-F	15,000	12.5	3
PG 76 or higher	Tex-242-F	20,000	12.5	3

1. The Construction Observer may accept Hamburg Wheel test results for production and placement if no more than 1 of the 5 most recent tests is below the specified number of passes and the failing test is no more than 2,000 passes below the specified number of passes.
2. Rut depth tested @ 122°F
3. Unless approved otherwise.

When using RAP and/or RAS:
Use of RAS is not allowed. When using RAP, include the management methods of processing, stockpiling, and testing of RAP in the QCP submitted for the project. Blending of RAP in one feeder bin or in a stockpile is not permitted.

Asphalt content and binder properties of RAP stockpiles must be documented when recycled asphalt content greater than 20% is utilized.

RAP is not allowed for any surface mix applications.

No more than 20% RAP by weight of aggregate is allowed in any mix application.

Complete all roadways before final surface course placement, unless directed otherwise.

Williamson County
Project: CR200 at Bold Sundown

Ensure placement sequence to avoid excess distance of longitudinal joint lapback not to exceed one day's production rates.

The Contractor shall utilize a material transfer device per item 320 and a grade reference (such as a ski) for overlay operations. Consider subsidiary to the pertinent items.

Use a device to create a maximum 3H: 1V notched wedge joint on all hot mix joints of two (2) inches or greater. Consider subsidiary to the pertinent Items.

Taper transverse faces at ends of passes as directed.

Make transverse tapers on each end of pass using a minimum slope rate of 60H:1V. Tapers shall be removed directly before placement of final lift. Consider subsidiary to the pertinent Items.

Provide a minimum transition for all side streets of at least 12 ft. and driveways of at least six (6) feet, unless otherwise shown on the plans or otherwise approved/directed.

Tack only between old existing asphalt surfaces and new HMAC layer, and on any sawed edge, unless otherwise directed. Do not dilute tack coat. Apply it through a distributor spray bar in accordance with Article 316.3.1 Distributor.

Submit any proposed adjustments or changes to a job mix formula to the Construction Observer before production of the new job mix formula.

For Mixture Design Verification, provide the Construction Observer with two 5-gallon buckets of each aggregate stockpile to be used on the project with three gallons of each PG binder from the plant to be used on the project. Sufficient quantities of any other additives that will be used in the HMA mixture shall also be provided.

Prior to allowing production of the trial batch, the Construction Observer will use the materials provided by the Contractor to perform the following tests to verify the HMA mixture .

1. Indirect Tensile Test in accordance with Tex-266-F
2. HAMBURG Wheel Test in accordance with Tex-242-F
3. Overlay Test in accordance with Tex-248-F
4. Cantabro Test in accordance with Tex-245-F

For mixtures designed with a Texas Gyratory Compactor (TGC), the Construction Observer may require that the target laboratory molded density be raised to no more than 97.5% or may lower the design number of gyrations to no less than 35 for mixtures designed with an SGC if any of the following conditions exist:

1. The Indirect Tensile Test results in a value greater than 200 PSI
2. The Hamburg Wheel Test results in a value less than 3.0 mm
3. The Overlay Test results in a value less than 100 cycles
4. The Cantabro Test results in a value of more than 20% loss

Williamson County
Project: CR200 at Bold Sundown

In lieu of or in addition to evaluating the mixture design prior to allowing a trial batch to be produced, the Construction Observer may also evaluate the mixture produced during the trial batch for compliance with the four tests listed above.

Submit thermal and segregation profiles as well as longitudinal joint densities on electronic forms provided by County to the Construction Observer.

When surface irregularities, as defined in Article 341.4.9.3.3.5, "Irregularities," are detected or measured, the Contractor must take immediate corrective action defined as the removal and replacement of a full lane width of the defective area using a paver to place new mix, unless otherwise directed. If there are multiple defective areas within a sub-lot, making up to 30% of the sub-lot by area, the Construction Observer will require the entire sub-lot be removed, unless directed otherwise.

ITEM 400 – EXCAVATION AND BACKFILL FOR STRUCTURES
Cut pavements with the use of a saw as directed. Consider subsidiary to pertinent Items.

Obtain approval of all compaction equipment prior to all backfilling and embankment operations.

Use Class "B" sand bedding for pipe and box culvert installation unless otherwise directed.

ITEM 467 – SAFETY END TREATMENT
Cut pipe ends, in the field, to match roadway side slopes, or as directed. Apply asphalt base aluminum paint to the cut ends.

All Type II SETs shall have mitered pipe ends and cast-in-place riprap aprons.

Use Class C concrete.

Remove all loose Formwork and other Materials from the Floodplain or drainage areas, daily, which could float off in a Storm Water Event, as directed.

ITEM 502 – BARRICADES, SIGNS, AND TRAFFIC HANDLING
Unless otherwise approved, one (1) lane in each direction shall remain open at all times.

The GEC is the authority to approve additional lane closures, prior to any work.

Maintain a written record of documentation of "The Additional Approved Lane Closures."

Submit and secure concurrence, prior to the publication of any notices or placement of any traffic control devices for implementation of the traffic control plan, hereinafter called a Lane Closure Notice (LCN).

Present to GEC, an LCN for traffic control, which is proposed for implementation, a minimum of four (4) full working days preceding any proposed implementation date. Indicate the estimated

Williamson County
Project: CR200 at Bold Sundown

date, time, duration, and location for the proposed work. As a part of the LCN submit a written description of the lane closure(s) depicting the proposed traffic control devices used, based on the appropriate plan sheet, TxDOT or Texas Manual on Uniform Traffic Control Devices (TMUTCD) standards, and an operational description of the work to be performed.

Present to GEC, LCN's proposed for night work, a minimum of ***seven (7)*** full calendar days preceding any proposed implementation date.

Receive concurrence prior to LCN implementation.

Meet with the Construction Observer prior to roadway and lane closures to ensure that sufficient equipment, materials, devices, and workers will be used. Discuss contingency plans at that time. Consider inclement weather prior to implementing the lane closures.

Submit a cancellation of any lane closures, no later than noon on the day preceding the proposed work.

Do not set up any Lane Closure / TCP when the pavement is wet prior to the "setup," unless otherwise directed. Revise Traffic Control, when inclement weather is imminent, as directed.

Incorporate and maintain a 3H: 1V safety wedge into the proposed construction for any roadway edge of 2 inches or greater adjacent to a roadway under traffic.

Within the limits of the project, provide standard barricades, warning signs, delineators, lights, 28-inch cones, and flaggers in enough numbers and combinations, as directed.

No closures will be allowed on the weekends, which include the following holidays: January 1st, the last Monday in May, July 4th, the first Monday in September, the fourth Thursday in November, December 25th, Easter weekend, and the working day prior to or immediately after any of the aforementioned holidays. Unless otherwise approved, no closures will be allowed on the weekends of special events that could be impacted by the construction. Ensure all equipment, vehicles, workers, etc., associated with these closures are off the roadways and all lanes re-opened, at least, by noon of the Friday before these holidays and special events.

ITEM 530 – INTERSECTIONS, DRIVEWAYS, AND TURNOUTS

Notify property owners a minimum of 48 hours in advance of beginning work on their driveways. Provide, to GEC, a list of each notification and contact prior to each closure.

Provide access, at all times, to adjacent property. Construct driveways one-half sections, to allow access.

Do not completely close driveways for reconstruction purposes, unless a reasonable alternate access exists to the property, as approved.

Place the Flex Base for the Driveways using Ordinary Compaction.

Williamson County
Project: CR200 at Bold Sundown

ITEM 540 – METAL BEAM GUARD FENCE (MBGF)
Before beginning the installation of the proposed Metal Beam Guard Fence (MBGF), stake the locations for approval. Adjust the limits of the MBGF to meet field conditions, as directed, before erection.

Furnish new, round, domed and unpainted timber posts. Furnish steel posts at locations where the minimum embedment shown on the plans for wooden posts cannot be achieved. Field verify the steel post lengths before fabrication. Consider the steel posts subsidiary to pertinent Items.

Provide Rail Elements that meet AASHTO M 180 TY I Galvanization (1.80 oz. per SY).

Rail and rail elements that are in compliance with current standards and are undamaged should stockpiled at a location, approved by the Construction Observer, within the project limits for pick up by the County.

ITEM 644 – SMALL ROADSIDE SIGN ASSEMBLIES
Fabricate all small signs not detailed on the plans in conformance with the latest edition of the "Standard Highway Sign Designs for Texas," refer to TxDOT's website.

ITEM 662 – WORK ZONE PAVEMENT MARKINGS
Notify the Construction Observer at least 24 hours in advance of removing existing striping and placing pavement markings & markers.

Apply markings during good weather unless otherwise directed. If markings are placed at Contractor's option, when inclement weather is impending, and the markings are damaged by subsequent precipitation, the Contractor is responsible for all costs associated with replacing the markings if required.

Remove work zone pavement markings within 48 hours after permanent striping has been completed.

Foil backed pavement markings will not be allowed.

ITEM 666 – RETROREFLECTORIZED PAVEMENT MARKINGS
Reference existing channel islands, gores, and lane striping before commencing work. Provide referencing that will include a sketch of the layout to the Construction Observer. Obtain approval for placement of guidemarks from the Construction Observer before installing any permanent pavement markings. Consider subsidiary to the pertinent Items.

ITEM 738 – CLEANING AND SWEEPING HIGHWAYS
Complete cleaning and sweeping cycles at the intervals, as directed. Complete one cycle at the end of construction and prior to final acceptance by the Department.

County Road 200 at Bold Sundown
WILLIAMSON COUNTY
GOVERNING SPECIFICATIONS
(STANDARD SPECIFICATIONS, SPECIAL PROVISIONS, AND SPECIAL SPECIFICATIONS)

WHERE DISCREPENCIES OCCUR BETWEEN THE VARIOUS GOVERNING SPECIFICATIONS, THE SPECIAL PROVISIONS SHALL GOVERN OVER BOTH STANDARD SPECIFICATIONS AND SPECIAL SPECIFICATIONS.

ALL SPECIFICATIONS AND SPECIAL PROVISIONS APPLICABLE TO THIS PROJECT ARE IDENTIFIED AS FOLLOWS:

STANDARD SPECIFICATIONS: ADOPTED BY THE TEXAS DEPARTMENT OF TRANSPORTATION NOVEMBER 1, 2014. STANDARD SPECIFICATIONS ARE INCORPORATED INTO THE CONTRACT BY REFERENCE.

< > REFERNCE ITEMS NOT USED ON THIS CONTRACT
( ) REFERENCE ITEMS USED ON THIS CONTRACT

ITEMS 1 - 9 ARE SUPERSEDED BY THE CONTRACT GENERAL AND SPECIAL CONDITIONS, WHERE APPLICABLE. WHEREVER, IN THE TXDOT STANDARD SPECIFICATIONS, REFERENCE IS MADE TO THE STATE OF TEXAS, THE DEPARTMENT AND ITS REPRESENTATIVES, SUCH REFERENCE SHALL BE TAKEN TO MEAN WILLIAMSON COUNTY AND ITS REPRESENTATIVES.

ITEM 100 PREPARING RIGHT OF WAY (132)
ITEM 110 EXCAVATION
ITEM 132 EMBANKMENT <100> (204) (216)(400)
ITEM 160 FURNISHING AND PLACING TOPSOIL (204)<WC101>
ITEM 161 COMPOST
ITEM 162 SODDING FOR EROSION CONTROL (168)(300)<WC102><WC103>
ITEM 164 SEEDING FOR EROSION CONTROL <166><168>(169)
ITEM 166 FERTILIZER
ITEM 168 VEGETATIVE WATERING
ITEM 169 SOIL RETENTION BLANKET
ITEM 247 FLEXIBLE BASE (204) <210><211><213>(216)
ITEM 310 PRIME COAT (CUTBACK ASPHALTIC MATERIAL) (300)
ITEM 316 SURFACE TREATMENTS (300)<302><520>
ITEM 340 DENSE-GRADED HOT-MIX ASPHALT(METHOD) (300)<320>
ITEM 464 REINFORCED CONCRETE PIPE (400)
ITEM 467 SAFETY END TREATMENT (400)<420><421><432>(440)<445><462><464><496><520> <524><526>
ITEM 500 MOBILIZATION
ITEM 502 BARRICADES, SIGNS AND TRAFFIC HANDLING
ITEM 504 FACILITIES FOR FIELD OFFICE AND LABORATORY
ITEM 506 TEMPORARY EROSION, SEDIMENTATION, AND ENVIRONMENTAL CONTROLS
ITEM 530 DRIVEWAYS AND TURNOUTS (360)<522>
ITEM 540 METAL BEAM GUARD FENCE <421>(442)(445)<492>
ITEM 542 REMOVING METAL BEAM GUARD FENCE
ITEM 544 GUARDRAIL END TREATMENTS <421>(442)(445)<492>
ITEM 644 SMALL ROADSIDE SIGN ASSEMBLIES (421)(440)(634)(636)<643>(646)(656)
ITEM 658 DELINEATOR AND OBJECT MARKER ASSEMBLIES (445)<660>
ITEM 662 WORK ZONE PAVEMENT MARKINGS (666)(672)(677)
ITEM 666 REFLECTORIZED PAVEMENT MARKINGS <677>(678)
ITEM 672 RAISED PAVEMENT MARKERS (677)(5699)

SPECIAL PROVISIONS: THE CONTENT OF THE SPECIAL PROVISIONS ARE INCLUDED ON THE FOLLOWING PAGES.

SPECIAL PROVISION TO ITEM 000	000---0001
SPECIAL PROVISION TO ITEM 160	160---WC001
SPECIAL PROVISION TO ITEM 161	161---WC001
SPECIAL PROVISION TO ITEM 164	164---WC001
SPECIAL PROVISION TO ITEM 168	168---WC001
SPECIAL PROVISION TO ITEM 300	300---009
SPECIAL PROVISION TO ITEM 421	421---002
SPECIAL PROVISION TO ITEM 500	500---WC01
SPECIAL PROVISION TO ITEM 502	502---WC01
SPECIAL PROVISION TO ITEM 506	506---WC001
SPECIAL PROVISION TO ITEM 636	636---001
SPECIAL PROVISION TO ITEM 666	666---007

SPECIAL SPECIFICATIONS: THE CONTENT OF THE SPECIAL SPECIFICATIONS ARE INCLUDED ON THE FOLLOWING PAGES.

SPECIAL SPECIFICATIONS: THE CONTENT OF THE SPECIAL SPECIFICATIONS ARE INCLUDED ON THE FOLLOWING PAGES.

ITEM WC101 SOIL RIPPING
ITEM WC102 MULCH
ITEM WC103 MULCH TOPDRESSING

GENERAL: THE ABOVE-LISTED SPECIFICATION ITEMS ARE THOSE UNDER WHICH PAYMENT IS TO BE MADE. THESE, TOGETHER WITH SUCH OTHER PERTINENT ITEMS, IF ANY, AS MAY BE REFERRED TO IN THE ABOVE-LISTED SPECIFICATION ITEMS, AND INCLUDING THE SPECIAL PROVISIONS AND SPECIAL SPECIFICATIONS LISTED ABOVE, CONSTITUTE THE COMPLETE SPECIFICATIONS FOR THIS PROJECT.

Special Provision to Item 000
Schedule of Liquidated Damages

Table1
Schedule of Liquidated Damages

For Dollar Amount of Original Contract		Dollar Amount of Daily Contract Administration Liquidated Damages per Working Day
From More Than	To and Including	
0	100,000	**570**
100,000	500,000	**590**
500,000	1,000,000	**610**
1,000,000	1,500,000	**685**
1,500,000	3,000,000	**785**
3,000,000	5,000,000	**970**
5,000,000	10,000,000	**1125**
10,000,000	20,000,000	**1285**
20,000,000	Over 20,000,000	**2590**

PDF processed with CutePDF evaluation edition www.CutePDF.com

Special Provision 160-WC001
Topsoil

For this project, Item 160, "Topsoil," of the Standard Specifications, is hereby voided and replaced in its entirety with the clauses and requirements below.

PART 1 – GENERAL

1.1 DESCRIPTION

Furnish and apply topsoil as shown in the plans or as directed.

1.2 RELATED ITEMS

A. Item 161–WC001, "Compost"

B. Item WC101, "Soil Ripping"

1.3 MEASUREMENT

This item will be measured by the 100-ft. station along the baseline of each roadbed, by the square yard complete in place, or by the cubic yard in vehicles at the point of delivery.

1.4 PAYMENT

Unless topsoil is specified as a pay item, the work performed and materials furnished in accordance with this item will not be paid for directly, but will be subsidiary to pertinent Items.

When topsoil is specified on the plans as a pay item, the work performed and topsoil furnished will be paid for at the unit price bid for "Furnishing and Placing Topsoil" of the depth specified on the plans (except for measurement by the cubic yard). This price is full compensation for securing necessary sources and royalties, furnishing topsoil, excavation, loading, hauling, stockpiling and placing, watering, rolling and equipment, labor, materials, tools, and incidentals. Limits of excavation and embankment for payment are shown in Figure 1.

1.5 QUALITY CONTROL SUBMITTALS

A. Submit one (1) pound sample of on-site stockpiled topsoil for approval.

B. Submit imported topsoil and supplier information, including product composition, as well as a one (1) pound sample for approval.

C. A statement that the on-site stockpiled topsoil has met the decomposition process.

PART 2 – PRODUCTS

2.1 MATERIALS

A. Use easily cultivated, fertile topsoil, through fresh mining, that is free from objectionable material such as weed seeds, roots, rhizomes, or stolons, has a high resistance to erosion, and is able to support plant growth.

1. Obtain topsoil from the right-of-way at sites of proposed excavation or embankment when specified on the plans or as directed.

2. Secure additional topsoil, if necessary, from approved sources outside the right-of-way in accordance with all applicable environmental laws, rules, regulations, and requirements. Ensure that the topsoil obtained from sites outside the right-of-way has a pH of 5.5 to 8.5.

3. Topsoil is subject to testing by the Engineer.

4. Use water that is clean and free of industrial wastes and other substances harmful to the growth of vegetation.

PART 3 – EXECUTION

3.1 SEQUENCING

A. Following removal of the existing vegetation from the site (if specified), excavate in specified areas and place in a stockpile on-site. Complete the decomposition process in stockpile prior to installation or use of topsoil at depths specified on plans. Install topsoil prior to installation of erosion control compost (ECC). Reference Item 161–WC001, “Compost” for installation specifications.

3.2 CONSTRUCTION

A. Installation

1. Remove and dispose of objectionable material from the topsoil source before beginning the work.

2. Place excavated topsoil in stockpiles no less than three (3) feet by three (3) feet by three (3) feet in size at designated locations along the right-of-way line or as directed.

3. Keep source and stockpile areas drained during the period of topsoil removal and leave them in a neat condition when removal is complete.

4. From June 1 to October 15, completely turn the stockpiled mulch once per month. Internal temperature of the material should be 120°F – 140°F. Stockpile should continue to be turned and remain at this internal temperature for no less than one (1) month before use.

5. From October 16 to May 31, if the average outdoor temperature is below 75°F, remove and discard the top six (6) inches of the stockpile. It is not necessary to turn the stockpile during this time period.

6. Stockpiles should be surrounded by biodegradable erosion control logs to prevent run-off of material.

7. Uniformly blend topsoil per “Compost” if specified as Compost Modified Topsoil (CMT). Reference “Compost” for installation specifications.

8. For subsoils that are not compacted, scarify or break the surface of the soil with a flexible tine harrow one (1) to two (2) inches in depth. Spread the topsoil to a uniform loose cover at the thickness specified. Place and shape the topsoil to no greater than 70% – 75% Proctor density. Soils compacted above the specified Proctor density must be ripped until they are within the desired percentages according to Item WC101, “Soil Ripping.” Apply the topsoil to the ripped soil and work into the lower soil horizons with a harrow.

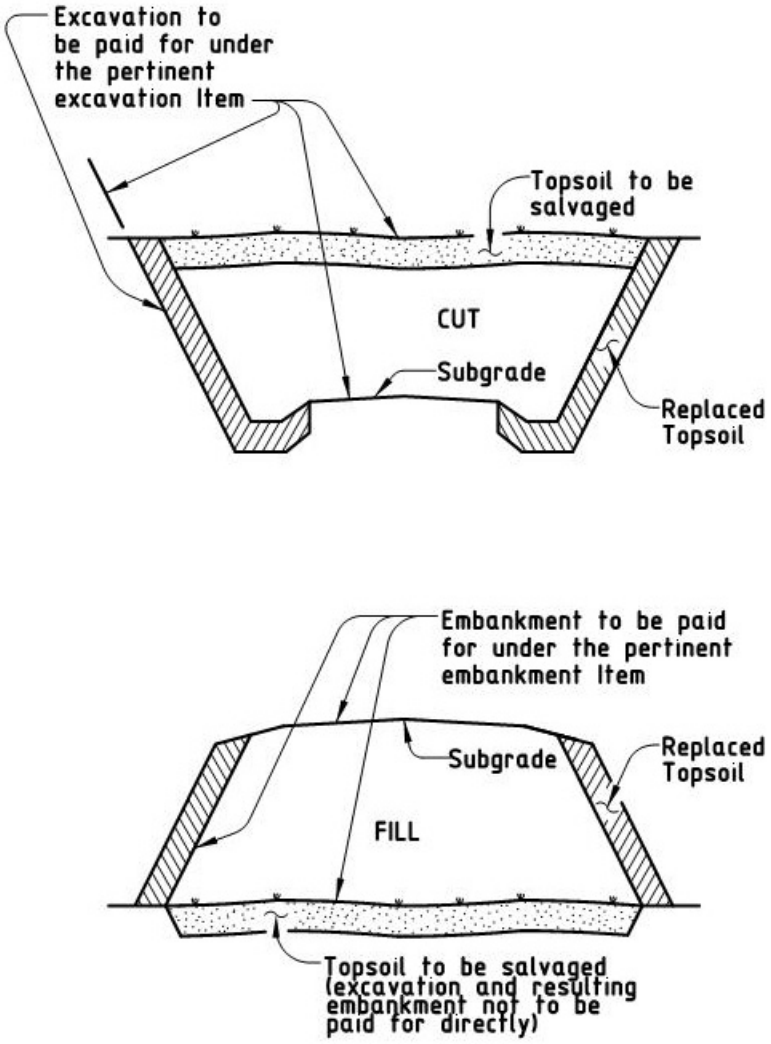


Figure 1
Roadway cross sections showing payment for excavation and embankment.

END OF SECTION

Special Provision 161-WC001
Compost

For this project, Item 161, "Compost," of the Standard Specifications, is hereby voided and replaced in its entirety with the clauses and requirements below.

PART 1 – GENERAL

1.1 DESCRIPTION

Furnish and apply compost as shown in the plans or as directed.

1.2 RELATED ITEMS

A. Item WC102, "Mulch"

B. Item WC101, "Soil Ripping"

C. Item 164–WC001, "Seeding for Erosion Control"

D. Item 160–WC001, "Topsoil"

E. United States Code of Federal Regulations (CFR), Title 40, Part 503 standards for Class A biosolids

F. Texas Commission on Environmental Quality (TCEQ) health and safety regulations as defined in the Texas Administrative Code (TAC), Chapter 332, including the time and temperature standards in Subchapter B, Part 23

G. USCC Seal of Testing Assurance (STA) program

1.3 MEASUREMENT

This item will be measured by the square yard or cubic yard.

1.4 PAYMENT

Unless compost is specified as a pay item, the work performed and the materials furnished in accordance with this Item will not be paid for directly, but will be subsidiary to pertinent items.

When compost is specified on the plans as a pay item, the work performed and the compost furnished will be paid for at the unit price bid for "Compost Manufactured Topsoil" or "Erosion Control Compost" of the depth specified. This price is full compensation for furnishing materials, labor, equipment, maintenance, tools, supplies, and incidentals.

1.5 QUALITY CONTROL SUBMITTALS

A. Prior to the delivery of the compost to the site, the following submittals are to be provided to the Owner's representative for approval:

1. A statement that the compost meets federal and state health and safety regulations.

2. A statement that the composting process has met time and temperature requirements.

3. A copy of the producer's STA certification.

4. A copy of the lab analysis, performed by an STA-certified lab, verifying the compost meets the materials requirements, for every 1000 CY of material. Test data should not be older than one (1) month old.

5. The compost installation method.

6. A copy of purchase receipt from approved vendor.

7. A copy of the current TCEQ compliance statement signed by the facility manager when furnishing biosolids compost.

8. A copy of the compost analysis from the compost supplier that lists NO_3, NH_4, and P levels (parts per million).

PART 2 – PRODUCTS

2.1 MATERIALS

A. Compost

1. Furnish compost that has been produced by aerobic (biological) decomposition of organic matter and meets the requirements set forth by the United States Department of Agriculture and the United States Composting Council (USCC), "Test Methods for Examination of Composting and Compost" (TMECC), shown in 2.1.A.2.

2. Physical Requirements for Compost:

a. Particle Size: 95% passing 5/8 inch, 70% passing 3/8 inch in accordance with TMECC 02.02-B, "Sample Sieving for Aggregate Size Classification"

b. Heavy Metals: Pass in accordance with TMECC 04.06, "Heavy Metals and Hazardous Elements"

i. 04.06-As, Arsenic

ii. 04.06-Cd, Cadmium

iii. 04.06-Cu, Copper

iv. 04.06-Pb, Lead

v. 04.06-Hg, Mercury

vi. 04.06-Mo, Molybdenum

vii. 04.06-Ni, Nickel

viii. 04.06-Se, Selenium

ix. 04.06-Zn, Zinc

c. Soluble Salts: 5.0 max.* dS/m in accordance with TMECC 04.10-A, "1:5 Slurry Method, Mass Basis" (*A soluble salt content up to 10.0 dS/m for compost used in CMT will be acceptable)

d. pH: 5.5 – 8.5** in accordance with TMECC 04.11-A, “1:5 Slurry pH” (**A maximum pH of 9.5 will be acceptable for manure compost)

e. Maturity: greater than 80% in accordance with TMECC 05.05-A, “Germination and Root Elongation”

f. Organic Matter Content: 25% – 65%*** (dry mass) in accordance with TMECC 05.07-A, “Loss-On-Ignition Organic Matter Method” (***A minimum organic matter content of 10% will be acceptable for manure compost)

g. Stability: less than 0.5 mg CO_2 carbon/g compost carbon/day

h. Fecal Coliform: Pass in accordance with TMECC 07.01-B, “Fecal Coliforms”

3. Compost feedstock may include, but is not limited to, leaves and yard trimmings, biosolids, food scraps, food-processing residuals, manure or other agricultural residuals, forest residues, bark, and paper.

4. Compost shall be reasonably free (less than 1% by dry weight) of manmade foreign matter. The organic matter shall not possess objectionable odor and shall not resemble the raw material from which it was derived. Particle size shall meet the following additional specifications: maximum particle length 0.5 inches

5. Ensure compost does not contain any visible refuse, other physical contaminants, or any substance considered to be harmful to plant growth, as approved by the engineer. Do not use materials that have been treated with chemical preservatives as a compost feedstock or as wood chips.

6. Provide compost meeting all applicable CFR, Title 40, Part 503 standards for Class A biosolids and TCEQ health and safety regulations as defined in the TAC, Chapter 332, including the time and temperature standards in Subchapter B, Part 23. Meet the requirements of the USCC STA program. (TxDOT, 2014)

7. Compost shall be obtained from any of the following approved vendors (vendors that utilize static compost piling are preferred):

a. Organics by Gosh, Austin, TX

(512) 276-1211

b. Garden-Ville, Austin, TX

(888) 655-6115

c. Geo Growers, Austin, TX

(512) 892-2722

d. Soil Express, Prosper, TX

(972) 347-2994

B. Compost Manufactured Topsoil (CMT)

CMT consists of blended compost, as specified in 2.1.A, and mineral soil. The Contractor shall determine the blend based on the compost supplier’s nutrient analysis and the corresponding ratios in Table 1. The mineral soil should have a soil texture of less than 75% sand and organic matter less than 2%. Measures must be taken to avoid weed contamination, through fresh mining, or complete cover or non-use of top six (6) inches of stockpiled material. Reference Item 160-WC001, “Topsoil” for stockpiling specifications of on-site excavated topsoil. Material sources

must be approved by the Owner's Representative. Dilution of compost must not be achieved with organic matter (mulch).

Table 1: Compost to Mineral Soil Amendment Ratios for Compost Manufactured Topsoil (CMT)

Compost Condition NO_3, NH_4, or P (available):	Ratio (volume) Compost: Soil
exceed 2000 ppm (0.2%)	1:25
are less than 2000 ppm (0.2%), but greater than 1000 ppm (0.1%)	1:20
are less than 1000 ppm (0.1%), but greater than 500 ppm (0.05%)	1:10
are less than 500 ppm (0.05%), but greater than 250 ppm (0.025%)	1:4
are less than 250 ppm (0.1%), but greater than 100 ppm (0.05%)	2:3

Source: Lady Bird Johnson Wildflower Center, 2010

C. Erosion Control Compost (ECC)

ECC consists of compost, as specified in 2.1.A, blended with mulch in a ratio of three (3) parts compost to one (1) part mulch (3:1). Mulch to be in accordance with Item WC102, "Mulch."

PART 3 – EXECUTION

3.1 SEQUENCING

A. CMT

Initiate site preparation, CMT and fine grading prior to any native grass and wildflower seeding as specified in the plans or as directed to disturbed roadside areas and channels. If road base operations have not been completed, exclude site preparation and CMT installation fifteen (15) ft. from the road pavement.

B. ECC

Initiate site preparation, topsoil installation, fine grading, and ECC topdressing installation prior to any grass and wildflower seeding as specified in the plans or as directed to disturbed roadside areas and channels. If road base operations have not been completed, exclude site preparation and ECC topdressing installation fifteen (15) ft. from the road pavement.

C. Following road pavement, initiate specified CMT or ECC installation prior to grass and wildflower seeding to remaining disturbed areas, as specified in the plans or as directed.

3.2 CONSTRUCTION

A. Site Preparation

1. Remove debris, unsatisfactory soil materials, and obstructions from surface prior to CMT or ECC installation.

2. Remove top growth of vegetation to remain by mowing to a six (6) inch height to ensure that the CMT or ECC contacts the surface material.

3. CMT and ECC should not be installed onto compacted soil. Scarify or break the surface of the soil with a flexible tine harrow one (1) to two (2) inches in depth.

B. Installation

1. Apply CMT or ECC evenly at depths and locations as indicated in the drawings or as directed.

2. Installation method of the CMT or ECC is to be determined by the Contractor and submitted for approval. Any of the following are acceptable methods of installation:

   a. By hand raking

   b. By mechanized spreader

   c. By a pneumatic blower – Seed can be mixed with CMT or ECC during this application. Reference Item 164-WC001, "Seeding for Erosion Control."

3. Depending on slope, accessibility of location, and rockiness of the terrain, the Contractor is to select an approved installation method that is the least invasive to the adjacent areas.

4. Spread the CMT or ECC to a uniform loose cover at the thickness specified.

5. Till the CMT to a depth no less than four (4) inches to integrate into the subsoil.

6. Lightly rake the ECC compost to ensure good seed to compost contact.

7. Apply ECC at least three (3) ft. over the shoulder of a slope to prevent rill formation and erosion of compost.

8. Do not apply ECC on surfaces with a slope greater than 4:1.

9. Do not apply on surfaces that are muddy, frozen, or contain frost or ice.

10. Do not roll or tamp CMT or ECC.

11. Do not compact the CMT or ECC after application with heavy equipment or foot traffic.

3.3 MAINTENANCE

A. Requirements

1. Maintain CMT or ECC in a functional condition at all times and correct deficiencies immediately until acceptance of project.

2. Install additional CMT or ECC as directed by the Owner's Representative after inspection.

3. Protect areas from traffic and repair or re-establish if damaged or compacted.

4. Restore appearance, quality, and condition to match adjacent work if damaged.

B. Schedule

1. The CMT or ECC should be inspected weekly until native grass is established, in accordance with the Stormwater Pollution Prevention Plan (SW3P), and within 24 hours of every one-half (½) inch or greater rain event until project completion.

END OF SECTION

Special Provision 164-WC001
Seeding for Erosion Control

For this project, Item 164, "Seeding for Erosion Control," of the Standard Specifications, is hereby voided and replaced in its entirety with the clauses and requirements below.

PART 1 – GENERAL

1.1 DESCRIPTION

Provide and install native grass seeding as shown in the plans or as directed.

1.2 RELATED ITEMS

A. Item 161-WC001, "Compost"

B. Item 168-WC001, "Vegetative Watering"

C. Item 160-WC001, "Topsoil"

D. Item 636, "Aluminum Signs"

E. Item 644, "Small Roadside Sign Supports and Assemblies"

1.3 REFERENCES

A. Federal Seed Act

B. Texas Seed Law

C. Texas Fertilizer Law

1.4 MEASUREMENT

This item will be measured by the square yard.

1.5 PAYMENT

A. The work performed and the materials furnished in accordance with the seeding Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Seeding for Erosion Control." This price is full compensation for furnishing materials, including seed, fertilizer, mowing, labor, equipment, maintenance, tools, supplies, and incidentals.

B. When humic acid or MycoApply Endo are specified on the plans as a pay item, the work performed and the material furnished will be paid for at the unit price bid for "Humic Acid" or "MycoApply Endo" at the application rates specified. This price is full compensation for furnishing materials, labor, equipment, water, tools, supplies, and incidentals.

1.6 QUALITY CONTROL SUBMITTALS

A. Submit seeding product data, including plant tags and seed certification for native grass seed mix for approval.

B. Submit seed planting equipment method, manufacturer, and data for approval.

C. Submit product data and sample for sign in accordance with Tex-726-I.

D. Submit humic acid and MycoApply Endo product data and supplier's information for approval.

E. Submit fertilizer analysis, manufacturer, and product data for approval.

PART 2 – PRODUCTS

2.1 MATERIALS

A. Native Grass Seed

Provide seed as shown in the plans or as directed, using Tables 1 – 11 to determine the appropriate seed mix and rates, and meeting the requirements of the Federal Seed Act and Texas Seed Law, including the testing and labeling for pure live seed (PLS = Purity and Germination). Minimum purity shall be 50%. The seed test to be conducted by the State Seed Laboratory, and a seed test report shall be submitted in accordance with 1.6, "Quality Control Submittals." Each type (mix) of seed must be mixed by the supplier and delivered in labeled and unopened bags or containers, unless otherwise approved by the Owner's representative. Do not blend the seed mixes on site. Use within twelve (12) months from that date of analysis. When Buffalograss is specified, use seed treated with KNO_3 (potassium nitrate) to overcome dormancy.

Parts A and B of the seed mix tables are the primary seed mixes for application. Part A is not required unless shown in the plans. In the event that a species in Part A or B of the mixes is not seasonally available, coordinate with the seed supplier to designate substitute species and quantities in the mix using Part C of the tables. Substitutions will only be allowed at the discretion of the County.

Seeds must be stored in a dry, well-ventilated location away from contaminants. Seed storage humidity level should be lower than 75%. Store any unused seed in a water resistant container. If seed will be stored longer than one (1) year, the optimal temperature range would be 40°F – 60°F.

During transit (from storage to sowing), seed should be protected from dramatic temperature fluctuations day after day; temperature cannot exceed 100°F at any time. Seed must remain dry and protected from sun exposure. The transit period may not exceed ten (10) days.

Obtain native grass seed from any three of the approved providers:

1. Native American Seed, Junction TX
   (800) 728-4043

2. Wildseed Farms, Fredericksburg, TX
   (800) 848-0078

3. Douglass King Company, San Antonio, TX
   (888) 357-3337

Table 1: Type 1 – Tall Native Grass Seed Mix with Wildflowers for Edward's Plateau and Blackland Prairie Eco-Regions

Part A: Wildflowers		
Species	Common Name	lbs. per acre
Cassia (Chamaecrista) fasiculata	Partridge Pea	5.00
Centaurea americana	American Basketflower	5.00
Coreopsis tinctoria	Plains Coreopsis	2.00
Desmanthus illinoensis	Illinois Bundleflower	3.75
Engelmannia pinnatifida (Engelmannia peristenia)	Engelmann Daisy (Cutleaf Daisy)	9.00
Gaillardia pulchella	Indian Blanket	7.50
Helianthus maximiliani	Maximilian Sunflower	2.00
Ipomopsis rubra	Standing Cypress	3.00
Monarda citriodora	Lemon Mint	1.50
Oenothera speciosa	Pink Evening Primrose	0.50
Rudbeckia hirta	Black-eyed Susan	0.50
Thelesperma filifolium	Greenthread	2.00
		41.75
Part B: Grasses		
Species	Common Name	lbs. per acre
Bouteloua curtipendula	Sideoats Grama	14.00
Bouteloua gracilis	Blue Grama	15.00
Buchloe dactyloides	Buffalograss	6.00
Elymus canadensis	Canada (Prairie) Wildrye	10.00
Leptochloa dubia	Green Sprangletop	4.00
Panicum virgatum	Switchgrass (Upland)	2.00
Schizachyrium scoparium	Little Bluestem	4.00
Sorghastrum nutans	Indian Grass	3.00
		58.00
Part C: Replacement Species and/or Species Added for Increased Diversity		
Species	Common Name	lbs. per acre
Andropogon gerardii	Big Bluestem	4.00
Argemone albiflora	White Prickly Poppy	3.00
Bothriochloa laguroides	Silver Bluestem	
Bouteloua rigidiseta	Texas Grama Grass	2.70
Callirhoe leiocarpa	Annual Winecup	1.20
Castilleja indivisa	Indian Paintbrush	0.15
Dalea candida (Petalostemon candidus)	White Prairie Clover	1.00
Eragrostis trichoides	Sand Lovegrass	0.50
liatris mucronata	Gayfeather	2.50
Lindheimera texana	Texas Yellow Star	3.00
Oenothera missouriensis	Missouri Primrose	0.50
Oenothera speciosa	Pink Evening Primrose	0.50
Salvia azurea	Pitcher Sage	0.25
Salvia farinacea	Mealy Blue Sage	1.50
Simsia calva	Bush Sunflower	1.75
Solidago nemoralis	Grey Goldenrod	1.75
"Midway Mix" (Native American Seed)	Grasses 1 ft. – 2 ft. tall	2.50

Source: Lady Bird Johnson Wildflower Center, 2010

Table 2: Type 2 – Tall Native Grass Seed Mix with Wildflowers for Post Oak Savanna Eco-Region

Part A: Wildflowers		
Species	Common Name	lbs. per acre
Cassia (Chamaecrista) fasiculata	Partridge Pea	5.00
Centaurea americana	American Basketflower	5.00
Coreopsis tinctoria	Plains Coreopsis	1.00
Desmanthus illinoensis	Illinois Bundleflower	3.75
Engelmannia pinnatifida (Engelmannia peristenia)	Engelmann Daisy (Cutleaf Daisy)	9.00
Ipomopsis rubra	Standing Cypress	3.00
Monarda citriodora	Lemon Mint	1.50
Oenothera speciosa	Pink Evening Primrose	0.25
Rudbeckia hirta	Black-eyed Susan	0.50
Thelesperma filifolium	Greenthread	2.00
		31.00
Part B: Grasses		
Species	Common Name	lbs. per acre
Bouteloua curtipendula	Sideoats Grama	14.00
Bouteloua gracilis	Blue Grama	15.00
Buchloe dactyloides	Buffalograss	6.00
Elymus canadensis	Canada Wildrye	10.00
Eragrostis trichoides	Sand Lovegrass	0.50
Panicum virgatum	Switchgrass (Upland)	10.00
Schizachyrium scoparium	Little bluestem (Native)	4.00
Sporobolus cryptandrus	Sand Dropseed	1.00
Sorghastrum nutans	Indian Grass	3.00
		63.5
Part C: Replacement Species and/or Species added for Increased Diversity		
Species	Common Name	lbs. per acre
Andropogon gerardii	Big Bluestem Grass	2.00
Argemone albiflora	White Prickly Poppy	2.00
Asclepias tuberosa	Butterfly Weed	2.50
Bouteloua rigidiseta	Texas Grama Grass	2.25
Callirhoe leiocarpa	Annual Winecup	1.00
Castilleja indivisa	Indian Paintbrush	0.15
Corydalis curvisiliqua	Scrambled Eggs	0.50
liatris mucronata	Gayfeather	2.25
Lindheimera texana	Texas Yellow Star	3.00
Salvia azurea	Pitcher Sage	1.50
Salvia farinacea	Mealy Blue Sage	1.50
Simsia calva	Bush Sunflower	1.25
Tridens flavus	Purpletop (Grass)	2.25
"Midway Mix" (Native American Seed)	Grasses 1 ft. – 2 ft. tall	2.00

Source: Lady Bird Johnson Wildflower Center, 2010

Table 3: Type 3 – Riparian Native Grass Seed Mix for Edward's Plateau, Blackland Prairie, and Post Oak Savannah Eco-Regions

Part A: Wildflowers		
Species	Common Name	lbs. per acre
Centaurea Americana	American Basketflower	5.00
Coreopsis tinctoria	Plains Coreopsis	4.00
Desmanthus illinoensis	Illinois Bundleflower	7.50
Engelmannia pinnatifida (Engelmannia peristenia)	Engelmann Daisy (Cutleaf Daisy)	9.00
Helianthus maximiliani	Maximilian Sunflower	2.00
Oenothera speciosa	Pink Evening Primrose	0.50
Rudbeckia (Dracopis) amplexicaulis	Clasping Coneflower	3.00
		31.00
Part B: Grasses		
Species	Common Name	lbs. per acre
Bouteloua curtipendula	Sideoats Grama	14.00
Bouteloua gracilis	Blue Grama	15.00
Buchloe dactyloides	Buffalograss	6.00
Elymus canadensis	Canada (Prairie) Wildrye	10.00
Leptochloa dubia	Green Sprangletop	4.00
Panicum virgatum	Switchgrass (Upland)	2.00
Schizachyrium scoparium	Little Bluestem	4.00
Sorghastrum nutans	Indian Grass	3.00
Tripsacum dactyloides	Eastern Gamagrass	10.00
		68.00
Part C: Replacement Species and/or Species Added for Increased Diversity		
Species	Common Name	lbs. per acre
Andropogon gerardii	Big Bluestem	1.00
Andropogon glomeratus	Bushy Bluestem Grass (for moist areas)	0.50
Chasmanthium latifolium	Inland Sea Oats	1.50
Physostegia intermedia	Obedient Plant	0.50
Solidago altissima (S. canadensis)	Tall Goldenrod	0.75
Solidago gigantea	Giant Goldenrod	0.75
Salvia azurea	Pitcher Sage	0.75
"Midway Mix" (Native American Seed)	Grasses 1 ft. – 2 ft. tall	2.50

Source: Lady Bird Johnson Wildflower Center, 2009

Table 4: Type 4 – Cool Season Native Grass Seed Mix for Edward's Plateau, Blackland Prairie, and Post Oak Savannah Eco-Regions

Species	Common Name	lbs. per acre
Elymus canadensis	Prairie Wildrye	10.00
Pascopyrum smithii	Western Wheatgrass	9.00
Dalea candida (var. candida)	White Prairie Clover	3.00
		22.00

Source: Lady Bird Johnson Wildflower Center, 2009

Table 5: Type 5 – Standard Native Grass Seed Mix for Edward's Plateau and Blackland Prairie Eco-Regions

Species	Common Name	lbs. per acre
Bouteloua curtipendula	Sideoats grama	14.00
Bouteloua gracilis	Blue grama	15.00
Buchloe dactyloides	Buffalograss	6.00
Elymus canadensis	Canada wildrye	10.00
Leptochloa dubia	Green sprangletop	4.00
Panicum virgatum	Switchgrass (upland variety)	2.00
Schizachyrium scoparium	Little bluestem (native)	4.00
Sorghastrum nutans	Indian grass	3.00
		58.00

Source: Lady Bird Johnson Wildflower Center, 2009

Table 6: Type 6 – Standard Native Grass Seed Mix for Post Oak Savannah Eco-Region

Species	Common Name	lbs. per acre
Bouteloua curtipendula	Sideoats grama	14.00
Bouteloua gracilis	Blue grama	15.00
Buchloe dactyloides	Buffalograss	6.00
Elymus canadensis	Canada wildrye	10.00
Eragrostis trichoides	Sand lovegrass	0.50
Panicum virgatum	Switchgrass (upland variety)	10.00
Schizachyrium scoparium	Little bluestem (native)	4.00
Sporobolus cryptandrus	Sand dropseed	1.00
Sorghastrum nutans	Indian grass	3.00
		63.50

Source: Lady Bird Johnson Wildflower Center, 2009

Table 7: Type 7 – Standard Short Native Grass Seed Mix for Edward's Plateau and Blackland Prairie Eco-Regions

Part A: Wildflowers		
Species	Common Name	lbs. per acre
Cassia (Chamaecrista) fasiculata	Partridge Pea	5.00
Coreopsis tinctoria	Plains Coreopsis	1.00
Lupinus texensis	Bluebonnet	15.00
Gaillardia pulchella	Indian Blanket	10.00
Mondarda citriodora	Lemon Mint	3.00
Oenothera speciosa	Pink Evening Primrose	0.50
Rudbecia hirta	Black-eyed Susan	2.00
Thelesperma filifolium	Greenthread	1.50
		38.00
Part B: Grasses		
Species	Common Name	lbs. per acre
Bouteloua curtipendula	Sideoats Grama	21.00
Bouteloua gracilis	Blue Grama	35.00
Buchloe dactyloides	Buffalograss	50.00
Elymus Canadensis	Prairie Wildrye	10.00
Eragrostis trichoides	Sand Lovegrass	0.50
		116.5

Part C: Replacement Species and/or Species added for Increased Diversity		
Species	Common Name	lbs. per acre
Bouteloua rigidiseta	Texas Gama Grass	2.25
Callirhoe leiocarpa	Annual Winecup	1.00
Castilleja indivisa	Indian Paintbrush	0.15
Corydalis curvisiliqua	Scrambled Eggs	0.50
liatris mucronata	Gayfeather	2.25
Oenothera missouriensis	Missouri Primrose	1.75
Dalea candida (Petalostemon candidus)	White Prairie Clover	0.75
Salvia farinacea	Mealy Blue Sage	1.50
Simsia calva	Bush Sunflower	1.75
"Midway Mix" (Native American Seeds)	Grasses 1 ft. – 2 ft. tall	2.50

Source: Lady Bird Johnson Wildflower Center, 2010

Table 8: Type 8 – Standard Short Native Grass Seed Mix For Post Oak Savannah Eco-Region

Part A: Wildflowers		
Species	Common Name	lbs. per acre
Cassia (Chamaecrista) fasiculata	Partridge Pea	5.00
Centaurea americana	American Basketflower	5.00
Coreopsis tinctoria	Plains Coreopsis	2.00
Desmanthus illinoensis	Illinois Bundleflower	3.75
Engelmannia pinnatifida	Engelmann Daisy (Cutleaf Daisy)	9.00
Gaillardia pulchella	Indian Blanket	7.50
Ipomopsis rubra	Standying Cypress	3.00
Mondardo citriodora	Lemon Mint	1.50
Oenothera speciosa	Pink Evening Primrose	0.25
Rudbecia herta	Black-eyed Susan	0.50
Thelesperma filifolium	Greenthread	2.00
		39.50
Part B: Grasses		
Grasses	Species	lbs. per acre
Bouteloua curtipendula	Sideoats Grama	14.00
Bouteloua gracilis	Blue Grama	15.00
Buchloe dactyloides	Buffalograss	6.00
Elymus canadensis	Canada Wildrye	10.00
Schizachyrium scoparium	Little Bluestem (Native)	8.00
		53.00
Part C: Replacement Species and/or Species added for Increased Diversity		
Grasses	Species	lbs. per acre
Argemone albiflora	White Prickly Poppy	2.50
Bouteloua rigidiseta	Texas Grama Grass	2.75
Callirhoe leiocarpa	Annual Winecup	1.00
Castilleja indivisa	Indian Paintbrush	0.15
Eragrostis trichoides	Sand Lovegrass	0.50
liatris mucronata	Gayfeather	2.50

Lindheimera texana	Texas Yellow Star	3.00
Oenothera missouriensis	Missouri Primrose	0.50
Oenothera speciosa	Pink Evening Primrose	0.25
Salvia azurea	Pitcher Sage	0.75
Salvia farinacea	Mealy Blue Sage	1.50
Simsia calva	Bush Sunflower	1.25
"Midway Mix" (Native American Seeds)	Grasses 1 ft. – 2 ft. tall	2.50

Source: Lady Bird Johnson Wildflower Center, 2010

Table 9: Type 9 – Bare Patch Repair Mix for Edward's Plateau, Blackland Prairie, and Post Oak Savannah Eco-Regions

Species	Common Name	lbs. per acre
Bouteloua curtipendula	Sideoats grama	25.00
Bouteloua gracilis	Blue grama	10.00
Leptochloa dubia	Green sprangletop	10.00
		45.00

Source: Lady Bird Johnson Wildflower Center, 2009

Table 10: Type 10 – Warm Season Mix for Edward's Plateau, Blackland Prairie, and Post Oak Savannah Eco-Regions

Species	Common Name	lbs. per acre
Seleria italica	Foxtail Millet	34
		34

Table 11: Type 11 – Substitute Standard Mix for Blackland Prairie Eco-Regions

Species	Common Name	lbs. per acre
Cynodon dactylon	Bermuda	10
		10

B. Cool Season Temporary Cover Seed

If native grass seed is to be installed during the winter period of November 8th to February 14th, then Table 4 (temporary cool season mix) must be incorporated into the native grass seed mix, as specified on the plans, or as directed.

C. Warm Season Temporary Cover Seed

Between the dates of May 1st to August 31st, use Temporary Warm Season Seeding (Type 10) as specified on the plans, or as directed.

D. Warm Season Permanent Cover Seed Substitute

For installation in areas with curb and gutter, substitute applicable Type 7 or Type 8 Standard Short Native Grass Seed in lieu of Tall Native selections.

E. Substitute Standard Mix for Blackland Prairie Eco-Regions

Table 11 (Type 11) may be substituted in areas where adjacent private property employs the use of herbicides which limits the plant establishment of specified seasonal seeding.

F. Compost Manufactured Topsoil (CMT) and Erosion Control Compost (ECC)

As specified in Item 161–WC001, “Compost.”

G. Topsoil

As specified in Item 160–WC001, “Topsoil.”

H. Humic Acid

Humic Acid can be obtained from the following supplier or approved equal:

1. Medina Agriculture Products
   (830) 426-3011

I. Fertilizer

Use a complete fertilizer containing nitrogen (N), phosphoric acid (P), and potash (K) nutrients. Ensure at least 50% of the nitrogen component is a slow-release sulfur-coated urea. Ensure that fertilizer is in an acceptable condition for distribution in containers labeled with product analysis. Fertilizer is subject to testing in accordance with Texas Fertilizer Law. Deliver and apply the complete fertilizer uniformly, as a dry material, at a rate equal to 60 lbs. of nitrogen per acre or at the analysis and rate specified on the plans.

J. Mycorrhizal Fungi

MycoApply Endo, produced by Mycorrhizal Applications, Inc., can be obtained from the following supplier or approved equal:

1. Horizon Distributors, Inc.
   (512) 282-2331

This product will require de-chlorinated, clean, fresh water for application.

K. Vegetative Watering

Clean, fresh, and free of substances or matter that could inhibit vigorous growth of plants. As specified in Item 168–WC001, “Vegetative Watering.”

L. No Mowing Notice Sign

As specified in Item 636, “Aluminum Signs.”

M. Sign Support

As specified in Item 644, “Small Roadside Sign Supports and Assemblies.”

PART 3 – EXECUTION

3.1 SEQUENCING

A. Following fine grading and topsoil or compost/fertilizer installation, initiate seed installation as specified in the plans or as directed to disturbed roadside areas and channels. If road base operations have not been completed, exclude seeding install fifteen (15) ft. from the road pavement.

B. Following road pavement, initiate seed installation following grading and topsoil or compost/fertilizer installation to remaining disturbed areas, as specified in the plans or as directed.

C. Install no mowing notice signs in accordance with the plans or as directed at time of Final Acceptance.

3.2 CONSTRUCTION

A. Installation

1. Remove and dispose of objectionable material from the topsoil source before beginning the work.

B. Site Preparation

1. Remove all invasive species.

a. Invasive weeds, either living plants or weed seed, shall be minimized at the site using appropriate herbicide application and/or weed-free soil amendments. Mow, burn, or apply herbicides as needed to control unwanted vegetation as directed.

2. Seed should not be installed onto compacted soil. Scarify or break the surface of the soil with a flexible tine one (1) to two (2) inches in depth in the area to be seeded.

3. Apply specified compost/fertilizer and/or topsoil to the seeding surface (refer to plans for required depth).

4. Humic Acid concentrate shall be mixed with clean, fresh water prior to application. Apply humic acid and water mixture to all areas to receive any type of native grass seeding at the rate of one (1) gallon of humic acid concentrate per acre (or 0.16 teaspoons per square yard).

5. MycoApply Endo shall be mixed with de-chlorinated, clean, fresh water prior to application. The water MUST be de-chlorinated or the fungi in the MycoApply Endo will die. Apply MycoApply Endo mixture to all areas to receive any type of native grass seeding at the rate of 10 lbs. per acre (or 0.0336 ounces per square yard).

6. The humic acid and the MycoApply Endo can be mixed together with de-chlorinated water and applied to areas to receive any native grass seeding at the same time. The water MUST be de-chlorinated or the fungi in the MycoApply Endo will die.

7. Seed area in accordance with the plans or as directed, with regard to installation specification below.

C. Installation

Apply the entire specified amount of seed to the area to be seeded. Application rates should be set to allow at least two complete passes over seeding area so the area is completely and evenly covered. Lightly rake compost and/or topsoil to ensure good seed contact. Seeds should not be buried at a depth over ¼ inches.

1. Broadcast Seeding

All areas shown to be seeded in the plans must be broadcast unless otherwise directed by the Engineer. Broadcast seed using hand or mechanical distribution in a uniform manner. Coordinate the application rate setting with the Owner's Representative prior to application. Apply seed on the surface of compost or topsoil. The seedbed should be culti-packed or rolled before and after seeding to ensure seed contact with the soil. Roll the seeding areas along slope contours. Wind speed should be fifteen (15) mph or less during seeding. Up to one-third ($^1/_3$) of the seed may remain on top of the soil surface.

2. No-Till Drill Seeding

No-till drill seeding should only be used when directed by the Engineer. Use a no-till drill to reduce the risk of erosion and loss of seed. Ensure the drill opening size is adequate to allow free movement of full range of seed sizes being planted. Coordinate the application rate setting with the Owner's Representative prior to application. Plant seed parallel to the contour of the slopes.

3. Pre-mixing Seed with Compost (CMT and ECC)

Apply uniform dry mixture of seed and compost pneumatically only as directed by the Engineer in areas shown in the plans to a depth not to exceed two (2) inches. Pre-mixing the seed with compost will aid in a uniform application of seed.

D. Seeding Schedule

1. The preferred time to seed is from September 21st to November 7th to take advantage of winter rains.

2. Native Grass Seeding Schedule:

Table 12: Seeding Schedule

	OPTIMUM PLANTING TIME			
	Fall Seeding	Winter Seeding	Spring Seeding	Summer Seeding
Seeding Dates	Sept. 21st – Nov. 7th	Nov. 8th – Feb. 14th	Feb. 15th – June 15th	June 16th – Sept. 20th
Grass Type	Type 1 Type 2 Type 5 Type 7 Type 8 Type 9 Type 11	Type 1 Type 2 Type 5 Type 6 Type 7 Type 9 Type 11	Type 5 or 6	Type 10
		PLUS	PLUS (Only if Directed)	PLUS
Supplemental Grass		Apply the Table 4: Type 4 Cool Season Non-Native Grass Seed Mix	Apply the Table 2: Type 2 Wildflower Seed Mix in the next Fall Seeding Time Period	Apply the Permanent Type 1,Type 3, or Type 5 Grass Mix in the Fall Seeding Time Period

E. Vegetative Watering

Provide vegetative watering to seeded areas shown on the plan immediately after seed installation for healthy vegetative establishment, in accordance with Item 168-WC001, "Vegetative Watering" or as directed.

F. No Mow Signs

At final acceptance, post signs at locations indicated on the plans or as directed to prevent mowing of established native grass stands.

3.3 MAINTENANCE

A. Requirements

1. Maintain the native grass areas during and after construction until the certificate of completion is issued.

2. Maintain the ECC if the seeding time falls in the summer period. Seed the specified grass mix when the fall seeding period begins.

3. Maintain native grass areas to establish vigorous growth and plant establishment of native grass mix. Establish an overall vegetative cover of 70% – 80% minimum with no single bare area larger than 100 SF. Areas should have at least 30% of species diversity and be four (4) to six (6) inches in height.

4. Watering of the native grass seed shall be in accordance with Item 168-WC001, "Vegetative Watering."

5. Posted signs should be repaired or replaced immediately if found to be damaged or missing.

B. Schedule

1. Inspect the grass areas weekly and within 24 hours after each rain event of one-half (½) inch or more. Restore eroded areas to finished grade and reseed.

2. Reseed areas that have not established if grass cover is less than 80% of coverage (TCEQ, 2005).

3. Inspect seeded areas every two weeks during establishment phase to check for invasive species, refer to Invasive Species Control.

END OF SECTION

Special Provision 168-WC001
Vegetative Watering

For this project, Item 168, "Vegetative Watering," of the Standard Specifications, is hereby voided and replaced in its entirety with the clauses and requirements below.

PART 1 – GENERAL

1.1 DESCRIPTION

Provide and distribute water to promote growth of vegetation as specified or as directed.

1.2 RELATED ITEMS

A. Item 164-WC001, "Seeding for Erosion Control"

B. Item WC104, "Wildflower Seeding"

C. Item 170, "Irrigation System"

1.3 MEASUREMENT

This item will be measured by the 1000 gallons as applied.

1.4 PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Vegetative Watering." This price is full compensation for furnishing and operating watering equipment and measuring devices for furnishing and applying water, including hauling, equipment, labor, and incidentals.

1.5 QUALITY CONTROL SUBMITTALS

A. Submit water source and technique of application for approval.

B. Submit a layout drawing and shop drawings of the temporary irrigation system (drip or rotor/spray irrigation) for approval.

C. Submit a report of pH and soluble salt levels of the irrigation water for approval prior to installation.

D. Submit a weekly report for each delivery of water per water truck, if source of water is off-site.

PART 2 – PRODUCTS

2.1 MATERIALS

A. Water

Use water that is clean and free of industrial wastes and other substances harmful to the growth of vegetation. Do not incorporate fertilizer into the water for irrigation. The pH should be between 6.5 and 8.4 to be acceptable for use as irrigation water (MSUES, 2009). Soluble salt levels between 0 and 1,500 mmhos/cm are acceptable for use (CTIP, 2008).

B. Temporary Irrigation

For materials, refer to Item 170, “Irrigation System.”

PART 3 – EXECUTION

3.1 SEQUENCING

A. Vegetative watering shall commence following installation of seeding and plants.

3.2 CONSTRUCTION

A. Schedule

1. Apply vegetative watering in the appropriate quantities and frequencies shown in Table 2 for native grass and wildflower seeded areas and Table 3 for planted trees and shrubs or to replace moisture loss per evapotranspiration (ET) rate, whichever is greater. Significant on-site rainfall of one-half (½) inch or greater allows the postponement of watering until the next scheduled irrigation.

2. Daily ET rates for the County may be found at this AgriLife Extension website: http://texaset.tamu.edu/

See an example as shown in Table 1.

How to use this table: Look at the first column, ETo, for the inches of water lost per day in evapotranspiration. Add the inches for the last 7 or 14 days (depending on your watering phase shown in Tables 2 and 3) of ETo to get the total number of inches lost by evapotranspiration. This is the amount of watering that needs to be applied to the vegetation at the frequency given in Tables 2 and 3.

Table 1: ET and Weather Data – 14 Day Table (for example only)

Georgetown II Weather Station
Station Sponsored by : Williamson County Extension

Date	ETo PET (in)	Tmax (F)	Tmin (F)	RHmin (%)	Solar (MJm2)	Rain (in)	Wind 4am (mph)	Wind 4pm (mph)
2010-08-26	0.20	90	76	35	15.47	0.00	4.91	4.15
2010-08-27	0.25	93	67	21	26.20	0.00	0.33	7.51
2010-08-28	0.24	95	62	23	26.05	0.00	0.10	4.28
2010-08-29	0.29	95	70	32	22.64	0.00	8.42	8.55
2010-08-30	0.30	96	78	38	20.19	0.00	8.73	8.46
2010-08-31	0.27	95	75	41	21.45	0.00	5.91	6.64
2010-09-01	0.28	95	77	38	21.56	0.00	5.55	6.35
2010-09-02	0.22	91	77	49	17.02	0.00	8.52	6.62
2010-09-03	0.16	84	71	49	11.92	0.18	1.34	9.83
2010-09-04	0.25	88	69	37	23.25	0.00	4.65	6.88
2010-09-05	0.24	91	67	32	23.00	0.00	0.49	6.55
2010-09-06	0.20	89	69	54	18.45	0.05	2.96	11.46
2010-09-07	0.06	77	72	84	2.64	4.74	4.73	14.46
2010-09-08	0.11	83	74	73	7.36	4.69	12.68	4.04
14 Day Summary	3.07	90	72	43	18.37	9.66	4.95	7.56

Note: Reported are the average hourly values, not the absolute highs and lows.
Source: AgriLIFE EXTENSION - Texas A&M System

Table 2: Vegetative Watering Schedule for Native Grass, Wildflower Seeding, and Live Root Plantings

Time Period	Irrigation Application Amount*	Frequency**
Day of Installation	Min. 1 inch	Min. 2 times per day
Phase 1 – Next 10 days	Min. 1 inch	Min. 1 time per day (no rain)
Phase 2 – Next 14 days	Min. 1 inch or replace weekly ET	Min. 2 times per week (no rain or dew)
Phase 3 – Until Plant Establishment	Min. 1.5 inches or replace weekly ET	Min. 1 time per every other week, or as necessary***

Source: Adapted from COA, 2009 & TCEQ, 2005.

Note 1: *5.6 gallons per square yard = 1 inch of applied water

Note 2: **Reduce irrigation frequency if during period of seasonal rains, since the watering frequency will greatly depend on the time of year. Deviations from the above watering schedule should be approved.

Note 3: ***Irrigation in Phase 3 should pause during the dormant season, beginning on December 15th, and should be reinstated beginning February 15th.

Note 4: Reference Item 164-WC001, "Seeding for Erosion Control" 3.3 Maintenance Requirements for plant establishment specifications.

Note 5: Stop irrigation if there is puddling.

Table 3: Vegetative Watering Schedule for Planted Trees and Shrubs

Time Period	Irrigation Application Amount*	Frequency**
Day of Installation	Saturate Root Depth	Min. 1 times per day
Phase 1 – Next 14 days	Saturate Root Depth	Min. 1 time per every other day, or as necessary
Phase 2 – Until Plant Establishment	Saturate Root Depth	Min. 1 time per week, or as necessary***

Source: Adapted from COA, 2009 & TCEQ, 2005.

Note 1: *5.6 gallons per square yard = 1 inch of applied water

Note 2: **Reduce irrigation frequency if during period of seasonal rains, since the watering frequency will greatly depend on the time of year. Deviations from the above watering schedule should be approved.

Note 3: ***Irrigation in Phase 2 should pause during the dormant season, beginning on December 15th, and should be reinstated beginning February 15th.

Note 4: Stop irrigation if there is puddling.

B. General Guidelines:

1. Contractor should determine the vegetative watering technique (temporary drip irrigation, temporary rotor or spray irrigation, or water truck) most appropriate for the project if not specified in the plans.

2. After approval of drip or rotor/spray irrigation technique (if selected as the appropriate technique), produce shop drawings for these systems for approval by the Engineer.

3. Apply water to all newly vegetated areas as shown on the plans or as directed.

4. Irrigation water should not cause excessive run-off.

5. Water should ensure 100% coverage on all seeded and planted areas.

6. Overspray onto pavement is not allowed.

C. Temporary drip irrigation guidelines:

1. Install temporary drip irrigation lines per approved shop drawings.

2. Irrigation system should provide coverage to 100% of plant establishment areas.

3. Drip irrigation water should come from one of the following sources, submit water source for approval.

   a. Tie into existing water source or well.

   b. Pump water from nearby creek or river with the use of a generator. Obtain approval from Construction Observer prior to pumping.

   c. Tie temporary irrigation line to a water truck.

   d. Store water in a storage tank and locate at the highest elevation on the site to effectively move water to each emitter through pressure.

4. Pressure compensating emitters should be used on hilly sites.

5. Two emitters should be placed at each plant to ensure adequate watering in case one emitter becomes clogged.

6. Drip system components may consist of barbed emitters in polyethylene tubing or in-line emitter tubing. Spaghetti tubing from multi-nozzle emitter heads should not be used due to ease of damage and numerous parts involved.

7. Irrigation piping and all related equipment should be removed from site at acceptance at the conclusion of the establishment period.

D. Temporary rotor or spray irrigation guidelines:

1. Install temporary rotor or spray irrigation lines per approved shop drawings.

2. Irrigation system should provide coverage to 100% of plant establishment areas.

3. Rotor or spray water should come from one of the following sources, submit water source to Owner's representative for approval.

a. Tie into existing water source or well.

b. Pump water from nearby creek or river with the use of a generator. Obtain approval from Construction Observer prior to pumping.

c. Tie temporary irrigation line to a water truck.

d. Store water in a storage tank and locate at the highest elevation on the site to effectively move water to each emitter through pressure.

4. Pressure compensating emitters shall be used on hilly sites.

5. Collect water lines and all irrigation equipment at the conclusion of the establishment period.

E. Water truck distribution:

1. Furnish and operate water truck equipment to apply water at a uniform and controllable rate that does not scour or erode the soil or seeding bed or wash away seeds or plantings. Applying water in multiple passes may be necessary to avoid scouring or erosion.

2. The water truck operator should not drive within designated seeding or planting areas.

3. The water spray should be directed upwards to distribute the water force and reduce potential erosion.

3.3 MAINTENANCE

A. The contractor should maintain the irrigation system and inspect designated seeding or planting areas after each watering to ensure adequate water distribution. If erosion or seed washout occurs, soil and compost shall be restored to finished grade and the area shall be reseeded (refer to Item 164-WC001, "Seeding for Erosion Control").

B. Irrigation water lines should remain intact and functioning during the establishment period. The contractor should inspect equipment, including drip lines, connectors, and main lines on a regular basis to ensure that they are operable and do not leak. Broken water lines should be repaired immediately.

C. The site should be inspected after irrigation applications to ensure watering trucks have not eroded soil or compost or washed out seeds or plants. Soils compacted by water trucks are to be ripped. Refer to Item WC101, "Soil Ripping." Damaged areas should be regraded and reseeded immediately.

END OF SECTION

Special Provision to Item 300
Asphalts, Oils, and Emulsions

Item 300, "Asphalts, Oils, and Emulsions," of the Standard Specifications is amended with respect to the clauses cited below. No other clauses or requirements of this Item are waived or changed.

Article 300.2., "Materials." The first paragraph is voided and replaced by the following.

Provide asphalt materials that meet the stated requirements when tested in accordance with the referenced Department, AASHTO, and ASTM test methods. Use asphalt containing recycled materials only if the recycled components meet the requirements of Article 6.9, "Recycled Materials." Provide asphalt materials that the Department has preapproved for use in accordance with Tex-545-C, "Asphalt Binder Quality Program."

Inform the Department of all additives or modifiers included in the asphalt binder as part of the facility quality plan, as required by Tex-545-C, "Asphalt Binder Quality Program," and provide that information to Department personnel. The Department reserves the right to prohibit the use of any asphalt additive or modifier.

Section 300.2.10. "Performance-Graded Binders," is supplemented by the following:

Limit the use of polyphosphoric acid to no more than 0.5% by weight of the asphalt binder.

Limit the use of re-refined engine oil bottoms to no more than 5.0% by weight of the asphalt binder.

Special Provision to Item 421
Hydraulic Cement Concrete

Item 421, "Hydraulic Cement Concrete" of the Standard Specifications is amended with respect to the clauses cited below. No other clauses or requirements of this Item are waived or changed.

Article 421.4.2, "Mix Design Proportioning," Table 8 is voided and replaced by the following.

Table 8
Concrete Classes

Class of Concrete	Design Strength,[1] Min f'_c (psi)	Max w/cm Ratio	Coarse Aggregate Grades[2,3,4]	Cement Types	Mix Design Options	Exceptions to Mix Design Options	General Usage[5]
A	3,000	0.60	1–4, 8	I, II, I/II, IL, IP, IS, IT, V	1, 2, 4, & 7	When the cementitious material content does not exceed 520 lb./cu. yd., Class C fly ash may be used instead of Class F fly ash.	Curb, gutter, curb & gutter, conc. retards, sidewalks, driveways, back-up walls, anchors, non-reinforced drilled shafts
B	2,000	0.60	2–7				Riprap, traffic signal controller foundations, small roadside signs, and anchors
C[6]	3,600	0.45	1–6	I, II, I/II, IP, IS, IT[7], V	1–8		Drilled shafts, bridge substructure, bridge railing, culverts except top slab of direct traffic culverts, headwalls, wing walls, inlets, manholes, concrete traffic barrier
E	3,000	0.50	2–5	I, II, I/II, IL, IP, IS, IT[7], V	1–8	When the cementitious material content does not exceed 520 lb./cu. yd., Class C fly ash may be used instead of Class F fly ash.	Seal concrete
F[6]	Note[8]	0.45	2–5	I, II, I/II, IP, IS, IT[7], V			Railroad structures; occasionally for bridge piers, columns, or bents
H[6]	Note[8]	0.45	3–6	I, II, I/II, III, IP, IS, IT[7], V	1–5	Do not use Type III cement in mass placement concrete. Up to 20% of blended cement may be replaced with listed SCMs when Option 4 is used for precast concrete.	Precast concrete, post-tension members
S[6]	4,000	0.45	2–5	I, II, I/II, IP, IS, IT[7], V	1–8		Bridge slabs, top slabs of direct traffic culverts, approach slabs
P	See Item 360, "Concrete Pavement."	0.50	2–3	I, II, I/II, IL, IP, IS, IT, V	1–8	When the cementitious material content does not exceed 520 lb./cu. yd., Class C fly ash may be used instead of Class F fly ash.	Concrete pavement
CO[6]	4,600	0.40	6	I, II, I/II, IP, IS, IT[7], V	1–8		Bridge deck concrete overlay
LMC[6]	4,000	0.40	6–8				Latex-modified concrete overlay
SS[6]	3,600	0.45	4–6		1-8	Use a minimum cementitious material content of 658 lb./cu. yd. of concrete. Limit the alkali loading to 4.0 lbs./cu. yd. or less when using option 7.	Slurry displacement shafts, underwater drilled shafts

Class of Concrete	Design Strength,[1] Min f'c (psi)	Max w/cm Ratio	Coarse Aggregate Grades[2,3,4]	Cement Types	Mix Design Options	Exceptions to Mix Design Options	General Usage[5]
K[6]	Note[8]	0.40	Note[8]	I, II, I/II, III IP, IS, IT[7], V	1-8		Note[8]
HES	Note[8]	0.45	Note[8]	I, IL, II, I/II, III		Mix design options do not apply. 700 lb. of cementitious material per cubic yard limit does not apply.	Concrete pavement, concrete pavement repair
"X" (HPC) [6,9,10]	Note[11]	0.45	Note[11]	I, II, I/II, III IP, IS, IT[7], V	1–5, & 8	Maximum fly ash replacement for Options 1 and 3 may be increased to 45%. Up to 20% of a blended cement may be replaced with listed SCMs for Option 4. Do not use Option 8 for precast concrete.	
"X" (SRC) [6,9,10]	Note[11]	0.45	Note[11]	I/II, II, IP, IS, IT[7], V	1–4 , & 7	Do not use Class C Fly Ash. Type III-MS may be used where allowed. Type I and Type III cements may be used with Options 1–3, with a maximum w/cm of 0.40. Up to 20% of blended cement may be replaced with listed SCMs when Option 4 is used for precast concrete. Do not use Option 7 for precast concrete[12].	

1. Design strength must be attained within 56 days.
2. Do not use Grade 1 coarse aggregate except in massive foundations with 4 in. minimum clear spacing between reinforcing steel bars, unless otherwise permitted. Do not use Grade 1 aggregate in drilled shafts.
3. Use Grade 8 aggregate in extruded curbs unless otherwise approved.
4. Other grades of coarse aggregate maybe used in non-structural concrete classes when allowed by the Engineer.
5. For information only.
6. Structural concrete classes.
7. Do not use Type IT cements containing > 5% limestone.
8. As shown on the plans or specified.
9. "X" denotes class of concrete shown on the plans or specified.
10. (HPC): High Performance Concrete, (SRC): Sulfate Resistant Concrete.
11. Same as class of concrete shown on the plans.
12. Option 7 will be allowed for precast concrete products included in Items 462, 464, and 465.

Article 421.4.2.2, "Aggregates," is supplemented by the following.

Use the following equation to determine if the aggregate combination meets the sand equivalency requirement when blending fine aggregate or using an intermediate aggregate:

$$\frac{(SE_1 \times P_1) + (SE_2 \times P_2) + (SE_{ia} \times P_{ia})}{100} \geq 80\%$$

where:
SE_1 = sand equivalency (%) of fine aggregate 1
SE_2 = sand equivalency (%) of fine aggregate 2
SE_{ia} = sand equivalency (%) of intermediate aggregate passing the 3/8 in. sieve
P_1 = percent by weight of fine aggregate 1 of the fine aggregate blend
P_2 = percent by weight of fine aggregate 2 of the fine aggregate blend
P_{ia} = percent by weight of intermediate aggregate passing the 3/8 in. sieve

Article 421.4.2.5, "Slump," the second paragraph is voided and not replaced.

Article 421.4.2.7, "Optimized Aggregate Gradation (OAG) Concrete," the first sentence of the first paragraph is voided and replaced by the following.

The gradations requirements in Table 4 and Table 6 do not apply when OAG concrete is specified or used by the Contractor unless otherwise shown on the plans.

Article 421.4.6.2, "Delivering Concrete," the fifth paragraph is voided and replaced with the following:

Begin the discharge of concrete delivered in truck mixers within the times listed in Table 14. Concrete delivered after these times, and concrete that has not begun to discharge within these times will be rejected.

Article 421.4.8.3, "Testing of Fresh Concrete," is voided and replaced with the following:

Testing Concrete. The Engineer, unless specified in other Items or shown on the plans, will test the fresh and hardened concrete in accordance with the following methods:

- Slump. Tex-415-A
- Air Content. Tex 414-A or Tex-416-A
- Temperature. Tex-422-A
- Making and Curing Strength Specimens. Tex-447-A
- Compressive Strength. Tex-418-A
- Flexural Strength. Tex-448-A
- Maturity. Tex-426-A

Flexural strength and maturity specimens will not be made unless specified in other items or shown on the plans. Concrete not meeting fresh concrete testing requirements will be rejected. Fresh concrete exhibiting segregation and excessive bleeding will be rejected.

Article 421.4.8.3.1. "Job-Control Testing," is voided and not replaced.

Special Provision to Item 500
Mobilization

Item 500, "Mobilization," of the Standard Specifications is amended with respect to the clauses cited below. No other clauses or requirements of this Item are waived or changed.

Article 500.3., "Payment." The 6th and 7th bullet is deleted and replaced by the following:

- Upon Final Completion, 97% of the mobilization lump sum bid will be paid. Previous payments under this Item will be deducted from this amount, and

- Payment for the remainder of the lump sum bid for "Mobilization" will be made with the Final Payment after all submittals are received, final quantities have been determined, and when any separate vegetative establishment and maintenance, test, and performance periods provided for in the Contract have been successfully completed and the County has issued the Certificate of Acceptance.

Special Provision to Item 502
Barricades, Signs, and Traffic Handling

For this project, Item 502, "Barricades, Signs, and Traffic Handling," of the Standard Specifications is amended with respect to the clauses cited below. No other clauses or requirements of this Item are waived or changed.

Article 502.4.1.3., "Maximum Total Payment Prior to Acceptance" is voided and replaced by the following:

> Maximum Total Payment Prior to Completion. The total payment for this Item will not exceed 10% of the total Contract amount before final completion in accordance with General Conditions of Agreement, Section 5.06, "Final Completion and Acceptance." The remaining balance will be paid in accordance with Section 502.4.1.5, "Balance Due."

Article 502.4.1.5., "Balance Due" is voided and replaced by the following:

> Balance Due. If all work is complete in accordance with General Conditions of Agreement, Section 5.06, "Final Completion and Acceptance," before payment of the amount allowed by this Article, the balance due will be paid with the Final Payment.

Special Provision 506-WC001

Temporary Erosion, Sedimentation, and Environmental Controls

For this project, Item 506, "Temporary Erosion, Sedimentation, and Environmental Controls," of the Standard Specifications, is hereby voided and replaced with the following.

PART 1 – GENERAL

1.1 DESCRIPTION

Install, maintain, and remove erosion, sedimentation, and environmental control measures to prevent or reduce the discharge of pollutants in accordance with the Storm Water Pollution Prevention Plan (SW3P) in the plans and the Texas Pollutant Discharge Elimination System (TPDES) General Permit TXR150000.

1.2 MEASUREMENT

A. Rock Filter Dams

Installation or removal of rock filter dams will be measured by the foot or by the cubic yard. The measured volume will include sandbags when used.

1. Linear Measurement

When rock filter dams are measured by the foot, measurement will be along the centerline of the top of the dam.

2. Volume Measurement

When rock filter dams are measured by the cubic yard, measurement will be based on the volume of rock computed by the method of average end areas.

a. Installation: Measurement will be made in final position.

b. Removal: Measurement will be made at the point of removal.

B. Temporary Pipe Slope Drains

Temporary pipe slope drains will be measured by the foot.

C. Temporary Paved Flumes

Temporary paved flumes will be measured by the square yard of surface area. The measured area will include the energy dissipater at the flume outlet.

D. Construction Exits

Construction exits will be measured by the square yard of surface area.

E. Earthwork for Erosion and Sediment Control

1. Equipment and Labor Measurement

   Equipment and labor used will be measured by the actual number of hours the equipment is operated and the labor is engaged in the work.

2. Volume Measurement

   a. In Place

      i. Excavation

         Excavation will be measured by the cubic yard in its original position and the volume computed by the method of average end areas.

      ii. Embankment

         Embankment will be measured by the cubic yard in its final position by the method of average end areas. The volume of embankment will be determined between:

         - the original ground surfaces or the surface upon that the embankment is to be constructed for the feature and
         - the lines, grades, and slopes of the accepted embankment for the feature.

   b. In Vehicles

      Excavation and embankment quantities will be combined and paid for under "Earthwork (Erosion and Sediment Control, In Vehicle)." Excavation will be measured by the cubic yard in vehicles at the point of removal. Embankment will be measured by the cubic yard in vehicles measured at the point of delivery. Shrinkage or swelling factors will not be considered in determining the calculated quantities.

F. Construction Perimeter Fence

   Construction perimeter fence will be measured by the foot.

G. Sandbags for Erosion Control

   Sandbags will be measured as each sandbag or by the foot along the top of sandbag berms or dams.

H. Temporary Sediment-Control Fence

   Installation or removal of temporary sediment-control fence will be measured by the foot.

I. Biodegradable Erosion Control Logs

   Installation or removal of biodegradable erosion control logs will be measured by the foot along the centerline of the top of the control logs.

J. Vertical Tracking

   Vertical tracking will not be measured or paid for directly, but is considered subsidiary to this Item.

1.3 PAYMENT

The following will not be paid for directly, but are subsidiary to pertinent Items:

- erosion-control measures for Contractor project-specific locations (PSLs) inside and outside the right-of-way (such as construction and haul roads, field offices, equipment and supply areas, plants, and material sources);

- removal of litter, unless a separate pay item is shown on the plans;
- repair to devices and features damaged by Contractor operations;
- added measures and maintenance needed due to negligence, carelessness, lack of maintenance, and failure to install permanent controls;
- removal and reinstallation of devices and features needed for the convenience of the Contractor;
- finish grading and dressing upon removal of the device; and
- minor adjustments including, but not limited to plumbing posts, reattaching fabric, minor grading to maintain slopes on an erosion embankment feature, or moving small numbers of sandbags.

Stabilization of disturbed areas will be paid for under pertinent Items.

Furnishing and installing pipe for outfalls associated with sediment traps and ponds will not be paid for directly, but is subsidiary to the excavation and embankment under this Item.

A. Rock Filter Dams

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid as follows:

1. Installation

Installation will be paid for as "Rock Filter Dams (Install)" of the type specified. This price is full compensation for furnishing and operating equipment, finish backfill and grading, lacing, proper disposal, labor, materials, tools, and incidentals.

2. Removal

Removal will be paid for as "Rock Filter Dams (Remove)." This price is full compensation for furnishing and operating equipment, proper disposal, labor, materials, tools, and incidentals.

When the Owner directs that the rock filter dam installation or portions thereof be replaced, payment will be made at the unit price bid for "Rock Filter Dams (Remove)" and for "Rock Filter Dams (Install)" of the type specified. This price is full compensation for furnishing and operating equipment, finish backfill and grading, lacing, proper disposal, labor, materials, tools, and incidentals.

B. Temporary Pipe Slope Drains

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Temporary Pipe Slope Drains" of the size specified. This price is full compensation for furnishing materials, removal and disposal, furnishing and operating equipment, labor, tools, and incidentals.

Removal of temporary pipe slope drains will not be paid for directly, but is subsidiary to the installation Item. When the Owner directs that the pipe slope drain installation or portions thereof be replaced, payment will be made at the unit price bid for "Temporary Pipe Slope Drains" of the size specified, which is full compensation for the removal and reinstallation of the pipe drain.

Earthwork required for the pipe slope drain installation, including construction of the sediment trap, will be measured and paid for under "Earthwork for Erosion and Sediment Control."

Riprap concrete or stone, when used as an energy dissipater or as a stabilized sediment trap, will be measured and paid for in accordance with Item 432, "Riprap."

C. Temporary Paved Flumes

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Temporary Paved Flume (Install)" or "Temporary Paved Flume (Remove)." This price is full compensation for furnishing and placing materials, removal and disposal, equipment, labor, tools, and incidentals.

When the Owner directs that the paved flume installation or portions thereof be replaced, payment will be made at the unit prices bid for "Temporary Paved Flume (Remove)" and "Temporary Paved Flume (Install)." These prices are full compensation for the removal and replacement of the paved flume and for equipment, labor, tools, and incidentals.

Earthwork required for the paved flume installation, including construction of a sediment trap, will be measured and paid for under "Earthwork for Erosion and Sediment Control."

D. Construction Exits

Contractor-required construction exits from off right-of-way locations or on right-of-way PSLs will not be paid for directly, but are subsidiary to pertinent Items.

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" for construction exits needed on right-of-way access to work areas required by the Owner will be paid for at the unit price bid for "Construction Exits (Install)" of the type specified or "Construction Exits (Remove)." This price is full compensation for furnishing and placing materials, excavating, removal and disposal, cleaning vehicles, labor, tools, and incidentals.

When the Owner directs that a construction exit or portion thereof be removed and replaced, payment will be made at the unit prices bid for "Construction Exit (Remove)" and "Construction Exit (Install)" of the type specified. These prices are full compensation for the removal and replacement of the construction exit and for equipment, labor, tools, and incidentals.

Construction of sediment traps used in conjunction with the construction exit will be measured and paid for under "Earthwork for Erosion and Sediment Control."

E. Earthwork for Erosion and Sediment Control

1. Initial Earthwork for Erosion and Sediment Control

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Excavation (Erosion and Sediment Control, In Place)," "Embankment (Erosion and Sediment Control, In Place)," "Excavation (Erosion and Sediment Control, In Vehicle)," "Embankment (Erosion and Sediment Control, (In Vehicle)," or "Earthwork (Erosion and Sediment Control, In Vehicle)."

This price is full compensation for excavation and embankment, including hauling, disposal of material not used elsewhere on the project; embankments, including furnishing material from approved sources and construction of erosion-control features; and equipment, labor, tools, and incidentals.

Sprinkling and rolling required by this Item will not be paid for directly, but will be subsidiary to this Item.

2. Maintenance Earthwork for Erosion and Sediment Control for Cleaning and Restoring Control Measures

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid under a Contractor Force Account Item from invoice provided to the Owner.

This price is full compensation for excavation, embankment, and re-grading, including removal of accumulated sediment in various erosion control installations as directed, hauling, and disposal of material not used elsewhere on the project, excavation for construction of erosion-control features, embankments, including furnishing material from approved sources and construction of erosion-control features, and equipment, labor, tools, and incidentals.

Earthwork needed to remove and obliterate erosion-control features will not be paid for directly, but is subsidiary to pertinent Items unless otherwise shown on the plans.

Sprinkling and rolling required by this Item will not be paid for directly, but will be subsidiary to this Item.

F. Construction Perimeter Fence

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Construction Perimeter Fence." This price is full compensation for furnishing and placing the fence, digging, fence posts, wire, and flagging, removal and disposal, and materials, equipment, labor, tools, and incidentals.

Removal of construction perimeter fence will be not paid for directly, but is subsidiary to the installation Item. When the Owner directs that the perimeter fence installation or portions thereof be removed and replaced, payment will be made at the unit price bid for "Construction Perimeter Fence," which is full compensation for the removal and reinstallation of the construction perimeter fence.

G. Sandbags for Erosion Control

Sandbags will be paid for at the unit price bid for "Sandbags for Erosion Control" (of the height specified when measurement is by the foot). This price is full compensation for materials, placing sandbags, removal and disposal, equipment, labor, tools, and incidentals.

Removal of sandbags will not be paid for directly but is subsidiary to the installation Item. When the Owner directs that the sandbag installation or portions thereof be replaced, payment will be made at the unit price bid for "Sandbags for Erosion Control," which is full compensation for the reinstallation of the sandbags.

H. Temporary Sediment-Control Fence

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid as follows:

1. Installation

Installation will be paid for as "Temporary Sediment-Control Fence (Install)." This price is full compensation for furnishing and operating equipment, finish backfill and grading, lacing, proper disposal, labor, materials, tools, and incidentals.

2. Removal

Removal will be paid for as "Temporary Sediment-Control Fence (Remove)." This price is full compensation for furnishing and operating equipment, proper disposal, labor, materials, tools, and incidentals.

I. Biodegradable Erosion Control Logs

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid as follows:

1. Installation

   Installation will be paid for as "Biodegradable Erosion Control Logs (Install)" of the size specified. This price is full compensation for furnishing and operating equipment, finish backfill and grading, staking, proper disposal, labor, materials, tools, and incidentals.

2. Removal

   Removal will be paid for as "Biodegradable Erosion Control Logs (Remove)." This price is full compensation for furnishing and operating equipment, proper disposal, labor, materials, tools, and incidentals.

J. Vertical Tracking

Vertical tracking will not be measured or paid for directly, but is considered subsidiary to this Item.

PART 2 – PRODUCTS

2.1 MATERIALS

Furnish materials in accordance with the following:

- Item 161, "Compost"
- Item 432, "Riprap"
- Item 556, "Pipe Underdrains"

A. Rock Filter Dams

1. Aggregate

   Furnish aggregate with hardness, durability, cleanliness, and resistance to crumbling, flaking, and eroding acceptable to the Owner. Provide the following:

   a. Type 1, Type 2, and Type 4 rock filter dams: Use three (3) inches to six (6) inches aggregate.

   b. Type 3 rock filter dams: Use four (4) inches to eight (8) inches aggregate.

2. Wire

   Provide minimum twenty (20) gauge galvanized wire for the steel wire mesh and tie wires for Types 2 and Type 3 rock filter dams. Type 4 dams require:

   a. a double-twisted, hexagonal weave with a nominal mesh opening of 2½ inches by 3¼ inches;

   b. minimum 0.0866 inches steel wire for netting;

   c. minimum 0.1063 inches steel wire for selvages and corners; and

   d. minimum 0.0866 inches for binding or tie wire.

3. Sandbag Material

   Furnish sandbags meeting Section 506.2.8., "Sandbags," except that any gradation of aggregate may be used to fill the sandbags.

B. Temporary Pipe Slope Drains

Provide corrugated metal pipe, polyvinyl chloride (PVC) pipe, flexible tubing, watertight connection bands, grommet materials, prefabricated fittings, and flared entrance sections that conform to the plans. Recycled and other materials meeting these requirements are allowed if approved.

Furnish concrete in accordance with Item 432, "Riprap."

C. Temporary Paved Flumes

Furnish asphalt concrete, hydraulic cement concrete, or other comparable non-erodible material that conforms to the plans. Provide rock or rubble with a minimum diameter of six (6) inches and a maximum volume of one-half (½) $ft.^3$ for the construction of energy dissipaters.

D. Construction Exits

Provide materials that meet the details shown on the plans and this Section.

1. Rock Construction Exit

Provide crushed aggregate for long-term and short-term construction exits. Furnish aggregates that are clean, hard, durable, and free from adherent coatings such as salt, alkali, dirt, clay, loam, shale, soft or flaky materials, and organic and injurious matter. Use four (4) inch to eight (8) inch aggregate for Type 1. Use two (2) inch to four (4) inch aggregate for Type 3.

2. Timber Construction Exit

Furnish No. 2 quality or better railroad ties and timbers for long-term construction exits, free of large and loose knots, and treated to control rot. Fasten timbers with nuts and bolts or lag bolts, of at least one-half (½) inch diameter, unless otherwise shown on the plans or allowed. Provide plywood or pressed wafer board at least one-half (½) inch thick for short-term exits.

3. Foundation Course

Provide a foundation course consisting of flexible base, bituminous concrete, hydraulic cement concrete, or other materials as shown on the plans or directed.

E. Embankment for Erosion Control

Provide rock, loam, clay, topsoil, or other earth materials that will form a stable embankment to meet the intended use.

F. Pipe

Provide pipe outlet material in accordance with Item 556, "Pipe Underdrains," and details shown on the plans.

G. Construction Perimeter Fence

1. Posts

Provide essentially straight wood or steel posts that are at least sixty (60) inches long. Furnish soft wood posts with a minimum diameter of three (3) inches or use nominal two (2) inch by four (4) inch boards. Furnish hardwood posts with a minimum cross-section of 1½ inches by $1^1/_5$ inches. Furnish T-shaped or L-shaped steel posts with a minimum weight of 0.5 lbs. per foot.

2. Fence

   Provide orange construction fencing as approved.

3. Fence Wire

   Provide eleven (11) gauge or larger galvanized smooth or twisted wire. Provide sixteen (16) gauge or larger tie wire.

4. Flagging

   Provide brightly-colored flagging that is fade-resistant and at least ¾ inches wide to provide maximum visibility both day and night.

5. Staples

   Provide staples with a crown at least one-half (½) inch wide and legs at least one-half (½) inch long.

6. Used Materials

   Previously used materials meeting the applicable requirements may be used if approved.

H. Sandbags

Provide sandbag material of polypropylene, polyethylene, or polyamide woven fabric with a minimum unit weight of four (4) oz. per square yard, a Mullen burst-strength exceeding 300 psi, and an ultraviolet stability exceeding 70%.

Use natural coarse sand or manufactured sand meeting the gradation given in Table 1 to fill sandbags. Filled sandbags must be twenty-four (24) inches to thirty (30) inches long, sixteen (16) inches to eighteen (18) inches wide, and six (6) inches to eight (8) inches thick.

Table 1: Sand Gradation

Sieve #	Retained (% by Weight)
4	Maximum 3%
100	Minimum 80%
200	Minimum 95%

Aggregate may be used instead of sand for situations where sandbags are not adjacent to traffic. The aggregate size shall not exceed $^{3}/_{8}$ inch.

I. Temporary Sediment Control Fence

Provide a net-reinforced fence using woven geo-textile fabric. Logos visible to the traveling public will not be allowed.

1. Fabric

   Provide fabric materials in accordance with DMS-6230, “Temporary Sediment Control Fence Fabric.”

2. Posts

   Provide essentially straight wood or steel posts with a minimum length of 48 inches, unless otherwise shown on the plans. Furnish soft wood posts at least three (3) inches in diameter or use nominal two (2) inch by four (4) inch boards. Furnish hardwood posts with a minimum cross-section of 1½ inches by 1½ inches. Furnish T-shaped or L-shaped steel posts with a minimum weight of 1.3 lbs. per foot.

3. Net Reinforcement

Provide net reinforcement of at least 12½ gauge galvanized welded wire mesh, with a maximum opening size of two (2) inches by four (4) inches, at least twenty-four (24) inches wide, unless otherwise shown on the plans.

4. Staples

Provide staples with a crown at least ¾ inch wide and legs one-half (½) inch long.

5. Used Materials

Use recycled material meeting the applicable requirements if approved.

J. Biodegradable Erosion Control Logs

1. Core Material

Furnish core material that is biodegradable or recyclable. Use compost, mulch, aspen excelsior wood fibers, chipped site vegetation, agricultural rice or wheat straw, coconut fiber, 100% recyclable fibers, or any other acceptable material unless specifically called out on the plans. Permit no more than 5% of the material to escape from the containment mesh. Furnish compost meeting the requirements of Item 161, "Compost."

2. Containment Mesh

Furnish containment mesh that is 100% biodegradable, photodegradable, or recyclable such as burlap, twine, UV photodegradable plastic, polyester, or any other acceptable material.

Furnish biodegradable or photodegradable containment mesh when log will remain in place as part of a vegetative system.

Furnish recyclable containment mesh for temporary installations.

3. Size

Furnish biodegradable erosion control logs with diameters shown on the plans or as directed. Stuff containment mesh densely so logs do not deform.

PART 3 – EXECUTION

3.1 Construction

A. Contractor Responsibilities

Implement the Owner's SW3P for the project in accordance with the plans and specifications, TPDES General Permit TXR150000, and as directed by the Owner. Develop and implement an SW3P for project-specific material supply plants within and outside of the Owner's right-of-way in accordance with the specific or general storm water permit requirements. Prevent water pollution from storm water associated with construction activity from entering any surface water or private property on or adjacent to the project site.

B. General

1. Phasing

Implement control measures in the area to be disturbed before beginning construction or as directed. Limit the disturbance to the area shown on the plans or as directed. If, in the opinion of the Owner, the Contractor cannot control soil erosion and sedimentation resulting from construction operations, the Owner will limit the disturbed area to that which the Contractor is able to control. Minimize disturbance to vegetation.

2. Maintenance

Immediately correct ineffective control measures. Implement additional controls as directed. Remove excavated material within the time requirements specified in the applicable storm water permit.

3. Stabilization

Stabilize disturbed areas where construction activities will be temporarily stopped in accordance with the applicable storm water permit. Establish a uniform vegetative cover. The project will not be accepted until a 70% density of existing adjacent undisturbed areas is obtained, unless otherwise shown on the plans. When shown on the plans, the Owner may accept the project when adequate controls are in place that will control erosion, sedimentation, and water pollution until sufficient vegetative cover can be established.

4. Finished Work

Upon acceptance of vegetative cover, remove and dispose of all temporary control measures, temporary embankments, bridges, matting, falsework, piling, debris, or other obstructions placed during construction that are not a part of the finished work or as directed.

5. Restricted Activities and Required Precautions

Do not discharge onto the ground or surface waters any pollutants such as chemicals, raw sewage, fuels, lubricants, coolants, hydraulic fluids, bitumens, or any other petroleum product. Operate and maintain equipment on-site to prevent actual or potential water pollution. Manage, control, and dispose of litter on-site such that no adverse impacts to water quality occur. Prevent dust from creating a potential or actual unsafe condition, public nuisance, or condition endangering the value, utility, or appearance of any property. Wash out concrete trucks only as described in the TPDES General Permit TXR150000. Utilize appropriate controls to minimize the off-site transport of suspended sediments and other pollutants if it is necessary to pump or channel standing water (i.e. dewatering). Prevent discharges that would contribute to a violation of Edwards Aquifer Rules, water quality standards, the impairment of a listed water body, or other state or federal law.

C. Installation, Maintenance, and Removal Work

Perform work in accordance with the SW3P, according to manufacturers' guidelines, and in accordance with the TPDES General Permit TXR150000. Install and maintain the integrity of temporary erosion and sedimentation control devices to accumulate silt and debris until soil disturbing activities are completed and permanent erosion control features are in place or the disturbed area has been adequately stabilized as determined by the Owner. If a device ceases to function as intended, repair or replace the device or portions thereof as necessary. Remove sediment, debris, and litter. When approved, sediments may be disposed of within embankments, or in the right-of-way in areas where the material will not contribute to further siltation. Dispose of removed material in accordance with federal, state, and local regulations.

Remove devices upon approval or as directed. Finish-grade and dress the area upon removal. Stabilize disturbed areas in accordance with the permit and as shown on the plans or as directed. Materials removed are considered consumed by the project. Retain ownership of stockpiled material and remove it from the project when new installations or replacements are no longer required.

1. Rock Filter Dams for Erosion Control

   Remove trees, brush, stumps, and other objectionable material that may interfere with the construction of rock filter dams. Place sandbags as a foundation when required or at the Contractor's option.

   Place the aggregate to the lines, height, and slopes specified, without undue voids for Types 1, 2, 3, and 5. Place the aggregate on the mesh and then fold the mesh at the upstream side over the aggregate and secure it to itself on the downstream side with wire ties or hog rings for Types 2 and Type 3, or as directed. Place rock filter dams perpendicular to the flow of the stream or channel unless otherwise directed. Construct filter dams according to the following criteria unless otherwise shown on the plans:

   a. Type 1: Non-reinforced

      i. Height: At least eighteen (18) inches measured vertically from existing ground to top of filter dam

      ii. Top Width: At least two (2) ft.

      iii. Slopes: No steeper than 2:1

   b. Type 2: Reinforced

      i. Height: At least eighteen (18) inches measured vertically from existing ground to top of filter dam

      ii. Top Width: At least two (2) ft.

      iii. Slopes: No steeper than 2:1

   c. Type 3: Reinforced

      i. Height: At least thirty-six (36) inches measured vertically from existing ground to top of filter dam

      ii. Top Width: At least two (2) ft.

      iii. Slopes: No steeper than 2:1

   d. Type 4: Sack Gabions

      Unfold sack gabions and smooth out kinks and bends. Connect the sides by lacing in a single loop–double loop pattern on four (4) inch to 5 inch spacing for vertical filling. Pull the end lacing rod at one end until tight, wrap around the end, and twist four (4) times. Fill with stone at the filling end, pull the rod tight, cut the wire with approximately six (6) inches remaining, and twist wires four (4) times.

      Place the sack flat in a filling trough, fill with stone, connect sides, and secure ends as described above for horizontal filling.

      Lift and place without damaging the gabion. Shape sack gabions to existing contours.

   e. Type 5: Provide rock filter dams as shown on the plans.

2. Temporary Pipe Slope Drains

   Install pipe with a slope as shown on the plans or as directed. Construct embankment for the drainage system in eight (8) inch lifts to the required elevations. Hand-tamp the soil around and under the entrance section to the top of the embankment as shown on the plans or as directed. Form the top of the embankment or earth dike over the pipe slope drain at least one (1) ft. higher than the top of the inlet pipe at all points. Secure the pipe with hold-downs or hold-down grommets spaced a maximum of ten (10) ft. on

center. Construct the energy dissipaters or sediment traps as shown on the plans or as directed. Construct the sediment trap using concrete or rubble riprap in accordance with Item 432, "Riprap," when designated on the plans.

3. Temporary Paved Flumes

Construct paved flumes as shown on the plans or as directed. Provide excavation and embankment (including compaction of the subgrade) of material to the dimensions shown on the plans unless otherwise indicated. Install a rock or rubble riprap energy dissipater, constructed from the materials specified above, to a minimum depth of nine (9) inches at the flume outlet to the limits shown on the plans or as directed.

4. Construction Exits

Prevent traffic from crossing or exiting the construction site or moving directly onto a public roadway, alley, sidewalk, parking area, or other right-of-way areas other than at the location of construction exits when tracking conditions exist. Construct exits for either long-term or short-term use.

a. Long-Term

Place the exit over a foundation course as required. Grade the foundation course or compacted subgrade to direct runoff from the construction exits to a sediment trap as shown on the plans or as directed. Construct exits with a width of at least fourteen (14) ft. for one-way and twenty (20) ft. for two-way traffic for the full width of the exit or as directed.

i. Type 1: Construct to a depth of at least eight (8) inches using crushed aggregate as shown on the plans or as directed.

ii. Type 2: Construct using railroad ties and timbers as shown on the plans or as directed.

b. Short-Term

i. Type 3: Construct using crushed aggregate, plywood, or wafer board. This type of exit may be used for daily operations where long-term exits are not practical.

ii. Type 4: Construct as shown on the plans or as directed.

5. Earthwork for Erosion Control

Perform excavation and embankment operations to minimize erosion and to remove collected sediments from other erosion control devices.

a. Excavation and Embankment for Erosion Control Features

Place earth dikes, swales, or combinations of both along the low crown of daily lift placement, or as directed, to prevent runoff spillover. Place swales and dikes at other locations as shown on the plans or as directed to prevent runoff spillover or to divert runoff. Construct cuts with the low end blocked with undisturbed earth to prevent erosion of hillsides. Construct sediment traps at drainage structures in conjunction with other erosion control measures as shown on the plans or as directed.

Create a sediment basin, where required, providing 3,600 cu. ft. of storage per acre drained, or equivalent control measures for drainage locations that serve an area with ten (10) or more disturbed acres at one time, not including off-site areas.

b. Excavation of Sediment and Debris

Remove sediment and debris when accumulation affects the performance of the devices, after a rain, and when directed.

6. Construction Perimeter Fence

Construct, align, and locate fencing as shown on the plans or as directed.

a. Installation of Posts

Embed posts eighteen (18) inches deep or adequately anchor in rock, with a spacing of eight (8) ft. to ten (10) ft.

b. Wire Attachment

Attach the top wire to the posts at least three (3) ft. from the ground. Attach the lower wire midway between the ground and the top wire.

c. Flag Attachment

Attach flagging to both wire strands midway between each post. Use flagging at least eighteen (18) inches long. Tie flagging to the wire using a square knot.

7. Sandbags for Erosion Control

Construct a berm or dam of sandbags that will intercept sediment-laden storm water runoff from disturbed areas, create a retention pond, detain sediment, and release water in sheet flow. Fill each bag with sand so that at least the top six (6) inches of the bag is unfilled to allow for proper tying of the open end. Place the sandbags with their tied ends in the same direction. Offset subsequent rows of sandbags one-half (½) the length of the preceding row. Place a single layer of sandbags downstream as a secondary debris trap. Place additional sandbags as necessary or as directed for supplementary support to berms or dams of sandbags or earth.

8. Temporary Sediment-Control Fence

Provide temporary sediment-control fence near the downstream perimeter of a disturbed area to intercept sediment from sheet flow. Incorporate the fence into erosion-control measures used to control sediment in areas of higher flow. Install the fence as shown on the plans, as specified in this Section, or as directed.

a. Installation of Posts

Embed posts at least eighteen (18) inches deep, or adequately anchor if in rock, with a spacing of six (6) ft. to eight (8) ft. and install on a slight angle toward the runoff source.

b. Fabric Anchoring

Dig trenches along the uphill side of the fence to anchor six (6) inches to eight (8) inches of fabric. Provide a minimum trench cross-section of six (6) inches by six (6) inches. Place the fabric against the side of the trench and align approximately two (2) inches of fabric along the bottom in the upstream direction. Backfill the trench, then hand-tamp.

c. Fabric and Net Reinforcement Attachment

Attach the reinforcement to wooden posts with staples, or to steel posts with T-clips, in at least four (4) places equally spaced unless otherwise shown on the plans. Sewn vertical pockets may be used to attach reinforcement to end posts. Fasten the fabric to the top strand of reinforcement by hog rings or cord every fifteen (15) inches or less.

d. Fabric and Net Splices

Locate splices at a fence post with a minimum lap of six (6) inches attached in at least six (6) places equally spaced unless otherwise shown on the plans. Do not locate splices in concentrated flow areas.

Requirements for installation of used temporary sediment-control fence include the following:

i. fabric with minimal or no visible signs of biodegradation (weak fibers);

ii. fabric without excessive patching (more than one (1) patch every fifteen (15) ft. to twenty (20) ft.);

iii. posts without bends; and

iv. backing without holes.

9. Biodegradable Erosion Control Logs

Install biodegradable erosion control logs near the downstream perimeter of a disturbed area to intercept sediment from sheet flow. Incorporate the biodegradable erosion control logs into the erosion measures used to control sediment in areas of higher flow. Install, align, and locate the biodegradable erosion control logs as specified below, as shown in plans or as directed.

Secure biodegradable erosion control logs in a method adequate to prevent displacement as a result of normal rain events, prevent damage to the logs, and to the satisfaction of the Owner such that flow is not allowed under the logs. Temporarily removing and replacing biodegradable erosion logs as to facilitate daily work is allowed at the Contractor's expense.

10. Vertical Tracking

Perform vertical tracking on slopes to temporarily stabilize soil. Provide equipment with a track undercarriage capable of producing a linear soil impression measuring a minimum of twelve (12) inches long by two (2) inches to four (4) inches wide by one-half (½) inch to two (2) inches deep. Do not exceed twelve (12) inches between track impressions. Install continuous linear track impressions where the twelve (12) inches length impressions are perpendicular to the slope. Vertical tracking is required on projects where soil disturbing activities have occurred unless otherwise approved.

END OF SECTION

636-001

Special Provision to Item 636
Signs

Item 636, "Signs" of the Standard Specifications, is hereby amended with respect to the clauses cited below, and no other clauses or requirements of this Item are waived or changed hereby.

Section 636.3.1, "Fabrication." is deleted.

Section 636.3.1.2, "Sheeting Application." The last sentence of the fourth paragraph is voided and replaced by the following.

Do not splice sheeting or overlay films for signs fabricated with ink or with colored transparent films.

Special Provision to Item 666
Retroreflectorized Pavement Markings

Item 666, "Retroreflectorized Pavement Markings," of the Standard Specifications is amended with respect to the clauses cited below. No other clauses or requirements of this Item are waived or changed.

Section 2.3., "Glass Traffic Beads." The first paragraph is voided and replaced by the following:

Furnish drop-on glass beads in accordance with DMS-8290, "Glass Traffic Beads," or as approved. Furnish a double-drop of Type II and Type III drop-on glass beads for longitudinal pavement markings where each type bead is applied separately in equal portions (by weight), unless otherwise approved. Apply the Type III beads before applying the Type II beads. Furnish Type II beads for work zone pavement markings and transverse markings or symbols.

Section 4.3.1., "Type I Markings.," is supplemented by the following:

4.3.1.3. Spot Striping. Perform spot striping on a callout basis with a minimum callout quantity as shown on the plans.

Section 4.3.2., "Type II Markings.," is supplemented by the following:

4.3.2.1. Spot Striping. Perform spot striping on a callout basis with a minimum callout quantity as shown on the plans.

Section 4.4., "Retroreflectivity Requirements.," is voided and replaced by the following.

Type I markings for Contracts totaling more than 20,000 ft. of pavement markings must meet the following minimum retroreflectivity values for all longitudinal edgeline, centerline or no passing barrier-line, and lane line markings when measured any time after 3 days, but not later than 10 days after application.

- White markings: 250 millicandelas per square meter per lux (mcd/m^2/lx)
- Yellow markings: 175 mcd/m^2/lx

Retroreflectivity requirements for Type I markings are not required for Contracts with less than 20,000 ft. of pavement markings or Contracts with callout work, unless otherwise shown on the plans.

Section 4.5., "Retroreflectivity Measurements.," is voided and replaced by the following:

Use a mobile retroreflectometer to measure retroreflectivity for Contracts totaling more than 50,000 ft. of pavement markings, unless otherwise shown on the plans. For Contracts with less than 50,000 ft. of pavement markings, mobile or portable retroreflectometers may be used at the Contractor's discretion. Coordinate with and obtain authorization from the Engineer before starting any retroreflectivity data collection.

Section 4.5.1., "Mobile Retroreflectometer Measurements." The last paragraph is voided and replaced by the following.

Restripe again at the Contractor's expense with a minimum of 0.060 in. (60 mils) of Type I marking material if the average of these measurements falls below the minimum retroreflectivity requirements. Take measurements every 0.1 miles a minimum of 10 days after this third application within that mile segment for that series of markings. If the markings do not meet minimum retroreflectivity after this third application, the Engineer may require removal of all existing markings, a new application as initially specified, and a repeat of the application process until minimum retroreflectivity requirements are met.

Section 4.5.2., "Portable Retroreflectometer Measurements." The first and second paragraphs are voided and replaced by the following.

Provide portable measurement averages for every 1.0 mile unless otherwise specified or approved. Take a minimum of 20 measurements for each 1-mi. section of roadway for each series of markings (e.g., edgeline, center skip line, each line of a double line) and direction of traffic flow when using a portable reflectometer. Measure each line in both directions for centerlines on two-way roadways (i.e., measure both double solid lines in both directions and measure all center skip lines in both directions). The spacing between each measurement must be at least 100 ft. The Engineer may decrease the mileage frequency for measurements if the previous measurements provide satisfactory results. The Engineer may require the original number of measurements if concerns arise.

Restripe at the Contractor's expense with a minimum of 0.060 in. (60 mils) of Type I marking material if the averages of these measurements fail. Take a minimum of 10 more measurements after 10 days of this second application within that mile segment for that series of markings. Restripe again at the Contractor's expense with a minimum of 0.060 in. (60 mils) of Type I marking material if the average of these measurements falls below the minimum retroreflectivity requirements. If the markings do not meet minimum retroreflectivity after this third application, the Engineer may require removal of all existing markings, a new application as initially specified, and a repeat of the application process until minimum retroreflectivity requirements are met.

Section 4.6. "Performance Period." The first sentence is voided and replaced by the following:

All longitudinal markings must meet the minimum retroreflectivity requirements within the time frame specified. All markings must meet all other performance requirements of this specification for at least 30 calendar days after installation.

Article 6. "Payment." The first two paragraphs are voided and replaced by the following.

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Pavement Sealer" of the size specified; "Retroreflectorized Pavement Markings" of the type and color specified and the shape, width, size, and thickness (Type I markings only) specified, as applicable; "Retroreflectorized Pavement Markings with Retroreflective Requirements" of the types, colors, sizes, widths, and thicknesses specified; "Retroreflectorized Profile Pavement Markings" of the various types, colors, shapes, sizes, and widths specified; or "Reflectorized Pavement Marking (Call Out)" of the shape, width, size, and thickness (Type I markings only) specified, as applicable; or "Pavement Sealer (Call Out)" of the size specified.

This price is full compensation for materials, application of pavement markings, equipment, labor, tools, and incidentals.

Special Specification WC101
Soil Ripping

PART 1 – GENERAL

1.1 DESCRIPTION

Soil ripping is a treatment measure that loosens overly compacted soil. Soil ripping is the plowing of the ground to alleviate compaction to allow for vegetated growth and to prevent erosion in sheet flow conditions. Perform soil ripping on designated areas according to the plans or as directed.

1.2 RELATED ITEMS

A. Item 160-WC001, “Topsoil”

B. Item 161-WC001, “Compost”

C. Item WC102, “Mulch”

D. Item 164-WC001, “Seeding for Erosion Control”

E. Item 506-WC001, “Temporary Erosion, Sedimentation and Environmental Controls”

1.3 MEASUREMENT & PAYMENT

Not measured or paid directly. This item is subsidiary to other items in the contract. The contractor should apply the quantity of project seeding area with 2.2 and 2.3 of this specification for estimation purposes.

1.4 QUALITY CONTROL SUBMITTALS

A. Submit soil ripping equipment data for approval, prior to installation.

PART 2 – EXECUTION

2.1 SEQUENCING

A. Complete final grading in accordance with the plans or as directed.

B. Soil ripping should be performed prior to the installation of compost and/or topsoil, mulch, and/or native grass seeding and wildflower seeding.

2.2 CONSTRUCTION

A. Installation:

1. All soil surfaces with a slope of 3:1 or less that are compacted due to equipment traffic should be ripped.

2. Perform soil ripping parallel and perpendicular (in both directions) to the slope at location, groove spacing, and depth shown on the plans as well as any additional areas that have been compacted during construction

activities to achieve a standard proctor density of 80% – 85% in channels and 70% – 75% in non-channel areas.

3. If construction activities are on-going, repeat procedure as necessary.

4. Soil ripping should not be implemented within a drainage channel or in channel flow conditions.

2.3 MAINTENANCE

A. Routinely inspect the soil ripping weekly during construction and within 24 hours after every one-half (½) inch or greater rainfall event. Inspections should ensure that:

1. No slumping of the rips has occurred.

2. The ripping was installed at the appropriate depth and spacing.

3. The contour rips are parallel and perpendicular to the slope.

B. If major slumping or slope failure occurs, the area should be regraded and reseeded. If minor slumping or rills occur, the specified topsoil and/or compost and seeding for the area in the plans may be applied, at the discretion of the Owner's Representative.

C. Continue to inspect the area on a weekly basis until vegetation has been established.

END OF SECTION

Special Specification WC102
Mulch

PART 1 – GENERAL

1.1 DESCRIPTION

Furnish and apply mulch as shown in the plans or as directed.

1.2 RELATED ITEMS

A. Item 161-WC001, “Compost”

B. Item WC103, “Mulch Topdressing”

C. Item 506-WC001, “Temporary Erosion, Sedimentation, and Environmental Controls”

1.3 MEASUREMENT & PAYMENT

Not measured or paid directly. This item is subsidiary to other items of the contract.

1.4 QUALITY CONTROL SUBMITTALS

A. Submit one (1) pound sample of on-site shredded mulch for approval.

B. Submit imported organic mulch product data and supplier information, including product composition, as well as a one (1) pound sample for approval.

C. A statement that the shredded mulch has met the decomposition process.

PART 2 – PRODUCTS

2.1 MATERIALS

A. Mulch can be on-site shredded organic mulch or an imported organic mulch product.

1. Mulch can be comprised of wood chips, shredded bark, shredded landscape trimmings, or coarse compost material originating from the 3-county Central Texas region (Williamson, Travis, and Hays).

2. Mulch to be shredded with no pieces greater than three (3) inches in length and with all pieces passing through a two (2) to three (3) inch screen.

3. Invasive species should be excluded from mulch.

4. Color: natural wood.

5. Contamination: less than 0.5% weight by volume.

6. Mulch to have undergone a decomposition process either on-site or at a supplier’s location.

PART 3 – EXECUTION

3.1 SEQUENCING

A. For mulch material that has not gone through the stockpiling and decomposition process: Following removal of the existing vegetation from the site, shred the material to the specified size and place in a stockpile on-site. Complete the decomposition process in stockpile prior to installation or use of mulch at depths specified on plans. If using the mulch for dust control, compaction control, or on existing vegetation to remain, place immediately after the completion of the decomposition process.

3.2 CONSTRUCTION

A. Installation

1. Shred trees and vegetation to the specified size requirements.

2. Apply Nitrogen at the rate of one (1) part Nitrogen to ten (10) parts mulch.

3. Stockpile the mulch and allow to sit or cook for a period of no less than three (3) weeks if the temperature is above 70°F. If the temperature is below 70°F, extend the sitting or cooking time to five (5) to six (6) weeks.

4. Turn the stockpile at least twice per week during the sitting or cooking period.

5. Stockpiles should be surrounded by biodegradable erosion control logs within 24 hours of placement to prevent run-off of the material.

END OF SECTION

Special Specification WC103
Mulch Topdressing

PART 1 – GENERAL

1.1 DESCRIPTION

Furnish and apply mulch topdressing as shown in the plans or as directed.

1.2 RELATED ITEMS

A. Item WC 102 “Mulch”

1.3 MEASUREMENT

This item will be measured by the cubic yard.

1.4 PAYMENT

The work performed and the materials furnished in accordance with this Item and measured as provided under “Measurement” will be paid for at the unit price bid for “Mulch Topdressing.” This price is full compensation for furnishing materials, including mowing, labor, equipment, maintenance, tools, supplies, and incidentals.

1.5 QUALITY CONTROL SUBMITTALS

A. Submit samples and product data in conformance with Item WC102, “Mulch,” Part 1, 1.4, “Quality Control Submittals.”

PART 2 – PRODUCTS

2.1 MATERIALS

A. Mulch

As specified in Item WC102, “Mulch”

PART 3 – EXECUTION

3.1 SEQUENCING

A. Apply mulch topdressing to vehicular drives, under driplines of existing trees, and to other designated locations, as specified on the plans or as directed after rough grading operations are complete.

3.2 CONSTRUCTION

A. Vegetation Removal

1. Remove vegetation as shown in the plans or as directed.

2. Conduct mulching operations at approved locations.

3. Stockpile mulch in locations shown on plans or as directed. Reference Item WC102, “Mulch,” for stockpiling specifications.

B. Site Preparation

1. Grade and remove debris, unsatisfactory soil materials, and obstructions from surface prior to mulch application.

2. Remove top growth of vegetation to ensure that the mulch contacts the surface material.

C. Installation

1. Apply mulch topdressing evenly at depths and locations as indicated in the drawings or as directed.

2. Do not roll, tamp, or compact mulch topdressing.

3. Apply mulch topdressing under driplines of existing tree locations for moisture retention and inhibiting of invasive growth as shown on plans at a minimum depth of five (5) inches and a maximum depth of eighteen (18) inches. Do not pile the mulch against tree trunks or root flares.

4. Spread mulch on vehicle drives for compaction reduction and dust abatement at a maximum eighteen (18) inch depth.

5. Contractor should remove and dispose of mulch topdressing in areas designated for seeding prior to seed installation.

3.3 MAINTENANCE

A. Requirements

1. Replace the mulch topdressing immediately if loosened or missing.

2. After the completion of construction, mulch topdressing shall be spread out or removed to ensure the total depth surrounding the critical root zones of vegetation is between five (5) inches and six (6) inches. Depth should not exceed six (6) inches.

B. Schedule

1. The mulch topdressing should be inspected weekly, in accordance with the Stormwater Pollution Prevention Plan (SW3P) and within 24 hours after every one-half (½) inch or greater rain event until project completion to identify loosened or missing mulch cover.

END OF SECTION

APPENDIX A

QUALITY CONTROL / QUALITY ASSURANCE PROGRAM

Approved December 2007

Appendix A

Quality Control / Quality Assurance Program

Section 1. Overview

Introduction

Williamson County has established the following Quality Control (QC) / Quality Assurance (QA) Program to assure that the materials and workmanship incorporated into any roadway or highway construction project are in reasonable conformity with the requirements of the approved plans and specifications, including any approved changes. It consists of an "Acceptance Program" and a “QA Program" based on test results obtained by qualified persons and equipment.

This QC/QA Program allows for the use of validated contractor-performed QC test results as part of an acceptance decision. It also allows for the use of test results obtained by commercial laboratories in the QA Program in acceptance decisions, as well. The effectiveness of the “Acceptance Program” shall be the responsibility of the Construction Observer.

Definitions

Acceptance Program - All factors that comprise the Williamson County's determination of the quality of the product as specified in the contract requirements. These factors include QC and QA verification sampling and testing, and inspection.

Quality Control Program - The contractor’s systematic program detailing the control measures and reporting requirements necessary to achieve reasonable conformance with the requirements of the approved plans and specifications.

Quality Assurance Program - Activities that are an unbiased and independent evaluation of all the inspection, sampling and testing procedures used in the acceptance program.

Proficiency Samples - Homogenous samples that are distributed and tested by two or more laboratories and/or personnel. The test results are compared to assure that the laboratories and/or personnel are obtaining the same results.

Qualified Laboratories - Laboratories that are capable as defined by appropriate programs established by Williamson County and as indicated in the "Laboratory Qualification Program". As a minimum, the qualification program shall include provisions for checking testing equipment and the laboratory shall keep records of calibration checks.

Qualified Sampling and Testing Personnel - Personnel who are capable as defined by appropriate programs established as stated in Section 6 of this Appendix.

Quality Assurance – All those planned and systematic actions necessary to provide confidence that a product or service will satisfy given requirements for quality.

Quality Control - All contractor/vendor operational techniques and activities that are performed or conducted to fulfill the contract requirements.

Vendor – A supplier of project-produced material that is not the contractor.

Verification Sampling and Testing - Sampling and testing performed to validate the quality of the product, which consists of the QC and QA sampling and testing.

Approved December 2007

Section 2. Acceptance Program

Materials incorporated into any roadway or highway construction project shall be subject to verification sampling and testing, and inspection as part of the QC program outlined below:

- Quality Control Inspection

  - Contractor-performed QC Inspection will be required as part of the acceptance decision. Inspection check lists for the following structural items shall be completed and submitted as part of the acceptance program:

    Item 400 – Excavation & Backfill
    Item 416 – Drilled Shaft Foundations
    Item 420 – Concrete Structures
    Item 421 – Hydraulic Cement Concrete
    Item 422 – Bridge Deck
    Item 423 – Retaining Wall
    Item 425 – Precast Pre-stressed Concrete Structural Members
    Item 440 – Reinforcing Steel
    Item 442 – Metal for Structures
    Item 462 – Concrete Box Culverts
    Item 464 – Reinforced Concrete Pipe

    Sample Inspection check lists are included at the end of this Appendix.

  - The contractor shall designate individual(s) responsible for the QC Inspection for the project or each work element thereof. The designated QC individual(s) will maintain responsibility for providing reports detailing the compliance of each work element to the requirements of the approved project plans and specifications.

  - The QC report will detail requirements of the approved project plans and specifications and measures initiated to ensure reasonable conformity.

  - The contactor shall submit the QC Plan for acceptance detailing the individuals & methods(s) intended to be used to obtain reasonable conformance to the approved project plans and specifications.

- Quality Control Sampling, Testing and frequency

  - Contractor-performed QC sampling and testing will be used as part of an acceptance decision.

  - The frequency and location will be according to the “Project Test” frequency as shown in Appendix B. This project has been designed utilizing TxDOT Specifications; therefore, the 2005 TxDOT Guide Schedule for Sampling and Testing has been adopted for the testing program. As a County-developed project, all references to TxDOT in the testing program shall be understood to mean Williamson County, and all references to the Engineer shall be understood to mean the County Engineer or his designated representative(s).

  - These QC sampling and testing personnel, laboratories, and equipment shall be qualified according to the "Sampling and Testing Personnel Qualification Program" and the "Laboratory Qualification Program" and shall be evaluated under the "Quality Assurance Program" contained herein.

- Any equipment used to perform QC sampling and testing shall be subject to an evaluation by QA sampling and testing personnel. This evaluation shall include calibration checks and split or proficiency sample tests. The requirements for, and frequency of, equipment calibration are shown in Appendix B. Acceptable tolerance limits for the comparison of test results from split or proficiency samples are shown in “Acceptable Tolerance Limits for Independent Assurance.”

- Any individual who performs verification or QC sampling and testing shall be evaluated by QA sampling and testing personnel. This evaluation shall include observations and split or proficiency sample testing. Acceptable tolerance limits for the comparison of test results for split or proficiency samples are shown in "Acceptable Tolerance Limits for Quality Assurance."

- Furthermore, these QC test results may be validated by verification test results obtained from independently taken samples at the direction of the Construction Observer or the County.

Approved December 2007

Section 3. Quality Assurance Program

This Quality Assurance Program; as deemed necessary by the County or the Construction Observer; shall evaluate all QC inspection, sampling and testing procedures, personnel, and equipment used as part of the acceptance program.

- QA Inspection
    - The Construction Observer will be responsible for QA inspection. The inspection will be performed at periodic intervals to assure compliance with the accepted QC program, as well as to assure reasonable close conformity to the approved project plans and specifications.
- Sampling and Testing Frequency and Location
    - Quality Assurance sampling and testing shall be performed at the same location and frequency established for the Project Tests in the "Guide Schedule of Sampling and Testing" found in Appendix B.
    - The frequency for the “Independent Assurance Tests” shall be as directed by the Construction Observer.
- Testing Equipment
    - Laboratory testing equipment used for QA sampling and testing shall be qualified according to the "Laboratory Qualification Program."
    - All laboratories used for QA sampling and testing must be AASHTO accredited and listed as an accepted Lab by the County.
    - The frequency for qualifying QA sampling and testing equipment shall not exceed one (1) year or as directed by the Construction Observer.
    - Calibration/verification is required whenever the laboratory or equipment is moved.
    - The QA equipment shall be other than that used for performing verification or QC testing.
- Testing Personnel
    - Laboratory personnel who perform QA sampling and testing shall be in accordance with the "Sampling and Testing Personnel Qualification Program" Included herein.
    - The individuals performing QA sampling and testing shall be other than those who perform other verification or QC testing.
- Comparison of QC and QA Test Results
    - Acceptable tolerance limits for the comparison of test results from split and proficiency samples are shown in "Acceptable Tolerance Limits for Independence Assurance."
    - If the comparison of the test results do not comply with the tolerances, an engineering review of the test procedures and equipment shall be performed immediately to determine the source of the discrepancy.
    - Corrective actions must be identified and incorporated as appropriate.

Test results from all samples involved in the Quality Assurance Program shall be documented and reported in the project files.

- Dispute Resolution System
    - Testing disputes arising between the Construction Observer, or his/her designated agents, and the Contractor shall be resolved in a reliable, unbiased manner. The decision of the County, the Construction Observer, or their authorized representatives will be final.

Approved December 2007

Section 4. Materials Certification

The Independent Assurance agency shall submit a "Certificate of Materials" to the Construction Observer indicating the conformity of tested materials to the approved plans and specifications including any exceptions, if applicable.

Approved December 2007

Section 5. Conflict of Interest

To avoid an appearance of a conflict of interest, sampling and testing of materials under the QA program shall be performed at a qualified laboratory other than the laboratory used for project testing by the Contractor.

Approved December 2007

Section 6. Sampling and Testing Personnel Qualification Program

Purpose

This program provides uniform Countywide procedures for sampling and testing personnel qualification to ensure that tests required by the specifications are performed according to the prescribed sampling and testing methods.

Sampling and Testing Personnel Qualification

Sampling and testing personnel will be qualified to perform tests for the acceptance of materials in the areas of Portland cement concrete, soils and aggregates and bituminous materials. The test methods for which individuals can be qualified include, but are not limited to, the following.
(* Denotes tests on which split or proficiency sample evaluations are required.)

Soils & Aggregates (100-E Series & 400-A Series)
Tex-101-E, Preparing Soil and Flexible Base Materials for Testing

Tex-102-E, Determining Slaking Time

Tex-103-E, Determining Moisture Content in Soil Materials

Tex-104-E, Determining Liquid Limit of Soils*

Tex-105-E, Determining Plastic Limit of Soils*

Tex-106-E, Calculating the Plasticity Index of Soils*

Tex-107-E, Determining the Bar Linear Shrinkage of Soils*

Tex-108-E, Determining the Specific Gravity of Soils

Tex-110-E, Particle Size Analysis of Soils*

Tex-111-E, Determining the Amount of Material in Soils Finer than 75 □m (No.200) Sieve

Tex-113-E, Laboratory Compaction Characteristics and Moisture-Density Relationship of Base Materials

Tex-114-E, Laboratory Compaction Characteristics and Moisture-Density Relationship of Subgrade and Embankment Soils

Tex-115-E, Field Method for Determining In-Place Density of Soils and Base Materials

Tex-116-E, Ball Mill Method for Determining the Disintegration of Flexible Base Material

Tex-117-E, Triaxial Compression Tests for Disturbed Soils and Base Materials

Tex-120-E, Soil-Cement Testing

Tex-121-E, Soil-Lime Testing

Tex-126-E, Molding, Testing, and Evaluating Bituminous Black Base Materials*

Tex-127-E, Lime Fly-Ash Compressive Strength Test Methods
Tex-128-E, Determining Soil pH

Tex-129-E, Measuring the Resistivity of Soil Materials

Approved December 2007

Tex-140-E, Measuring Thickness of Pavement Layer

Tex-400-A, Sampling Stone, Gravel, Sand, and Mineral Aggregates

Tex-401-A, Sieve Analysis of Fine and Coarse Aggregate*

Tex-402-A, Fineness Modulus of Fine Aggregate

Tex-403-A, Saturated Surface Dry Specific Gravity and Absorption of Aggregates

Tex-404-A, Determining Unit Mass (Weight) of Aggregates

Tex-405-A, Determining Percent Solids and Voids in Concrete Aggregates

Tex-406-A, Material Finer Than 75 □m (No. 200) Sieve in Mineral Aggregates (Decantation Test for Concrete Aggregates)

Tex-408-A, Organic Impurities in Fine Aggregate for Concrete

Tex-409-A, Free Moisture and Water Absorption in Aggregate for Concrete

Tex-409-A, Free Moisture and Water Absorption in Aggregate for Concrete

Tex-411-A, Soundness of Aggregate by Using Sodium Sulfate or Magnesium Sulfate

Tex-413-A, Determining Deleterious Materials in Mineral Aggregates

Tex-425-A, Determining Moisture Content in Fine Aggregate by the "Speedy" Moisture Method

Tex-460-A, Determining Crushed Face Particle Count

Bituminous (200-F Series)

Tex-200-F, Sieve Analysis of Fine and Coarse Aggregate*

Tex-201-F, Bulk Specific Gravity and Water Absorption of Aggregate

Tex-202-F, Apparent Specific Gravity of Material Finer than 180 □m (No. 80) Sieve

Tex-203-F, Sand Equivalent Test*

Tex-204-F, Design of Bituminous Mixtures

Tex-205-F, Laboratory Method of Mixing Bituminous Mixtures

Tex-206-F, Compacting Test Specimens of Bituminous Mixtures*

Tex-207-F, Determining Density of Compacted Bituminous Mixtures*

Tex-208-F, Test for Stabilometer Value of Bituminous Mixtures*

Tex-210-F, Determining Asphalt Content of Bituminous Mixtures by Extraction*

Tex-211-F, Recovery of Asphalt from Bituminous Mixtures by the Abson Process

Tex-212-F, Determining Moisture Content of Bituminous Mixtures

Approved December 2007

Tex-213-F, Determining Hydrocarbon-Volatile Content of Bituminous Mixtures

Tex-217-F, Determining Deleterious Material and Decantation Test for Coarse Aggregates

Tex-221-F, Sampling Aggregate for Bituminous Mixtures, Surface Treatments and Limestone Rock Asphalt

Tex-222-F, Sampling Bituminous Mixtures

Tex-224-F, Determining Flakiness Index

Tex-226-F, Indirect Tensile Strength Test

Tex-227-F, Theoretical Maximum Specific Gravity of Bituminous Mixtures*

Tex-228-F, Determining Asphalt Content of Bituminous Mixtures by the Nuclear Method*

Tex-229-F, Combined HMAC Cold-Belt Sampling and Testing Procedure

Tex-236-F, Determining Asphalt Content from Asphalt Paving Mixtures by the Ignition Method*

Concrete (400-A Series)

Tex-407-A, Sampling Freshly-Mixed Concrete

Tex-414-A, Air Content of Freshly Mixed Concrete by the Volumetric Method*

Tex-415-A, Slump of Portland Cement Concrete*

Tex-416-A, Air Content of Freshly Mixed Concrete by the Pressure Method*

Tex-417-A, Unit Weight, Yield, and Air Content (Gravimetric) of Concrete

Tex-418-A, Compressive Strength of Cylindrical Concrete Specimens*

Tex-419-A, Compressive Strength of Concrete Using Portions of Beams Broken in Flexure

Tex-424-A, Obtaining and Testing Drilled Cores of Concrete

Tex-436-A, Measuring Texture Depth by the Sand Patch Method

Tex-437-A, Test for Flow of Grout Mixtures (Flow Cone Method)

Tex-447-A, Making and Curing Concrete Test Specimens

Tex-448-A, Flexural Strength of Concrete Using Simple Beam Third-Point Loading*

Tex-450-A, Capping Cylindrical Concrete Specimens

Tex-460-A, Determining Crushed Face Particle Count

Asphalt (500-C Series)

Tex-502-C, Penetration of Bituminous Materials (refer to AASHTO T 49)

Tex-530-C, Effect of Water on Bituminous Paving Mixtures

Approved December 2007

Tex-531-C, Prediction of Moisture-Induced Damage to Bituminous Paving Materials Using Molded Specimens

Tex-1000-S, Operating Pavement Profilograph and Evaluating Profiles

Who Must Be Qualified?

Any individual who performs tests on materials for acceptance must be qualified.

.

Qualification of Sampling and Testing Personnel

All sampling and testing personnel for approved laboratories shall be qualified to do the work in accordance with "Laboratory Qualification Program".

Each laboratory shall maintain a minimum of one (1) qualified individual for each test procedure performed.

Approved December 2007

Section 7. Laboratory Qualification Program

Purpose

This program provides uniform countywide procedures to ensure that laboratory facilities and equipment are adequate for the performance of required sampling and testing methods.

Laboratories

All laboratories that perform testing for Williamson County must be accredited under the AASHTO Laboratory Accreditation Program. These include, but are not limited to the following:

- Area/project laboratories (includes field laboratories)
- Commercial laboratories
- Contractor laboratories
- Vendor laboratories (material suppliers).

The most current AASHTO accredited laboratories in the State of Texas can be obtained at http://patapsco.nist.gov/aashto/amrl/services/aap_intro.htm. In addition, Appendix C includes a list of AASHTO accredited laboratories obtained at the time this document was prepared.

Laboratory Qualification Responsibility

The Construction Observer or his/her authorized representatives will be responsible to ensure all QA laboratories used for project and QA testing and sampling are qualified.

Qualification Process

The laboratory qualifying authority will:

- identify the scope of testing to be performed
- verify that manuals and/or test methods used to perform tests are available and up-to-date
- document that the laboratory has the required equipment to perform the tests
- check the calibration/verification records for each piece of equipment, to include:
    - description of equipment
    - identification of any traceable standard used
    - frequency of calibration
    - date of last calibration
    - date of next calibration
    - procedure used to calibrate equipment
    - procedure used to identify equipment not in compliance.

In addition, all equipment may be subjected to calibration verification or other inspection by the qualifying authority.

Approved December 2007

Calibration Standards and Frequencies for Laboratory Equipment

The standards for calibration and the frequencies for laboratory equipment calibrations shall be in accordance with appropriate testing equipment measures as indicated in the Texas Department of Transportation Manual of Testing Procedures. 100-E (Soils), 200-F (Bituminous), and 400-A (Concrete) series of TxDOT's *Manual of Testing Procedures*.

Frequency for Laboratory Qualification

Laboratories shall be qualified at an interval not to exceed six (6) months, or as directed by the Construction Observer. Calibration/verification is required whenever the laboratory or equipment is moved.

Non-Compliance

A laboratory that does not meet the above requirements is subject to disqualification. Any equipment in a qualified laboratory failing to meet specified equipment requirements for a specific test method shall not be used for that test method.

Documentation

The Construction Observer will be responsible for verifying that laboratories are qualified to perform material testing. Documentation will be required to be kept by the qualified laboratory. Calibration records will be maintained for three (3) years, unless directed otherwise by the Construction Observer.

Dispute Resolution

The County will have the final decision regarding all disputes of the laboratory qualification and calibration of testing equipment.

Approved December 2007

Section 8. Acceptable Tolerance Limits for Quality Assurance

The following tables indicate the acceptable tolerance limits for the specified material.

Embankment

Embankment		
Procedure	**Texas Test Method**	**Tolerance**
In-place Density	"Tex-115-E, Field Method for Determining In-Place Density of Soils and Base Materials"	± 2.5% Field Density

Untreated & Treated Sub-base and Base Courses

Untreated & Treated Sub-base and Base Courses		
Procedure	**Texas Test Method**	**Tolerance**
In-place Density	"Tex-115-E, Field Method for Determining In-Place Density of Soils and Base Materials"	± 2.5% Field Density
Gradation:	"Tex-110-E, Particle Size Analysis of Soils"	-
> No. 4 ≤ No. 4	-	± 5% ± 3%
Liquid Limit	"Tex-104-E, Determining Liquid Limit of Soils"	15% of the mean*
Plasticity Index	"Tex-106-E, Calculating the Plasticity Index of Soils"	20% of the mean*

Asphalt Stabilized Base

Asphalt Stabilized Base		
Procedure	**Texas Test Method**	**Tolerance**
Gradation:	"Tex-200-F, Sieve Analysis of Fine and Coarse Aggregates"	-
> No. 4 ≤ No. 4	-	± 5% ± 3%
Liquid Limit	"Tex-104-E, Determining Liquid Limit of Soils"	15% of the mean*
Plasticity Index	"Tex-106-E, Calculating the Plasticity Index of Soils"	20% of the mean*
Percent Asphalt	"Tex-210-F, Determining Asphalt Content of Bituminous Mixtures by Extraction"	± 0.3%
-	"Tex-228-F, Determining Asphalt Content of Bituminous Mixtures by the Nuclear Method"	± 0.3%

Approved December 2007

-	"Tex-126-E, Molding, Testing, and Evaluating Bituminous Black Base Materials"	± 0.3%
-	"Tex-229-F, Combined HMAC Cold-belt Sampling and Testing Procedure"	± 0.3%
-	"Tex-236-F, Determining Asphalt Content from Asphalt Paving Mixtures by the Ignition Method"	± 0.3%
In-place Density (Cores)	"Tex-207-F, Determining Density of Compacted Bituminous Mixtures"	± 1% Field Density

Surface Treatment Aggregates

Surface Treatment Aggregates		
Procedure	**Texas Test Method**	**Tolerance**
Gradation:	"Tex-200-F, Sieve Analysis of Fine and Coarse Aggregates"	-
> No. 4 ≤ No. 4	-	± 5% ± 3%

Portland Cement Concrete Coarse Aggregate

Portland Cement Concrete Coarse Aggregate		
Procedure	**Texas Test Method**	**Tolerance**
Gradation:	"Tex-401-A, Sieve Analysis of Fine and Coarse Aggregate"	-
> No. 4 ≤ No. 4	-	± 5% ± 3%

Portland Cement Concrete Fine Aggregate

Portland Cement Concrete Fine Aggregate		
Procedure	**Texas Test Method**	**Tolerance**
Gradation (3/8" through No. 200)	"Tex-401-A, Sieve Analysis of Fine and Coarse Aggregate"	± 3%
Sand Equivalent	"Tex-203-F, Sand Equivalent Test"	± 10

Portland Cement Concrete Complete Mixture

Portland Cement Concrete Complete Mixture		
Procedure	**Texas Test Method**	**Tolerance**
Flexural Strength Compressive	1. "Tex-448-A, Flexural Strength of Concrete Using Simple Beam Third-Point Loading" 2. "Tex-418-A, Compressive Strength of Cylindrical Concrete Specimens"	20% of the mean*

Approved December 2007

Slump	"Tex-415-A, Slump of Portland Cement Concrete"	± 1.0"
Entrained Air	3. "Tex-414-A, Air Content of Freshly Mixed Concrete by the Volumetric Method" 4. "Tex-416-A, Air Content of Freshly Mixed Concrete by the Pressure Method"	± 1%

Asphaltic Concrete Coarse Aggregate

Asphaltic Concrete Coarse Aggregate		
Procedure	**Texas Test Method**	**Tolerance**
Gradation:	"Tex-200-F, Sieve Analysis of Fine and Coarse Aggregates"	-
> No. 10 ≤ No. 10	-	± 5% ± 3%
Deleterious Material	"Tex-217-F, Determining Deleterious Material and Decantation Test for Coarse Aggregates"	± 0.3 %
Decantation	"Tex-217-F, Determining Deleterious Material and Decantation Test for Coarse Aggregates"	20% of the mean*

Asphaltic Concrete Fine Aggregate

Asphaltic Concrete Fine Aggregate		
Procedure	**Texas Test Method**	**Tolerance**
Gradation (No. 10 through No. 200)	"Tex-200-F, Sieve Analysis of Fine and Coarse Aggregates"	± 3%
Bar Linear Shrinkage	"Tex-107-E, Determining the Bar Linear Shrinkage of Materials"	± 2

Asphaltic Concrete Combined Aggregate

Asphaltic Concrete Combined Aggregate		
Procedure	**Texas Test Method**	**Tolerance**
Gradation:	"Tex-200-F, Sieve Analysis of Fine and Coarse Aggregates"	-
> 5/8" 5/8" through No. 200 Passing No. 200	-	± 5% ± 3% ± 1.5%
Sand Equivalent	"Tex-203-F, Sand Equivalent Test"	± 10

Approved December 2007

Asphaltic Concrete Complete Mixture

Asphaltic Concrete Complete Mixture		
Procedure	**Texas Test Method**	**Tolerance**
Asphalt Content	"Tex-210-F, Determining Asphalt Content of Bituminous Mixtures by Extraction"	± 0.3%
-	"Tex-228-F, Determining Asphalt Content of Bituminous Mixtures by the Nuclear Method"	± 0.3%
-	"Tex-229-F, Combined HMAC Cold-belt Sampling and Testing Procedure"	± 0.3%
-	"Tex-236-F, Determining Asphalt Content from Asphalt Paving Mixtures by the Ignition Method"	± 0.3%
Maximum Theoretical Specific Gravity	"Tex-227-F, Theoretical Maximum Specific Gravity of Bituminous Mixtures"	± 0.020
Laboratory Molded Density	"Tex-207-F, Determining Density of Compacted Bituminous Mixtures"	± 1.0%
Laboratory Molded Bulk Specific Gravity	"Tex-207-F, Determining Density of Compacted Bituminous Mixtures"	± 0.020
Stability	"Tex-208-F, Test for Stabilometer Value of Bituminous Mixtures"	5 points
Moisture	"Tex-212-F, Determining Moisture Content of Bituminous Mixtures"	± 0.2 mL
In-place Air Voids (Core)	"Tex-207-F, Determining Density of Compacted Bituminous Mixtures"	± 1.0%

NOTE: The above tolerances are to be used when comparison of test results is by split samples. A tolerance of plus or minus two (2) standard deviations shall be used when comparison of test results is by proficiency samples.

*The difference between compared test results shall not exceed the indicated percentage of the mean of the compared test results - the mean being the average of the two test results.

EXAMPLE: Plasticity Index	
Job Control test value	18
IA Test value	22
Mean	20
20% difference	4

Both values are within 20% of the mean.

Approved December 2007

Williamson County Road Bond Program
Construction Quality Control & Quality Assurance Program

Inspection Check Lists

Williamson County
Road Bond Program
Inspection Check Lists

Spec Item: 400 – Excavation & Backfill for Structures
Description:
Location:
Report No.:
Date:
Time:

QC Reviewer:

Results: ☐ Accepted ☐ Not Accepted

Remarks:

QC Reviewer Signature:

Excavation and Backfill for Structures	**Yes**	**No**	**NA**
I. Excavation (400.3)			
1. Whenever excavating for installing structures across private property beyond the limits of the embankment, is the top soil removed prior excavation and kept separate and later replaced, as nearly as feasible, in its original position?	☐	☐	☐
2. If trench excavation deeper than five (5) feet, is trench protection required?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

		Yes	No	NA
3.	When old or abandoned structures or foundations are encountered in the excavation, are they removed for the full width of the excavation and to a depth of one (1) foot below the bottom of the excavation?	☐	☐	☐
4.	During construction, did the contractor receive approval from the Engineer of Record before laying any structures in the presence of water?	☐	☐	☐
5.	If the excavation cannot be dewatered to the point where the subgrade is free of mud, was a concrete mixture with not less than three (3) sacks of cement per cubic yard (or other material approved by the Engineer of Record) placed a minimum of three (3) inches in depth in the bottom of the excavation?	☐	☐	☐
6.	For all culverts where the soil encountered at established footing grade is an unstable or incompressible material is the procedure shown in Item 400.3.A.4 followed unless other methods are called for in the plans?	☐	☐	☐
7.	Unless otherwise shown on the plans, are all sewer pipe structures constructed in an open cut with vertical sides to a point one (1) foot above the pipe?	☐	☐	☐
8.	Are all vertical sides sheeted and braced when necessary to maintain the required vertical excavation throughout the construction?	☐	☐	☐
9.	For pipe to be installed in a fill section was the embankment constructed to one (1) foot above the top of the pipe and then excavated for the pipe?	☐	☐	☐

Williamson County Road Bond Program Inspection Check Lists

	Yes	No	NA
10. Is the trench excavated to the width and elevations as shown in the plans?	☐	☐	☐
11. Is the pipe, culvert, etc., properly centered in the trench?	☐	☐	☐

II. Shaping and Bedding (400.3.B)

1. For precast box sections and pipe, is the bedding in accordance with Item 400.3.B unless otherwise shown on the plans?	☐	☐	☐
2. For precast pipe and box sections where cement stabilized backfill is indicated on the plans, is the excavation undercut a minimum 4 inches and backfilled with stabilized material to support the pipe at the required grade?	☐	☐	☐

III. Backfill – General (400.3.C)

1. Is backfill material free from stones of such size as to interfere with compaction, large or frozen lumps which will not break down readily under compaction; and wood or other extraneous material?	☐	☐	☐
2. a. Is backfill in areas not supporting any portion of the completed roadbed, retaining wall or embankment, placed in layers not more than ten (10) inches in depth (loose measurement)?	☐	☐	☐
b. Is backfill which will support any portion of the roadbed, retaining wall or embankment, placed in uniform layers not to exceed eight (8) inches in depth (loose measurement)?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

	Yes	No	NA
3. Is each layer of backfill material to the moisture content needed to obtain the required density?	☐	☐	☐
4. If a cohesionless material, such as sand, is used, is it compacted with vibratory equipment, water ponding or a combination of both?	☐	☐	☐

IV. Backfill – Bridge Foundations, Retaining Walls and Culverts (400.3.C.2)

1. Is the material used for backfilling free of any appreciable amount of gravel or stone particles more than four (4) inches in greatest dimension and of a gradation that permits thorough compaction?	☐	☐	☐
2. Are mechanical tamps or rammers required when the structure being backfilled could sustain damage from other compacting operations?	☐	☐	☐
3. Are any special density requirements for backfill under or adjacent to structures met?	☐	☐	☐

V. Backfill – Pipe (400.3.C.3)

1. After the bedding and pipes have been installed as required, is the selected backfill materials brought to proper moisture condition, placed along both sides of the pipe equally, in uniform layers not exceeding eight (8) inches in depth (loose measurement), and thoroughly compacted mechanically?	☐	☐	☐



Williamson County
Road Bond Program
Inspection Check Lists

	Yes	No	NA
2. Is the method of backfill in question 1 above continued in this manner to the top of pipe elevation and compacted in accordance with Item 400.3.C.1?	☐	☐	☐

VI. Cement Stabilized Backfill (400.3.C.4)

	Yes	No	NA
1. When required by plans, is cement stabilized backfill or flowable backfill placed equally along all sides of the structure, so as to prevent strain on or displacement of the structure; and are all voids filled?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Spec Item: 416 – Drilled Shaft Foundations
Description: _____
Location: _____
Report No.: _____
Date: _____
Time: _____

QC Reviewer: _____

Results: ☐ Accepted ☐ Not Accepted

Remarks: _____

QC Reviewer Signature: _____

416 – Drilled Shaft Foundations	**Yes**	**No**	**NA**
I. Materials (416.2)			
1. Did the Contractor incorporate materials into this project that meet the requirements of referenced items in Section 416.2?	☐	☐	☐
2. Does concrete for Drilled Shafts meet the requirements of Table 1 and Table 2 for concrete class and slump?	☐	☐	☐
3. If drilling slurry is used, does it meet the requirements of Table 3, as determined by Tex-130 E?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Drilled Shaft Foundations – Item 416

	Yes	No	NA
4. Do Chemical Admixtures meet the requirements of DMS-4620?	☐	☐	☐

II. Construction (416.3)

A. Excavation

1. When excavating, was satisfactory founding material encountered at plan elevation?	☐	☐	☐
If not, was the bottom of the shaft adjusted, or the foundation altered, as determined by the Engineer of Record, to satisfactorily comply with the design requirements?			
2. Is the shaft vertical alignment measured and found to be within a tolerance of 1 inch per 10 feet of depth? **(Hold Point)**	☐	☐	☐
3. Is the center of shaft location measured and found to be not more than 1 inch from the horizontal position shown on the plans? **(Hold Point)**	☐	☐	☐
If not, was a structural review performed?			
4. Did the Contractor provide suitable access and lighting for proper inspection of the completed excavation?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Drilled Shaft Foundations – Item 416

	Yes	No	NA
5. For abutment drill shafts, is the embankment at the bridge ends completed to grade and thoroughly compacted prior to drilling?	☐	☐	☐

B. Requirements for Slurry Displacement Method

1. If the slurry method is used to construct drilled shaft, is slurry mixed at the project site or is it premixed in a reservoir adjacent to the excavation (not in the shaft excavation or other hole)?	☐	☐	☐
2. During and after drilling was a head of slurry maintained in the shaft excavation at or near ground level or higher as necessary to counteract ground water pressure?	☐	☐	☐
3. Just prior to placement of reinforcing steel, was an airlift or proper size cleanout bucket used to remove accumulated material on the bottom after the completion of drilling? **(Hold Point)**	☐	☐	☐
4. Was concrete placement started within 4 hours of shaft excavation? If not, was shaft reprocessed?	☐	☐	☐
5. Is the slurry agitated if the placement of concrete is delayed to keep it liquefied?			

Williamson County
Road Bond Program
Inspection Check Lists

Drilled Shaft Foundations – Item 416

C. Reinforcing Steel	Yes	No	NA
1. Is the cage of reinforcing steel completely assembled according to plans and placed in the drill shaft as a unit immediately prior to concrete placement? **(Hold Point)**	☐	☐	☐
2. Where spiral reinforcement is used, is it tied to longitudinal bars (not welded) at a spacing not to exceed 24 inches?	☐	☐	☐
3. In uncased shafts, are concrete spacer blocks or steel chairs placed at sufficient intervals to insure concentric spacing for the entire length of the cage?	☐	☐	☐
4. In cased shafts, are steel chair spacers or bent pieces of steel bars placed at sufficient intervals to insure concentric spacing inside the casing?	☐	☐	☐
5. Is the cage adequately supported to control vertical displacement and racking and distortion of the steel during concrete placement and/or extraction of the casing?	☐	☐	☐
6. a. Is the elevation of the steel cage checked before and after concrete placement or after casing extraction when casing is used?	☐	☐	☐
b. Did the downward movement of the steel not exceed 6 inches per 20 feet of shaft length?	☐	☐	☐

Williamson County Road Bond Program Inspection Check Lists

Drilled Shaft Foundations – Item 416

	Yes	No	NA
c. Did the upward movement of the steel not exceed 6 inches?	☐	☐	☐
d. Were the dowel bars checked for proper lap length between the shaft and column?	☐	☐	☐

D. Concrete (Perform all work in accordance with the requirements of Item 420, "Concrete Structures".)

1. For dry shafts 24" in diameter or smaller, is concrete placed continuously through the entire length of the shaft through a suitable tube or tremie (limit freefall to 25 feet) to prevent segregation of materials?	☐	☐	☐
2. Does the elapsed time from the beginning of concrete placement into the cased portion of the shaft until the completion of extraction of the casing exceed one hour?	☐	☐	☐
3. At the time the concrete is placed, is the excavated drill shaft free from accumulated seep water?	☐	☐	☐
4. Has all loose material been removed from the bottom of the excavation prior to placing concrete?	☐	☐	☐

(Note: For dry shafts over 24" diameter concrete freefall is unlimited; use 3 foot drop tube.)

Williamson County
Road Bond Program
Inspection Check Lists

Drilled Shaft Foundations – Item 416

	Yes	No	NA
E. Additional Requirements for Slurry Displacement or Underwater Concrete Placement Methods			
1. Is the concrete placed through a closed tremie or pumped to the bottom of the excavation?	☐	☐	☐
2. If a tremie is used, is it kept full of concrete and well submerged in the previously placed concrete at all times?	☐	☐	☐

How is this determined?

3. During the placement of concrete was the tremie raised, as necessary, to maintain the free flow of concrete and the stability of any casing used?

4. Was additional concrete placed to ensure the removal of any contaminated concrete at the top of the shaft?

5. For pours over water, was a collar used to capture the slurry and the top portion of concrete flushed from the shaft?

6. If the tremie seal (separating layer between the concrete and contaminated bottom hole material) is lost, was the tremie removed, the bottom resealed and the tremie re-inserted at least 5 feet below the new seal before continuing concrete placement?

Williamson County
Road Bond Program
Inspection Check Lists

Drilled Shaft Foundations – Item 416

	Yes	No	NA
F. Load Testing			
1. If required, were the poured drill shafts load tested after curing in accordance with Item 405, "Foundation Test Load"?	☐	☐	☐

_____

_____

Williamson County Road Bond Program Inspection Check Lists

Drilled Shaft Foundations – Item 416

Drilled Shaft Record
Form No. 416

DRILLED SHAFT				BELL FTG.		Date Drilled	Casing Used	Drilling Mud	Slurry Plmt.	Remarks
No.	Dia. (in)	Top of Shaft Elev.	Length (ft)	Dia. (CY)	Vol. (CY)					
Bent No.	Design Load		Tons per shaft							
Bent No.	Design Load		Tons per shaft							
Bent No.	Design Load		Tons per shaft							
Bent No.	Design Load		Tons per shaft							
Bent No.	Design Load		Tons per shaft							

Summary for Payment				Comments
Total this sheet		Total this structure		
size of shaft	Length (ft.)	size of shaft	Length (ft.)	
Total Vol of Bells		Total Vol of Bells		

Williamson County
Road Bond Program
Inspection Check Lists

Drilled Shaft Foundations – Item 416

Signature/Date:_____

Williamson County
Road Bond Program
Inspection Check Lists

Spec Item: 420 – Concrete Structures
Description: _____
Location: _____
Report No.: _____
Date: _____
Time: _____

QC Reviewer: _____

Results: ☐ Accepted ☐ Not Accepted

Remarks: _____

QC Reviewer Signature: _____

Concrete Structures	**Yes**	**No**	**NA**
I. Materials (420.2)	☐	☐	☐
1. Were concrete structures constructed from materials conforming to TxDOT's Department Material Specifications in accordance with Section 420.2?			

II. Construction (420.4)

A. Schedule Restrictions

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Structures – Item 420

	Yes	No	NA
1. Did the Contractor comply with the schedule restrictions of Section 420.4.A, prior to erecting forms, removing forms, placement of materials, equipment and bridge rail, opening to construction or full traffic, post-tensioning or backfilling, ensure the previously placed concrete attained the minimum compressive strength or curing time?	☐	☐	☐

B. Falsework and Forms

1. Are the working drawings for forms and falsework signed and sealed by a Registered Professional Engineer, licensed in the state of Texas?	☐	☐	☐
2. Were the falsework and forms placed braced and alignments checked to ensure placement in accordance with the plans signed/sealed working drawings?	☐	☐	☐

C. Reinforcement (provided under Item 440)

1. Was reinforcing steel supports welded to I-beams or girders or to reinforcing steel as shown in the plans?	☐	☐	☐
2. Is the installation of dowels and anchor bolts in accordance with Section 420.4.G.10?	☐	☐	☐

D. Placing Concrete - General

1. Is the temperature of structural concrete at the time of placement between 50°and 95° F?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Structures – Item 420

	Yes	No	NA
2. Is the temperature of each truck load of concrete for bridge slabs and top slabs of direct traffic culverts being checked and is it between 50° and 85°F?	☐	☐	☐
3. Does the transporting time from the Batching Plant to the placing of concrete in the forms conform to the specification or requirements?	☐	☐	☐
4. If a pump is used to deliver concrete from the truck to the structure, is sampling for testing done at the discharge or was correlation testing performed and documented to ensure that specifications are met at the discharge end?	☐	☐	☐
5. Are all forms, pre-stressed concrete panels, T-beams and concrete box beams wetted thoroughly and remaining puddles of excess water removed prior to concrete placement?	☐	☐	☐
6. Does the method of handling, placing and consolidation of concrete minimize segregation of the concrete and displacement of the reinforcement?	☐	☐	☐
7. Does the concrete have a free fall of five (5) feet or less except in the case of thin walls or as specified otherwise?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Structures – Item 420

	Yes	No	NA
8. Is the concrete deposited in the forms in uniform layers not more than thirty-six (36) inches in thickness unless otherwise directed by the Engineer?	☐	☐	☐
9. Is the sequence of successive layers or adjacent portions of concrete such that they can be vibrated into a homogenous mass with the previously placed concrete before it sets?	☐	☐	☐
10. Is the construction sequence arranged so that cold joints in a monolithic placement is avoided?	☐	☐	☐
11. Is the concrete vibrated immediately after placement to consolidate the concrete and have the mortar flushed to the form surfaces?	☐	☐	☐
12. Is at least one stand-by vibrator provided for emergency use in addition to those required for placement?	☐	☐	☐
13. Is the rate of placement and finish satisfactory?	☐	☐	☐
14. Unless otherwise shown on the plans, for monolithic mass placements having a least dimension greater than five (5) feet, did the contractor submit a detailed plan to minimize temperature differential and meet the requirements of the Specification?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Structures – Item 420

	Yes	No	NA
E. Construction Joints			
1. Are all construction joints in bridge slabs of the type and at the locations shown on the plans?	☐	☐	☐
2. Are there additional bridge slab construction joints placed that are not shown on the plans?	☐	☐	☐
3. Was written authorization from the Engineer given for additional joints in these members?	☐	☐	☐
F. Placing Concrete in Cold Weather			
1. Is concrete placed only when the ambient temperature in the shade is 35°F and rising or above 40°F?	☐	☐	☐
2. Is the temperature maintained after placement in accordance with Section 420.4.G.11?	☐	☐	☐
G. Placing Concrete in Hot Weather			
1. Unless otherwise directed by the Engineer, is an approved retarding agent used in all concrete pours for superstructures and top slabs of direct traffic culverts when the air temperature is above 85°F?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Structures – Item 420

	Yes	No	NA
H. Placing Concrete in Water			
1. Are all classes of concrete placed under water, except Class E and Class SS, redesigned to contain an additional sack of cement per cubic yard?	☐	☐	☐
2. Is the concrete placed with a tremie meeting the requirements of Section 420.4.G.13, and is it not permitted to fall freely through the water nor disturbed after being placed?	☐	☐	☐
I. Placing Concrete in Superstructure			
1. For simple span bridge slabs, what type of finishing machine was used?	☐	☐	☐
2. If other than a mechanical longitudinal screed or a self-propelled transverse finishing machine was used, was approval given by the Engineer for small placements or unusual conditions?	☐	☐	☐
J. Finish of Bridge Slabs			
1. Did QC Reviewer witness the dry-run with the Contractor to ensure dead load deflection, screed profile, steel elevation, tying of rebar, armor joint elevation, depth of cover, etc. was checked?	☐	☐	☐
2. Was the concrete worked with a float to ensure a smooth finish?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Structures – Item 420

	Yes	No	NA
3. Did QC Reviewer perform sufficient checks with a 16-ft. straight edge on the plastic concrete to ensure final surface is within specified tolerances?	☐	☐	☐
4. Did QC Reviewer continue checking and floating until the deck surface was true to grade, free of depressions, high spots, voids and rough spots?	☐	☐	☐
5. Was the surface finish achieved by using a carpet drag, burlap drag or broom?	☐	☐	☐
6. Was the finished concrete surface coated within 10 minutes with a single application of evaporation retardant at the rate recommended by the manufacturer?	☐	☐	☐
7. Is the final bridge deck surface given a grooved steel tine finish approximately 1/8 to 3/16 inches deep approximately 1/8 inches wide, randomly spaced approximately ¾ to 1 inch apart?	☐	☐	☐
8. Did the bridge deck finish meet the ride quality tolerance of 1/8 inch in ten (10) feet (10 feet straight edge test)?	☐	☐	☐
9. Was the bridge deck grooved by saw-cutting in accordance with Section 420.4.I?	☐	☐	☐

Williamson County Road Bond Program Inspection Check Lists

Concrete Structures – Item 420

	Yes	No	NA
K. Curing Concrete			
1. Were the curing requirements of Item 420.4.J met? (Note: See Table 1 – Please note "Exceptions to 4-Day Curing?")	☐	☐	☐
L. Removal of Forms and Falsework			
1. Did the Contractor remove the forms and falsework in accordance with Section 420.4.K?	☐	☐	☐
M. Ordinary Surface Finish			
1. Unless noted otherwise in the plans, did the exposed surfaces for the following items receive an ordinary finish in accordance with Section 420.4.M?			
a. Inside and top of inlets?	☐	☐	☐
b. Inside and top of manholes?	☐	☐	☐
c. Inside of sewer appurtenances?	☐	☐	☐
d. Inside of culvert barrels?	☐	☐	☐
e. Bottom of bridge slab between girders or beams?	☐	☐	☐
f. Vertical and bottom surfaces of interior concrete beams or girders?	☐	☐	☐

Note: Form marks and chamfer edges do not need to be smoothed for inside of culvert barrels and bottom of bridge slabs between girders or beams.

N. Surface Finishes for Concrete (Item 427)			
1. Was the surface cleaned and patched in preparation to receive the finish coating as shown in the plans: was this work performed in accordance with the requirements of Item 427?	☐	☐	☐



Williamson County
Road Bond Program
Inspection Check Lists

Concrete Structures – Item 420

_____

_____

Williamson County
Road Bond Program
Inspection Check Lists

Spec Item: 421 – Hydraulic Cement Concrete
Description: _____
Location: _____
Report No.: _____
Date: _____
Time: _____

QC Reviewer: _____

Results: ☐ Accepted ☐ Not Accepted

Remarks: _____

QC Reviewer Signature: _____

Portland Cement Concrete	**Yes**	**No**	**NA**
I. Materials (421.2)			
1. Do the materials used in all mixed concrete placed on the job conform to TxDOT's Department Material Specifications and other requirements of Section 421.2?	☐	☐	☐
2. Is the concrete mix visually checked for uniformity from the beginning to the end of each load?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Hydraulic Cement Concrete – Item 421

	Yes	No	NA
II. Construction (421.4)			
A. Classification and Mix Design			
1. Are the requirements for entrained air met as outlined in Section 421.4.A.4 (Table 7)?	☐	☐	☐
2. Are the requirements of Table 8 – "Slump Requirements" being met?	☐	☐	☐
3. Is the maximum water-cement ratio exceeded?	☐	☐	☐
4. If question 3 is "yes", is the ratio regularly exceeded; was a new design performed?	☐	☐	☐
5. Is no water added to the concrete once discharge has begun to ensure that the maximum water-cement ratio is not exceeded?	☐	☐	☐
B. Job Testing and Documentation			
1. Was the concrete checked at the beginning of the load for slump or entrained air to prohibit placement of non-conforming material?	☐	☐	☐
2. Is the required job site testing (strength, clump, entrained air, concrete temperature, etc.) being performed at the required frequency using proper TxDOT testing methods?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Hydraulic Cement Concrete – Item 421

	Yes	No	NA
3. Are the concrete tickets properly completed?	☐	☐	☐
4. Is the amount of water withheld (based on the design water-cement ratio) at the plant shown on the concrete ticket?	☐	☐	☐
5. If concrete is pumped, where is sampling and testing being performed?	☐	☐	☐
6. Were comparison tests recorded between the haul unit and the point of unit discharge after pump?	☐	☐	☐

C. Truck Mounted Paving Mixers and Transit Mix Trucks

1. Is each truck delivered concrete batch mixed not less than 70 nor more than 100 revolutions of the drum at the mixing speed designated by the manufacturer to produce a uniform concrete mix?	☐	☐	☐
2. When water is added at the job site, is the batch mixed a minimum of 25 revolutions at mixing speed?	☐	☐	☐

Concrete Batch Ticket

Ticket No: _____

Date: _____

Material Information

MAT'L	Identification*	Am't Batched
AEA		oz.
RA		oz.
WRA		oz.
		oz.
CA_1		lbs.
CA_2		lbs.
FA_1		lbs.
Cement		lbs.
Fly Ash		lbs.
		lbs.
		lbs.
		lbs.

AT PLANT

Plant | Des. No. | Truck No.

CY | County | Project | CCSJ

Class | Air Temp °F | Mixer Chg'd. ☐ AM ☐ PM | MAX TIME

*%Moist | CA_1 | CA_2 | CA_3 | CA_4 | FA_1 | FA_2

Water: Added (gal). | Ice. (lbs) | Max. (gal)

Rev. Const.: Beg. | End | Mix Rev.

Remarks

Plant Inspector Signature

AT JOBSITE

Structure | Location in Str.

Water Added (gal). | Ice (lbs).

Rev. Constr. Beg. | End. | Mix Rev.

*Slump | *%Air | *Conc. Temp °F | *Unit Weight Lbs/ft^3

*Bm. Or Cyl. Nos | Target Value psi | Mixer Unloaded ☐ AM ☐ PM

Remarks

Plant Inspector Signature

Williamson County
Road Bond Program
Inspection Check Lists

Spec Item: 422 – Reinforced Concrete Slab
Description: _____
Location: _____
Report No.: _____
Date: _____
Time: _____

QC Reviewer: _____

Results: ☐ Accepted ☐ Not Accepted

Remarks: _____

QC Reviewer Signature: _____

Reinforced Concrete Slab	**Yes**	**No**	**NA**
I. Materials (422.2)			
1. Are the materials furnished by the Contractor in accordance with the referenced Items of work and meet the requirements of Section 422.2?	☐	☐	☐
II. Construction (422.3)			
A. Pre-placement			
1. Is all placing, finishing and curing equipment in place and operational?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Reinforced Concrete Slab – Item 422

	Yes	No	NA
2. Has a dry runoff the equipment been done?	☐	☐	☐
3. Has the proper clear cover for the rebar been checked?	☐	☐	☐
4. Does screed clear at the armor joints?	☐	☐	☐
5. Are drains and grates at plan location and elevation?	☐	☐	☐
6. Is sufficient plastic and curing blankets available in case of inclement weather after the pour begins?	☐	☐	☐
7. Are forms, deck panels, beams and every element that the fresh concrete will come in contact with properly wetted?	☐	☐	☐

B. During Placement

1. Has placement begun at the low end on spans with a profile grade of 1.5% or more?	☐	☐	☐
2. Are proper clear cover depths being checked at the frequency shown in the Test Guide Schedule?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Reinforced Concrete Slab – Item 422

	Yes	No	NA
3. Is concrete being placed between exterior and adjacent beams prior to placing concrete on overhangs?	☐	☐	☐
4. Is the application of evaporation retardant and curing compound being applies at the times required by specification and at the rates identified by the manufacturer?	☐	☐	☐

C. Post Placement

1. Is the final surface within specification tolerances when checked with a 16-ft straightedge?	☐	☐	☐
2. Has concrete attained a compressive strength in accordance with Section 420.4.A and Table 5 of Section 421.4 prior to removing forms or introducing loads?	☐	☐	☐
3. If deck grooves are saw cut, were they installed in accordance with Section 420.4.I?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Spec Item: 423 – Retaining Wall
Description:
Location:
Report No.:
Date:
Time:

QC Reviewer:

Results: ☐ Accepted ☐ Not Accepted

Remarks:

QC Reviewer Signature:

Retaining Wall	**Yes**	**No**	**NA**
I. Materials (432.2)			
1. Do the materials furnished by the Contractor meet the requirements of the referenced Items of work and other requirements of Section 432.2?			
2. For non-reinforced cast-in-place, was “Class A” concrete used?	☐	☐	☐
3. For reinforced cast-in-place, was “Class C” concrete used?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Retaining Wall – Item 423

	Yes	No	NA
4. Are precast panels fabricated with "Class H" concrete with compressive strength breaks of 4,000 psi or greater?	☐	☐	☐
5. If machine-made concrete block units are used, were they cast in accordance with ASTM C-90, Class 1, Type II and meet the 28-day compressive strength of 4,000 psi with maximum moisture absorption of 7%?	☐	☐	☐
6. If machine-made concrete block units are used, were they sampled and tested in accordance with ASTM C-140 and are the molded dimensions within 1/8" tolerance, except where height must be within 1/16"?	☐	☐	☐
7. For filter fabric used in the Retaining Wall System, is it UV-resistant and does the material meet the requirements of DMS-6200?	☐	☐	☐
8. Are approved joint fillers, pads, waterstops, etc. used as shown in the plans?	☐	☐	☐
9. Does the retaining wall design service life meet the requirements of Section 423.3B?	☐	☐	☐
10. Does the backfill material conform to the gradation and other requirements stated in the plans and/or Item 423.C.2: Table 2 and Item 423.3.C.3: Table 3?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Retaining Wall – Item 423

II. Construction (423.2)

	Yes	No	NA
1. Is the foundation for the structure graded level and compacted with a roller approved prior to wall construction? (Hold Point)	☐	☐	☐
2. Are any foundation soils found to be unsuitable removed and replaced?	☐	☐	☐
3. Is filter fabric placed behind all wall joints, and at the intersection of retaining walls with other structures, including riprap?	☐	☐	☐
4. Does the filter fabric cover joints a minimum of 6 inches on each side and is it positively held in place?	☐	☐	☐
5. As select fill material is placed behind the wall panels, are the panel alignments maintained by acceptable bracing methods?	☐	☐	☐
6. Do vertical tolerances and horizontal alignment tolerance not exceed ¾" when measured along the wall with a 10-foot straight edge?	☐	☐	☐
7. Is the overall vertical tolerance of the wall (plumbness from top to bottom) within ½" per 10-feet of wall height?	☐	☐	☐
8. Does the backfill placement closely follow the erection of each lift of panels, and is it placed in 8" lifts and compacted to 95% of density?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Retaining Wall – Item 423

	Yes	No	NA
9. At each reinforcement level, is the backfill leveled and compacted before placing the reinforcement?	☐	☐	☐
10. Is adjacent embankment placed to approximately the same level as the backfill material? Note: Do not create a continuous, distinct, vertical joint between the select and embankment backfill.	☐	☐	☐
11. Is compaction in the 3-foot strip adjacent to the backside of the wall accomplished with hand operated or walk-behind compacter?	☐	☐	☐
12. If rock backfill is used as select material, was a filter fabric layer placed before placing the last 2 feet of backfill immediately below the pavement structure or top of wall? Note: Overlap splices by at least 18".	☐	☐	☐
13. Does the upper 2 feet of rock backfill contain no stones larger than 3" in their greatest dimension and is it composed of material with sufficient fines to fill the voids in a compacted state?	☐	☐	☐
14. Is the wall being constructed in accordance with the details shown on the plan sheets and/or construction drawings?	☐	☐	☐
15. If construction drawings are used to show the construction details, does the Reviewer have (or have access to) a copy of these drawings?	☐	☐	☐

Williamson County Road Bond Program Inspection Check Lists

Retaining Wall – Item 423

	Yes	No	NA
16. Are proper spacers provided between panels?	☐	☐	☐
17. Is grading and drainage maintained adjacent to the wall during construction?	☐	☐	☐
18. If temporary MSE walls are used, were the walls constructed in accordance with Section 423.3.F requirements?	☐	☐	☐
19. If Concrete Block Retaining Walls are used, were the walls constructed in accordance with Section 423.3.G?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Spec Item:	425 – Precast Pre-stressed Concrete Structural Members	Report No.:	
Description:		Date:	
Location:		Time:	

QC Reviewer: _____

Results: ☐ Accepted ☐ Not Accepted

Remarks: _____

QC Reviewer Signature: _____

Precast/Pre-stressed Concrete Structural Members	**Yes**	**No**	**NA**
I. Materials (425.2)			
1. Do the materials incorporated in the Precast Pre-stressed Concrete Structural Members conform to the reference items of work, TxDOT's Department Material Specifications and other requirements of Section 425.2?	☐	☐	☐
2. Did the Contractor provide manufacturer's certifications for bedding strips and use adhesives or bonding agents as recommended by the polystyrene manufacturer?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Precast Pre-stressed Concrete Structural Members – Item 425

	Yes	No	NA
II. Construction (425.3)			
1. Are beams, bridge deck panels and bearing pads approved by TxDOT and is the TxDOT stamp on them?	☐	☐	☐
2. Do beams have any signs of damage such as cracks, spalling and/or "honeycombs"?	☐	☐	☐
3. Are dimensions correct?	☐	☐	☐
4. During erection of beams, did the Contractor securely tie or brace all beams in accordance with minimum erection and bracing standards?	☐	☐	☐
5. Are any safety hazards apparent (power lines, traffic hazards or other construction activities)?	☐	☐	☐
6. Have beams been erected to proper alignment as shown on the plans?	☐	☐	☐
7. Are beams positioned with the proper clearance from the abutment back-wall and adjacent beam?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Spec Item: 440 – Reinforcing Steel
Description:
Location:
Report No.:
Date:
Time:

QC Reviewer:

Results: ☐ Accepted ☐ Not Accepted

Remarks:

QC Reviewer Signature:

Reinforcing Steel	**Yes**	**No**	**NA**
I. Materials (440.2)			
1. Does the reinforcing steel to be welded comply with ASTM A706 or have a carbon equivalency of not more than 0.55%?	☐	☐	☐
2. Do the electrodes used for welding conform to the requirements of Item 448.2 for the type of reinforcing steel used?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Reinforcing Steel – Item 440

		Yes	No	NA
3.	Does the person performing the welding operation have welder certification paper issued by TxDOT that covers the type of work he/she is performing? (448.4)	☐	☐	☐
4.	Is an oven used to dry and store electrodes with low hydrogen coverings for the times and at the temperatures required? (448.4.C)	☐	☐	☐
5.	Is the rebar used on the job from an approved Mill as required by Section 440.2.A?	☐	☐	☐
6.	Unless otherwise shown on the plans, is the deformed rebar Grade 60 as required by Section 440.2.B?	☐	☐	☐
7.	For Epoxy Coated Rebar, is the coated reinforcing steel in accordance with Table 3 (440.2.F)?	☐	☐	☐
8.	Are mechanical couplers used when reinforcing steel is spliced?	☐	☐	☐
9.	Are all couplers furnished by the Contractor produced by a pre-qualified manufacturer? (DMS-4510)	☐	☐	☐
10.	Before being used, are the couplers sampled and tested as required in Item 440.2.G and do they meet all requirements? (DMS-4510)	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Reinforcing Steel – Item 440

	Yes	No	NA
II. Construction (440.3.C)			
1. Is steel reinforcement adequately stored above the surface of the ground upon platforms, skids or other supports and protected from damage and deterioration?	☐	☐	☐
2. In final placement, is the reinforcement free from dirt, paint, grease, oil or other foreign materials and from defects such as cracks and delaminations?	☐	☐	☐
3. Are lap-splice, wield-splice, or mechanically spliced bars placed as shown on the plans and meet the requirements of Section 440.3.D and Table 5 "Minimum Lap Requirements by Bar Size"?	☐	☐	☐
If not, was written approval given by the Engineer for additional splices?			
4. In the plane of the steel parallel to the nearest surface of concrete, do the bars vary from plan placement by not more than 1/12 of the spacing between bars?	☐	☐	☐
5. In the plane of the steel perpendicular to the nearest surface of concrete, do the bars vary from plan placement by not more than 1/4"?	☐	☐	☐
6. Is the depth of cover (concrete) to the nearest surface of steel at least 1" unless otherwise shown on the plans?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Reinforcing Steel – Item 440

		Yes	No	NA
7.	For bridge slabs, is the clear cover tolerance for the top mat of reinforcement 0" to ½"?	☐	☐	☐
8.	Are bars of the proper size, location and quantity as shown on the plans?	☐	☐	☐
9.	a. What type of bar supports are used?	☐	☐	☐
	b. Are the bar supports adequate in strength and number to hold the reinforcement in place, before and during concrete placement?	☐	☐	☐
	If not, is concrete placement halted until corrective measures are taken?			
	c. If individual bar supports are used, are they placed in rows at 4 ft. maximum spacing?	☐	☐	☐
	d. If continuous type bar supports are used, are they placed in rows at 4 ft. maximum spacing?	☐	☐	☐
	e. Are continuous type bar supports used when permanent metal deck forms are used?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Reinforcing Steel – Item 440

	Yes	No	NA
10. Are all accessories used with epoxy coated reinforcement such as tie wires, bar chairs, supports or clips made of steel, fully coated with epoxy or plastic?	☐	☐	☐
11. Has all visible damage to the coating been repaired in accordance with Section 440.3.F.3 before the reinforcement is used?	☐	☐	☐
12. Is any cutting of coated reinforcement done only by sawing or shear cutting with permission of the Engineer?	☐	☐	☐
13. Have all cut ends been coated before the reinforcement is used?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Spec Item: 442 – Metal for Structures
Description: _____
Location: _____
Report No.: _____
Date: _____
Time: _____

QC Reviewer: _____

Results: ☐ Accepted ☐ Not Accepted

Remarks: _____

QC Reviewer Signature: _____

Metal for Structures	**Yes**	**No**	**NA**
I. Materials (442.2)			
A. Non-Bridge Structures:			
1. Was the structural steel delivered and used within the project tested in accordance with ASTM A370?	☐	☐	☐
2. Does the type and grades of steel used by the Contractor in accordance with the listing in Section 442.2.2.A or as shown on the plans?	☐	☐	☐

Williamson County Road Bond Program Inspection Check Lists

Metal for Structures – Item 442

	Yes	No	NA
3. Have tension members and other components listed in Section 442.2.2.B been impact tested and do the test results conform with the Charpy V-notch (CVN) requirements of Table 1 within the above stated section?	☐	☐	☐

B. Other Components such as Shear Connectors, Anchors, Fasteners, Slip-resistant Deck Plates and Rail Posts:

1. Do the materials supplied to the project under this section have a certification of material properties from the manufacturer?	☐	☐	☐
2. Do the materials meet the ASTM requirements as shown in Section 442.2.3 per category description and tested in accordance with section requirements?	☐	☐	☐

C. Forgings, Castings and Extrusions (442.2.B, C, D, E, F, G):

1. Do the components under this category meet the ASTM, class, grade and/or alloy-temper as required in accordance by Section 442.2.B, C, D, E, F, G?	☐	☐	☐

II. Construction Methods (442.3)

1. Was the structural metal fabricated, welded and erected in accordance with Item 441, “Steel Structures”; Item 447, “Structural Bolting; Item 448, “Structural Field Welding”; and applicable AWS welding codes?	☐	☐	☐
2. Were the fabricated and erected structural metal members painted in accordance with Item 446, “Cleaning and Painting Steel”?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Metal for Structures – Item 442

		Yes	No	NA
3.	When specified in the plans, was the fabricated steel items galvanized in accordance with Item 445, “Galvanizing”?	☐	☐	☐
4.	Were field repairs to the painting or galvanizing of fabricated and erected steel items performed in accordance with Item 446, “Cleaning and Painting” or Item 445, “Galvanizing”?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Spec Item: 462 – Concrete Box Culverts & Storm Drains
464 – Reinforced Concrete Pipe

Report No.: _____

Description: _____

Date: _____

Location: _____

Time: _____

QC Reviewer: _____

Results: ☐ Accepted ☐ Not Accepted

Remarks: _____

QC Reviewer Signature: _____ :

Concrete Box Culverts & Storm Drains/Reinforced Concrete Pipe	**Yes**	**No**	**NA**
I. Materials (462.2 and 464.2)			
A. Reinforced Concrete Pipe, Concrete Box Culverts and Strom Drains	☐	☐	☐
1. Were the individual sections of pipe or pre-cast boxes inspected and rejected if they do not have the Division of Materials and Tests monogram on them?	☐	☐	☐
2. For cast-in-place or pre-cast box culverts and storm drains, do the materials and method of fabrication comply with the requirements of Section 462.2.A, B?			

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Box Culverts & Storm Drains – Item 462
Reinforced Concrete Pipe – Item 464

	Yes	No	NA
3. For cast-in-place box culverts and storm drains, during fabrication, did test specimens meet the requirements of Item 421, "Hydraulic Cement Concrete"; Item 440, "Reinforcing Steel" and conform to the requirements of Item 420, "Concrete Structures"?	☐	☐	☐
4. Were the individual sections of pipe or pre-cast boxes inspected at the project site and repaired or rejected if any of the defects are found?	☐	☐	☐
5. Were pre-cast sections inspected to ensure they meet the tolerance in accordance with Section 462.2.F?	☐	☐	☐
6. Are cracks which extend into the plane of the reinforcing steel repaired in an approved manner?	☐	☐	☐
7. Are small damaged or honeycombed areas which are purely surface in nature repaired to the satisfaction of the Engineer?	☐	☐	☐
8. Are precast sections stored on level blocking in a manner acceptable to the Engineer?	☐	☐	☐
9. Are lifting holes larger than 3" diameter?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Box Culverts & Storm Drains – Item 462
Reinforced Concrete Pipe – Item 464

	Yes	No	NA
B. Jointing Materials			
1. For all jointing materials except mortar, has the Contractor furnished the Engineer the Manufacturer's Certificate of Compliance that complies with the requirements in Section 464.2.I?	☐	☐	☐

II. Construction (462.3 and 464.3)

A. Laying Pipe and Pre-cast Boxes

1. Unless otherwise authorized by the Engineer, did the Contractor start the laying of pipe or present boxes on the bedding at the outlet end with the spigot or tongue pointing downstream and proceed toward the inlet end with the abutting sections properly matched, true to the established lines and grade?	☐	☐	☐
2. Is proper equipment provided for hoisting and lowering the sections of pipe or pre-cast boxes into the trench without disturbing the bedding and the sides of the trench?	☐	☐	☐
3. Are the ends of the pipe or precast boxes carefully cleaned, if necessary?	☐	☐	☐
4. Is the pipe or pre-cast boxes fitted and matched so that when laid in the bed, it forms a smooth uniform conduit?	☐	☐	☐
5. Are multiple installations of reinforced concrete pipe (RCP) laid with the center lines of individual barrels parallel?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Box Culverts & Storm Drains – Item 462
Reinforced Concrete Pipe – Item 464

	Yes	No	NA
6. Unless otherwise shown on the plans for multiple installations for RCP, are the clear distances between outer surfaces of adjacent pipes as shown in Item 464.3.B (Table 5)?	☐	☐	☐
7. Is the area for placement of structures excavated, shaped and the structures bedded and backfilled in accordance with Item 400, "Excavation and Backfill Structures"?	☐	☐	☐
8. Unless otherwise shown on the plans or permitted in writing by the Engineer, did heavy earth moving equipment haul over the structure before a minimum of 4-feet of compacted fill was placed over the top of the structure?	☐	☐	☐
9. Is pipe or pre-cast boxes damaged by the Contractor's equipment removed and replaced or repaired by an approved method by the Engineer?	☐	☐	☐

B. Jointing for Pipes, Concrete Box Culverts and Storm Drains

1. Does the mortar consist of one part cement, two parts sand, and sufficient water to make a plastic mix?	☐	☐	☐
2. Are the structure ends cleaned and wetted before making the joint?	☐	☐	☐
3. After the structures are tightly jointed, is the mortar packed into the joint from both inside and outside the structure, and then the inside finished smooth and flush with adjacent joints of structure?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Box Culverts & Storm Drains – Item 462
Reinforced Concrete Pipe – Item 464

	Yes	No	NA
4. Are mortar joints cured by keeping the joints wet for at least 48 hours or until the backfill operation begins after the mortar joint has cured for at least 6 hours?	☐	☐	☐
5. Is no mortar jointing done when the atmospheric temperature is at or below 40°F?	☐	☐	☐
6. Are mortared joints protected against freezing by backfilling or other approved methods for at least 24 hours?	☐	☐	☐

C. Joints using Cold-Applied, Plastic Asphalt Sewer Joint Compound

1. Are both ends of the structure clean and dry at the time the joint is made?	☐	☐	☐
2. Was a ½" thick layer of the compound troweled or otherwise placed in the groove end of the structure covering not less than two-thirds of the joint face around the entire circumference before the tongue end of the next structure is shoved home with sufficient pressure to make a tight joint?	☐	☐	☐
3. After the joint is made, is any excess mastic projecting into the structure removed?	☐	☐	☐

D. Joints Using Rubber Gasket

1. Where rubber gasket joints are required by the plans, is the joint assembly made according to the recommendations of the gasket manufacturer?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Box Culverts & Storm Drains – Item 462
Reinforced Concrete Pipe – Item 464

	Yes	No	NA
2. When using rubber gaskets, are the joints water tight?	☐	☐	☐

E. Joints Using Pre-formed Flexible Joint Sealants

1. Are the joints placed according to the procedure shown in Article 464.3.C.4 and the manufacturer's recommendations?	☐	☐	☐
2. Is the joint sealer placed in such manner that no dirt or other deleterious materials will come in contact with the joint sealing material?	☐	☐	☐
3. When the atmospheric temperature is below 60°F, are plastic joint seal gaskets either stored in an area warmed to above 70°F or artificially warmed to this temperature in a manner satisfactory to the Engineer?	☐	☐	☐

F. Connections and Stub Ends for Pipes, Concrete Box Culverts and Storm Drains

1. Is the bottom of existing structures mortared or concreted if necessary to eliminate any drainage pockets created by the connections?	☐	☐	☐
2. Is any damage to the existing structure resulting form making the connection satisfactorily repaired by the Contractor?	☐	☐	☐
3. Unless otherwise shown on the plans, are the connections between concrete pipe and corrugated metal pipe made with a suitable concrete collar having a minimum thickness of 4"?	☐	☐	☐

Williamson County
Road Bond Program
Inspection Check Lists

Concrete Box Culverts & Storm Drains – Item 462
Reinforced Concrete Pipe – Item 464

	Yes	No	NA
4. Are stub ends, for connections to future work not shown on the plans, finished by installing watertight plugs into the free end of the pipe?	☐	☐	☐
5. For precast boxes, fill lifting holes with mortar or concrete and cure or precast concrete mortar plugs may be used. Have the holes been filled accordingly prior to backfill?	☐	☐	☐

APPENDIX B

GUIDE SCHEDULE OF SAMPLING AND TESTING

GUIDE SCHEDULE OF SAMPLING & TESTING

MAY 2016



Using the Guide Schedule

Research of sampling and testing rates listed for project tests in the following Guide Schedule show that the Department's and the Contractor's risk of either rejecting "good" material or accepting "bad" material range from 20% to 40%.

To reduce this risk, we recommend that the sampling rate be increased during initial production. A four-fold increase in testing frequency will generally reduce risk to approximately 5%. The intent of increasing testing at the start of production is to insure that the Contractor's processes are in control and to establish acceptability requirements early.

There is a need to increase the frequency of testing for high-variability materials and when testing results do not meet specifications. The Engineer may require the Contractor to reimburse the Department for costs resulting from failing test results, in accordance with the specifications.

Materials incorporated in TxDOT projects are subjected to various quality assurance procedures such as testing (as outlined in this document), certification, quality monitoring, approved lists, etc. The Engineer and testing staff should familiarize themselves with materials to be used before work begins by reviewing the specifications and this document. Discuss material testing requirements with the Contractor.

Other testing required by the specifications, but not shown in the Guide Schedule, should be performed at a frequency necessary to provide adequate confidence that materials meet specifications.

NOTE: For projects subject to FHWA construction oversight activities, use the "Letter of Certification of Materials Used" to document reasons for material acceptance when a test fails. For all other projects, document the justification and explanation for acceptance of materials that fail project tests in the project file.

Assuring the quality of the product and proper incorporation of materials into the project begins with proper sampling practices. Sampling, testing, and construction inspection must be performed collaboratively to assure the specific attributes of the finished product reflect quality workmanship. Sampling guidance for hot-mixed asphalt is contained in Tex-225-F, "Random Selection of Bituminous Mixture Samples," and the respective specification for that material. All remaining materials are covered by method and materials specifications, to which the following applies.

For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows:

- Soils/flexible base: Vary sampling between stockpiling operations, completed stockpile, windrow, and project site. Vary the time of day sampling is performed.
- Aggregates: Sample aggregates nearest the point of incorporation into the work. Vary sampling between stockpiling operations, completed stockpile, belt sampling, and if deemed necessary, railroad cars/trucks. Vary the time of day sampling is performed.
- Concrete (structural and miscellaneous: Always sample as near as practicable to the point of placement. For strength testing, vary the time of day or the number of truck from which the concrete is sampled. Tests for slump, air, and temperature should be done often to ensure the consistent control of the concrete production (not applicable to miscellaneous concrete).

This Guide Schedule is applicable to all contracts associated with the 2014 Standard Specifications.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE I – EMBANKMENTS, SUBGRADES, BACKFILL, AND BASE COURSES

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (F)	REMARKS
EMBANKMENT (CUTS & FILLS)	Liquid Limit **(A)**	Tex-104-E	During stockpiling operations, from completed stockpile, or project site **(B)**	Materials with PI ≤ 15: 10,000 CY	For Type A embankment or when required by the plans. This test may be waived for embankment cuts as directed by the Engineer. Determine a new liquid limit and plasticity index for each different material or notable change in material. Sample in accordance with Tex-100-E.
	Plasticity Index **(A)**	Tex-106-E		Materials with PI > 15: 5,000 CY	
	Gradation	Tex-110-E		Each 10,000 CY	When shown on plans. This test may be waived for embankment cuts, as directed by the Engineer. Sample in accordance with Tex-100-E.
	Moisture/Density	Tex-114-E		As directed by the Engineer	Not required for ordinary compaction. Determine a new optimum moisture and maximum density for each different material or notable change in material. Sample in accordance with Tex-100-E.
	In-place Density **(A)**	Tex-115-E	As designated by the Engineer	Fill: each 5,000 CY min. 1 per lift.	Not required for ordinary compaction. Determine a new optimum moisture and maximum density according to Tex-114-E for each different material or notable change in material. Correct the moisture contents measured by nuclear density gauge in Tex-115-E with the moisture contents determined in accordance with Tex-103-E, as necessary for control, for each different material or notable change in material and adjust the density accordingly. Materials such as RAP, gypsum, lime, cement, and iron ore tend to bias the counts for nuclear density gauges.
				Cut: each 6,000 LF	
RETAINING WALL (NON-SELECT BACKFILL)	As shown above for Embankment (Cuts and Fills)		As shown above for Embankment (Cuts and Fills)	As shown above for Embankment (Cuts and Fills)	Sample in accordance with Tex-100-E.
RETAINING WALL (SELECT BACKFILL)	Gradation	Tex-110-E	During stockpiling operations, from completed stockpile, or project site **(B)**	Each 5,000 CY	Sample in accordance with Tex-400-A.
	Resistivity **(A)**	Tex-129-E	During stockpiling operations, from completed stockpile, or project site **(B)**	Each 5,000 CY	For material with resistivity between 1,500 and 3,000 ohm-cm, determine chloride and sulfate content, as specified in Item 423. Sample in accordance with Tex-400-A.
	pH **(A)**	Tex-128-E	During stockpiling operations, from completed stockpile, or project site **(B)**	Each 5,000 CY	Sample in accordance with Tex-400-A.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE I – EMBANKMENTS, SUBGRADES, BACKFILL, AND BASE COURSES

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (F)	REMARKS
RETAINING WALL (SELECT BACKFILL) (continued)	Soundness	Tex-411-A	During stockpiling operations, or from completed stockpile	1 per source, per project	Test when backfill sources appear to contain particles such as shale, caliche, or other soft, poor-durability particles. Sample in accordance with Tex-400-A.
	In-place Density **(A)**	Tex-115-E	As designated by the Engineer.	1 per backfill lift, per wall	Not required for rock backfill. For walls greater than 500 ft. in length, perform one test per lift for every 500 ft. in length. **(F)** Correct the moisture contents measured by nuclear density gauge in Tex-115-E with the moisture contents determined in accordance with Tex-103-E for each different material or notable change in material and adjust the density accordingly.
UNTREATED BASE COURSES	Liquid Limit **(A)**	Tex-104-E	During stockpiling operations, from completed stockpile, or windrow **(B)**	Each 5,000 CY	Sample in accordance with Tex-400-A.
	Plasticity Index **(A)**	Tex-106-E	During stockpiling operations, from completed stockpile, or windrow **(B)**	Each 5,000 CY	
	Gradation **(A)**	Tex-110-E	During stockpiling operations, from completed stockpile, or windrow **(B)**	Each 5,000 CY	Sample in accordance with Tex-400-A.
	Moisture/Density	Tex-113-E	From completed stockpile at the source **(E)**	Each 20,000 CY	Not required for ordinary compaction. Sample in accordance with Tex-400-A.
	Wet Ball Mill **(A)**	Tex-116-E	From completed stockpile at the source **(E)**	Each 20,000 CY	As required by the plans. Sample in accordance with Tex-400-A.
	Strength **(A)**	Tex-117-E	From completed stockpile at the source **(E)**	Each 20,000 CY	As required by the plans. When base material is from a source where the District has a record of satisfactory triaxial results, the frequency of testing may be reduced to one per 30,000 CY. If any one test falls below the minimum value required, the frequency of testing will return to the original frequency of 20,000 CY. Sample in accordance with Tex-400-A.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE I – EMBANKMENTS, SUBGRADES, BACKFILL, AND BASE COURSES

				PROJECT TESTS		
MATERIAL OR PRODUCT		TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (F)	REMARKS
UNTREATED BASE COURSES		In-place Density (A)	Tex-115-E	As designated by the Engineer	Each 3,000 CY, min. 1 per lift	Correct the moisture contents measured by nuclear density gauge in Tex-115-E with the moisture contents determined in accordance with Tex-103-E, as necessary for control, for each different material or notable change in material and adjust the density accordingly. Materials such as RAP, gypsum, lime, cement, and iron ore tend to bias the counts for nuclear density gauges.
		Thickness (A)	Tex-140-E	As designated by the Engineer	Each 3,000 CY	Not required where survey grade control documents compliance.
TREATED SUBGRADE AND BASE COURSES	SUBGRADE BEFORE TREATMENT	Organic Content	Tex-148-E	As designated by the Engineer	1 per 500 linear feet or 5,000 CY	Required for existing subgrade material and material imported from a borrow source. Soil survey and geologic maps may be used to determine sampling locations. Sample in accordance with Tex-100-E.
		Sulfate Content	Tex-145-E	As designated by the Engineer	1 per 500 linear feet or 5,000 CY	Required for existing subgrade material and material imported from a borrow source. Soil survey and geologic maps may be used to determine sampling locations. Sample in accordance with Tex-100-E.
	NEW BASE MATERIAL	Liquid Limit (A)	Tex-104-E	During stockpiling operations, from completed stockpile, or windrow (B)	Each 5,000 CY	When central mix site or plant is used, windrow sampling may be waived. Sample in accordance with Tex-400-A.
		Plasticity Index (A)	Tex-106-E	During stockpiling operations, from completed stockpile, or windrow (B)	Each 5,000 CY	
		Gradation (A)	Tex-110-E	During stockpiling operations, from completed stockpile, or windrow (B)	Each 5,000 CY	Sample in accordance with Tex-400-A.
		Wet Ball Mill (A)	Tex-116-E	From completed stockpile at the source (E)	Each 20,000 CY	As required by the plans. Sample in accordance with Tex-400-A.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE I – EMBANKMENTS, SUBGRADES, BACKFILL, AND BASE COURSES

				PROJECT TESTS		
MATERIAL OR PRODUCT		TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (F)	REMARKS
TREATED SUBGRADE AND BASE COURSES	NEW BASE MATERIAL	Strength **(A)**	Tex-117-E	From completed stockpile at the source **(E)**	Each 20,000 CY	As required by the plans. When base material is from a source where the District has a record of satisfactory triaxial results, the frequency of testing may be reduced to one per 30,000 CY. If any one test falls below the minimum value required, the frequency of testing will return to the original frequency of 20,000 CY.
	LIME	Compliance with DMS-6350	Tex-600-J	During delivery to project	Commercial Lime Slurry: each 200 tons of lime Carbide Lime Slurry: each 100 tons of lime	Sample in accordance with Tex-400-A.Verify the source is listed on the current Material Producer List for Lime. Only materials appearing on the Material Producer List will be accepted. Sample frequency for Carbide Lime Slurry may be increased as directed by the Engineer. For Hydrated Lime and Quick Lime project testing is not required but it is encouraged to sample and test the material at a rate of 1 per project as a best practice.
	CEMENT	Compliance with DMS-4600		Railroad car, truck, or cement bins		Verify the source is listed on the current Material Producer List for Cement. If not, sample and test in accordance with DMS-4600. **(C)**
	FLY ASH MATERIAL	Compliance with DMS-4615		Project samples at location designated by the Engineer		Verify the source is listed on the current Material Producer List for Fly Ash. Only materials from CST/M&P approved sources appearing on the Material Producer List for Fly Ash will be accepted. Project testing is not required but it is encouraged to sample and test the material at a rate of 1 per project as a best practice. **(C)**
	COMPLETE MIXTURE	Pulverization Gradation	Tex-101-E Part III	Roadway, after pulverization and mixing	As necessary for control	At the beginning of the project, one test must be made for each 4,500 CY or 6,000 tons until the Engineer is satisfied that acceptable pulverization results are being obtained. Sample in accordance with Tex-100-E.
		Soil-Cement Testing Soil-Lime Testing	Tex-120-E, Part II, or Tex-121-E, Part II	From roadway windrow after treatment **(E)**	Each 20,000 CY	Not required for ordinary compaction. Determine a new moisture/density curve for each different or notable change in material. Perform Tex-120-E, Part II, for Cement Treated Material, and Tex-121-E, Part II, for Lime, Lime-Fly Ash, or Fly Ash Treated Material. If Tex-120-E, Part I, Tex-121-E, Part I, or Tex-127-E is performed prior to the project, this test may be waived. Sample in accordance with Tex-100-E.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE I – EMBANKMENTS, SUBGRADES, BACKFILL, AND BASE COURSES

MATERIAL OR PRODUCT		TEST FOR	TEST NUMBER	PROJECT TESTS: LOCATION OR TIME OF SAMPLING (D)	PROJECT TESTS: FREQUENCY OF SAMPLING (F)	REMARKS
TREATED SUBGRADE AND BASE COURSES	COMPLETE MIXTURE	Soil-Cement Testing Soil-Lime Testing	Tex-120-E, Part I, Tex-121-E, Part I, or Tex-127-E	From roadway windrow after treatment	As necessary for control	Perform Tex-120-E, Part I, on cement treated material, and Tex-121-E, Part I, for lime-fly ash or fly ash treated material. Verifies the field strength by comparing results from the mix design. Performed at the discretion of Engineer. Sample in accordance with Tex-100-E.
		In-place Density **(A)**	Tex-115-E	As designated by the Engineer	Each 3,000 CY, min 1 per lift	Determine the appropriate moisture/density curve for each different material or notable change in material. Correct the moisture contents measured by nuclear density gauge in Tex-115-E with the moisture contents determined in accordance with Tex-103-E, as necessary for control, for each different material or notable change in material and adjust the density accordingly. Stabilizers and materials such as RAP, gypsum, and iron ore tend to bias the counts for nuclear density gauges.
		Thickness **(A)**	Tex-140-E	As designated by the Engineer	Each 3,000 CY	Not required where survey grade control documents are used for compliance
RECLAIMED ASPHALT PAVEMENT (RAP), CRUSHED CONCRETE, and RECYCLED MATERIALS		Sulfate Content	Tex-145-E	During stockpiling operations, from completed stockpile, or windrow	Each 5,000 CY	Required only for contractor furnished recycled material, including crushed concrete. Not required for RAP. Sample in accordance with Tex-400-A.
		Deleterious Material	Tex-413-A		Each 5,000 CY	Required only for contractor furnished recycled material, including crushed concrete. Sample in accordance with Tex-400-A.
		Decantation	Tex-406-A	During stockpiling operations, from completed stockpile, or windrow	Each 5,000 CY	Required only for contractor furnished RAP. Sample in accordance with Tex-400-A.

TABLE I – FOOTNOTES

A	When this project acceptance test fails but the product is accepted, document the reasons for acceptance on the Letter of Certification of Materials Used or in the SiteManager Remarks field.
B	Engineer will select any of these locations or any combinations thereof with the provision that the initial sample will be obtained from the completed stockpile at the source and at least one out of ten consecutive samples will be taken at the project site (from the windrow for treated and untreated bases and embankments when possible).
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.

This is a guide for minimum sampling and testing.

Testing frequency may need to be increased for high material variability or when test results approach specification limits.

D	For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows: • Soils/Flexible Base: For gradation, liquid limit, and plastic limit, vary sampling between stockpiling operations, completed stockpile, windrow, and project site. Vary the time of day sampling is performed. • Aggregates: Sample aggregates nearest the point of incorporation into the work. Vary sampling between stockpiling operations, completed stockpile, belt sampling, and if deemed necessary, railroad cars/trucks. Vary the time of day sampling is performed.
E	The Engineer will sample from the completed stockpile at the source and test prior to placement.
F	Each test performed that is based on a quantity of material is considered “or fraction thereof” for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IA – ASPHALT STABILIZED BASE (Plant Mix)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (C)	FREQUENCY OF SAMPLING (D)	REMARKS
AGGREGATE	Gradation **(A)**	Tex-200-F, Part I	During stockpiling operations, from completed stockpile, or prior to mixing	Each 5,000 CY	Sample in accordance with Tex-400-A.
	Liquid Limit **(A)**	Tex-104-E	During stockpiling operations, from completed stockpile, or prior to mixing	Each 5,000 CY	Sample in accordance with Tex-400-A.
	Plasticity Index **(A)**	Tex-106-E	During stockpiling operations, from completed stockpile, or prior to mixing	Each 5,000 CY	
	Wet Ball Mill or L. A. Abrasion **(A)**	Tex-116-E or Tex-410-A	During stockpiling operations, from completed stockpile, or prior to mixing	Each 20,000 CY	When L. A. Abrasion is specified, tests are not required when the published value of the source, as listed on the current Material Producer List for BRSQC, meets the project specifications. Sample in accordance with Tex-400-A. **(B)**
	Coarse Aggregate Angularity **(A)**	Tex-460-A, Part I	During stockpiling operations, from completed stockpile, or prior to mixing	1 per project, per source	Not required for crushed stone sources. Sample in accordance with Tex-400-A.
	Sand Equivalent	Tex-203-F	Hot aggregate bins, feeder belt, or stockpile	1 per project, per source	When designated by the Engineer, test may be run on combined aggregates when multiple sources are used. Sample in accordance with Tex-400-A.
LIME	Compliance with DMS-6350		During delivery to the project	Hydrated Lime: 1 per project Commercial Lime Slurry: each 200 tons of lime **(D)** Carbide Lime Slurry: each 100 tons of lime **(D)** Quick Lime: 1 per project	On projects requiring less than 50 tons, material from CST/M&P approved sources may be accepted on the basis of Producer's Certification without sampling.
RECLAIMED ASPHALT PAVEMENT (RAP), and RECYCLED AGGREGATE	Decantation	Tex-217-F, Part II	During stockpiling operations, from completed stockpile, or prior to mixing	Each 10,000 CY	Sample in accordance with Tex-400-A.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IA – ASPHALT STABILIZED BASE (Plant Mix)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (C)	FREQUENCY OF SAMPLING (D)	REMARKS
RECYCLED ASPHALT SHINGLES (RAS)	Decantation	Tex-217-F, Part III	During stockpiling operations, from completed stockpile, or prior to mixing	Each 10,000 CY	Sample in accordance with Tex-400-A.
ASPHALT BINDER	Compliance with Item 300 – Binder and Tack Coat		Sampled, tested and preapproved by CST/M&P. Take project samples when designated by the Engineer.	1 each for binder and tack coat per project, per grade, per source	Test at least one sample taken from the project. Sample tack coat at the distributor on the roadway in accordance with Tex-500-C, Part III. Sample binder at hot mix plant in accordance with Tex-500-C, Part II. Binder should arrive on the project pre-approved. If not pre-approved, sample binder before use.
COMPLETE MIXTURE	Laboratory Density **(A)**	Tex-126-E	Plant Mix **(C)**	20,000 CY (25,000 tons)	Sample in accordance with Tex-222-F.
	Percent Asphalt **(A)**	Tex-236-F	Plant Mix **(C)**	Each 1,500 CY (2,000 tons) or days production	Determine asphalt content correlation factors for ignition oven at a minimum of one per project. Sample in accordance with Tex-222-F.
	Indirect Tensile Strength – Dry	Tex-226-F	Plant Mix	1 per project, per design	Sample in accordance with Tex-222-F.
	Moisture Susceptibility	Tex-530-C	As designated by the Engineer	1 per project, per design	This test may be waived, when shown on the plans. Sample in accordance with Tex-222-F.
ROADWAY	In-Place Air Voids **(A)**	Tex-207-F	Roadway cores, as designated by the Engineer **(C, D)**	Each 2,500 CY (3,000 tons) or days production	Not required for ordinary compaction or when air void requirements are waived. Sample in accordance with Tex-222-F.

TABLE IA – FOOTNOTES

A	When this project acceptance test fails but the product is accepted, document the reasons for acceptance on the Letter of Certification of Materials Used or in the SiteManager Remarks field.
B	Engineer will select any of these locations or any combinations thereof with the provision that at least one out of ten consecutive samples will be taken at the project site (from the windrow for treated and untreated bases and embankments when possible).
C	For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows: • Soils/flexible base: Vary sampling between stockpiling operations, completed stockpile, windrow, and project site. Vary the time of day sampling is performed. • Aggregates: Sample aggregates nearest the point of incorporation into the work. Vary sampling between stockpiling operations, completed stockpile, belt sampling, and if deemed necessary, railroad cars/trucks. Vary the time of day sampling is performed.
D	Each test performed that is based on a quantity of material is considered “or fraction thereof” for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE II – SEAL COAT

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (C)	FREQUENCY OF SAMPLING (D)	REMARKS
AGGREGATE	Gradation **(A)**	Tex-200-F, Part I	Stockpile (At source or at point of delivery)	One each 1,000 CY	Rate may be reduced to one each 2,000 CY if the Engineer approves a contractor quality control plan. Sample in accordance with Tex-221-F.
	L. A. Abrasion **(A)**	Tex-410-A	Stockpile	1 per 20,000 CY	Verify the published value of the source, as listed on the current Material Producer List for BRSQC, meets the project specifications. If not, sample and test at 1 per 20,000 CY prior to use. Sample in accordance with Tex-221-F. **(B)**
	Magnesium Soundness **(A)**	Tex-411-A	Stockpile	1 per 20,000 CY	Verify the published value of the source, as listed on the current Material Producer List for BRSQC, meets the project specifications. If not, sample and test at 1 per 20,000 CY prior to use. Sample in accordance with Tex-221-F. **(B)**
	Surface Aggregate Classification **(A)**	Tex-612-J, Tex-411-A	Stockpile	1 per 20,000 CY	Verify the published value of the source, as listed on the current Material Producer List for BRSQC, meets the project specifications. If not, sample and test at 1 per 20,000 CY prior to use. Sample in accordance with Tex-221-F. **(B)**
	Pressure Slake **(A)**	Tex-431-A	Stockpile	1 per 20,000 CY	Same as above. Required only for lightweight aggregate. Sample in accordance with Tex-221-F.
	Freeze Thaw **(A)**	Tex-432-A	Stockpile	1 per 20,000 CY	Same as above. Required only for lightweight aggregate. Sample in accordance with Tex-221-F.
	Unit Weight	Tex-404-A	Stockpile	1 per 20,000 CY	Same as above. Required only for lightweight aggregate. Sample in accordance with Tex-221-F.
	24 hr Water Absorption **(A)**	Tex-433-A	Stockpile	1 per 20,000 CY	Same as above. Required only for lightweight aggregate. Sample in accordance with Tex-221-F.
	Coarse Aggregate Angularity	Tex-460-A	Stockpile	1 per 20,000 CY	Only required for crushed gravel. Sample in accordance with Tex-221-F.
	Deleterious Material **(A)**	Tex-217-F, Part I	Stockpile	1 per 10,000 CY	Not required for lightweight aggregate. Sample in accordance with Tex-221-F.
	Decantation **(A)**	Tex-406-A	Stockpile	1 per 10,000 CY	Sample in accordance with Tex-221-F.
	Flakiness Index	Tex-224-F	Stockpile	Frequency as directed by the Engineer	Sample in accordance with Tex-221-F.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IA – ASPHALT STABILIZED BASE (Plant Mix)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (C)	FREQUENCY OF SAMPLING (D)	REMARKS
	Micro Deval	Tex-461-A	Stockpile	1 per project or as necessary for control	Compare result to published value listed on the current Material Producer List for BRSQC. Submit sample to CST/M&P for Soundness and L.A. Abrasion testing when results differ by more than 3% points, unless otherwise directed by the Engineer. Sample in accordance with Tex-221-F.
	White Rock Count	Tex-220-F	Stockpile		Required only for Limestone Rock Asphalt. Not required when CST/M&P provides inspection at the plant. Sample in accordance with Tex-221-F.
	Naturally Impregnated Bitumen Content	Tex-236-F	Stockpile		Required only for Limestone Rock Asphalt. Not required when CST/M&P provides inspection at the plant. Sample in accordance with Tex-221-F.
PRECOATED AGGREGATE	Asphalt Content	Tex-236-F	Stockpile	Frequency as directed by the Engineer when a target value is specified	Sample in accordance with Tex-221-F.
ASPHALT	Compliance with Item 300		Sampled, tested, and preapproved by CST/M&P. Take project samples when designated by the Engineer from the distributor or transport.	1 per project, per grade, per source	Sample in accordance with Tex-500-C. Binder should arrive on the project pre-approved. If not pre-approved, sample binder before use.

TABLE II – FOOTNOTES

A	When this project acceptance test fails but the product is accepted, document the reasons for acceptance on the Letter of Certification of Materials Used or in the SiteManager Remarks field.
B	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
C	For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows: • Aggregates: Sample aggregates nearest the point of incorporation into the work. Vary sampling between stockpiling operations, completed stockpile, belt sampling, and if deemed necessary, railroad cars/trucks. Vary the time of day sampling is performed.
D	Each test performed that is based on a quantity of material is considered “or fraction thereof” for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE III – HYDRAULIC CEMENT CONCRETE – STRUCTURAL (Classes: C, F, H, S, CO, K, LMC, or SS)						
				PROJECT TESTS		
MATERIAL OR PRODUCT		TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (E)	REMARKS
MINERAL AGGREGATE	COARSE AGGREGATE	Decantation **(B)**	Tex-406-A	From stockpile at concrete plant	Each 20,000 CY of concrete (each source)	Sample in accordance with Tex-400-A.
		Sieve Analysis **(A) (B)**	Tex-401-A		Each 1,000 CY of concrete (each source)	Sample in accordance with Tex-400-A. Test combined aggregate when used.
		Deleterious Materials **(B)**	Tex-413-A		1 per project or as necessary for control	Sample in accordance with Tex-400-A.
		Los Angeles Abrasion **(A) (B)**	Tex-410-A		Two, each source	Verify the value of the source, as listed on the current Material Producer list for CRSQC, meets the project specifications. If not, sample and submit to CST/M&P for testing prior to use in accordance with Tex-499-A. Sample in accordance with Tex-400-A. **(C)**
		5-cycle Magnesium Sulfate Soundness **(A) (B)**	Tex-411-A		Two, each source	Verify the value of the source, as listed on the current CRSQC, meets the project specifications. **(C)**
	FINE AGGREGATE	Sand Equivalent **(B)**	Tex-203-F	From stockpile at concrete plant	1 per project or as necessary for control	Sample in accordance with Tex-400-A. Test combined aggregate when used.
		Organic Impurities **(B)**	Tex-408-A		1 per project, per source	Sample in accordance with Tex-400-A.
		Sieve Analysis **(A) (B)**	Tex-401-A		Each 1,000 CY of concrete (each source)	Sample in accordance with Tex-400-A.
		Fineness Modulus **(B)**	Tex-402-A		1 per project or as necessary for control	Sample in accordance with Tex-400-A. Test combined aggregate when used. Test to confirm material variability when strength values are in question.
		Deleterious Material **(B)**	Tex-413-A		1 per project or as necessary for control	Sample in accordance with Tex-400-A. Test to confirm material variability when strength values are in question.
		Acid Insoluble Residue **(A) (B)**	Tex-612-J		Two, each source	Only for concrete subject to direct traffic. Verify the value of the source, as listed on the current CRSQC, meets the project specifications. If not, sample and submit to CST/M&P for testing prior to use in accordance with Tex-499-A. Sample in accordance with Tex-400-A. **(C)**
SILICA FUME		Compliance with DMS-4630 **(A)**		Railroad car, truck, bags or silos	1 per project, per class of concrete (For each type and brand)	Sample in accordance with Tex-320-D.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE III – HYDRAULIC CEMENT CONCRETE – STRUCTURAL (Classes: C, F, H, S, CO, K, LMC, or SS)					
			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (E)	REMARKS
METAKAOLIN	Compliance with DMS-4635 **(A)**		Railroad car, truck or silos	1 per project, per class of concrete (For each type and brand)	
MIX DESIGN	Compliance with Standard Specification Item 421.4.A		At source (if not approved)	Min. 1 design per class, per source	Verify if cement, fly ash, slag cement, and chemical admixture sources are listed on the Material Producer Lists. If not, sample and submit to CST/M&P for testing. Water testing is contracted by the concrete supplier (commercial lab report to be reviewed by TxDOT). Sample in accordance with Tex-300-D for cement and in accordance with Tex-733-I for fly ash.
JOINT MATERIAL	Compliance with DMS-6300				Sample in accordance with Tex-500-C. Verify the source is listed on the Material Producer List for Joint Sealers. If not, sample and test prior to use in accordance with DMS-6310. **(C)**
CURING COMPOUND	Compliance with DMS-4650		Sampled at jobsite; tested by CST/M&P. See remarks.	When requested by CST	Only products listed on the Material Producer List for Concrete Curing Compounds will be allowed. When sample is requested by CST, sample in accordance with Tex-718-I. Ensure container has been agitated and mixed prior to sampling. **(C)**
EVAPORATION RETARDANTS	Compliance with DMS-4650				Only products listed on the Material Producer list for Evaporation Retardants will be allowed. **(C)**
REINFORCING STEEL	Compliance with the Std. Specifications & Spec. Provisions	As Specified			Only materials from CST/M&P approved sources listed on the Material Producer Lists for Reinforcing Steel Mills and Seven Wire Steel Strand will be allowed. **(C)**
MECHANICAL COUPLERS	Compliance with DMS-4510	Tex-743-I	Sampled at jobsite; Tested by CST/M&P	3 couplers per lot (500 couplers) for each type, model, bar size and grade	Only materials from CST/M&P approved sources listed on the Material Producer List for Mechanical Couplers will be allowed. **(C)**
LATEX	Compliance with DMS-4640 for concrete chemical admixtures		Sampled at jobsite.	Min. of 1 test per project	Sample in accordance with Tex-321-E.
EPOXY	Compliance with DMS-6100, unless otherwise specified		Sampled at jobsite if not pre-approved by CST/M&P.	1 per batch or shipment	Verify the source is listed on the Material Producer List for Epoxies and Adhesives. If not, sample and test prior to use in accordance with DMS-6100. Sample in accordance with Tex-734-I. **(C)**

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE III – HYDRAULIC CEMENT CONCRETE – STRUCTURAL (Classes: C, F, H, S, CO, K, LMC, or SS)					
			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (E)	REMARKS
CONCRETE	Compressive Strength (A)	Tex-418-A	At point of concrete placement	4 cylinders for each 60 CY per class, per day (For bridge railing and traffic railing, testing may be reduced to 4 cylinders per 180 CY per class regardless of days)	Sampling must be in accordance with Tex-407-A. Test two cylinders at 7 days, and if the average value is below the design strength as defined in Item 421 Table 8, test the remaining 2 cylinders at 28 days. If the average value of the 2 cylinders tested at 7 days meets the minimum design strength listed in Item 421 Table 8, the 2 remaining cylinders are not required to be tested.
CONCRETE	Slump	Tex-415-A		1 test per 4 strength specimens	Sample in accordance with Tex-407-A. Perform slump and temperature tests on the same load from which strength test specimens are made. Perform entrained air test only when entrained air concrete is specified in the plans. Check temperature of every load for bridge slabs and mass concrete placements. Contractor's required testing will be in accordance with specification requirements for the appropriate specification Item #.
	Entrained Air (A)	Tex-416-A or Tex-414-A			
	Temperature of Concrete (A)	Tex-422-A			
	Slab Thickness and Depth of Reinforcement	Tex-423-A, Part II	During dry run and during concrete placement (Bridge decks and direct traffic culverts)	1 per span	Min 6–Max 18 locations per span

TABLE III – FOOTNOTES	
A	When this project acceptance test fails but the product is accepted, document the reasons for acceptance on the Letter of Certification of Materials Used or in the SiteManager Remarks field.
B	These Project Tests may be used for one or more projects being furnished concrete from the same plant during the same period.
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
D	For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows: • Aggregates: Sample aggregates nearest the point of incorporation into the work. Vary sampling between stockpiling operations, completed stockpile, and if deemed necessary, railroad cars/trucks. Vary the time of day sampling is performed. • Concrete (structural): Always sample as near as practicable to the point of placement. For strength testing, vary the time of day or the number of truck from which the concrete is sampled. Test often for slump, air, and temperature to ensure the consistent control of the concrete production.
E	Each test performed that is based on a quantity of material is considered "or fraction thereof" for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IV – HYDRAULIC CEMENT CONCRETE – NON-STRUCTURAL CONCRETE (Classes: A, B, or E)					
			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (B)	FREQUENCY OF SAMPLING (C)	REMARKS
CONCRETE	Compressive Strength (A)	Tex-418-A	At point of concrete placement	2 cylinders per 180 CY, per class	Sampling must be in accordance with Tex-407-A. Strength will be determined by 7-day specimens.
MIX DESIGN	Compliance with the Standard Specification		At source if not approved.	Min. 1 design per class, per source	Verify if cement, fly ash, slag cement, and chemical admixture sources are listed on the Material Producer Lists. If not, sample and submit to CST/M&P for testing. Sample in accordance with Tex-300-D for cement and in accordance with Tex-733-I for fly ash. Water testing is contracted by the concrete supplier (commercial lab report to be reviewed by TxDOT).
SILICA FUME	Compliance with DMS-4630		Railroad car, truck, bags or silos	1 test per project, per class (for each type and brand)	Sample in accordance with Tex-320-D.
METAKAOLIN	Compliance with DMS-4635		Railroad car, truck or silos	1 test per project, per class (for each type and brand)	

TABLE IV – FOOTNOTES	
A	When this project acceptance test fails but the product is accepted, document the reasons for acceptance on the Letter of Certification of Materials Used or in the SiteManager Remarks field.
B	For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows: • Concrete (miscellaneous): Always sample as near as practicable to the point of placement. For strength testing, vary the time of day or the number of truck from which the concrete is sampled.
C	Each test performed that is based on a quantity of material is considered “or fraction thereof” for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE V – HYDRAULIC CEMENT CONCRETE PAVEMENT (Classes: P or HES)

				PROJECT TESTS		
MATERIAL OR PRODUCT		TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING	FREQUENCY OF SAMPLING (D)	REMARKS
MINERAL AGGREGATE	COARSE AGGREGATE	Decantation	Tex-406-A	From stockpile at concrete plant	Each 20,000 CY of concrete (each source)	Sample in accordance with Tex-400-A.
		Sieve Analysis (A)	Tex-401-A		As necessary for control	Sample in accordance with Tex-400-A. Test combined aggregate when used.
		Deleterious Materials	Tex-413-A		Each 20,000 CY of concrete (each source)	Sample in accordance with Tex-400-A.
		L.A. Abrasion (A)	Tex-410-A		Two, each source	Verify the value of the source, as listed on the current CRSQC, meets the project specifications. If not, sample and submit to CST/M&P for testing prior to use in accordance with Tex-499-A. Sample in accordance with Tex-400-A. (C)
		5-Cycle Magnesium Sulfate Soundness (A)	Tex-411-A			
	FINE AGGREGATE	Sand Equivalent	Tex-203-F	From stockpile at concrete plant	Each 3,000 CY of concrete (Each source or combination of sources)	Sample in accordance with Tex-400-A. Test combined aggregate when used. No less than one per week's production.
		Organic Impurities	Tex-408-A		1 per project, per source	Sample in accordance with Tex-400-A.
		Sieve Analysis (A)	Tex-401-A		As necessary for control	Sample in accordance with Tex-400-A. Test combined aggregate when used.
		Fineness Modulus (B)	Tex-402-A			
		Deleterious Material (B)	Tex-413-A		Each 20,000 CY of concrete (each source)	Sample in accordance with Tex-400-A.
		Acid Insoluble (A)	Tex-612-J		1 per project, per source	Verify the value of the source, as listed on the current CRSQC, meets the project specifications. If not, sample and submit to CST/M&P for testing prior to use in accordance with Tex-499-A. Sample in accordance with Tex-400-A. (C)
MIX DESIGN		Compliance with the Standard Specifications Item 421.4.A		At source, if not approved	Min. 1 design, per class, per source	Verify if cement, fly ash, ground granulated blast furnace slag, and admixture sources are listed on the Material Producer List. If not, sample and submit to CST/M&P for testing. Sample in accordance with Tex-300-D for cement and in accordance with Tex-733-I for fly ash. Water testing is contracted by the concrete supplier (commercial lab report to be reviewed by TxDOT).

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE V – HYDRAULIC CEMENT CONCRETE PAVEMENT (Classes: P or HES)					
			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING	FREQUENCY OF SAMPLING (D)	REMARKS
SILICA FUME	Compliance with DMS-4630		Railroad car, truck, bags or silos	1 per project per class of concrete (For each type and brand)	Sample in accordance with Tex-320-D.
METAKAOLIN	Compliance with DMS-4635		Railroad car, truck or silos	1 per project per class of concrete (For each type and brand)	Sample in accordance with Tex-320-D.
JOINT MATERIAL	Compliance with DMS-6310		Sampled at jobsite if not sampled at source by CST/M&P; tested by CST/M&P. See remarks.	1 per batch or shipment	Sample in accordance with Tex-500-C. Sampling may be waived when the source is listed on the Material Producer List for Joint Sealers. **(C)**
CURING COMPOUND	Compliance with DMS-4650		Sampled at jobsite; tested by CST/M&P. See remarks.	When requested by CST	Only products listed on the Material Producer List for Concrete Curing Compounds will be allowed. When sample is requested by CST, sample in accordance with Tex-718-I. Ensure container has been agitated and mixed prior to sampling. **(C)**
EVAPORATION RETARDANTS	Compliance with DMS-4650				Only products listed on the Material Producer List for Evaporation Retardants will be allowed. **(C)**
REINFORCING STEEL	Compliance with the Std. Specifications & Spec. Provisions	As Specified			Only materials from CST/M&P approved sources listed on the Material Producer List for Reinforcing Steel Mills and Seven Wire Steel Strand will be accepted. **(C)**
MULTIPLE PIECE TIE BARS	Compliance with DMS-4515	Tex-712-I	Sampled at jobsite if not sampled at source by CST/M&P; tested by CST/M&P. See remarks.	Refer to Tex-711-I for sampling rates	Only materials from CST/M&P approved sources listed on the Material Producer List for Multiple Piece Tie-bars for Concrete Pavements will be allowed. Sample in accordance with Tex-734-I.
EPOXY	Compliance with DMS-6100		Sampled at jobsite if not pre-approved by CST/M&P. See remarks.	1 batch per shipment	Verify the source is listed on the Material Producer List for Epoxies and Adhesives. If not, sample and test prior to use in accordance with DMS-6100. Sample in accordance with Tex-734-I. **(C)**

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE V – HYDRAULIC CEMENT CONCRETE PAVEMENT (Classes: P or HES)					
			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING	FREQUENCY OF SAMPLING (D)	REMARKS
CONCRETE	Strength (A) (B)	Tex-448-A or Tex-418-A	At point of concrete placement	2 cylinders for every 10 contractor job control tests	Sample in accordance with Tex-407-A. When the contract requires the project testing to be by the Engineer, the frequency and job control testing will be in accordance with the item of work. Split sample verification testing used when contractor performs job control testing. When job control testing by the contractor is waived by the plans, the frequency of sampling will be one test (2 specimens) for each 3,000 SY of concrete or fraction thereof or per day and split sample verification testing will be waived. Contractor's required testing will be in accordance with specification requirements for the appropriate specification Item #.
	Slump	Tex-415-A	At time and location strength specimens are made	1 test for every 10 contractor job control tests.	Sample in accordance with Tex-407-A. Slump is not required for slip-formed pavement. Perform slump and temperature tests on the same load from which the strength specimens are made. Perform entrained air test only when entrained air concrete is specified in the plans. Contractor's required testing will be in accordance with specification requirements for the appropriate specification Item #.
	Entrained Air (A)	Tex-416-A or Tex-414-A			
	Temperature	Tex-422-A			
	Thickness	Tex-423-A	Center of paving machine	Every 500 feet	Methods other than Tex-423-A may be shown on the plans.
	Ride Quality Surface Test Type B (A)	Tex-1001-S	Final riding surface of travel lanes		Engineer may verify contractor's results for surface test Type B. For traditional design-bid-build TxDOT projects, CST has contracted with TTI to perform random ride verification at 10% frequency. Results from surface test Type A are not required to be reported.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE V – FOOTNOTES	
A	When this project acceptance test fails but the product is accepted, document the reasons for acceptance on the Letter of Certification of Materials Used or in the SiteManager Remarks field.
B	When a project test does not meet the specified strength requirements and a reduced pay factor is assigned, document the analysis on the Letter of Certification of Materials Used.
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
D	Each test performed that is based on a quantity of material is considered “or fraction thereof” for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VI – ASPHALT CONCRETE PAVEMENT (Items 341, 342, 344, 346, 347 and 348) (All testing as noted in Table VI may be waived for exempt production as defined by specification.)					
			PROJECT TESTS		
MATERIAL OR PRODUCT	**TEST FOR**	**TEST NUMBER**	**LOCATION (Per Design)**	**FREQUENCY OF SAMPLING (E)**	**REMARKS**
COARSE AGGREGATE	L. A. Abrasion **(A)**	Tex-410-A	Stockpile **(B)**	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer list for BRSQC, meets the project specifications. If not, sample in accordance with Tex-221-F and submit to CST/M&P for testing prior to use in accordance with Tex-499-A. **(C)**
	Magnesium Sulfate Soundness **(A)**	Tex-411-A			
	Surface Aggregate Classification **(A)**	Tex-499-A		1 per project, per source	
	Micro Deval	Tex-461-A		1 per project, per aggregate source	Not required when the Rated Source Soundness Magnesium loss is 15 or less as listed on the current published BRSQC. If testing is required, sample in accordance with Tex-221-F.
COMBINED AGGREGATE	Sand Equivalent	Tex-203-F	Stockpiles, hot bins or feeder belts	1 per project, per source, per design	Does not apply to Item 342. Sample in accordance with Tex-221-F. The timing of when the test is performed is at the discretion of the Engineer.
ASPHALT BINDER	Compliance with Item 300 Binder & Tack Coat **(A)**		Sampled, tested and pre-approved by CST/M&P. Project test sampled at the Plant for Binder & Road for Tack Coat	1 each for binder and tack coat per project, per grade, per source	Test a minimum of one sample taken from the project. Sample tack coat at the distributor on the roadway in accordance with Tex-500C, Part III. Sample binder at hot mix plant in accordance with Tex-500-C, Part II. Binder should arrive on the project pre-approved. If not pre-approved, sample binder before use.
MIX DESIGN	Compliance with applicable specification	Tex-204-F	At source (if not approved)	Min 1 design per Mix Type and Asphalt Grade	Verify that aggregates, recycled asphalt pavement, recycled asphalt shingles, mineral filler, asphalt binder, anti-stripping additives, and warm mix systems are on the Material Producer List where applicable and that they meet project specification requirements. Project sampling and testing may be conducted on individual materials as necessary for control.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VI – ASPHALT CONCRETE PAVEMENT (Items 341, 342, 344, 346, 347 and 348)

(All testing as noted in Table VI may be waived for exempt production as defined by specification.)

			PROJECT TESTS		PROJECT INDEPENDENT ASSURANCE TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION	FREQUENCY (Per Design)	LOCATION	FREQUENCY	REMARKS
COMPLETE MIXTURE	Asphalt Content (%) (A)	Tex-236-F	Engineer Truck Sample (D)	Minimum 1 per Lot			Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Voids in Mineral Aggregates (VMA)	Tex-207-F	Truck Sample Plant Produced (D)	1 per Sublot	Truck	1 per 10 Lots only if compactor is shared by Contractor and State	Sample in accordance with Tex-222-F. Does not apply to Item 342, "Permeable Friction Course." Contractor's required testing will be in accordance with specification requirements for the appropriate specification Item #.
	Gradation (A)	Tex-236-F	Engineer Truck Sample (D)	Minimum 1 per 12 Sublots (E)			Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Boil Test	Tex-530-C	Truck Sample	1 per project			Sample in accordance with Tex-222-F. Unless waived by the Engineer.
	Indirect Tensile Strength – Dry	Tex-226-F					Sample in accordance with Tex-222-F. Unless waived by the Engineer. Does not apply to Items 342, 346, and 348.
	Moisture Content	Tex-212-F, Part II	Engineer Truck Sample				Sample in accordance with Tex-222-F.
	Lab Molded Density (A)	Tex-207-F	Truck Sample (D)	1 per Sublot 1 per Lot for Item 347	Truck	1 per 10 Lots only if compactor is shared by Contractor and State	Sample in accordance with Tex-222-F. Contractor's required testing will be in accordance with specification requirements for the appropriate specification Item #.
	Drain Down Test (A)	Tex-235-F	Engineer Truck Sample	1 per project 1 per Lot for Item 342			Sample in accordance with Tex-222-F. Not required for Item 341 and Item 344.
	Hamburg Wheel Test (A)	Tex-242-F	Engineer Truck Sample	1 per project			Sample in accordance with Tex-222-F. Sample during production. Does not apply to Item 348.
	Overlay Test	Tex-248-F	Engineer Truck Sample	1 per project			Sample in accordance with Tex-222-F. Does not apply to Items 341, 344, and 348.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VI – ASPHALT CONCRETE PAVEMENT (Items 341, 342, 344, 346, 347, and 348) (All testing as noted in Table VI may be waived for exempt production as defined by specification.)					
			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION	FREQUENCY (Per Design)	REMARKS
ROADWAY	In-Place Air Voids (A)	Tex-207-F	Roadway (D)	2 cores per Sublot	Two cores taken per Sublot and averaged. Sample in accordance with Tex-222-F. Does not apply to Items 342, 347, and 348.
ROADWAY	Segregation Profile (A)	Tex-207-F, Part V	Roadway	1 per project	Not required when Contractor uses thermal imaging system. Does not apply to Items 342, 347, and 348.
	Joint Density (A)	Tex-207-F, Part VII	Roadway	1 per project	
	Thermal Profile	Tex-244-F	Immediately behind paver	1 per project	Not required when Contractor uses thermal imaging system.
	Ride Quality Test Type B (A)	Tex-1001-S	Final riding surface of travel lanes	1 per project	Engineer may verify Contractor's results for surface test Type B. For traditional design-bid-build TxDOT projects, CST has contracted with TTI to perform random ride verification at 10% frequency. Results for surface test Type A are not required to be reported.
	Permeability	Tex-246-F	Roadway	1 per project	Only applies to Items 342, 347, and 348.
FABRIC UNDERSEAL	Compliance with DMS-6220		Sampled, tested, and approved by CST/M&P		Sampling must be in accordance with Tex-735-I. Verify the source is listed on the current Material Producer List for Silt Fence, Filter Fabric, and Fabric Underseals. If not, sample and test prior to use in accordance with DMS-6220.

TABLE VI – FOOTNOTES	
A	When this project acceptance test fails but the product is accepted, document the reasons for acceptance on the Letter of Certification of Materials Used or in the SiteManager Remarks field. This letter is required only for Asphalt Content and/or Gradation when production of complete mixture is suspended as required by QC/QA specifications.
B	Sampling may be performed at the plant, quarry, or both. Aggregate properties may be re-tested at any time during the project. These project tests may be used for one or more projects furnishing hot mix with the same aggregate source.
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
D	Perform random sampling as specified in Tex-225-F, "Random Selection of Bituminous Mixture Samples."
E	Each test performed that is based on a quantity of material is considered "or fraction thereof" for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VII – ASPHALT CONCRETE PAVEMENT (Items 334)
(Refer to DMS-9210, "Limestone Rock Asphalt (LRA)," for testing requirements for Item 330.)

			PROJECT TESTS		
MATERIAL OR PRODUCT	**TEST FOR**	**TEST NUMBER**	**LOCATION**	**FREQUENCY (Per Design) (F)**	**REMARKS**
COARSE AGGREGATE	L. A. Abrasion **(A)**	Tex-410-A	Stockpile **(B)**	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer List for BRSQC, meets the project specifications. If not, sample in accordance with Tex-221-F and submit to CST/M&P for testing prior to use in accordance with Tex-499-A. **(D)**
	Magnesium Sulfate Soundness **(A)**	Tex-411-A			
	Micro Deval	Tex-461-A			Sample in accordance with Tex-221-F. Testing frequency may be reduced or eliminated based on a satisfactory test history.
	Surface Aggregate Classification **(A)**	Tex-499-A	Stockpile **(B)**	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer List for BRSQC, meets the project specifications. If not, sample in accordance with Tex-221-F and submit to CST/M&P for testing prior to use in accordance with Tex-499-A. SiteManager Quality Monitoring test documentation is accomplished by attaching an approved mix design.
COMBINED AGGREGATE	Sand Equivalent	Tex-203-F	Stockpiles, hot bins or feeder belts	1 per project, per source	Sample in accordance with Tex-221-F. The timing of when the test is performed is at the discretion of the Engineer.
ASPHALT BINDER	Compliance with Item 300 Binder & Tack Coat **(A) (C)**		Sampled, tested and pre-approved by CST/M&P. Project test sampled at the Plant for Binder & Road for Tack Coat	1 each for binder and tack coat per project, per grade, per source	Test a minimum of one sample from production. Sample tack coat at the distributor on the roadway in accordance with Tex-500-C, Part III. Sample binder at hot mix plant in accordance with Tex-500-C, Part II. Binder should arrive on the project pre-approved. If not pre-approved, sample binder before use.
MIX DESIGN	Compliance with applicable specification	Tex-204-F	At source (if not approved)	Min 1 design per Mix Type and Asphalt Grade	Verify that aggregates, recycled asphalt pavement, recycled asphalt shingles, mineral filler, asphalt binder, anti-stripping additives, and warm mix systems are on the Material Producer List where applicable and that they meet project specification requirements. Project sampling and testing may be conducted in individual materials as necessary for control.
COMPLETE MIXTURE	Asphalt Content (%) **(A)**	Tex-236-F	Engineer Truck Sample **(E)**	Minimum of 1 per 5,000 tons	Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Voids in Mineral Aggregates (VMA)	Tex-207-F	Truck Sample Plant Produced **(E)**	1 per 5,000 tons	Sample in accordance with Tex-222-F.
	Gradation **(A)**	Tex-236-F	Truck Sample	Minimum 1 per 5,000 tons	Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Boil Test	Tex-530-C		1 per project	Sample in accordance with Tex-222-F. The timing of when the test is performed is at the discretion of the Engineer.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VII – ASPHALT CONCRETE PAVEMENT (Items 334) (Refer to DMS-9210, "Limestone Rock Asphalt (LRA)," for testing requirements for Item 330.)					
			PROJECT TESTS		
MATERIAL OR PRODUCT	**TEST FOR**	**TEST NUMBER**	**LOCATION**	**FREQUENCY (Per Design) (F)**	**REMARKS**
COMPLETE MIXTURE	Moisture Content	Tex-212-F, Part II	Truck Sample	1 per 5,000 tons	Sample in accordance with Tex-222-F. Performed by CST/M&P at the point of production for payment calculations.
	Hydrocarbon-Volatile Content	Tex-213-F		1 per 5,000 tons	Sample in accordance with Tex-222-F. The timing of when the test is performed is at the discretion of the Engineer.
	Lab Molded Density **(A)**	Tex-207-F		1 per 5,000 tons	Sample in accordance with Tex-222-F.
	Hveem Stability **(A)**	Tex-208-F		1 per 5,000 tons	Sample in accordance with Tex-222-F. The timing of when the test is performed is at the discretion of the Engineer.
ROADWAY	Ride Quality Test Type B **(A)**	Tex-1001-S	Final riding surface of travel lanes		Engineer may verify Contractor's results for surface test Type B. For traditional design-bid-build TxDOT projects, CST has contracted with TTI to perform random ride verification at 10% frequency. Results from surface test Type A are not required to be reported.

TABLE VII – FOOTNOTES	
A	When this project acceptance test fails but the product is accepted, document the reasons for acceptance on the Letter of Certification of Materials Used or in the SiteManager Remarks field.
B	Sampling may be performed at the plant, quarry, or both. Aggregate properties may be re-tested at any time during the project.
C	Or as called for in the Specifications.
D	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
E	Perform random sampling as specified in Tex-225-F, "Random Selection of Bituminous Mixture Samples."
F	Each test performed that is based on a quantity of material is considered "or fraction thereof" for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VIII – ASPHALT CONCRETE PAVEMENT (Item 340)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION	FREQUENCY	REMARKS
COARSE AGGREGATE	L. A. Abrasion (A)	Tex-410-A	Stockpile (B)	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer List for BRSQC, meets the project specifications. If not, sample in accordance with Tex-221-F and submit to CST/M&P for testing prior to use in accordance with Tex-499-A. (C)
	Magnesium Sulfate Soundness (A)	Tex-411-A			
	Micro Deval	Tex-461-A	Stockpile (B)	1 per project, per source	Sample in accordance with Tex-221-F. Testing frequency may be reduced or eliminated based on a satisfactory test history.
	Surface Aggregate Classification (A)	Tex-499-A	Stockpile (B)	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer list for BRSQC, meets the project specifications. If not, sample in accordance with Tex-221-F and submit to CST/M&P for testing prior to use in accordance with Tex-499-A. (C)
COMBINED AGGREGATE	Sand Equivalent	Tex-203-F	Stockpiles, hot bins or feeder belts	1 per project, per design	Sample in accordance with Tex-221-F.
ASPHALT BINDER	Compliance with Item 300 Binder & Tack Coat (A)		Sampled, tested and pre-approved by CST/M&P. Plant for Binder & Road for Tack Coat	1 each for binder and tack coat per project, per grade, per source	Test a minimum of 1 sample taken from the project. Sample tack coat at the distributor on the roadway in accordance with Tex-500-C, Part III. Sample binder at hot mix plant in accordance with Tex-500-C, Part II. Binder should arrive on the project pre-approved. If not pre-approved, sample binder before use.
MIX DESIGN	Compliance with applicable specification	Tex-204-F	At source (if not approved)	Min. 1 design per Mix Type and Asphalt Grade	Verify that aggregates, recycled asphalt pavement, recycled asphalt shingles, mineral filler, asphalt binder, anti-stripping additives, and warm mix systems are on the Material Producer List where applicable and that they meet project specification requirements. Project sampling and testing may be conducted in individual materials as necessary for control.
COMPLETE MIXTURE	Asphalt Content (%)	Tex-236-F	Truck Sample (D)	Minimum of 1 per day	Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Voids in Mineral Aggregates (VMA)	Tex-207-F	Truck Sample Plant Produced (D)	1 per day	Sample in accordance with Tex-222-F.
	Gradation (A)	Tex-236-F	Truck Sample	Minimum 1 per day	Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Boil Test	Tex-530-C		1 per project	Sample in accordance with Tex-222-F. Unless waived by the Engineer.
	Indirect Tensile Strength – Dry	Tex-226-F		1 per project, per design	Sample in accordance with Tex-222-F. Unless waived by the Engineer.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VIII – ASPHALT CONCRETE PAVEMENT (Item 340)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION	FREQUENCY	REMARKS
COMPLETE MIXTURE	Lab Molded Density (A)	Tex-207-F	Truck Sample	1 per day	Sample in accordance with Tex-222-F.
	Hamburg Wheel Tracker (A)	Tex-242-F		1 per project	Sample in accordance with Tex-222-F. Sample during production.
ROADWAY	Air Voids (A)	Tex-207-F	Selected by the Engineer (D)	1 per day (2 Cores)	Sample in accordance with Tex-222-F.
	Ride Quality Test Type B (A)	Tex-1001-S	Final riding surface of travel lanes		Engineer may verify Contractor's results for surface test Type B. For traditional design-bid-build TxDOT projects, CST has contracted with TTI to perform random ride verification at 10% frequency. Results from surface test Type A are not required to be reported.
FABRIC UNDERSEAL	Compliance with DMS-6220		Sampled, tested, and approved by CST/M&P		Sample in accordance with Tex-735-I. Verify the source is listed on the current Material Producer List for Silt Fence, Filter Fabric, and Fabric Underseals. If not sample and submit to CST/M&P for testing prior to use in accordance with DMS-6220.

TABLE VIII – FOOTNOTES

A	When this project acceptance test fails but the product is accepted, document the reasons for acceptance on the Letter of Certification of Materials Used or in the SiteManager Remarks field. This letter is required only for Asphalt Content and/or Gradation when production of complete mixture is suspended as required by QC/QA specifications.
B	Sampling may be performed at the plant, quarry, or both. Aggregate properties may be re-tested at any time during the project. These project tests may be used for one or more projects furnishing hot mix with the same aggregate source.
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
D	Perform random sampling as specified in Tex-225-F, "Random Selection of Bituminous Mixture Samples."

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IX – MICROSURFACING (Item 350)

			PROJECT TESTS		
MATERIAL OR PRODUCT	**TEST FOR**	**TEST NUMBER**	**LOCATION OF SAMPLING**	**FREQUENCY (Per Design)**	**REMARKS**
AGGREGATE	5-Cycle Magnesium Sulfate Soundness **(A)**	Tex-411-A	Stockpile **(B)**	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer list for BRSQC meets the project specifications. If not, sample in accordance with Tex-221-F and submit to CST/M&P for testing at 1 per project, per source. **(C)**
	Gradation	Tex-200-F, Part II		1 per project, per source	Sample in accordance with Tex-221-F.
	Crushed Face Count	Tex-460-A		1 per project, per source	Sample in accordance with Tex-221-F.
	Acid Insoluble **(A)**	Tex-612-J		1 per project, per source	Verify the value of the source, as listed on the current BRSQC, meets the project specifications. If not, sample and submit to CST/M&P for testing prior to use in accordance with Tex-499-A. Sample in accordance with Tex-221-F. **(C)**
	Surface Aggregate Classification	Tex-499-A	Stockpile, or BRSQC **(B)**	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer list for BRSQC meets the project specifications. If not, sample in accordance with Tex-221-F and submit to CST/M&P for testing at 1 per project, per source. **(C)**
COMBINED BLEND	Sand Equivalent	Tex-203-F	Stockpile **(B)**	1 per project, per source	Sample in accordance with Tex-221-F.
ASPHALT BINDER	Compliance with Item 300 Binder & Tack Coat **(A)**		Sampled, tested, and pre-approved by CST/M&P. Project test sampled at the Plant for Binder & Road for Tack Coat	1 each for binder and tack coat per project, per grade, per source	Test a minimum of one sample during production. Sample tack coat at the distributor on the roadway in accordance with Tex-500-C, Part III. Sample binder at microsurfacing machine in accordance with Tex-500-C, Part III. Binder should arrive on the project pre-approved. If not pre-approved, sample binder before use.
CEMENT	Compliance with DMS-4600				Verify the source is listed on the current Material Producer List for Cement. If not, sample and submit to CST/M&P for testing prior to use in accordance with DMS-4600.
COMPLETE MIX	Asphalt Content	Tex-236-F	During production	1 per day	Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Gradation	Tex-200-F, Part II Tex-236-F			Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven use at a minimum of one per project.

This is a guide for minimum sampling and testing.

Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IX – FOOTNOTES	
A	When this project acceptance test fails but the product is accepted, document the reasons for acceptance on the Letter of Certification of Materials Used or in the SiteManager Remarks field. This letter is required only for Asphalt Content and/or Gradation when production of complete mixture is suspended as required by QC/QA specifications.
B	Sampling may be performed at the plant, quarry, or both. Aggregate properties may be re-tested at any time during the project. These project tests may be used for one or more projects furnishing hot mix with the same aggregate source.
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
D	Each test performed that is based on a quantity of material is considered “or fraction thereof” for calculating number of tests.

APPENDIX C

AASHTO ACCREDITED LABORATORIES

AASHTO Accredited CMT Laboratories in Texas

* Directory of accredited laboratories and scope of testing is maintained on the AASHTO Materials Reference Laboratory website at: http://www.amrl.net. Laboratory must be accredited for each specific test performed.

3/15/2018 7:39 AM

WILLIAMSON COUNTY

CR 200	RURAL COLLECTOR	50 MPH
CR 200	ADT = 1,700 (2017)	2,400 (2037)

INDEX OF SHEETS

SHEET NO.	DESCRIPTION
1	TITLE SHEET
2	INDEX OF SHEETS

COUNTY ROAD 200 AT BOLD SUNDOWN
PRECINCT NUMBER 2


NET LENGTH OF ROADWAY = 925 FT (0.175 MILES)
NET LENGTH OF BRIDGE = 0.00 FT (0.000 MILES)
NET LENGTH OF PROJECT = 925 FT (0.175 MILES)

LIMITS: FROM APPROXIMATELY 550' SOUTH OF BOLD SUNDOWN TO APPROXIMATELY 375' NORTH OF BOLD SUNDOWN

FOR THE WIDENING OF THE EXISTING ROADWAY
CONSISTING OF GRADING, DRAINAGE IMPROVEMENTS, FLEXIBLE BASE,
HMACP, STRIPING AND PAVEMENT MARKERS.

BEGIN PROJECT
STA. 258+00.00


END PROJECT
STA. 267+25.53

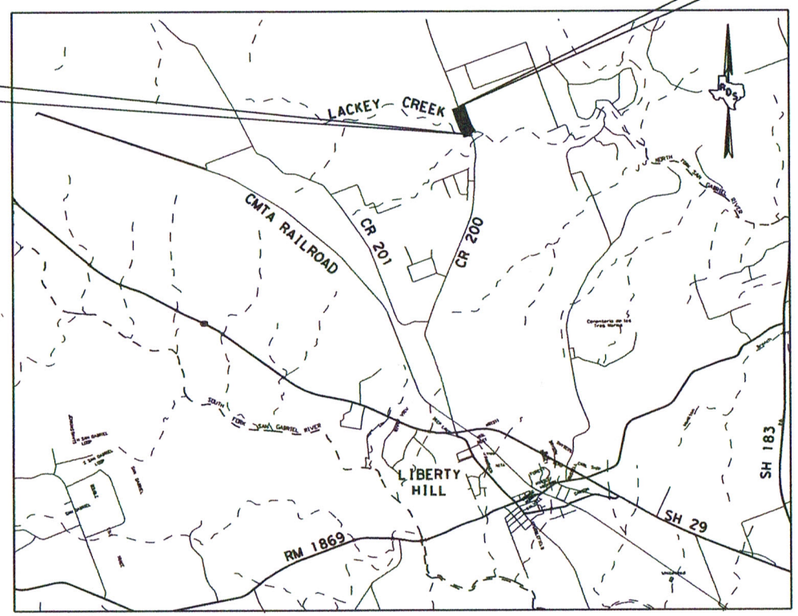

VICINITY MAP
N.T.S.

REGISTERED ACCESSIBILITY SPECIALIST (RAS) INSPECTION NOT REQUIRED.

REQUIRED SIGNS SHALL BE PLACED IN ACCORDANCE WITH STANDARD SHEETS BC(1)-14 THRU BC(12)-14 AND THE "TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES.:

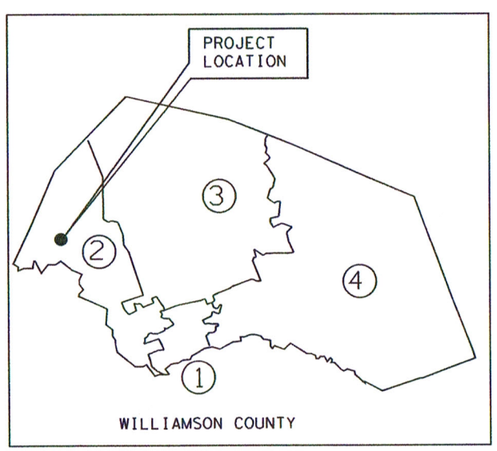

WILLIAMSON COUNTY

TxDOT STANDARD SPECIFICATIONS FOR CONSTRUCTION OF HIGHWAYS, STREETS AND BRIDGES ADOPTED ON NOVEMBER 1, 2014 AND ALL APPLICABLE SPECIAL PROVISIONS AND SPECIAL SPECIFICATIONS AS INDICATED IN THE BID DOCUMENTS SHALL GOVERN ON THIS PROJECT.

EXCEPTIONS: NONE
EQUATIONS: NONE
RAILROAD CROSSINGS: NONE
WATERSHED: LACKEY CREEK
AREA OF DISTURBANCE: 2.52 ac.

PREPARED BY:
O'BRIEN ENGINEERING SERVICES-
TBPE # 14060

J. KENT O'BRIEN 12/21/17
J. KENT O'BRIEN DATE
P.E. 64398

STATE OF TEXAS
J. KENT O'BRIEN
64398
LICENSED
PROFESSIONAL ENGINEER

WILLIAMSON COUNTY
1848

© 2017 Williamson County, Texas
All rights reserved.

APPROVED BY:
WILLIAMSON COUNTY

DATE

DAN A. GATTIS
COUNTY JUDGE
WILLIAMSON COUNTY JUDGE

APPROVED BY:
WILLIAMSON COUNTY

DATE

COMMISSIONER CYNTHIA LONG
WILLIAMSON COUNTY COMMISSIONER, PRECINCT 2

APPROVED BY:
HNTB CORPORATION

DATE

RICHARD RIDINGS, P.E.
ROAD BOND MANAGEMENT TEAM

Williamson County, Texas
Bid 1802-217

INDEX OF SHEETS

SHEET	GENERAL
1	TITLE SHEET
2	INDEX OF SHEETS
3 - 3G	GENEARL NOTES
4	ESTIMATE & QUANTITY SHEET
5	SUMMARY OF QUANTITIES
6	SUMMARY OF SMALL SIGNS
7 - 8	TYPICAL SECTIONS
	TRAFFIC CONTROL PLAN
9	ADVANCED WARNING SIGNS
10 - 11	TRAFFIC CONTROL PLAN PHASE 2 & 3
12 - 23	BC(1)-14 THRU BC(12)-14
24	TCP(1-2)-12
25	TCP(2-1)-12
26	TCP(3-1)-13
27	TCP(3-3)-14
28	TCP(7-1)-13
29	WZ(BRK)-13
30	WZ(RS)-16
31	WZ(STPM)-13
32	WZ(UL)-13
	ROADWAY DETAILS
33	HORIZONTAL ALIGNMENT DATA
34	PLAN AND PROFILE
35	DRIVEWAY DETAILS
36	UTILITY DETAILS
37	SETP-PD
38	GF(31)-14
39	SGT(8)31-14
	DRAINAGE DETAILS
40	DRAINAGE AREA MAP
	TRAFFIC ITEMS
41	SIGNING & PAVEMENT MARKINGS
42	SIGNING DETAILS
43 - 44	D&OM(1)-15 AND D&OM(2)-15
45	D&OM(3)-15B
46 - 47	D&OM(4)-15 AND D&OM(5)-15
48	D&OM(VIA)-15
49 - 51	PM(1)-12 THRU PM(3)-12
52 - 53	RS(3)-13 & RS(4)-13
54	SMD(GEN)-08
55 - 57	SMD(SLIP-1)-08 & SMD(SLIP-3)-08
58	SMD(TWT)-08
59 - 60	TSR(3)-13 & TSR(4)-13

SHEET	ENVIRONMENTAL ISSUES
61	STORM WATER POLLUTION PREVENTION PLAN (SW3P)
62 - 63	SW3P PLAN TEMPORARY & PERMANENT
64 - 66	EC(1)-16 THRU EC(3)-16
67 - 69	EC(9)-16
	MISCELLANEOUS
70	EXISTING UTILITIES
	CROSS SECTIONS
71 - 80	ROADWAY CROSS SECTIONS

THE STANDARD SHEETS SPECIFICALLY IDENTIFIED HERE HAVE BEEN SELECTED BY ME OR UNDER MY RESPONSIBLE SUPERVISION AS BEING APPLICABLE TO THIS PROJECT.

J. Kent O'Brien 12/21/2017

J. KENT O'BRIEN, PE 64398 DATE

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
J. Kent O'Brien 12/21/2017

WILLIAMSON COUNTY 1848

WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC — TBPE FIRM # 14060

Rogers Design Services Transportation Engineering — ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN

INDEX OF SHEETS

SHEET 1 OF 1 | SHEET # 2

CR200 PDF - GS.pltcfg
3/15/2018 7:15:47 PM
Plotted: 12/21/2017
J:\CES\CR 200\Documents\WA-4\CR201-BS\SHEETS\General\CR200-WA4B-INDEX.dgn

Williamson County **Sheet:**
Project:

GENERAL NOTES: April 21, 2017 Version

Basis of Estimate

Item	Description	**Rate	Basis	Quantity
160	**Furnishing and Placing Topsoil (4")**	1 CY/9 SY	4651 SY	517 CY
161	**Erosion Control Compost (3")**	1 CY/12 SY	1163 SY	97 CY
162	**Mulch Topdressing (5")**	1 CY/7 SY	1163 SY	166 CY
164	**Seed for Erosion Control** (Item 164) (Temp) (Cool) (TY 4) (Item 164) (Perm) (Warm) (TY 5) (Item 164) (Temp) (Warm) (TY 10)	 4840 SY/AC 4840 SY/AC 4840 SY/AC	 2326 SY 4651 SY 2326 SY	 0.48 AC 0.96 AC 0.48 AC
166	**Fertilizer (13-13-13)**	1/8 LB/SY	4651 SY	0.3 TON
168	**Vegetative Watering** (Item 162) (Item 164) (Temp) (Item 164) (Temp) (Item 164) (Perm)	 20 GAL/SY 10 GAL/SY 10 GAL/SY 20 GAL/SY	 1163 SY 2326 SY 2326 SY 4651 SY	 23 MG 23 MG 23 MG 91 MG
**204	**Sprinkling** (Dust) (Item 132) (Item 247)	 30 GAL/CY 30 GAL/CY 30 GAL/CY	 2597 CY 388 CY 1059 CY	 77910GAL 11640GAL 31770GAL
**210	**Roll (Flat Wheel)** (Item 247) (Item 316)	 1 HR/200 TON 1 HR/6000 SY	 1430 TON 4924 SY	 8 HR 1 HR
**210	**Roll (Tamping)** (Item 132)	 1 HR/200 CY	 388 CY	 2 HR
**210	**Roll (Heavy Tamp)** (Item 132)	 1 HR/200 CY	 388 CY	 2 HR
**210	**Roll (Lt Pneu Tire)** (Item 132) (Item 247) (Item 316) (Seal Coat)	 1 HR/500 CY 1 HR/200 TON 1 HR/6000 SY	 388 CY 1430 TON 4924 SY	 1 HR 8 HR 1 HR
247	**FL BS (CMP IN PLC)** (TY A GR 4)	 27 CF/CY	 1059 CY	 1059 CY
310	**Prime Coat (Multi-Option)**	0.20 GAL/SY	3178 SY	636 GAL

Williamson County **Sheet:**
Project:

Item	Description	**Rate	Basis	Quantity
		Total		
316	**Surface Treatments** **Seal Coat:** Asphalt Aggregate (TY-D G-5 SAC-B)	 0.40GAL/SY 1 CY/120 SY	 4924 SY 4924 SY	 2014 GAL 42 CY
340	**Dense-Graded Hot-Mix Asphalt** TY B PG 64-22 TY D SAC-B PG 70-22 TY D PG 64-22(LEVEL-UP)	 115 LB/SY/IN 115 LB/SY/IN 115 LB/SY/IN	 3168 SY 5035 SY 1851 SY	 547 TON 579 TON 100 TON

** For Informational Purposes Only

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
1/4/2018

WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC
TBPE FIRM # 14060

Rogers Design Services Transportation Engineering
ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN

GENERAL NOTES

SHEET 1 OF 8 | SHEET # 3

C:\Users\jkobrien\Documents\WA-4-CR201-BS\SHEETS\General\CR200-WA4b-GN01.dgn
CR200 PDF - GS.pltcfg
3/5/2018 7:55:29 AM
jkobrien

Williamson County **Sheet:**
Project:

MODIFIED STANDARDS
The following standard detail sheet or sheets have been modified:

NONE

GENERAL
References to manufacturer's trade name or catalog numbers are for the purpose of identification only. Similar materials from other manufacturers are permitted if they are of equal quality, comply with the specifications for this project, and are approved.

If work is performed at Contractor's option, when inclement weather is impending, and the work is damaged by subsequent precipitation, the Contractor is responsible for all costs associated with replacing the work, if required.

The roadbed shall be free of organic material prior to placing any section of the pavement structure.

Equip all construction equipment used in roadway work with highly visible omnidirectional flashing warning lights.

Provide a smooth, clean saw-cut along the existing asphalt pavement structure, as directed. Consider subsidiary to the pertinent Items.

Supply litter barrels in enough numbers at locations as directed to control litter within the project. Consider subsidiary to pertinent Items.

Use a self-contained vacuum broom to sweep the roadway and keep it free of sediment as directed. The contractor will be responsible for any sweeping above and beyond the normal maintenance required to keep fugitive sediment off the roadway as directed by the Construction Observer.

Protect all areas of the right of way, which are not included in the actual limits of the proposed construction areas, from disturbance. Restore any area disturbed because of the Contractor's operations to a condition as good as, or better than, before the beginning of work at no cost to the state.

Damage to existing pipes and SETs due to Contractor operations shall be repaired at Contractor's expense.

All locations used for storing construction equipment, materials, and stockpiles of any type, within the right of way, will be as directed. Use of right of way for these purposes will be restricted to those locations where driver sight distance to businesses and side street intersections is not obstructed and at other locations where an unsightly appearance will not exist. The Contractor will not have exclusive use of right of way but will cooperate in the use of the right of way with the city/county and various public utility companies as required.

Williamson County **Sheet:**
Project:

The Project Superintendent will be capable of speaking English and will be available to contact at all times when work is being performed, including subcontractor work. The Superintendent will be available and on-call 24 hours a day.

Coordinate and obtain approval from the Construction Observer for all bridgework over existing roadways.

Measure all minimum vertical clearances for all structures (including, but not limited to, signal mast arms, span wires, and overhead sign bridge structures) within the limits of the project for all roadway alignments in all directions of travel. Coordinate with the Construction Observer to take these measurements and obtain prior to opening roadways to traffic unless otherwise approved. The Construction Observer will report all minimum vertical clearance information on State maintained roadways to the Austin District Permit Office.

Use materials from prequalified material producers list as shown on the Texas Department of Transportation (TxDOT) – Construction Division's (CST) materials producers list. Refer to TxDOT's website for list of pre-qualified manufacturers. No substitutions will be allowed for materials found on the list. Submit list of approved suppliers/materials from TxDOT website to show items are TxDOT approved. Submit this list with request for material approval.

When any abandoned well is encountered, cease construction operations in this area and notify the Engineer who will coordinate the proper plugging procedures. A water well driller licensed in the State of Texas must be used to plug a well.

Erosion control and stabilization measures must be initiated immediately in portions of the site where construction activities have temporarily ceased and will not resume for a period exceeding 14 calendar days. Track all exposed soil, stockpiles, and slopes. Tracking consists of operating a tracked vehicle or equipment up and down the slope, leaving track marks perpendicular to the direction of the slope. Re-track slopes and stockpiles after each rain event or every 14 days, whichever occurs first. This work is subsidiary.

Perform maintenance of vehicles or equipment at designated maintenance sites. Keep a spill kit on-site during fueling and maintenance. This work is subsidiary.

Maintain positive drainage for permanent and temporary work for the duration of the project. Be responsible for any items associated with the temporary or interim drainage and all related maintenance. This work is subsidiary.

Suspend all activities near any significant recharge features, such as sinkholes, caves, or any other subterranean openings that are discovered during construction or core sampling. Do not proceed until the designated Geologist or TCEQ representative is present to evaluate and approve remedial action.

Locate aboveground storage tanks kept on-site for construction purposes in a contained area as to not allow any exposure to soils. The containment will be sized to capture 150% of the total capacity of the storage tanks.

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
12/21/2017

WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC
TBPE FIRM # 14060

Rogers Design Services Transportation Engineering
ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN

GENERAL NOTES

SHEET 2 OF 8 SHEET # 3A

CR200 PDF - GS.pltcfg
3/15/2018
3:15:54 PM
12/21/2017
C:\DES\CR 200\Documents\WA-44\CR201-BS\SHEETS\General\CR200-WA4b-GN02.dgn

Williamson County **Sheet:**
Project:

Project Specific Location (PSL) in USACE Jurisdictional Area.
Do not initiate activities in a PSL associated with a U.S. Army Corps of Engineers (USACE) jurisdictional area that have not been previously evaluated by the USACE as part of the permit review of this project. Such activities include, but are not limited to, haul roads, equipment staging areas, borrow and disposal sites. Associated defined here means materials are delivered to or from the PSL. The jurisdictional area includes all waters of the U.S. including wetlands or associated wetlands affected by activities associated with this project. Special restrictions may be required for such work. Consult with the USACE regarding activities, including PSLs that have not been previously evaluated by the USACE. Provide the Department with a copy of all USACE coordination and approvals before initiating activities.

Proceed with activities in PSLs that do not affect a USACE jurisdictional area if self-determination has been made that the PSL is non-jurisdictional or proper clearances have been obtained in USACE jurisdictional areas or have been previously evaluated by the USACE as part of the permit review of this project. Document any determinations that PSL activities do not affect a USACE jurisdictional area. Maintain copies of PSL determinations for review by the Department or any regulatory agency. The Contractor must document and coordinate with the USACE, if required, before any excavation material hauled from or embankment material hauled into a USACE jurisdictional area by either (1) or (2) below.

1. Restricted Use of Materials for the Previously Evaluated Permit Areas. When an area within the project limits has been evaluated by the USACE as part of the permit process for this project:
    a. suitable excavation of required material in the areas shown on the plans and cross sections as specified in Standard Specification Item 110, Excavation is used for permanent or temporary fill within a USACE jurisdictional area;
    b. suitable embankment from within the USACE jurisdictional area is used as fill within a USACE evaluated area;
    c. Unsuitable excavation or excess excavation that is disposed of at an approved location within a USACE evaluated area.
2. Contractor Materials from Areas Other than Previously Evaluated Areas. Provide the Department with a copy of all USACE coordination and approvals before initiating any activities in a jurisdictional area within the project limits that has not been evaluated by the USACE or for any off right of way locations used for the following, but not limited to, haul roads, equipment staging areas, borrow and disposal sites:
    a. Standard Specification Item 132, Embankment is used for temporary or permanent fill within a USACE jurisdictional area;
    b. Unsuitable excavation or excess excavation that is disposed of outside a USACE evaluated area.

Work over or near Bodies of Water (Lakes, Rivers, Ponds, Creeks, etc.).
Keep on site a universal spill kit adequate for the body of water and the work being performed. No debris is allowed to fall into a body of water. Debris that falls into the water must be removed at the end of each work day. Debris that falls into the floodway must be removed at the end of each work week or prior to a rain event. This work is subsidiary.

DSHS Asbestos and Demolition Notification.

Williamson County **Sheet:**
Project:

Migratory Birds and Bats.
Migratory birds may be nesting within the project limits and concentrated on roadway structures such as bridges and culverts. Remove all old and unoccupied migratory bird nests from any structures, trees, etc. between September 1st and January 31st. Prevent migratory birds from re-nesting between February 1st and August 31st.

All methods used for the removal of unoccupied bird nests and the prevention of re-nesting must be approved by the Construction Observer well in advance of the planned use.

In the event that any active nests are encountered on-site during construction, all construction activity within the immediate vicinity of the nest must cease immediately. Contact the Construction Observer to determine how to proceed.

Bats may roost within the project limits under bridges, in culverts, in large hollow trees, in dead standing trees, and in trees with shaggy bark. Maternity colonies may occur from April 1st through August 31st. If bats are present, ensure bats are not harmed. Exclusion protocols for known colonies should be followed well in advance of commencement of construction activities. Exclusion measures by qualified individuals are used to relocate existing colonies, except from April 1st through August 31st when such measures may separate mothers and pups. Exclusion measures are also the means of preventing establishment of new colonies and re-establishment of relocated colonies.

No extension of time or compensation payment will be granted for a delay or suspension of work caused by migratory birds or bats. This work is subsidiary.

ITEM 100 – PREPARING RIGHT OF WAY
Do not burn brush, unless otherwise approved.

Trim vegetation around signs and other obstructions. Consider subsidiary to pertinent Items.

Use hand methods or other means to remove objectionable material and obstructions, if doing work by mechanical methods is impractical. Consider subsidiary to the pertinent Items.

ITEM WC101 – SOIL RIPPING
Soil Ripping, as required for all projects in Special Specification WC101, shall be accomplished using the following values:

Spacing for slopes between 3:1 and 4:1, groves should be 16 inches on center.

For slopes flatter than 4:1, groves should be 12 inches on center.

Depth of compacted soils should be ripped to a depth of 18 inches. When embankment stabilization is a concern, ripping depth can be reduced to 12 inches.

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
12/21/2017

WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC
TBPE FIRM # 14060

Rogers Design Services Transportation Engineering
ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN

GENERAL NOTES

SHEET 3 OF 8 SHEET # 3B

CR200 PDF - GS.pltcfg
3/15/2018 7:39 AM
12/21/2017 4:16:00 PM
C:\Users\CR 200\Documents\WA-44\CR201-BS\SHEETS\General\CR200-WA4b-GN03.dgn

Williamson County **Sheet:**
Project:

ITEM 110 & 132 – EXCAVATION & EMBANKMENT
Unsuitable material encountered in a cut or fill section will be considered waste. The Construction Observer will define unsuitable material. Material, which the Contractor might deem to be unsatisfactory or unsuitable, due to moisture content, will not be considered unsuitable material, unless otherwise approved.

Obtain approval of all compaction equipment prior to all backfilling and embankment operations.

ITEM 132 – EMBANKMENT
The underlying layer or existing subgrade must be prepared and inspected prior to placement of the embankment. Proof roll the pavement area according to Item 216 prior to placement of embankment or subsequent layers. Payment for proof rolling will be subsidiary to the various bid Items of the contract.

Correct unstable material (e.g. dry, wet, loose, etc.) to a depth of six (6) inches below existing grade. This work will be considered subsidiary to pertinent bid Items. Drying required deeper than six (6) inches below existing grade will be paid for in accordance with Item 6.03, "Extra Work." However, there will be no payment to correct failures in the subgrade areas that were constructed under this contract.

ITEM 132 – EMBANKMENT TY C
The Construction Observer must approve the embankment material before use on the project.

Existing material located within the project limits may be used as embankment if it meets specifications shown on the plans and if approved by the Construction Observer.

If delivery from offsite source is necessary, furnish embankment with a PI of less than 25 that does not contain sulfate contents greater than 3000 ppm.

Meet the following select embankment (TY C) requirements when used as subgrade directly beneath flexible and/ or rigid pavement sections to depths specified in the typical section.

Embankment Material Requirements – Item 132 [TY C)

Item	Description	(Percent Retained-Sieve)					LL	PI	PI
		1¾"	7/8"	3/8"	#4	#40	Max.	Max.	Min.
132	Embankment (Density Control) (TY C1)	0-10	10-20	-	45-75	60-85	45	20	6
132	Embankment (Ordinary Compaction) (TY C2)	0-10	10-20	-	45-75	50-85	55	25	8

Stockpile imported TY C embankment at an approved location until it meets all testing requirements. The stockpile must be between 500 CY and 5000 CY and must not exceed a height of 15 ft. It is the Contractor's responsibility to identify and notify the Construction Observer of the location of the borrow source to allow time for testing and approval to avoid delay to the project. Allow a minimum of five (5) working days for testing.

Williamson County **Sheet:**
Project:

ITEM 134 – BACKFILLING PAVEMENT EDGES
For TY A backfill, furnish flexible base meeting the requirement as specified in the plans, in accordance to Item 247. Compressive strengths for Item 247 flexible base are waived when supplied for this item. In lieu of flexible base, RAP may be supplied for TY A backfill. RAP must be 100% passing a 2½ inch sieve in accordance to Tex-110-E. Compact using a light pneumatic roller. Install at 3:1 slope and tie into existing terrain. Apply SS-1 to front slope at a rate of 0.12 GAL/SY, after compaction is complete.

ITEM 160 – TOPSOIL
No sandy loam allowed. Obtain approval of the actual depth of the topsoil sources for both on-site and off-site sources.

ITEM 169 – SOIL RETENTION BLANKETS
Use materials from prequalified material producers list as shown on the Texas Department of Transportation (TxDOT) – Construction Divisions (CST) materials producers list. Refer to TxDOT's website for list of pre-qualified manufacturers. Direct all questions to the Maintenance Division, Vegetation Management Section, 125 E. 11th Street, Austin, TX 78701-2483.

ITEM 204 – SPRINKLING
Apply water for dust control as directed. When dust control is not being maintained, cease operations until dust control is maintained. Consider subsidiary to the pertinent Items.

ITEM 216 – PROOF ROLLING
Correct and perform "Proof Rolling" retest at the Contractor's expense, to the satisfaction of the Construction Observer, when initial "Proof Rolling" yields a failing result.

ITEM 247 – FLEXIBLE BASE
Furnish Type A material.

Furnish flexible base meeting Grade 4 requirements.

The following table will govern the acceptance of compaction on base courses, when compacted in multiple courses. Compaction requirements are in percent of maximum dry density as determined by (Tex-113-E). When compacting in a single course, compact to at least 100% of maximum dry density as determined by Tex-113-E.

Item	Material	All Roadways	
		Lift	Min. Density
247	FL BS (CMP IN PLC)	1st of 2 lifts	95%
		2nd of 2 lifts	98%
		(final lift)	100%

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
12/21/2017

WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC
TBPE FIRM # 14060

Rogers Design Services Transportation Engineering
ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN

GENERAL NOTES

SHEET 4 OF 8 SHEET # 3C

CR200 PDF - GS.pltcfg
12/21/2017 4:16:06 PM
C:\DES\CR 200\Documents\WA-44\CR201-BS\SHEETS\General\CR200-WA4b-GN04.dgn

Williamson County **Sheet:**
Project:

Table 1
Flexible Base Material Requirements

Property	Test Method	Grade 4
Master gradation sieve size	Tex-110-E	**% Retained**
2½ in.		0
1¾ in.		0
7/8 in.		10-35
3/8 in.		30-50
No. 4		45-65
No. 40		70-90
No. 200		87-95
Liquid Limit, % Max.[1]	Tex-104-E	35
Plasticity Index, Max.[1]	Tex-106-E	10
Wet ball mill, % Max.	Tex-116-E	40
Wet ball mill, % Max. increase passing the No. 40 sieve		20
Min. compressive strength, psi	Tex-117-E	
Lateral pressure 0 psi		–
Lateral pressure 3 psi		90
Lateral pressure 15 psi		175

1. Determine plastic index in accordance with Tex-107-E (linear shrinkage) when liquid limit is unattainable as defined in Tex-104-E.

Correct subgrade (e.g. unstable areas, soft spots, etc.) prior to placing Flex Base. Consider subsidiary to the pertinent Items.

Complete all subgrade, ditches, slopes, and place all drainage structures to conform to required lines, grades, and cross-sections, as shown and directed, prior to the placement of Flex Base.

For Flex Base placed over the box culverts, do not use a Vibratory Roller to compact the material.

ITEM 300 – ASPHALTS, OILS, AND EMULSIONS
Asphalt season starts May 1st and ends September 15th.

PPA and REOBs are not allowed.

ITEM 300 – ASPHALTS, OILS, AND EMULSIONS (NON-TRACKING TACK COAT)
Apply non-tracking tack coat at 0.2 GAL/SY (residual) or as directed by the Construction Observer.

Spray a test strip of tack coat at a location on or near the project as directed. Consult the manufacturer for the recommended application rate. Allow the strip to cure for the maximum time specified. Drive over the test strip with equipment to simulate the effect of paving equipment. There should be no evidence tracking or picking up of the tack coat on the wheels of the equipment.

Williamson County **Sheet:**
Project:

The Construction Observer shall verify the bond strength as directed.

ITEMS 310, 316, 340
Perform work during good weather, unless otherwise directed. If work is performed at Contractor's option, when inclement weather is impending, and the work is damaged by subsequent precipitation, the Contractor is responsible for all costs associated with replacing the work, if required.

ITEM 310 – PRIME COAT
Apply blotter material to all driveways and intersections.

Multi-option bituminous material is allowed.

Provide Construction Observer with current Distributer Certification confirming calibration of asphalt measurement equipment.

Distribute prime coat smoothly and evenly at the rate of 0.2 gallons per square yard.

Apply Prime to finished flex base surface at the rate shown in the plans. Hot mix can be applied to the primed surface of flex base after the prime has penetrated and cured for a minimum of 36 hours depending on weather conditions or as approved by the Construction Observer. Provide the Construction Observer with a copy of the asphalt deliver ticket prior to application.

Apply blotter material to all driveways and intersections. This work is subsidiary. When Multi Option is allowed, provide MC 30, EC 30, or AE-P. MC 30 is not allowed in Travis County.

ITEM 316 – SEAL COAT
Do not apply asphalt within 1½ hours of sunset, or later, unless otherwise directed.

Grade 4 and 5 Type D or Type E is allowed as AGGR (MULTI OPTION) for an underseal.

Ensure that all underseal surface treatment operations are covered by HMACP before exposing to traffic, including construction traffic.

Use paper or other approved material at the beginning and end of each shot so that the transverse joint is straight and prevents overlap of asphalt shots.

Any areas with excessive asphalt or aggregate will be removed.

The Contractor is required to provide recommendations to the Construction Observer on adjusting aggregate and asphalt rates, when the road conditions, material properties or construction methods change.

Furnish medium pneumatic-tire rollers in accordance with Item 210, "Rolling." Roll before opening to traffic.

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
12/21/2017

WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC
TBPE FIRM # 14060

Rogers Design Services Transportation Engineering
ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN

GENERAL NOTES

SHEET 5 OF 8 SHEET # 3D

CR200 PDF - GS.pltcfg
3/15/2018 7:39 AM
12/21/2017 16:12 PM
C:\DOBES\CR 200\Documents\WA-44\CR201-BS\SHEETS\General\CR200-WA4b-GN05.dgn

Williamson County **Sheet:**
Project:

Surface all transitions, tapers, climbing lanes and intersections to the limits as directed.

Keep all traffic, including construction traffic, off freshly placed surface treatment, as directed.

Provide Construction Observer with current Distributer Certification confirming calibration of asphalt measurement equipment.

Provide Construction Observer with a copy of the shipping ticket for the asphalt prior to application. Contractor must sample asphalt, in accordance to the applicable item. Label the sample can with date and project numbers. Samples must be stored where they are readily available to the County representative at the plant. The Contractor will be responsible for supplying storage for all samples until the project achieves substantial completion or otherwise directed.

Removal and proper disposal off the ROW of audible/profile markings, reflectorized markings, and raised markers is subsidiary.

ITEM 320 – EQUIPMENT FOR ASPHALT CONCRETE PAVEMENT
Use of motor grader is not allowed

ITEMS 340 (HMACP Testing)
The Contractor must sample asphalt binder, in accordance to the applicable item. Label the sample can with the corresponding CSJ, lot, and sub-lot numbers.

Samples must be stored in a common area where they are readily available to the County's representative at the plant. The Contractor will be responsible for supplying storage for all samples. Retain all asphalt samples until hot mix production is complete or directed otherwise.

When directed, the Contractor is responsible for disposal of all asphalt binder samples, in accordance to Local, State, and Federal regulations.

[Hot Mix Asphaltic Concrete (HMAC) Core Holes]
Refill and compact all HMAC core holes to the same elevation as the adjacent roadway. Use hot mix of the type being used in the project to fill core holes. As an alternative a high performance cold patching mix such as Rapid Cure Patching Mix meeting the requirements of DMS-9203 or Medium Cure Patching mix made with SCM meeting requirements of DMS-9202. Consider this work subsidiary to the pertinent Items.

Mill a transverse butt joint to transition from the new ACP to the existing surface tie-in. Make the transition a minimum of 50 feet H: 1 inch V slope ratio of newly placed ACP. Make the temporary joint, at the tie-in, a minimum of a 10 feet longitudinally and covering the entire width. Saw-cut existing pavement as directed. Prior to milling, core the existing pavement to determine its thickness. Do not proceed with milling until directed. Consider this work subsidiary to the pertinent Items.

Williamson County **Sheet:**
Project:

Contractor to submit for approval a current mix design (less than 6 months old) to the Construction Observer that meets the following requirements prior to use on the project.

PPA and REOBS are not allowed.

Aggregates used on shoulders and ramps are required to meet SAC requirements.

Target laboratory molded density is 97% for all mixtures for Texas Gyratory Compactor (TGC) mixture designs.

When using Superpave Gyratory Compactor (SGC) to design mixtures, submit the SGC mix design to the Construction Observer for approval.

When using substitute binders, mold specimens for mix design and production at the temperature required for the substitute binder used to produce the HMA.

All mixtures must meet the Hamburg requirement as stated in the table below.

High-Temperature Binder Grade	Test Method	Hamburg Wheel Test Requirements [1]		
		Minimum # of Passes	Maximum Rut Depth (mm)[2]	Minimum Rut Depth (mm)[2,3]
PG 64 or lower	Tex-242-F	7,000	12.5	3
PG 70	Tex-242-F	15,000	12.5	3
PG 76 or higher	Tex-242-F	20,000	12.5	3

1. The Construction Observer may accept Hamburg Wheel test results for production and placement if no more than 1 of the 5 most recent tests is below the specified number of passes and the failing test is no more than 2,000 passes below the specified number of passes.
2. Rut depth tested @ 122°F
3. Unless approved otherwise.

When using RAP and/or RAS:
Use of RAS is not allowed. When using RAP, include the management methods of processing, stockpiling, and testing of RAP in the QCP submitted for the project. Blending of RAP in one feeder bin or in a stockpile is not permitted.

Asphalt content and binder properties of RAP stockpiles must be documented when recycled asphalt content greater than 20% is utilized.

RAP is not allowed for any surface mix applications.

No more than 20% RAP by weight of aggregate is allowed in any mix application.

Complete all roadways before final surface course placement, unless directed otherwise.

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
12/21/2017

WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC
TBPE FIRM # 14060

Rogers Design Services Transportation Engineering
ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN

GENERAL NOTES

SHEET 6 OF 8 SHEET # 3E

CR200 PDF - GS.pltcfg
3/15/2018 7:16:18 PM
J:\CR 200\Documents\WA-44\CR201-BS\SHEETS\General\CR200-WA4b-GN06.dgn

Ensure placement sequence to avoid excess distance of longitudinal joint lapback not to exceed one day's production rates.

The Contractor shall utilize a material transfer device per item 320 and a grade reference (such as a ski) for overlay operations. Consider subsidiary to the pertinent items.

Use a device to create a maximum 3H: 1V notched wedge joint on all hot mix joints of two (2) inches or greater. Consider subsidiary to the pertinent Items.

Taper transverse faces at ends of passes as directed.

Make transverse tapers on each end of pass using a minimum slope rate of 60H:1V. Tapers shall be removed directly before placement of final lift. Consider subsidiary to the pertinent Items.

Provide a minimum transition for all side streets of at least 12 ft. and driveways of at least six (6) feet, unless otherwise shown on the plans or otherwise approved/directed.

Tack only between old existing asphalt surfaces and new HMAC layer, and on any sawed edge, unless otherwise directed. Do not dilute tack coat. Apply it through a distributor spray bar in accordance with Article 316.3.1 Distributor.

Submit any proposed adjustments or changes to a job mix formula to the Construction Observer before production of the new job mix formula.

For Mixture Design Verification, provide the Construction Observer with two 5-gallon buckets of each aggregate stockpile to be used on the project with three gallons of each PG binder from the plant to be used on the project. Sufficient quantities of any other additives that will be used in the HMA mixture shall also be provided.

Prior to allowing production of the trial batch, the Construction Observer will use the materials provided by the Contractor to perform the following tests to verify the HMA mixture .

1. Indirect Tensile Test in accordance with Tex-266-F
2. HAMBURG Wheel Test in accordance with Tex-242-F
3. Overlay Test in accordance with Tex-248-F
4. Cantabro Test in accordance with Tex-245-F

For mixtures designed with a Texas Gyratory Compactor (TGC), the Construction Observer may require that the target laboratory molded density be raised to no more than 97.5% or may lower the design number of gyrations to no less than 35 for mixtures designed with an SGC if any of the following conditions exist:

1. The Indirect Tensile Test results in a value greater than 200 PSI
2. The Hamburg Wheel Test results in a value less than 3.0 mm
3. The Overlay Test results in a value less than 100 cycles

4. The Cantabro Test results in a value of more than 20% loss

In lieu of or in addition to evaluating the mixture design prior to allowing a trial batch to be produced, the Construction Observer may also evaluate the mixture produced during the trial batch for compliance with the four tests listed above.

Submit thermal and segregation profiles as well as longitudinal joint densities on electronic forms provided by County to the Construction Observer.

When surface irregularities, as defined in Article 341.4.9.3.3.5, "Irregularities," are detected or measured, the Contractor must take immediate corrective action defined as the removal and replacement of a full lane width of the defective area using a paver to place new mix, unless otherwise directed. If there are multiple defective areas within a sub-lot, making up to 30% of the sub-lot by area, the Construction Observer will require the entire sub-lot be removed, unless directed otherwise.

ITEM 400 – EXCAVATION AND BACKFILL FOR STRUCTURES
Cut pavements with the use of a saw as directed. Consider subsidiary to pertinent Items.

Obtain approval of all compaction equipment prior to all backfilling and embankment operations.

Use Class "B" sand bedding for pipe and box culvert installation unless otherwise directed.

ITEM 467 – SAFETY END TREATMENT
Cut pipe ends, in the field, to match roadway side slopes, or as directed. Apply asphalt base aluminum paint to the cut ends.

All Type II SETs shall have mitered pipe ends and cast-in-place riprap aprons.

Use Class C concrete.

Remove all loose Formwork and other Materials from the Floodplain or drainage areas, daily, which could float off in a Storm Water Event, as directed.

ITEM 502 – BARRICADES, SIGNS, AND TRAFFIC HANDLING
Unless otherwise approved, one (1) lane in each direction shall remain open at all times.

The GEC is the authority to approve additional lane closures, prior to any work.

Maintain a written record of documentation of "The Additional Approved Lane Closures."

Submit and secure concurrence, prior to the publication of any notices or placement of any traffic control devices for implementation of the traffic control plan, hereinafter called a Lane Closure Notice (LCN).

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
12/21/2017

WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC
TBPE FIRM # 14060

Rogers Design Services Transportation Engineering
ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN

GENERAL NOTES

SHEET 7 OF 8 SHEET # 3F

CR200 PDF - GS.pltcfg
3/15/2018
8:16:24 PM
12/21/2017
C:\DES\CR 200\Documents\WA-44\CR201-BS\SHEETS\General\CR200-WA4b-GN07.dgn

Williamson County **Sheet:**
Project:

Present to GEC, an LCN for traffic control, which is proposed for implementation, a minimum of four (4) full working days preceding any proposed implementation date. Indicate the estimated date, time, duration, and location for the proposed work. As a part of the LCN submit a written description of the lane closure(s) depicting the proposed traffic control devices used, based on the appropriate plan sheet, TxDOT or Texas Manual on Uniform Traffic Control Devices (TMUTCD) standards, and an operational description of the work to be performed.

Present to GEC, LCN's proposed for night work, a minimum of ***seven (7)*** full calendar days preceding any proposed implementation date.

Receive concurrence prior to LCN implementation.

Meet with the Construction Observer prior to roadway and lane closures to ensure that sufficient equipment, materials, devices, and workers will be used. Discuss contingency plans at that time. Consider inclement weather prior to implementing the lane closures.

Submit a cancellation of any lane closures, no later than noon on the day preceding the proposed work.

Do not set up any Lane Closure / TCP when the pavement is wet prior to the "setup," unless otherwise directed. Revise Traffic Control, when inclement weather is imminent, as directed.

Incorporate and maintain a 3H: 1V safety wedge into the proposed construction for any roadway edge of 2 inches or greater adjacent to a roadway under traffic.

Within the limits of the project, provide standard barricades, warning signs, delineators, lights, 28-inch cones, and flaggers in enough numbers and combinations, as directed.

No closures will be allowed on the weekends, which include the following holidays: January 1st, the last Monday in May, July 4th, the first Monday in September, the fourth Thursday in November, December 25th, Easter weekend, and the working day prior to or immediately after any of the aforementioned holidays. Unless otherwise approved, no closures will be allowed on the weekends of special events that could be impacted by the construction. Ensure all equipment, vehicles, workers, etc., associated with these closures are off the roadways and all lanes re-opened, at least, by noon of the Friday before these holidays and special events.

ITEM 530 – INTERSECTIONS, DRIVEWAYS, AND TURNOUTS
Notify property owners a minimum of 48 hours in advance of beginning work on their driveways. Provide, to GEC, a list of each notification and contact prior to each closure.

Provide access, at all times, to adjacent property. Construct driveways one-half sections, to allow access.

Do not completely close driveways for reconstruction purposes, unless a reasonable alternate access exists to the property, as approved.

Williamson County **Sheet:**
Project:

Place the Flex Base for the Driveways using Ordinary Compaction.

ITEM 540 – METAL BEAM GUARD FENCE (MBGF)
Before beginning the installation of the proposed Metal Beam Guard Fence (MBGF), stake the locations for approval. Adjust the limits of the MBGF to meet field conditions, as directed, before erection.

Furnish new, round, domed and unpainted timber posts. Furnish steel posts at locations where the minimum embedment shown on the plans for wooden posts cannot be achieved. Field verify the steel post lengths before fabrication. Consider the steel posts subsidiary to pertinent Items.

Provide Rail Elements that meet AASHTO M 180 TY I Galvanization (1.80 oz. per SY).

Rail and rail elements that are in compliance with current standards and are undamaged should stockpiled at a location, approved by the Construction Observer, within the project limits for pick up by the County.

ITEM 644 – SMALL ROADSIDE SIGN ASSEMBLIES
Fabricate all small signs not detailed on the plans in conformance with the latest edition of the "Standard Highway Sign Designs for Texas," refer to TxDOT's website.

ITEM 662 – WORK ZONE PAVEMENT MARKINGS
Notify the Construction Observer at least 24 hours in advance of removing existing striping and placing pavement markings & markers.

Apply markings during good weather unless otherwise directed. If markings are placed at Contractor's option, when inclement weather is impending, and the markings are damaged by subsequent precipitation, the Contractor is responsible for all costs associated with replacing the markings if required.

Remove work zone pavement markings within 48 hours after permanent striping has been completed.

Foil backed pavement markings will not be allowed.

ITEM 666 – RETROREFLECTORIZED PAVEMENT MARKINGS
Reference existing channel islands, gores, and lane striping before commencing work. Provide referencing that will include a sketch of the layout to the Construction Observer. Obtain approval for placement of guidemarks from the Construction Observer before installing any permanent pavement markings. Consider subsidiary to the pertinent Items.

ITEM 738 – CLEANING AND SWEEPING HIGHWAYS
Complete cleaning and sweeping cycles at the intervals, as directed. Complete one cycle at the end of construction and prior to final acceptance by the Department.

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
12/21/2017

WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC
TBPE FIRM # 14060

Rogers Design Services Transportation Engineering
ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN

GENERAL NOTES

SHEET 8 OF 8 SHEET # 3G

CR200 PDF - GS.pltcfg
3/15/2018 7:39 AM
12/21/2017 4:16:30 PM
C:\PROJECTS\CR 200\Documents\WA-44\CR201-BS\SHEETS\General\CR200-WA4b-GN08.dgn

ESTIMATE SUMMARY

WILLIAMSON COUNTY CR 200 @ BOLD SUNDOWN		ALT	ITEM CODE			ITEM DESCRIPTION	UNIT	TOTAL	
EST.	FINAL		ITEM NO.	DESC. CODE	SP NO.			EST.	FINAL
			100	6002		PREPARING ROW	STA	9.30	
			110	6001		EXCAVATION (RDWY)	CY	2644.00	
			132	6003		EMBANKMENT (FINAL) (ORD COMP) (TY B)	CY	388.00	
			160	WC02		FURNISHING & PLACING TOPSOIL (4")	SY	4651.00	
			161	WC001		EROSION CONTROL COMPOST (3")	SY	1163.00	
			162	WC103		MULCH TOPDRESSING (5")	SY	1163.00	
			164	WC04		SEEDING FOR EROSION CONTROL (TEMP)(COOL) (TY 4)	SY	2326.00	
			164	WC05		SEEDING FOR EROSION CONTROL (PERM)(WARM)(TY 5)	SY	4651.00	
			164	WC10		SEEDING FOR EROSION CONTROL (TEMP)(WARM)(TY 10)	SY	2326.00	
			166	6002		FERTILIZER	TON	0.30	
			168	WC01		VEGETATIVE WATERING	MG	163.00	
			169	6001		SOIL RETENTION BLANKETS (CL 1) (TY A)	SY	2180.00	
			247	6044		FL BS (CMP IN PLC)(TY A GR 4)(FNAL POS)	CY	1059.00	
			310	6001		PRIME COAT (MULTI OPTION)	GAL	636.00	
			316	6193		AGGR (TY D GR-5 SAC-B)	CY	42.00	
			316	6413		ASPH (AC-15P, HFRS-2P OR CRS-2P)	GAL	2014.00	
			340	6011		D-GR HMA (SQ) TY-B PG64-22	TON	546.00	
			340	6120		D-GR HMA(SQ) TY-D SAC-B PG70-22	TON	579.00	
			340	6246		D-GR HMA TY-D PG64-22 (LEVEL-UP)	TON	100.00	
			464	6005		RC PIPE (CL III) (24 IN)	LF	30.00	
			467	6395		SET (TY II) (24 IN) (RCP) (6:1) (P)	EA	4.00	
			500	6001		MOBILIZATION	LS	1.00	
			502	6001		BARRICADES, SIGNS AND TRAFFIC HANDLING	MO	3.00	
			506	6002		ROCK FILTER DAMS (INSTALL) (TY 2)	LF	60.00	
			506	6011		ROCK FILTER DAMS (REMOVE)	LF	60.00	
			506	6020		CONSTRUCTION EXITS (INSTALL)(TY 1)	SY	224.00	
			506	6024		CONSTRUCTION EXITS (REMOVE)	SY	224.00	
			506	6040		BIODEG EROSN CONT LOGS (INSTL) (8")	LF	365.00	
			506	6043		BIODEG EROSN CONT LOGS (REMOVE)	LF	365.00	
			530	6005		DRIVEWAYS (ACP)	SY	51.00	
			540	6001		MTL W-BEAM GD FEN (TIM POST)	LF	287.50	
			542	6001		REMOVE METAL BEAM GUARD FENCE	LF	117.00	
			542	6002		REMOVE TERMINAL ANCHOR SECTION	EA	1.00	
			544	6001		GUARDRAIL END TREATMENT (INSTALL)	EA	2.00	
			544	6003		GUARDRAIL END TREATMENT (REMOVE)	EA	1.00	
			644	6001		IN SM RD SN SUP&AM TY10BWG(1)SA(P)	EA	1.00	
			644	6060		IN SM RD SN SUP&AM TYTWT(1)WS(P)	EA	3.00	
			644	6076		REMOVE SM RD SN SUP&AM	EA	3.00	
			658	6062		INSTL DEL ASSM (D-SW) SZ 1 (BRF) GF2 (BI)	EA	6.00	
			662	6109		WK ZN PAV MRK SHT TERM (TAB) TY W	EA	64.00	
			662	6110		WK ZN PAV MRK SHT TERM (TAB) TY Y	EA	93.00	
			666	6003		REFL PAV MRK TY I (W)4"(SLD)(100 MIL)	LF	2359.00	
			666	6036		REFL PAV MRK TY I (W)8"(SLD)(100 MIL)	LF	234.00	
			666	6042		REFL PAV MRK TY I (W)12"(SLD)(100 MIL)	LF	140.00	
			666	6048		REFL PAV MRK TY I (W)24"(SLD)(100 MIL)	LF	391.00	
			666	6054		REFL PAV MRK TY I (W)(ARROW)(100 MIL)	EA	2.00	
			666	6096		REFL PAV MRK TY I (W)(WORD)(100 MIL)	EA	2.00	
			666	6126		REFL PAV MRK TY I (Y)4"(SLD)(100 MIL)	LF	2275.00	
			672	6007		REFL PAV MRKR TY I-C	EA	12.00	
			672	6009		REFL PAV MRKR TY II-A-A	EA	150.00	

WILLIAMSON COUNTY
PRECINCT
#2

TBPE FIRM
14060

ROGERS DESIGN
SERVICES
FIRM # 9994

CR 200
AT BOLD SUNDOWN

ESTIMATE &
QUANTITY SHEET

SHEET 1 OF 1 | SHEET # 4

CR200 PDF - GS.pltcfg
3/15/2018
7:57:37 PM
J:\DES\CR 200\Documents\WA-44\CR201-BS\SHEETS\Summaries\CR200-WA4B-ES&Q.dgn

ROADWAY QUANTITIES SUMMARY

RDWY SHEET NO.	ITEM 100	ITEM 110	ITEM 132	ITEM 247	ITEM 310	ITEM 316		ITEM 340		
	6002	6001	6003	6044	6001	6193	6413	6011	6120	6246
	PREPARING ROW	EXCAVATION (RDWY)	EMBANKMENT (FINAL) (ORD COMP) (TY B)	FL BS (CMP IN PLC) (TY A GR 4) (FNAL POS)	PRIME COAT (MULTI OPTION)	AGGR (TY-D GR-5 SAC-B)	ASPH (AC-15P, HFRS-2P OR CRS-2P)	D-GR HMA (SQ) TY-B PG64-22	D-GR HMA (SQ) TY-D SAC-B PG70-22	D-GR HMA TY-D PG64-22 (LEVEL-UP)
	STA	CY	CY	CY	GAL	CY	GAL	TON	TON	TON
1 OF 1	9.3	2597	388	1022	613	41	1969	527	566	100
PVMT REPAIR		47		37	22	1	44	19	13	
TOTAL	9.3	2644	388	1059	636	42	2014	546	579	100

ROADWAY QUANTITIES SUMMARY (continued)

RDWY SHEET NO.	ITEM 464	ITEM 467	* ITEM 496		ITEM 530	ITEM 540	ITEM 542		ITEM 544	
	6005	6395	6004	6007	6005	6001	6001	6002	6001	6003
	RC PIPE (CL III) (24 IN)	SET (TY II) (24 IN) (RCP) (6:1) (P)	REMOV STR (SET)	REMOV STR (PIPE)	DRIVEWAYS (ACP)	MTL W-BEAM GD FEN (TIM POST)	REMOVE METAL BEAM GUARD FENCE	REMOVE TERMINAL ANCHOR SECTION	GUARDRAIL END TREATMENT (INSTALL)	GUARDRAIL END TREATMENT (REMOVE)
	LF	EA	EA	LF	SY	LF	LF	EA	EA	EA
1 OF 1	30	4	4	30	51	287.5	117	1	2	1
PVMT REPAIR										
TOTAL	30	4	4	30	51	287.5	117	1	2	1

* FOR CONTRACTOR'S INFORMATION ONLY

SUMMARY OF EROSION CONTROL ITEMS

SW3P SHEET NO.	ITEM 160	ITEM 161	ITEM 162	ITEM 164	ITEM 164	ITEM 164	ITEM 166	ITEM 168	ITEM 169	ITEM 506	ITEM 506	ITEM 506	ITEM 506	ITEM 506	ITEM 506
	WC02	WC001	WC103	WC04	WC05	WC10	6002	WC01	6001	6002	6011	6020	6024	6040	6043
	FURNISHING & PLACING TOPSOIL (4")	EROSION CONTROL COMPOST (3")	MULCH TOPDRESSING (5")	SEEDING FOR EROSION CONTROL (TEMP) (COOL) (TY 4)	SEEDING FOR EROSION CONTROL (PERM) (WARM) (TY 5)	SEEDING FOR EROSION CONTROL (TEMP) (WARM) (TY 10)	FERTILIZER	VEGETATIVE WATERING	SOIL RETENTION BLANKETS (CL 1) (TY A)	ROCK FILTER DAMS (INSTALL) (TY 2)	ROCK FILTER DAMS (REMOVE)	CONSTRUCTION EXITS (INSTALL) (TY 1)	CONSTRUCTION EXITS (REMOVE)	BIODEG EROSN CONT LOGS (INSTL) (8")	BIODEG EROSN CONT LOGS (REMOVE)
	SY	SY	SY	SY	SY	SY	TON	MG	SY	LF	LF	SY	SY	LF	LF
1 OF 1	4651	1163	1163	2326	4651	2326	0.3	160	2180	45	45	224		365	365
													224		
PROJECT TOTALS	4651	1163	1163	2326	4651	2326	0.3	160	2180	45	45	224	224	365	365

SIGNING & PAVEMENT MARKINGS SUMMARY

SHEET NO.	ITEM 644			ITEM 658	ITEM 666							ITEM 672	
	IN SM RD SN SUP & AM			D & O MKRS	REFLECTIVE PAVEMENT MARKINGS TYPE I							RAISED PVT MARKERS	
	6001	6060	6076	6062	6003	6036	6042	6048	6054	6096	6126	6007	6009
	IN SM RD SN SUP & AM TY 10BWG(1) SA(P)	IN SM RD SN SUP & AM TY TWT(1)WS(P)	REMOVE SM RD SN SUP & AM	INSTL DEL ASSM (D-SW) SZ 1 (BRF) GF2 (BI)	REFL PAV MRK TY I (W) 4" (SLD) (100 MIL)	REFL PAV MRK TY I (W) 8" (SLD) (100 MIL)	REFL PAV MRK TY I (W) 12" (SLD) (100 MIL)	REFL PAV MRK TY I (W) 24" (SLD) (100 MIL)	REFL PAV MRK TY I (W) (ARROW) (100 MIL)	REFL PAV MRK TY I (W) (WORD) (100 MIL)	REFL PAV MRK TY I (Y) 4" (SLD) (100 MIL)	REFL PAV MRKR TY I-C	REFL PAV MRKR TY II-A-A
	EA	EA	EA	EA	LF	LF	LF	LF	EA	EA	LF	EA	EA
1 OF 1	1	3	3	6	2359	234	140	391	2	2	2275	12	150
PROJECT TOTALS	1	3	3	6	2359	234	140	391	2	2	2275	12	150

WORK ZONE PAVEMENT MARKINGS SUMMARY

SHEET	ITEM 502	ITEM 662	
	6001	6109	6110
	BARRICADES, SIGNS AND TRAFFIC HANDLING	WK ZN PAV MRK SHT TERM (TAB) TY W	WK ZN PAV MRK SHT TERM (TAB) TY Y
	MO	EA	EA
PHASE 3		64	93
PROJECT TOTALS	3	64	93

WILLIAMSON COUNTY PRECINCT #2

TBPE FIRM # 14060

ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN

SUMMARY OF QUANTITIES

SHEET 1 OF 1 | SHEET # 5

CR200 PDF - CS.pltcfg
Default
3/13/2018 7:57:09 PM
C:\DGES\CR 200\Documents\WA-44CR201-RS\SHEETS\Summaries\CR200-2b-SUMM.dgn

SUMMARY OF SMALL SIGNS

STA.	SIGN NO.	SIGN NOMENCLATURE	SIGN	DIMENSIONS	FLAT ALUMINUM (TYPE A)	EXAL ALUMINUM (TYPE G)	SM RD SGN ASSM TY XXXXX (X) XX (X-XXXX) POST TYPE	POSTS	ANCHOR TYPE	MOUNTING DESIGNATION PREFABRICATED	MOUNTING DESIGNATION	BRIDGE MOUNT CLEARANCE SIGNS (See Note 2) TYPE N	BRIDGE MOUNT CLEARANCE SIGNS (See Note 2) TYPE S
							FRP = Fiberglass TWT = Thin-Wall 10BWG = 10 BWG S80 = Sch 80	1 or 2	UA=Universal Conc UB=Universal Bolt SA=Slipbase-Conc SB=Slipbase-Bolt WS=Wedge Steel WP=Wedge Plastic	P = "Plain" T = "T" U = "U"	1EXT or 2EXT = # of Ext BM = Extruded Wind Beam WC = 1.12 #/ft Wing Channel EXAL= Extruded Alum Sign Panels		
260+50 L	1-1	W8-25	SHOULDER ENDS	30X30	X		TWT	1	WS	P			
156+23 L	1-2	D3-1	CR 200	24X8	X		10BWG	1	SA	P			
		D3-1	BOLD SUNDOWN	48X8	X								
		R1-1	STOP	30X30	X								
156+58 L	1-3	R4-7	KEEP RIGHT	24X30	X		TWT	1	WS	P			
264+77 R	1-4	W8-25	SHOULDER ENDS	30X30	X		TWT	1	WS	P			

ALUMINUM SIGN BLANKS THICKNESS	
Square Feet	Minimum Thickness
Less than 7.5	0.080"
7.5 to 15	0.100"
Greater than 15	0.125"

The Standard Highway Sign Designs for Texas (SHSD) can be found at the following website.

http://www.txdot.gov/

NOTE:

1. Sign supports shall be located as shown on the plans, except that the Engineer may shift the sign supports, within design guidelines, where necessary to secure a more desirable location or to avoid conflict with utilities. Unless otherwise shown on the plans, the Contractor shall stake and the Engineer will verify all sign support locations.
2. For installation of bridge mount clearance signs, see Bridge Mounted Clearance Sign Assembly (BMCS)Standard Sheet.
3. For Sign Support Descriptive Codes, see Sign Mounting Details Small Roadside Signs General Notes & Details SMD(GEN).

Texas Department of Transportation

Traffic Operations Division Standard

SUMMARY OF SMALL SIGNS

SOSS


SHEET 1 OF 1

FILE: sums16.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT May 1987	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		6


T8

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:16:50 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\General\CR200-WA4b-sums16.dgn




DETAIL "C"

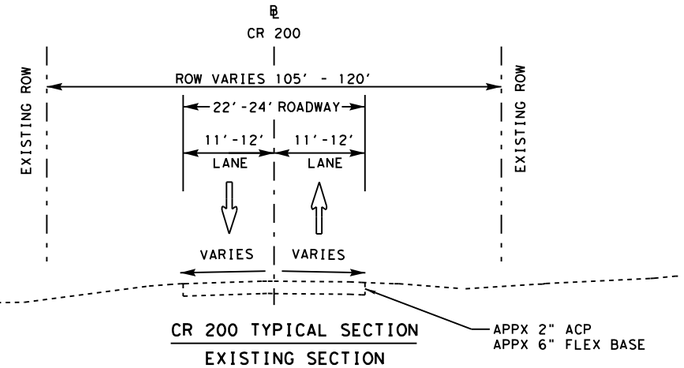


CR 200 TYPICAL SECTION

EXISTING SECTION

STA 258+000.00 TO STA 267+25.53




DETAIL "A"

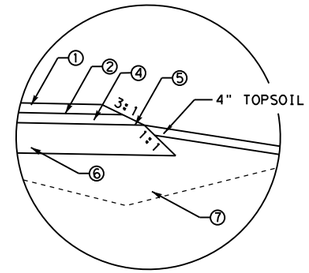

DETAIL "B"

① 2" HMACP(TY D)PG 70-22 SAC B
② SEAL COAT
③ HMACP (TY D) (LEVEL-UP)PG 64-22
④ 3" HMACP (TY B)PG 64-22
⑤ PRIME COAT
⑥ 12" FLEX BASE (2 EQUIVALENT LIFTS)
⑦ EMBANKMENT (TY B)

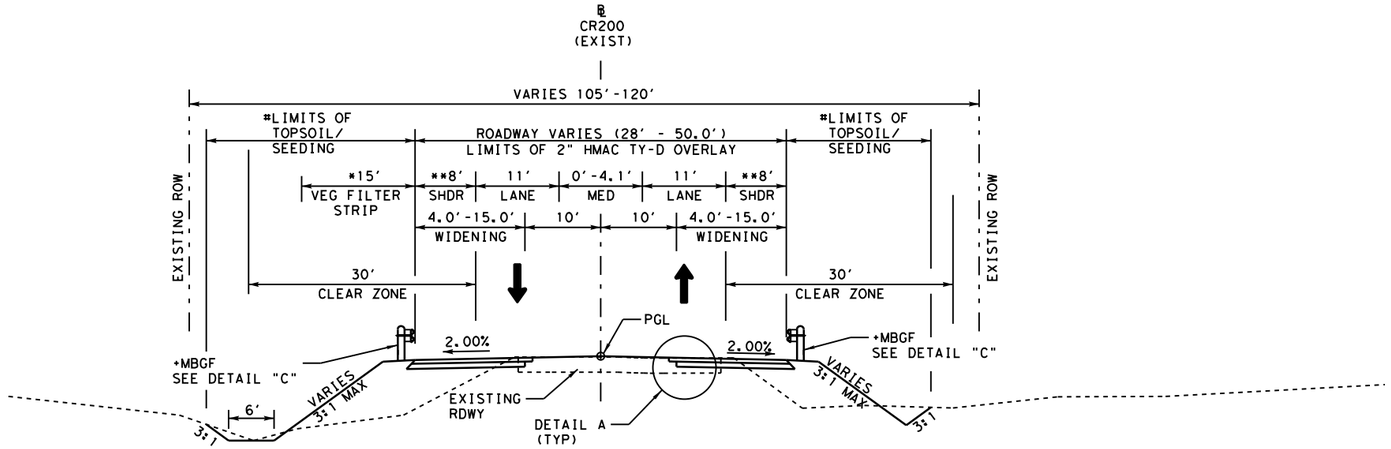

CR 200 TYPICAL SECTION

PROPOSED SECTION

STA 258+00.00 TO STA 260+71.37

\# COORDINATE WITH THE CONSTRUCTION OBSERVER REGARDING PLACEMENT OF ITEMS 161 AND 162.

\+ MBGF STA 258+00.00 TO STA 259+87.50, LT.
MBGF STA 258+00.00 TO STA 259+00.00, RT.

* 15' @ 20:1 DES, 6:1 MAX, STA 260+00.00 TO STA 260+71.37, LT.

** SHDR VARIES 0'-8' STA 258+00.00 TO STA 258+60.00

STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED
PROFESSIONAL ENGINEER

12/20/2017

WILLIAMSON COUNTY PRECINCT #2


TBPE FIRM # 14060

ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN
TYPICAL SECTIONS

SHEET 1 OF 2 | SHEET # 7

$$PLTDRVS$$
04:07 PM
12/20/2017
C:\Projects\CR 200\WA-4-CR201-BS\SHEETS\Typicals\CR200-WA4b-TYP401.dgn

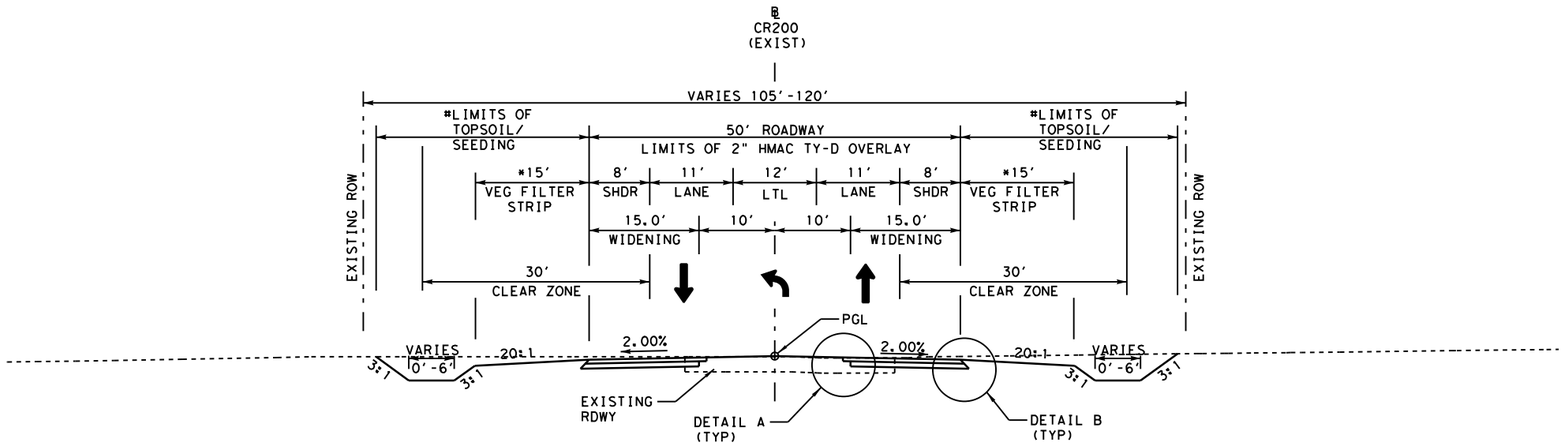


\# COORDINATE WITH THE CONSTRUCTION OBSERVER REGARDING PLACEMENT OF ITEMS 161 AND 162.

CR 200 TYPICAL SECTION


PROPOSED SECTION

STA 260+71.37 TO STA 264+25.53

* 15' @ 20:1 DES, 6:1 MAX, STA 260+71.37 TO STA 263+00.00, LT.
15' @ 20:1, STA 263+00.00 TO STA 264+25.53, RT.




DETAIL "A"

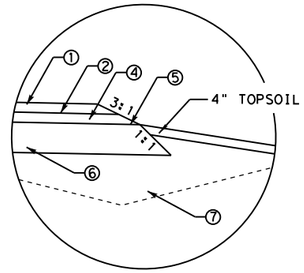

DETAIL "B"

① 2" HMACP(TY D)PG 70-22 SAC B
② SEAL COAT
③ HMACP (TY D) (LEVEL-UP)PG 64-22
④ 3" HMACP (TY B)PG 64-22
⑤ PRIME COAT
⑥ 12" FLEX BASE (2 EQUIVALENT LIFTS)
⑦ EMBANKMENT (TY B)

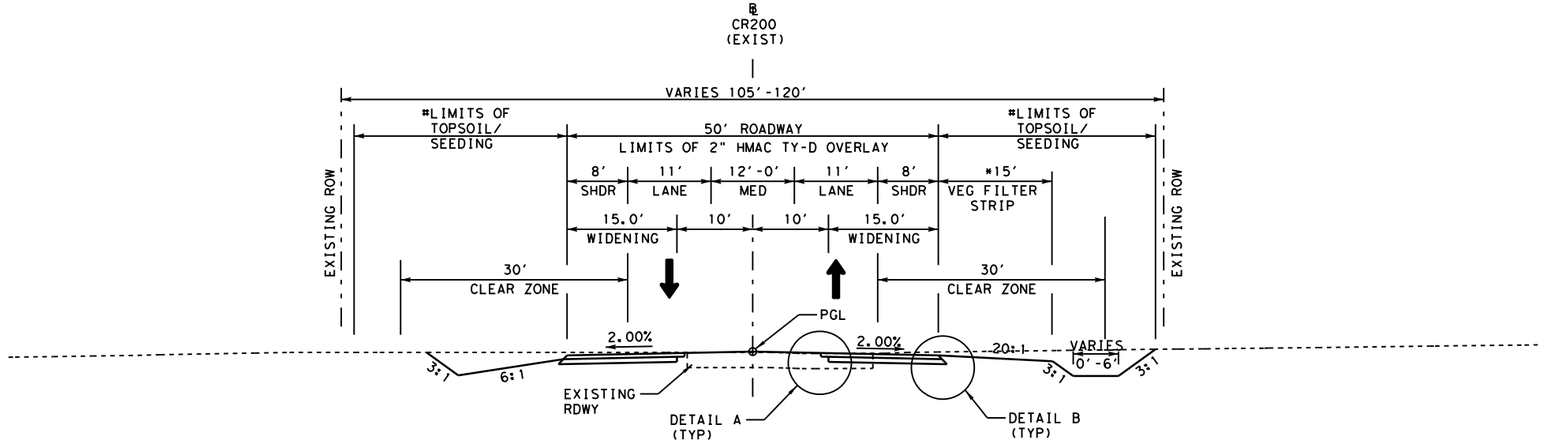

\# COORDINATE WITH THE CONSTRUCTION OBSERVER REGARDING PLACEMENT OF ITEMS 161 AND 162.

CR 200 TYPICAL SECTION

PROPOSED SECTION

STA 264+25.53 TO STA 267+25.53

* 15' @ 20:1, STA 264+25.53 TO STA 267+00.00, RT.

NOTE:

FOR THE FULL DEPTH REPAIR BEGINING +/-STA 261+90 AND ENDING +/-STA 262+90; THE FOLLOWING QUANTITIES WERE INCLUDED IN THE PROJECT QUANTITIES FOR PAVEMENT REPAIR:
ITEM 110-6001 - EXCAVATION 47 CY
ITEM 340-6011 - HMACP TY B 19 TON
ITEM 340-6120 - HMACP TY D 13 TON
AREA AND QUANTITY SHOWN ARE FOR ESTIMATING PURPOSES AND MAY VARY. REPAIR SHALL UTILIZE THE SAME PAVEMENT STRUCTURE AS THE WIDENING SECTION.

STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED
PROFESSIONAL ENGINEER

Daniel A. Rogers

3/13/2018

WILLIAMSON COUNTY 1848

WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC

TBPE FIRM # 14060

Rogers Design Services Transportation Engineering


ROGERS DESIGN SERVICES FIRM # 9994


CR 200
AT BOLD SUNDOWN

TYPICAL SECTIONS

SHEET 2 OF 2 | SHEET # 8

PLTDRVS#
03:45:43 AM
3/13/2018
J:\01510-000\CR 200\WA-4+CR201-BS\SHEETS\Typicals\CR200-WA4b-TYP402.dgn

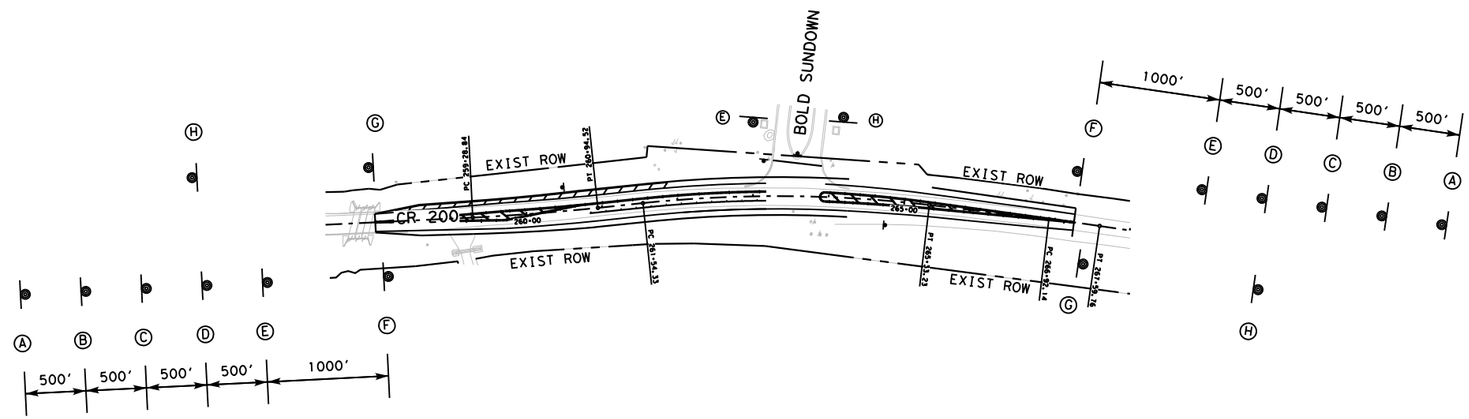




0 100 200
SCALE: 1"=200'

SEQUENCE OF WORK

1. PLACE APPROACH WARNING SIGNS AND BARRICADES.
2. PLACE SW3P MEASURES.
3. PHASE 1
   a. PLACE LEVEL-UP ON EXISTING ROADWAY TO CREATE 2% X-SLOPE (SEE NOTE 6).
4. PHASE 2
   a. CONSTRUCT WIDENING THRU HMAC (TY B) ON WEST SIDE.
5. PHASE 3
   a. SHIFT TRAFFIC TO WEST PER TCP LAYOUT.
   b. CONSTRUCT WIDENING THRU HMAC (TY B) ON EAST SIDE AND PAVEMENT REPAIR OF EXISTING ROADWAY.
6. PLACE SEAL COAT.
7. PLACE HMAC (TY D) ACROSS ENTIRE ROADWAY.
8. PLACE PERMANENT SIGNS AND MARKINGS.
9. FINAL CLEAN UP.

NOTES

1. ENTIRE ROADWAY SHALL BE RE-OPENED TO TRAFFIC DURING NON-WORK HOURS.
2. CONTRACTOR SHALL PROVIDE SAFETY SLOPE AT 3:1 OR FLATTER AGAINST EDGE DROP OFF USING SALVAGE BASE OR OTHER MATERIAL ACCEPTABLE TO THE ENGINEER.
3. DURING SCHOOL DAYS, LANE CLOSURES SHALL NOT BEGIN BEFORE 9AM AND SHALL BE RE-OPENED BY 3PM.
4. PROVIDE ACCESS TO SIDE STREETS AND DRIVEWAYS AT ALL TIMES.
5. SEE BC, TCP & WZ STANDARDS FOR TEMPORARY SIGNING AND PAVEMENT MARKING DETAILS.
6. PRIOR TO BEGINNING CONSTRUCTION, CONFIRM LIMITS & QUANTITY OF ACP LEVEL-UP TO CREATE 2% X-SLOPE ON EXISTING ROADWAY AND SUBMIT TO CONSTRUCTION OBSERVER FOR APPROVAL.

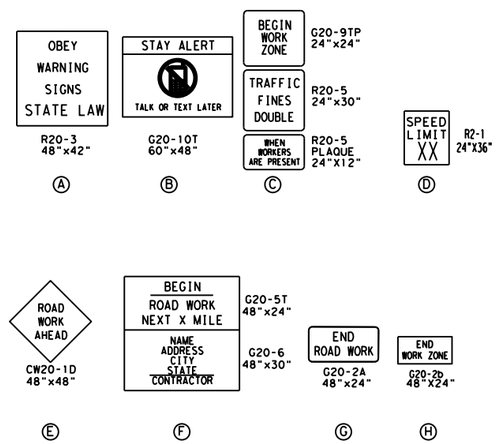



WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2


O'BRIEN LLC Engineering Services
TBPE FIRM # 14060

CR 200 AT BOLD SUNDOWN

ADVANCED WARNING SIGNS

SHEET 1 OF 1 | SHEET # 9

CR200 PDF - GS.pltcfg
3/15/2018 16:50 PM
12/21/2017
J:\JOBS\CR 200\Documents\WA-44\CR201-BS\SHEETS\TCP\CR200-WA4b-AWS+01.dgn

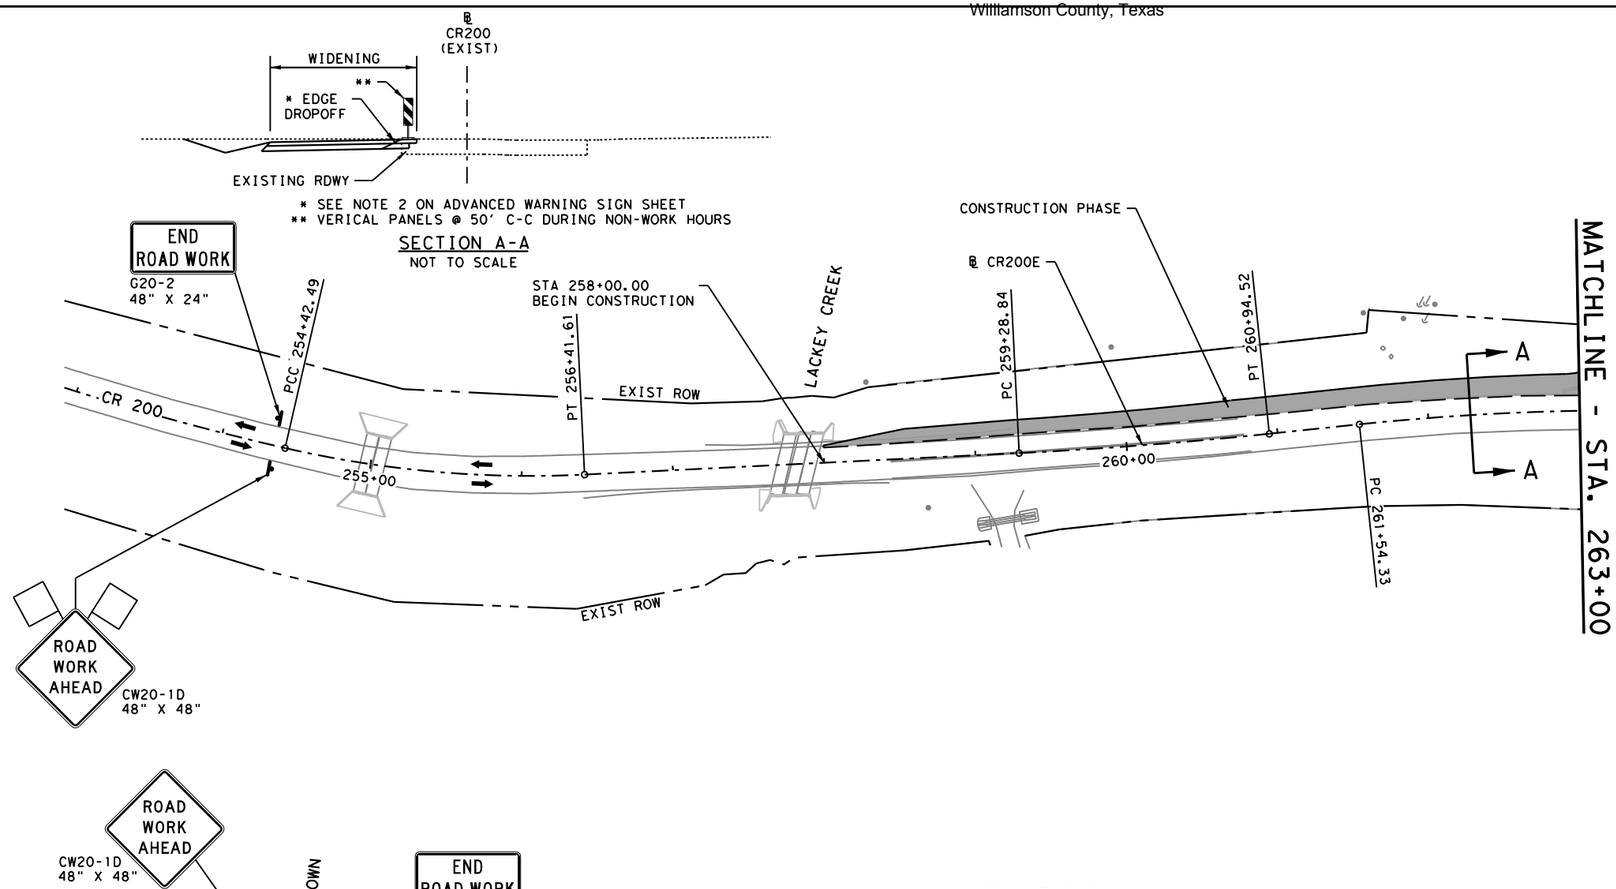

0 50 100
SCALE: 1"=100'

LANE CLOSURE SET UP SHALL BE PLACED TO MAXIMIZE SIGHT DISTANCE.

LEGEND

- DIRECTION OF TRAFFIC
- CONSTRUCTION PHASE

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED PROFESSIONAL ENGINEER
12/21/2017

NOTES:

1. SEE ADVANCED WARNING SIGN SHEET FOR SEQUENCE OF CONSTRUCTION AND NOTES.


WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2


O'BRIEN Engineering Services LLC
TBPE FIRM # 14060

CR 200 AT BOLD SUNDOWN TRAFFIC CONTROL PLAN PHASE 2

SHEET 1 OF 1 | SHEET # 10


CR200 PDF - GS.pltcfg
CR200
3/15/2018 16:51 PM
J.OBES\CR 200\Documents\WA-44CR201-BS\SHEETS\TCP\CR200-WA4b-TCP-P201.DGN

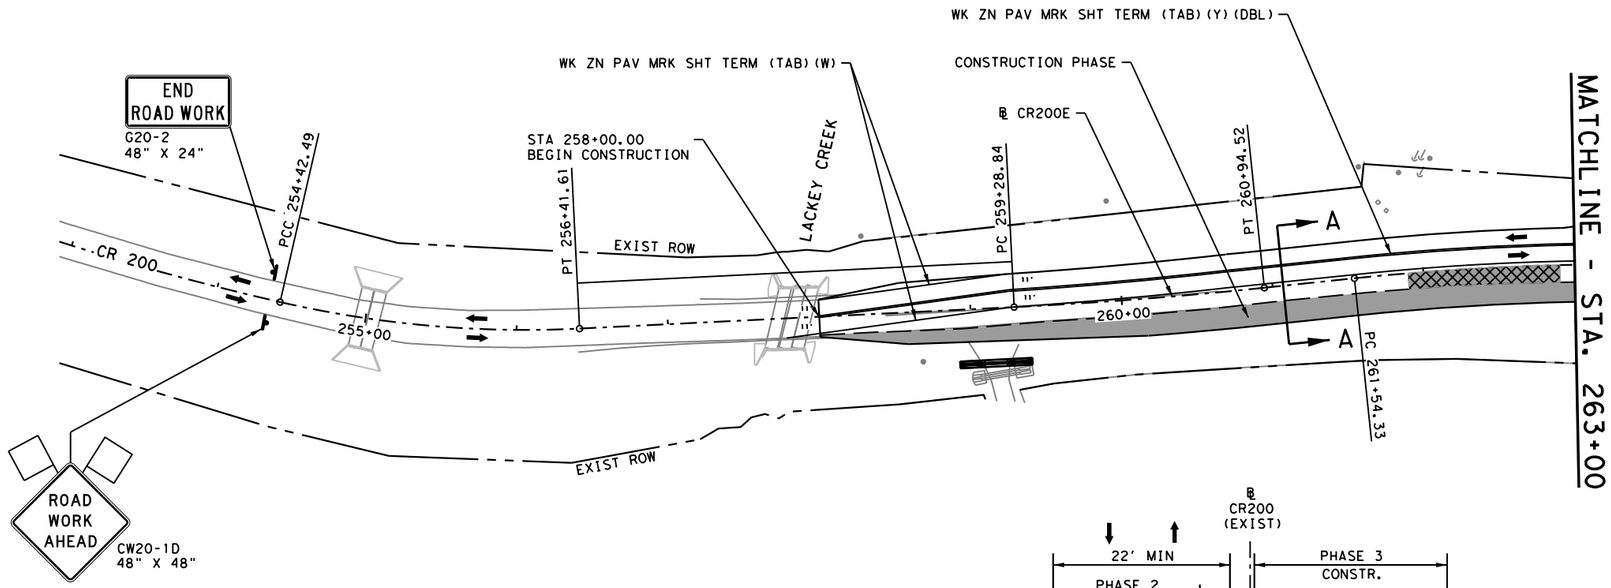


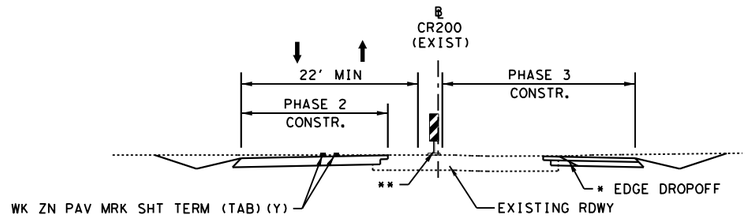

SECTION A-A
NOT TO SCALE

* SEE NOTE 2 ON ADVANCED WARNING SIGN SHEET
** VERICAL PANELS @ 50' C-C DURING NON-WORK HOURS

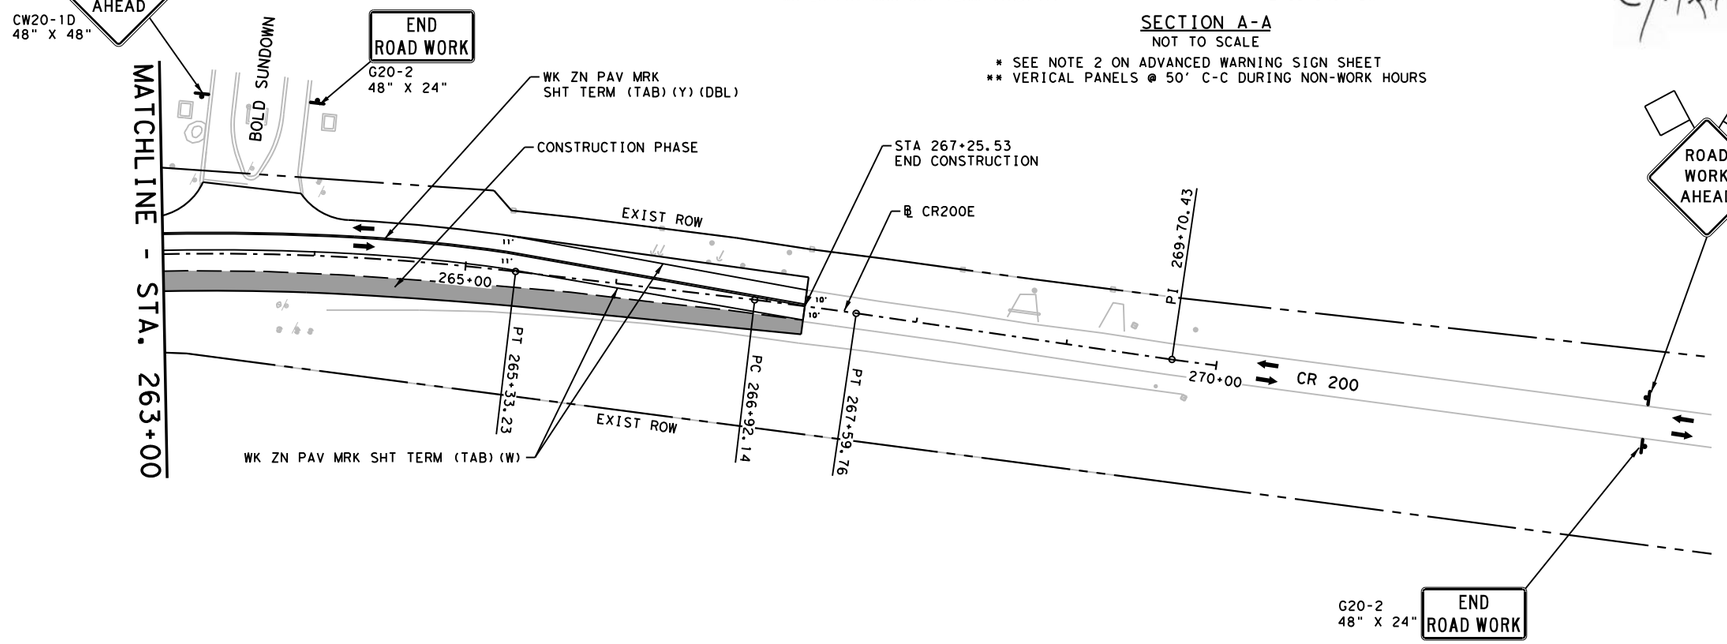



LANE CLOSURE SET UP SHALL BE PLACED TO MAXIMIZE SIGHT DISTANCE.

LEGEND

- DIRECTION OF TRAFFIC
- CONSTRUCTION PHASE
- PAVEMENT REPAIR SEE ROADWAY PLAN & PROFILE SHT FOR DETAILS.



NOTES:

1. SEE ADVANCED WARNING SIGN SHEET FOR SEQUENCE OF CONSTRUCTION AND NOTES.

WILLIAMSON COUNTY PRECINCT #2

TBPE FIRM # 14060

CR 200 AT BOLD SUNDOWN TRAFFIC CONTROL PLAN PHASE 3

SHEET 1 OF 1 | SHEET # 11

CR200 PDF - GS.pltcfg
12/21/2017 16:52 PM
jkobrien
J:\CR200 Documents\WA-4+CR201-BS\SHEETS\TCP\CR200-WA4b-TCP-P301.DGN

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:16:52 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn

BARRICADE AND CONSTRUCTION (BC) STANDARD SHEETS GENERAL NOTES:

1. The Barricade and Construction Standard Sheets (BC sheets) are intended to show typical examples for placement of temporary traffic control devices, construction pavement markings, and typical work zone signs. The information contained in these sheets meet or exceed the requirements shown in the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).

2. The development and design of the Traffic Control Plan (TCP)is the responsibility of the Engineer.

3. The Contractor may propose changes to the TCP that are signed and sealed by a licensed professional engineer for approval. The Engineer may develop, sign and seal Contractor proposed changes.

4. The Contractor is responsible for installing and maintaining the traffic control devices as shown in the plans. The Contractor may not move or change the approximate location of any device without the approval of the Engineer.

5. Geometric design of lane shifts and detours should, when possible, meet the applicable design criteria contained in manuals such as the American Association of State Highway and Transportation Officials (AASHTO), "A Policy on Geometric Design of Highways and Streets," the TxDOT "Roadway Design Manual" or engineering judgment.

6. When projects abut, the Engineer(s) may omit the END ROAD WORK, TRAFFIC FINES DOUBLE, and other advance warning signs if the signing would be redundant and the work areas appear continuous to the motorists. If the adjacent project is completed first, the Contractor shall erect the necessary warning signs as shown on these sheets, the TCP sheets or as directed by the Engineer. The BEGIN ROAD WORK NEXT X MILES sign shall be revised to show appropriate work zone distance.

7. The Engineer may require duplicate warning signs on the median side of divided highways where median width will permit and traffic volumes justify the signing.

8. All signs shall be constructed in accordance with the details found in the "Standard Highway Sign Designs for Texas," latest edition. Sign details not shown in this manual shall be shown in the plans or the Engineer shall provide a detail to the Contractor before the sign is manufactured.

9. The temporary traffic control devices shown in the illustrations of the BC sheets are examples. As necessary, the Engineer will determine the most appropriate traffic control devices to be used.

10. As shown on BC(2), the OBEY WARNING SIGNS STATE LAW sign, STAY ALERT TALK OR TEXT LATER (see Sign Detail G20-10T) and the WORK ZONE TRAFFIC FINES DOUBLE sign with plaque shall be erected in advance of the CSJ limits. However, the TRAFFIC FINES DOUBLE sign will not be required on projects consisting solely of mobile operation work, such as striping or milling edgeline rumble strips. The BEGIN ROAD WORK NEXT X MILES, CONTRACTOR and END ROAD WORK signs shall be erected at or near the CSJ limits.


11. Except for devices required by Note 10, traffic control devices should be in place only while work is actually in progress or a definite need exists.


12. The Engineer has the final decision on the location of all traffic control devices.

13. Inactive equipment and work vehicles, including workers' private vehicles must be parked away from travel lanes. They should be as close to the right-of-way line as possible, or located behind a barrier or guardrail, or as approved by the Engineer.

WORKER SAFETY APPAREL NOTES:

1. Workers on foot who are exposed to traffic or to construction equipment within the right-of-way shall wear high-visibility safety apparel meeting the requirements of ISEA "American National Standard for High-Visibility Apparel," or equivalent revisions, and labeled as ANSI 107-2004 standard performance for Class 2 or 3 risk exposure. Class 3 garments should be considered for high traffic volume work areas or night time work.

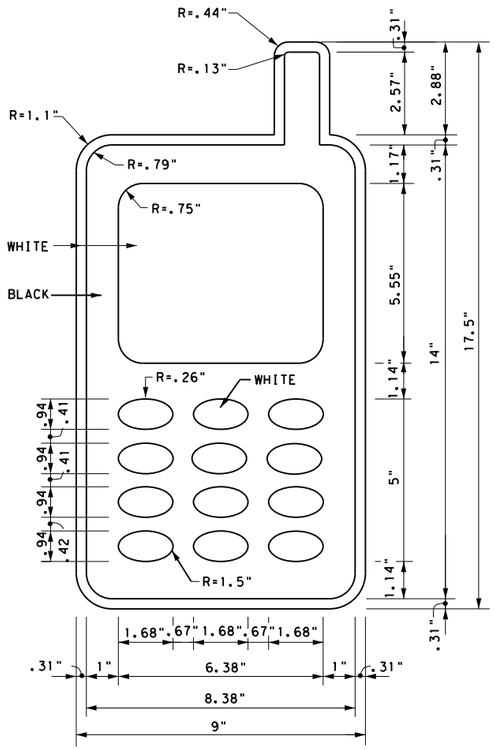

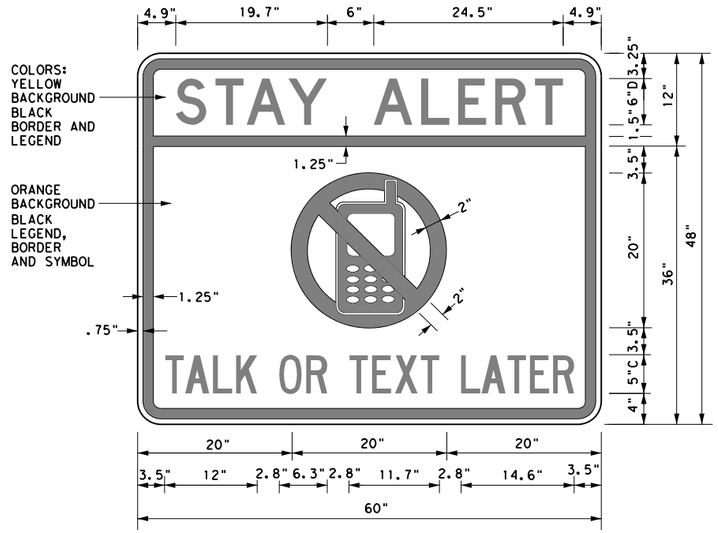

3.0" Radius, 1.25" Border, 0.75" Indent, Black on Yellow;
[STAY ALERT] Font: D
3.0" Radius, 1.25" Border, 0.75" Indent, Black on Orange;
[TALK OR TEXT LATER] Font: C specified length;

SIGN DETAIL (G20-10T)

Only pre-qualified products shall be used. The "Compliant Work Zone Traffic Control Devices List" (CWZTCD) describes pre-qualified products and their sources and may be found on-line at the web address given below or by contacting:

Texas Department of Transportation
Traffic Operations Division - TE
Phone (512) 416-3118

THE DOCUMENTS BELOW CAN BE FOUND ON-LINE AT http://www.txdot.gov
COMPLIANT WORK ZONE TRAFFIC CONTROL DEVICES LIST (CWZTCD)
DEPARTMENTAL MATERIAL SPECIFICATIONS (DMS)
MATERIAL PRODUCER LIST (MPL)
ROADWAY DESIGN MANUAL - SEE "MANUALS (ONLINE MANUALS)"
STANDARD HIGHWAY SIGN DESIGNS FOR TEXAS (SHSD)
TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (TMUTCD)
TRAFFIC ENGINEERING STANDARD SHEETS

Texas Department of Transportation — Traffic Operations Division Standard

BARRICADE AND CONSTRUCTION GENERAL NOTES AND REQUIREMENTS


BC(1)-14

FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS 4-03 5-10 8-14 9-07 7-13	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		12

95

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


TYPICAL LOCATION OF CROSSROAD SIGNS

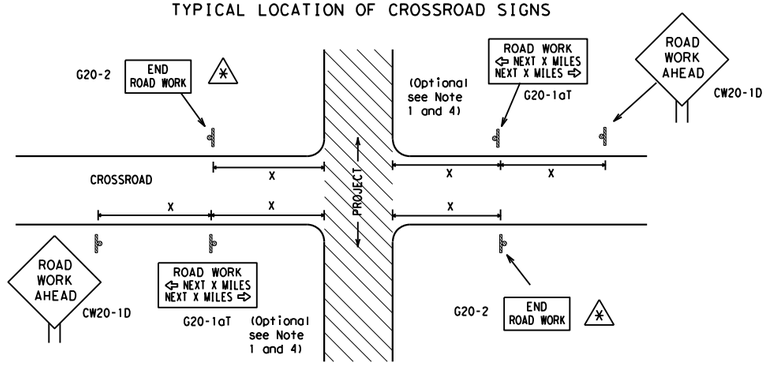

✱ May be mounted on back of "ROAD WORK AHEAD"(CW20-1D) sign with approval of Engineer. (See note 2 below)

1. The typical minimum signing on a crossroad approach should be a "ROAD WORK AHEAD" (CW20-1D)sign and a (G20-2) "END ROAD WORK" sign, unless noted otherwise in plans.
2. The Engineer may use the reduced size 36" x 36" ROAD WORK AHEAD (CW20-1D) sign mounted back to back with the reduced size 36" x 18" "END ROAD WORK"(G20-2) sign on low volume crossroads (see Note 4 under "Typical Construction Warning Sign Size and Spacing"). See the "Standard Highway Sign Designs for Texas" manual for sign details. The Engineer may omit the advance warning signs on low volume crossroads. The Engineer will determine whether a road is low volume. This information shall be shown in the plans.
3. Based on existing field conditions, the Engineer/Inspector may require additional signs such as FLAGGER AHEAD, LOOSE GRAVEL, or other appropriate signs. When additional signs are required, these signs will be considered part of the minimum requirements. The Engineer/Inspector will determine the proper location and spacing of any sign not shown on the BC sheets, Traffic Control Plan sheets or the Work Zone Standard Sheets.
4. The "ROAD WORK NEXT X MILES"(G20-1aT)sign shall be required at high volume crossroads to advise motorists of the length of construction in either direction from the intersection. The Engineer will determine whether a roadway is considered high volume.
5. Additional traffic control devices may be shown elsewhere in the plans for higher volume crossroads.
6. When work occurs in the intersection area, appropriate traffic control devices, as shown elsewhere in the plans or as determined by the Engineer/Inspector, shall be in place.

T-INTERSECTION

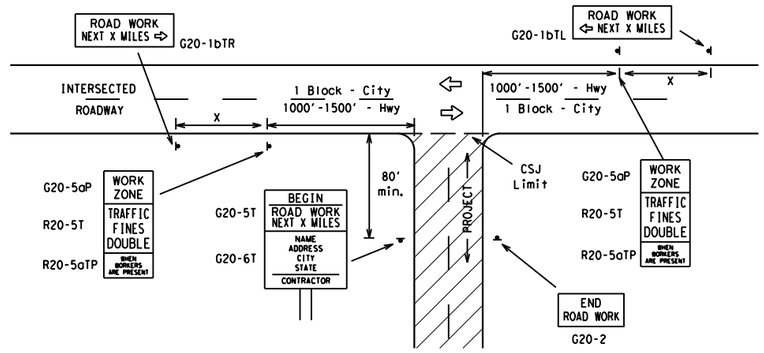

CSJ LIMITS AT T-INTERSECTION

1. The Engineer will determine the types and location of any additional traffic control devices, such as a flagger and accompanying signs, or other signs, that should be used when work is being performed at or near an intersection.
2. If construction closes the road at a T-intersection the Contractor shall place the "CONTRACTOR NAME"(G20-6T) sign behind the Type 3 Barricades for the road closure (see BC(10) also). The "ROAD WORK NEXT X MILES" left arrow(G20-1bTL) and "ROAD WORK NEXT X MILES" right arrow (G20-1bTR)" signs shall be replaced by the detour signing called for in the plans.

TYPICAL CONSTRUCTION WARNING SIGN SIZE AND SPACING[1,5,6]

SIZE

Sign Number or Series	Conventional Road	Expressway/ Freeway
CW20[4] CW21 CW22 CW23 CW25	48" x 48"	48" x 48"
CW1, CW2, CW7, CW8, CW9, CW11, CW14	36" x 36"	48" x 48"
CW3, CW4, CW5, CW6, CW8-3, CW10, CW12	48" x 48"	48" x 48"

SPACING

Posted Speed	Sign Δ Spacing "X"
MPH	Feet (Apprx.)
30	120
35	160
40	240
45	320
50	400
55	500[2]
60	600[2]
65	700[2]
70	800[2]
75	900[2]
80	1000[2]
✱	✱[3]


✱ For typical sign spacings on divided highways, expressways and freeways, see Part 6 of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) typical application diagrams or TCP Standard Sheets.

Δ Minimum distance from work area to first Advance Warning sign nearest the work area and/or distance between each additional sign.

GENERAL NOTES


1. Special or larger size signs may be used as necessary.
2. Distance between signs should be increased as required to have 1500 feet advance warning.
3. Distance between signs should be increased as required to have 1/2 mile or more advance warning.
4. 36" x 36" "ROAD WORK AHEAD" (CW20-1D)signs may be used on low volume crossroads at the discretion of the Engineer. See Note 2 under "Typical Location of Crossroad Signs".
5. Only diamond shaped warning sign sizes are indicated.
6. See sign size listing in "TMUTCD", Sign Appendix or the "Standard Highway Sign Designs for Texas" manual for complete list of available sign design sizes.

WORK AREAS IN MULTIPLE LOCATIONS WITHIN CSJ LIMITS

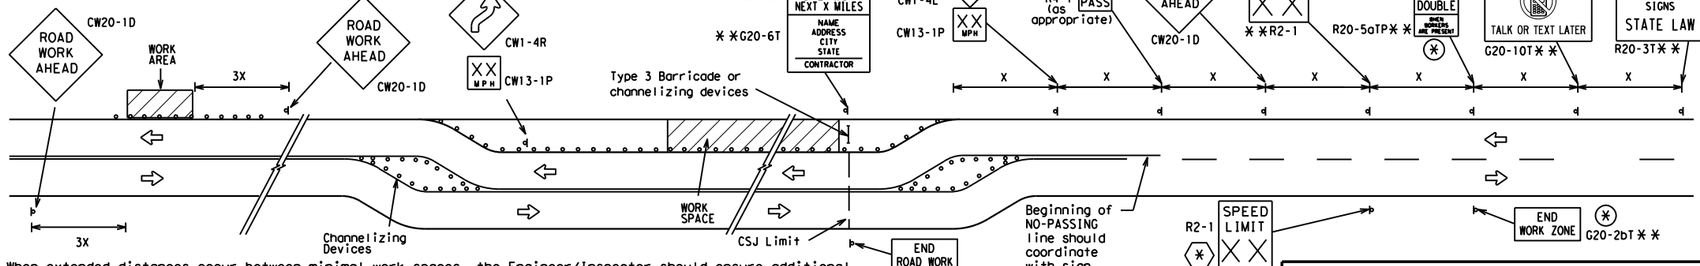


When extended distances occur between minimal work spaces, the Engineer/Inspector should ensure additional "ROAD WORK AHEAD"(CW20-1D)signs are placed in advance of these work areas to remind drivers they are still within the project limits. See the applicable TCP sheets for exact location and spacing of signs and channelizing devices.

SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING DOWNSTREAM OF THE CSJ LIMITS

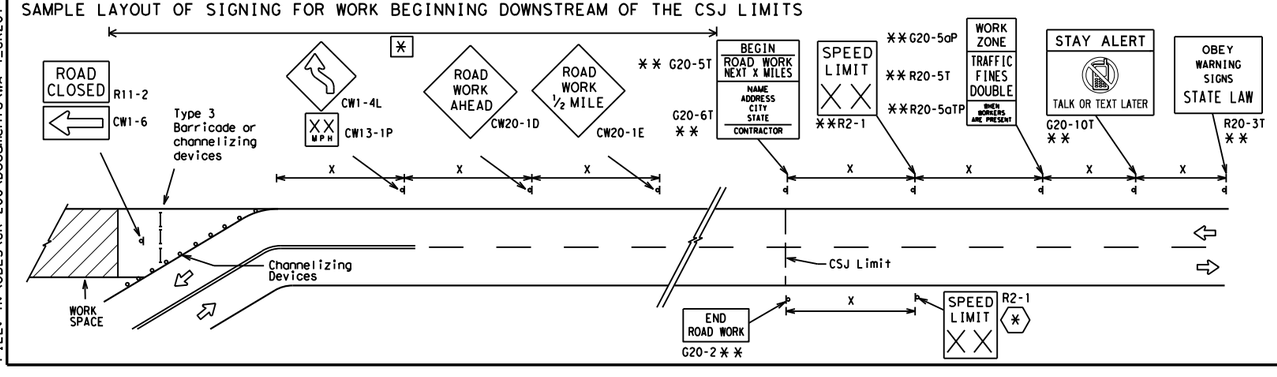

SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING AT THE CSJ LIMITS

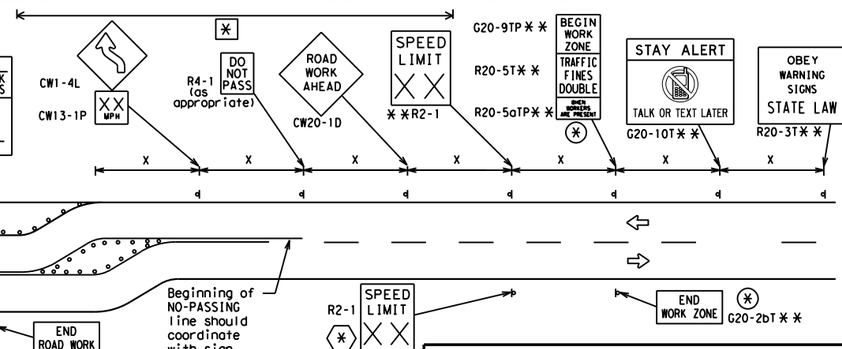

NOTES

The Contractor shall determine the appropriate distance to be placed on the G20-1 series signs and "BEGIN ROAD WORK NEXT X MILES"(G20-5T)sign for each specific project. This distance shall replace the "X" and shall be rounded to the nearest whole mile with the approval of the Engineer. No decimals shall be used.

✱ The "BEGIN WORK ZONE"(G20-9TP) and "END WORK ZONE" (G20-2bT) shall be used as shown on the sample layout when advance signs are required outside the CSJ Limits. They inform the motorist of entering or leaving a part of the work zone lying outside the CSJ Limits where traffic fines may double if workers are present.

✱✱ Required CSJ Limit signing. See Note 10 on BC(1). TRAFFIC FINES DOUBLE signs will not be required on projects consisting solely of mobile operations work.

✱ Area for placement of "ROAD WORK AHEAD" (CW20-1D)sign and other signs or devices as called for on the Traffic Control Plan.

✱ Contractor will install a regulatory speed limit sign at the end of the work zone.

LEGEND	
⟼⟻	Type 3 Barricade
○○○	Channelizing Devices
▬	Sign
X	See Typical Construction Warning Sign Size and Spacing chart or the TMUTCD for sign spacing requirements.

SHEET 2 OF 12

Texas Department of Transportation

Traffic Operations Division Standard

BARRICADE AND CONSTRUCTION PROJECT LIMIT

BC(2)-14

FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
9-07 8-14	DIST	COUNTY		SHEET NO.
7-13	AUS	WILLIAMSON		13

96

DATE: 12/21/2017 9:16:52 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 12/21/2017 9:16:53 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn

TYPICAL APPLICATION OF WORK ZONE SPEED LIMIT SIGNS

Work zone speed limits shall be regulatory, established in accordance with the "Procedures for Establishing Speed Zones," and approved by the Texas Transportation Commission, or by City Ordinance when within Incorporated City Limits.

Reduced speeds should only be posted in the vicinity of work activity and not throughout the entire project.

Regulatory work zone speed signs (R2-1) shall be removed or covered during periods when they are not needed.

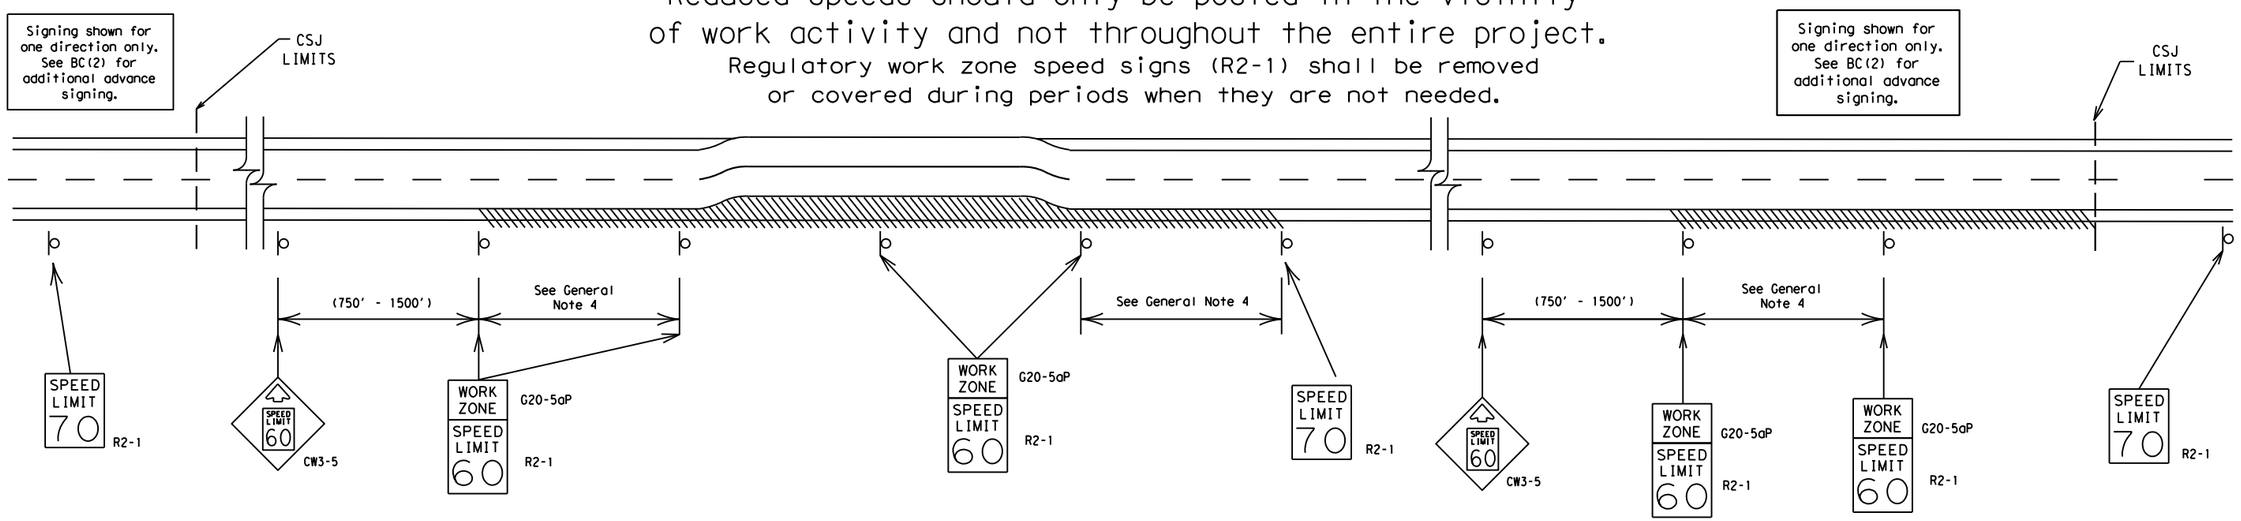

GUIDANCE FOR USE:

LONG/INTERMEDIATE TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit should be included on the design of the traffic control plans when restricted geometrics with a lower design speed are present in the work zone and modification of the geometrics to a higher design speed is not feasible.

Long/Intermediate Term Work Zone Speed Limit signs, when approved as described above, should be posted and visible to the motorist when work activity is present. Work activity may also be defined as a change in the roadway that requires a reduced speed for motorists to safely negotiate the work area, including:

a) rough road or damaged pavement surface
b) substantial alteration of roadway geometrics (diversions)
c) construction detours
d) grade
e) width
f) other conditions readily apparent to the driver

As long as any of these conditions exist, the work zone speed limit signs should remain in place.

SHORT TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit may be included on the design of the traffic control plans when workers or equipment are not behind concrete barrier, when work activity is within 10 feet of the traveled way or actually in the travelled way.

Short Term Work Zone Speed Limit signs should be posted and visible to the motorists only when work activity is present. When work activity is not present, signs shall be removed or covered.
(See Removing or Covering on BC(4)).

GENERAL NOTES

1. Regulatory work zone speed limits should be used only for sections of construction projects where speed control is of major importance.
2. Regulatory work zone speed limit signs shall be placed on supports at a 7 foot minimum mounting height.
3. Speed zone signs are illustrated for one direction of travel and are normally posted for each direction of travel.
4. Frequency of work zone speed limit signs should be:
   40 mph and greater 0.2 to 2 miles
   35 mph and less 0.2 to 1 mile
5. Regulatory speed limit signs shall have black legend and border on a white reflective background (See "Reflective Sheeting" on BC(4)).
6. Fabrication, erection and maintenance of the"ADVANCE SPEED LIMIT"(CW3-5)sign, "WORK ZONE"(G20-5aP) plaque and the "SPEED LIMIT"(R2-1)signs shall not be paid for directly, but shall be considered subsidiary to Item 502.
7. Turning signs from view, laying signs over or down will not be allowed, unless as otherwise noted under "REMOVING OR COVERING" on BC(4).
8. Techniques that may help reduce traffic speeds include but are not limited to:
   A. Law enforcement.
   B. Flagger stationed next to sign.
   C. Portable changeable message sign (PCMS).
   D. Low-power (drone) radar transmitter.
   E. Speed monitor trailers or signs.
9. Speeds shown on details above are for illustration only. Work Zone Speed Limits should only be posted as approved for each project.
10. For more specific guidance concerning the type of work, work zone conditions and factors impacting allowable regulatory construction speed zone reduction see TxDOT form #1204 in the TxDOT e-form system.

Texas Department of Transportation | Traffic Operations Division Standard

BARRICADE AND CONSTRUCTION WORK ZONE SPEED LIMIT

BC(3)-14


FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS 9-07 8-14 7-13	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		14

97

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:16:53 PM
FILE: H:\OBESCR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn


TYPICAL MINIMUM CLEARANCES FOR LONG TERM AND INTERMEDIATE TERM SIGNS

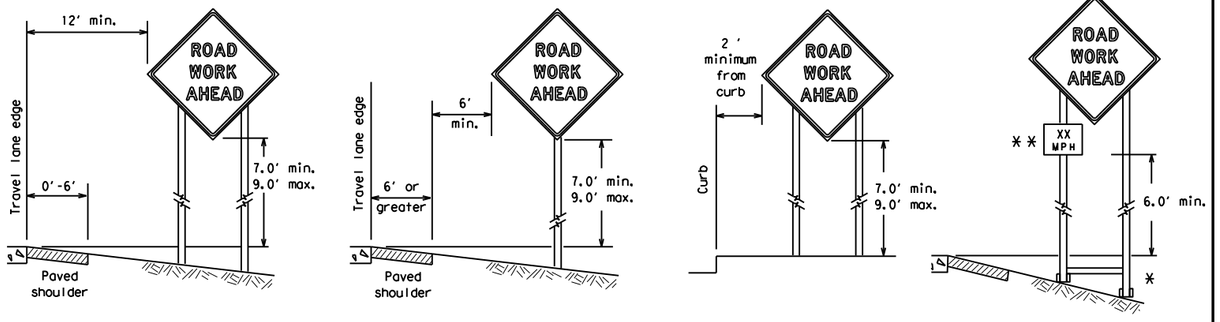


* When placing skid supports on unlevel ground, the leg post lengths must be adjusted so the sign appears straight and plumb. Objects shall NOT be placed under skids as a means of leveling.

** When plaques are placed on dual-leg supports, they should be attached to the upright nearest the travel lane. Supplemental plaques (advisory or distance) should not cover the surface of the parent sign.

ATTACHMENT FOR SIGN SUPPORTS

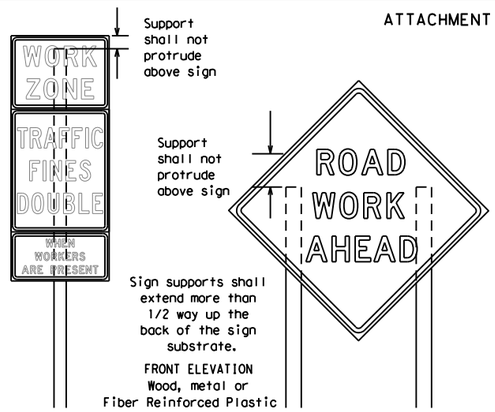

Splicing embedded perforated square metal tubing in order to extend post height will only be allowed when the splice is made using four bolts, two above and two below the spice point. Splice must be located entirely behind the sign substrate, not near the base of the support. Splice insert lengths should be at least 5 times nominal post size, centered on the splice and of at least the same gauge material.

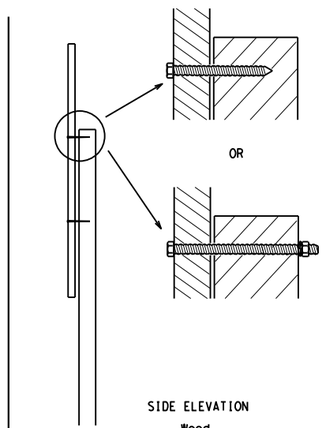


Attachment to wooden supports will be by bolts and nuts or screws. Use TxDOT's or manufacturer's recommended procedures for attaching sign substrates to other types of sign supports

Nails shall NOT be allowed. Each sign shall be attached directly to the sign support. Multiple signs shall not be joined or spliced by any means. Wood supports shall not be extended or repaired by splicing or other means.

STOP/SLOW PADDLES

1. STOP/SLOW paddles are the primary method to control traffic by flaggers. The STOP/SLOW paddle size should be 24" x 24" as detailed below.
2. When used at night, the STOP/SLOW paddle shall be retroreflectorized.
3. STOP/SLOW paddles may be attached to a staff with a minimum length of 6' to the bottom of the sign.
4. Any lights incorporated into the STOP or SLOW paddle faces shall only be as specifically described in Section 6E.03 Hand Signaling Devices in the TMUTCD.

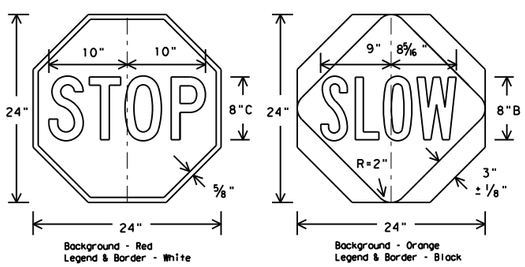

CONTRACTOR REQUIREMENTS FOR MAINTAINING PERMANENT SIGNS WITHIN THE PROJECT LIMITS

1. Permanent signs are used to give notice of traffic laws or regulations, call attention to conditions that are potentially hazardous to traffic operations, show route designations, destinations, directions, distances, services, points of interest, and other geographical, recreational, or cultural information. Drivers proceeding through a work zone need the same, if not better route guidance as normally installed on a roadway without construction.
2. When permanent regulatory or warning signs conflict with work zone conditions, remove or cover the permanent signs until the permanent sign message matches the roadway condition.
3. When existing permanent signs are moved and relocated due to construction purposes, they shall be visible to motorists at all times.
4. If existing signs are to be relocated on their original supports, they shall be installed on crashworthy bases as shown on the SMD Standard sheets. The signs shall meet the required mounting heights shown on the BC Sheets or the SMD Standards. This work should be paid for under the appropriate pay item for relocating existing signs.
5. If permanent signs are to be removed and relocated using temporary supports, the Contractor shall use crashworthy supports as shown on the BC sheets or the CWZTCD. The signs shall meet the required mounting heights shown on the BC Sheets or the SMD Standards during construction. This work should be paid for under the appropriate pay item for relocating existing signs.
6. Any sign or traffic control device that is struck or damaged by the Contractor or his/her construction equipment shall be replaced as soon as possible by the Contractor to ensure proper guidance for the motorists. This will be subsidiary to Item 502.

GENERAL NOTES FOR WORK ZONE SIGNS

1. Contractor shall install and maintain signs in a straight and plumb condition and/or as directed by the Engineer.
2. Wooden sign posts shall be painted white.
3. Barricades shall NOT be used as sign supports.
4. All signs shall be installed in accordance with the plans or as directed by the Engineer. Signs shall be used to regulate, warn, and guide the traveling public safely through the work zone.
5. The Contractor may furnish either the sign design shown in the plans or in the "Standard Highway Sign Designs for Texas" (SHSD). The Engineer/Inspector may require the Contractor to furnish other work zone signs that are shown in the TMUTCD but may have been omitted from the plans. Any variation in the plans shall be documented by written agreement between the Engineer and the Contractor's Responsible Person. All changes must be documented in writing before being implemented. This can include documenting the changes in the Inspector's TxDOT diary and having both the Inspector and Contractor initial and date the agreed upon changes.
6. The Contractor shall furnish sign supports listed in the "Compliant Work Zone Traffic Control Device List" (CWZTCD). The Contractor shall install the sign support in accordance with the manufacturer's recommendations. If there is a question regarding installation procedures, the Contractor shall furnish the Engineer a copy of the manufacturer's installation recommendations so the Engineer can verify the correct procedures are being followed.
7. The Contractor is responsible for installing signs on approved supports and replacing signs with damaged or cracked substrates and/or damaged or marred reflective sheeting as directed by the Engineer/Inspector.
8. Identification markings may be shown only on the back of the sign substrate. The maximum height of letters and/or company logos used for identification shall be 1 inch.
9. The Contractor shall replace damaged wood posts. New or damaged wood sign posts shall not be spliced.

DURATION OF WORK (as defined by the "Texas Manual on Uniform Traffic Control Devices" Part 6)

1. The types of sign supports, sign mounting height, the size of signs, and the type of sign substrates can vary based on the type of work being performed. The Engineer is responsible for selecting the appropriate size sign for the type of work being performed. The Contractor is responsible for ensuring the sign support, sign mounting height and substrate meets manufacturer's recommendations in regard to crashworthiness and duration of work requirements.
   a. Long-term stationary - work that occupies a location more than 3 days.
   b. Intermediate-term stationary - work that occupies a location more than one daylight period up to 3 days, or nighttime work lasting more than one hour.
   c. Short-term stationary - daytime work that occupies a location for more than 1 hour in a single daylight period.
   d. Short, duration - work that occupies a location up to 1 hour.
   e. Mobile - work that moves continuously or intermittently (stopping for up to approximately 15 minutes.)

SIGN MOUNTING HEIGHT

1. The bottom of Long-term/Intermediate-term signs shall be at least 7 feet, but not more than 9 feet, above the paved surface, except as shown for supplemental plaques mounted below other signs.
2. The bottom of Short-term/Short Duration signs shall be a minimum of 1 foot above the pavement surface but no more than 2 feet above the ground.
3. Long-term/Intermediate-term Signs may be used in lieu of Short-term/Short Duration signing.
4. Short-term/Short Duration signs shall be used only during daylight and shall be removed at the end of the workday or raised to appropriate Long-term/Intermediate sign height.
5. Regulatory signs shall be mounted at least 7 feet, but not more than 9 feet, above the paved surface regardless of work duration.

SIZE OF SIGNS

1. The Contractor shall furnish the sign sizes shown on BC (2) unless otherwise shown in the plans or as directed by the Engineer.

SIGN SUBSTRATES

1. The Contractor shall ensure the sign substrate is installed in accordance with the manufacturer's recommendations for the type of sign support that is being used. The CWZTCD lists each substrate that can be used on the different types and models of sign supports.
2. "Mesh" type materials are NOT an approved sign substrate, regardless of the tightness of the weave.
3. All wooden individual sign panels fabricated from 2 or more pieces shall have one or more plywood cleat, 1/2" thick by 6" wide, fastened to the back of the sign and extending fully across the sign. The cleat shall be attached to the back of the sign using wood screws that do not penetrate the face of the sign panel. The screws shall be placed on both sides of the splice and spaced at 6" centers. The Engineer may approve other methods of splicing the sign face.

REFLECTIVE SHEETING

1. All signs shall be retroreflective and constructed of sheeting meeting the color and retro-reflectivity requirements of DMS-8300 for rigid signs or DMS-8310 for roll-up signs. The web address for DMS specifications is shown on BC(1).
2. White sheeting, meeting the requirements of DMS-8300 Type A, shall be used for signs with a white background.
3. Orange sheeting, meeting the requirements of DMS-8300 Type B_{FL} or Type C_{FL}, shall be used for rigid signs with orange backgrounds.

SIGN LETTERS

1. All sign letters and numbers shall be clear, and open rounded type uppercase alphabet letters as approved by the Federal Highway Administration (FHWA) and as published in the "Standard Highway Sign Design for Texas" manual. Signs, letters and numbers shall be of first class workmanship in accordance with Department Standards and Specifications.

REMOVING OR COVERING

1. When sign messages may be confusing or do not apply, the signs shall be removed or completely covered.
2. Long-term stationary or intermediate stationary signs installed on square metal tubing may be turned away from traffic 90 degrees when the sign message is not applicable. This technique may not be used for signs installed in the median of divided highways or near any intersections where the sign may be seen from approaching traffic.
3. Signs installed on wooden skids shall not be turned at 90 degree angles to the roadway. These signs should be removed or completely covered when not required.
4. When signs are covered, the material used shall be opaque, such as heavy mil black plastic, or other materials which will cover the entire sign face and maintain their opaque properties under automobile headlights at night, without damaging the sign sheeting.
5. Burlap shall NOT be used to cover signs.
6. Duct tape or other adhesive material shall NOT be affixed to a sign face.
7. Signs and anchor stubs shall be removed and holes backfilled upon completion of work.

SIGN SUPPORT WEIGHTS

1. Where sign supports require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand should be used.
2. The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight.
3. Rock, concrete, iron, steel or other solid objects shall not be permitted for use as sign support weights.
4. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs.
5. Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall NOT be used.
6. Rubber ballasts designed for channelizing devices should not be used for ballast on portable sign supports. Sign supports designed and manufactured with rubber bases may be used when shown on the CWZTCD list.
7. Sandbags shall only be placed along or laid over the base supports of the traffic control device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners. Sandbags shall be placed along the length of the skids to weigh down the sign support.
8. Sandbags shall NOT be placed under the skid and shall not be used to level sign supports placed on slopes.

FLAGS ON SIGNS

1. Flags may be used to draw attention to warning signs. When used the flag shall be 16 inches square or larger and shall be orange or fluorescent red-orange in color. Flags shall not be allowed to cover any portion of the sign face.

Texas Department of Transportation — Traffic Operations Division Standard

BARRICADE AND CONSTRUCTION TEMPORARY SIGN NOTES


BC(4)-14


FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
9-07 8-14	DIST	COUNTY		SHEET NO.
7-13	AUS	WILLIAMSON		15

98

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 12/21/2017 9:16:54 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn

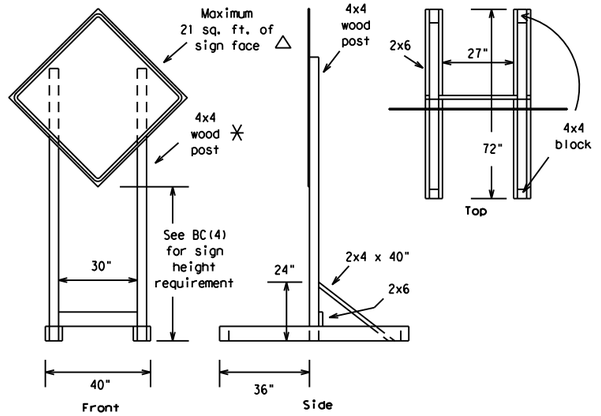

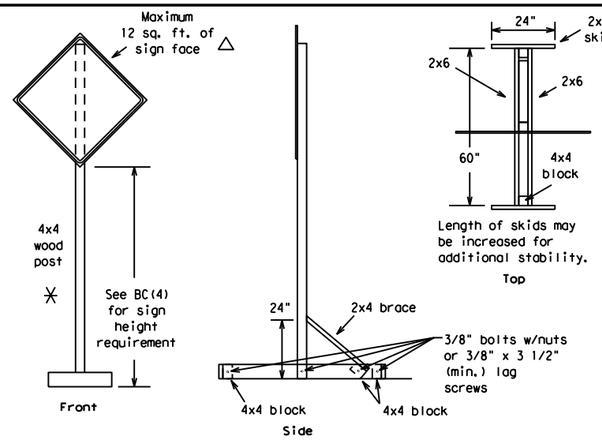


SKID MOUNTED WOOD SIGN SUPPORTS


LONG/INTERMEDIATE TERM STATIONARY - PORTABLE SKID MOUNTED SIGN SUPPORTS □

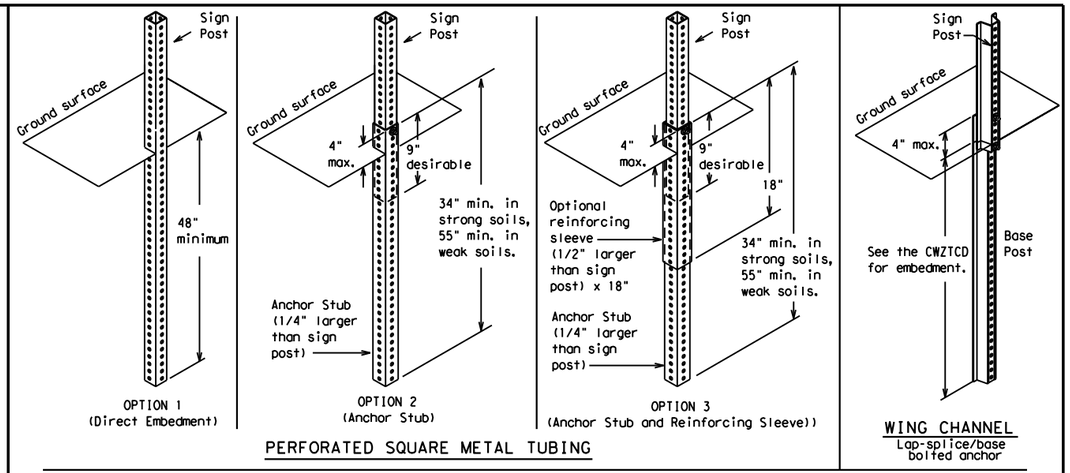


GROUND MOUNTED SIGN SUPPORTS

Refer to the CWZTCD and the manufacturer's installation procedure for each type sign support.
The maximum sign square footage shall adhere to the manufacturer's recommendation.
Two post installations can be used for larger signs.

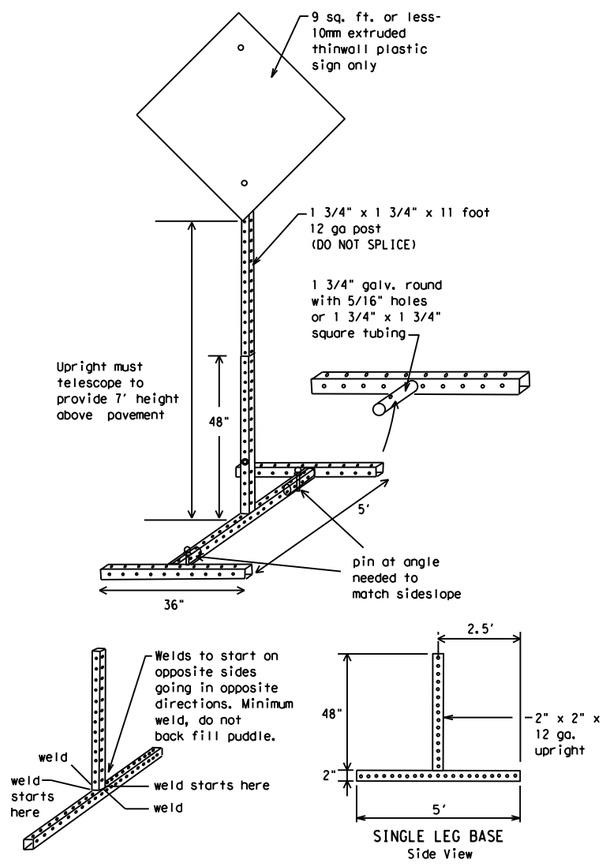


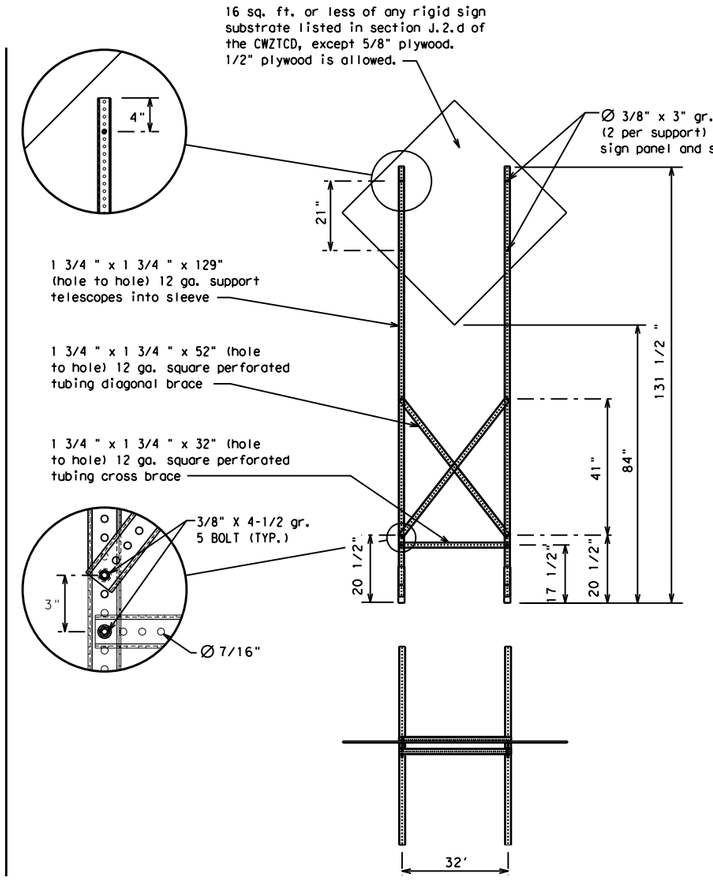

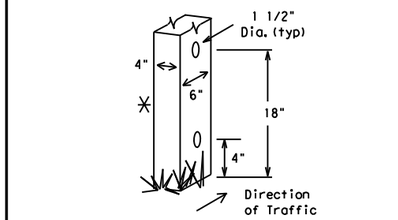

Nominal Post Size	Number of Posts	Maximum Sq. feet of Sign Face	Minimum Soil Embedment	Drilled Hole(s) Required
4 x 4	1	12	36"	NO
4 x 4	2	21	36"	NO
4 x 6	1	21	36"	YES
4 x 6	2	36	36"	YES

WOOD POST SYSTEM FOR GROUND MOUNTED SIGN SUPPORTS

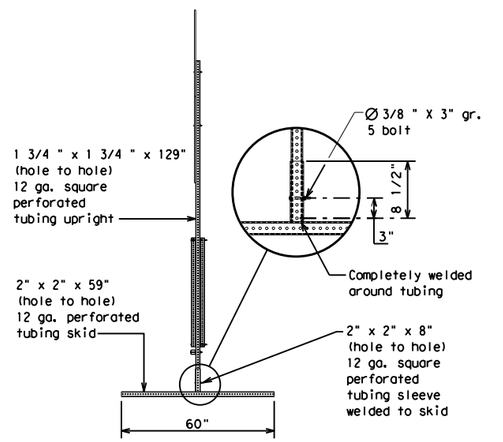

WEDGE ANCHORS

Both steel and plastic Wedge Anchor Systems as shown on the SMD Standard Sheets may be used as temporary sign supports for signs up to 10 square feet of sign face. They may be set in concrete or in sturdy soils if approved by the Engineer. (See web address for "Traffic Engineering Standard Sheets" on BC(1)).

OTHER DESIGNS

MORE DETAILS OF APPROVED LONG/INTERMEDIATE AND SHORT TERM SUPPORTS CAN BE FOUND ON THE CWZTCD LIST. SEE BC(1) FOR WEBSITE LOCATION.

GENERAL NOTES

1. Nails may be used in the assembly of wooden sign supports, but 3/8" bolts with nuts or 3/8" x 3 1/2" lag screws must be used on every joint for final connection.
2. No more than 2 sign posts shall be placed within a 7 ft. circle, except for specific materials noted on the CWZTCD List.
3. When project is completed, all sign supports and foundations shall be removed from the project site. This will be considered subsidiary to Item 502.

□ See BC(4) for definition of "Work Duration."

✳ Wood sign posts MUST be one piece. Splicing will NOT be allowed. Posts shall be painted white.

△ See the CWZTCD for the type of sign substrate that can be used for each approved sign support.

SHEET 5 OF 12

Texas Department of Transportation — Traffic Operations Division Standard

BARRICADE AND CONSTRUCTION TYPICAL SIGN SUPPORT

BC(5)-14

FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
9-07 8-14	DIST	COUNTY		SHEET NO.
7-13	AUS	WILLIAMSON		16

99

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:16:54 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn

WHEN NOT IN USE, REMOVE THE PCMS FROM THE RIGHT-OF-WAY OR PLACE THE PCMS BEHIND BARRIER OR GUARDRAIL WITH SIGN PANEL TURNED PARALLEL TO TRAFFIC

PORTABLE CHANGEABLE MESSAGE SIGNS

1. The Engineer/Inspector shall approve all messages used on portable changeable message signs (PCMS).
2. Messages on PCMS should contain no more than 8 words (about four to eight characters per word), not including simple words such as "TO," "FOR," "AT," etc.
3. Messages should consist of a single phase, or two phases that alternate. Three-phase messages are not allowed. Each phase of the message should convey a single thought, and must be understood by itself.
4. Use the word "EXIT" to refer to an exit ramp on a freeway; i.e., "EXIT CLOSED." Do not use the term "RAMP."
5. Always use the route or interstate designation (IH, US, SH, FM) along with the number when referring to a roadway.
6. When in use the bottom of a stationary PCMS message panel should be a minimum 7 feet above the roadway, where possible.
7. The message term "WEEKEND" should be used only if the work is to start on Saturday morning and end by Sunday evening at midnight. Actual days and hours of work should be displayed on the PCMS if work is to begin on Friday evening and/or continue into Monday morning.
8. The Engineer/Inspector may select one of two options which are available for displaying a two-phase message on a PCMS. Each phase may be displayed for either four seconds each or for three seconds each.
9. Do not "flash" messages or words included in a message. The message should be steady burn or continuous while displayed.
10. Do not present redundant information on a two-phase message; i.e., keeping two lines of the message the same and changing the third line.
11. Do not use the word "Danger" in message.
12. Do not display the message "LANES SHIFT LEFT" or "LANES SHIFT RIGHT" on a PCMS. Drivers do not understand the message.
13. Do not display messages that scroll horizontally or vertically across the face of the sign.
14. The following table lists abbreviated words and two-word phrases that are acceptable for use on a PCMS. Both words in a phrase must be displayed together. Words or phrases not on this list should not be abbreviated, unless shown in the TMUTCD.
15. PCMS character height should be at least 18 inches for trailer mounted units. They should be visible from at least 1/2 (.5) mile and the text should be legible from at least 600 feet at night and 800 feet in daylight. Truck mounted units must have a character height of 10 inches and must be legible from at least 400 feet.
16. Each line of text should be centered on the message board rather than left or right justified.
17. If disabled, the PCMS should default to an illegible display that will not alarm motorists and will only be used to alert workers that the PCMS has malfunctioned. A pattern such as a series of horizontal solid bars is appropriate.

WORD OR PHRASE	ABBREVIATION
Access Road	ACCS RD
Alternate	ALT
Avenue	AVE
Best Route	BEST RTE
Boulevard	BLVD
Bridge	BRDG
Cannot	CANT
Center	CTR
Construction Ahead	CONST AHD
CROSSING	XING
Detour Route	DETOUR RTE
Do Not	DONT
East	E
Eastbound	(route) E
Emergency	EMER
Emergency Vehicle	EMER VEH
Entrance, Enter	ENT
Express Lane	EXP LN
Expressway	EXPWY
XXXX Feet	XXXX FT
Fog Ahead	FOG AHD
Freeway	FRWY, FWY
Freeway Blocked	FWY BLKD
Friday	FRI
Hazardous Driving	HAZ DRIVING
Hazardous Material	HAZMAT
High-Occupancy	HOV
Vehicle Highway	HWY
Hour(s)	HR, HRS
Information	INFO
It Is	ITS
Junction	JCT
Left	LFT
Left Lane	LFT LN
Lane Closed	LN CLOSED
Lower Level	LWR LEVEL
Maintenance	MAINT

WORD OR PHRASE	ABBREVIATION
Major	MAJ
Miles	MI
Miles Per Hour	MPH
Minor	MNR
Monday	MON
Normal	NORM
North	N
Northbound	(route) N
Parking	PKING
Road	RD
Right Lane	RT LN
Saturday	SAT
Service Road	SERV RD
Shoulder	SHLDR
Slippery	SLIP
South	S
Southbound	(route) S
Speed	SPD
Street	ST
Sunday	SUN
Telephone	PHONE
Temporary	TEMP
Thursday	THURS
To Downtown	TO DWNTN
Traffic	TRAF
Travelers	TRVLRS
Tuesday	TUES
Time Minutes	TIME MIN
Upper Level	UPR LEVEL
Vehicles (s)	VEH, VEHS
Warning	WARN
Wednesday	WED
Weight Limit	WT LIMIT
West	W
Westbound	(route) W
Wet Pavement	WET PVMT
Will Not	WONT

Roadway designation # IH-number, US-number, SH-number, FM-number

RECOMMENDED PHASES AND FORMATS FOR PCMS MESSAGES DURING ROADWORK ACTIVITIES

(The Engineer may approve other messages not specifically covered here.)

Phase 1: Condition Lists

Road/Lane/Ramp Closure List

- FREEWAY CLOSED X MILE
- FRONTAGE ROAD CLOSED
- ROAD CLOSED AT SH XXX
- SHOULDER CLOSED XXX FT
- ROAD CLSD AT FM XXXX
- RIGHT LN CLOSED XXX FT
- RIGHT X LANES CLOSED
- RIGHT X LANES OPEN
- CENTER LANE CLOSED
- DAYTIME LANE CLOSURES
- NIGHT LANE CLOSURES
- I-XX SOUTH EXIT CLOSED
- VARIOUS LANES CLOSED
- EXIT XXX CLOSED X MILE
- EXIT CLOSED
- RIGHT LN TO BE CLOSED
- MALL DRIVEWAY CLOSED
- X LANES CLOSED TUE - FRI
- XXXXXXXX BLVD CLOSED

Other Condition List

- ROADWORK XXX FT
- ROAD REPAIRS XXXX FT
- FLAGGER XXXX FT
- LANE NARROWS XXXX FT
- RIGHT LN NARROWS XXXX FT
- TWO-WAY TRAFFIC XX MILE
- MERGING TRAFFIC XXXX FT
- CONST TRAFFIC XXX FT
- LOOSE GRAVEL XXXX FT
- UNEVEN LANES XXXX FT
- DETOUR X MILE
- ROUGH ROAD XXXX FT
- ROADWORK PAST SH XXXX
- ROADWORK NEXT FRI-SUN
- BUMP XXXX FT
- US XXX EXIT X MILES
- TRAFFIC SIGNAL XXXX FT
- LANES SHIFT *

* LANES SHIFT in Phase 1 must be used with STAY IN LANE in Phase 2.

Phase 2: Possible Component Lists

Action to Take/Effect on Travel List

- MERGE RIGHT
- FORM X LINES RIGHT
- DETOUR NEXT X EXITS
- USE XXXXX RD EXIT
- USE EXIT XXX
- USE EXIT I-XX NORTH
- STAY ON US XXX SOUTH
- USE I-XX E TO I-XX N
- TRUCKS USE US XXX N
- WATCH FOR TRUCKS
- WATCH FOR TRUCKS
- EXPECT DELAYS
- EXPECT DELAYS
- PREPARE TO STOP
- REDUCE SPEED XXX FT
- END SHOULDER USE
- USE OTHER ROUTES
- WATCH FOR WORKERS
- STAY IN LANE *

Location List

- AT FM XXXX
- BEFORE RAILROAD CROSSING
- NEXT X MILES
- PAST US XXX EXIT
- XXXXXXX TO XXXXXXX
- US XXX TO FM XXXX

Warning List

- SPEED LIMIT XX MPH
- MAXIMUM SPEED XX MPH
- MINIMUM SPEED XX MPH
- ADVISORY SPEED XX MPH
- RIGHT LANE EXIT
- USE CAUTION
- DRIVE SAFELY
- DRIVE WITH CARE

** Advance Notice List

- TUE-FRI XX AM- X PM
- APR XX-XX X PM-X AM
- BEGINS MONDAY
- BEGINS MAY XX
- MAY X-X XX PM - XX AM
- NEXT FRI-SUN
- XX AM TO XX PM
- NEXT TUE AUG XX
- TONIGHT XX PM- XX AM

* LANES SHIFT in Phase 1 must be used with STAY IN LANE in Phase 2.

** See Application Guidelines Note 6.

APPLICATION GUIDELINES

1. Only 1 or 2 phases are to be used on a PCMS.
2. The 1st phase (or both) should be selected from the "Road/Lane/Ramp Closure List" and the "Other Condition List".
3. A 2nd phase can be selected from the "Action to Take/Effect on Travel, Location, General Warning, or Advance Notice Phase Lists".
4. A Location Phase is necessary only if a distance or location is not included in the first phase selected.
5. If two PCMS are used in sequence, they must be separated by a minimum of 1000 ft. Each PCMS shall be limited to two phases, and should be understandable by themselves.
6. For advance notice, when the current date is within seven days of the actual work date, calendar days should be replaced with days of the week. Advance notification should typically be for no more than one week prior to the work.

WORDING ALTERNATIVES

1. The words RIGHT, LEFT and ALL can be interchanged as appropriate.
2. Roadway designations IH, US, SH, FM and LP can be interchanged as appropriate.
3. EAST, WEST, NORTH and SOUTH (or abbreviations E, W, N and S) can be interchanged as appropriate.
4. Highway names and numbers replaced as appropriate.
5. ROAD, HIGHWAY and FREEWAY can be interchanged as needed.
6. AHEAD may be used instead of distances if necessary.
7. FT and MI, MILE and MILES interchanged as appropriate.
8. AT, BEFORE and PAST interchanged as needed.
9. Distances or AHEAD can be eliminated from the message if a location phase is used.

PCMS SIGNS WITHIN THE R.O.W. SHALL BE BEHIND GUARDRAIL OR CONCRETE BARRIER OR SHALL HAVE A MINIMUM OF FOUR (4) PLASTIC DRUMS PLACED PERPENDICULAR TO TRAFFIC ON THE UPSTREAM SIDE OF THE PCMS, WHEN EXPOSED TO ONE DIRECTION OF TRAFFIC. WHEN EXPOSED TO TWO WAY TRAFFIC, THE FOUR DRUMS SHOULD BE PLACED WITH ONE DRUM AT EACH OF THE FOUR CORNERS OF THE UNIT.

FULL MATRIX PCMS SIGNS

1. When Full Matrix PCMS signs are used, the character height and legibility/visibility requirements shall be maintained as listed in Note 15 under "PORTABLE CHANGEABLE MESSAGE SIGNS" above.
2. When symbol signs, such as the "Flagger Symbol"(CW20-7) are represented graphically on the Full Matrix PCMS sign and, with the approval of the Engineer, it shall maintain the legibility/visibility requirement listed above.
3. When symbol signs are represented graphically on the Full Matrix PCMS, they shall only supplement the use of the static sign represented, and shall not substitute for, or replace that sign.
4. A full matrix PCMS may be used to simulate a flashing arrow board provided it meets the visibility, flash rate and dimming requirements on BC(7), for the same size arrow.

Texas Department of Transportation — Traffic Operations Division Standard

BARRICADE AND CONSTRUCTION PORTABLE CHANGEABLE MESSAGE SIGN (PCMS)


BC(6)-14

FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
9-07 8-14	DIST	COUNTY		SHEET NO.
7-13	AUS	WILLIAMSON		17

100


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

1. Barrier Reflectors shall be pre-qualified, and conform to the color and reflectivity requirements of DMS-8600. A list of prequalified Barrier Reflectors can be found at the Material Producer List web address shown on BC(1).
2. Color of Barrier Reflectors shall be as specified in the TMUTCD. The cost of the reflectors shall be considered subsidiary to Item 512.

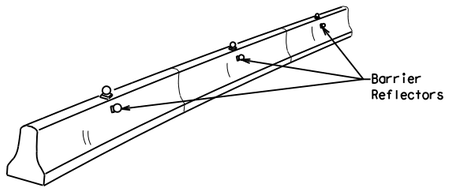


CONCRETE TRAFFIC BARRIER (CTB)

3. Where traffic is on one side of the CTB, two (2) Barrier Reflectors shall be mounted in approximately the midsection of each section of CTB. An alternate mounting location is uniformly spaced at one end of each CTB. This will allow for attachment of a barrier grapple without damaging the reflector. The Barrier Reflector mounted on the side of the CTB shall be located directly below the reflector mounted on top of the barrier, as shown in the detail above.
4. Where CTB separates two-way traffic, three barrier reflectors shall be mounted on each section of CTB. The reflector unit on top shall have two yellow reflective faces (Bi-Directional)while the reflectors on each side of the barrier shall have one yellow reflective face, as shown in the detail above.
5. When CTB separates traffic traveling in the same direction, no barrier reflectors will be required on top of the CTB.
6. Barrier Reflector units shall be yellow or white in color to match the edgeline being supplemented.
7. Maximum spacing of Barrier Reflectors is forty (40) feet.
8. Pavement markers or temporary flexible-reflective roadway marker tabs shall NOT be used as CTB delineation.
9. Attachment of Barrier Reflectors to CTB shall be per manufacturer's recommendations.
10. Missing or damaged Barrier Reflectors shall be replaced as directed by the Engineer.
11. Single slope barriers shall be delineated as shown on the above detail.

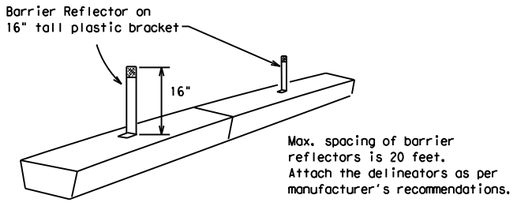

LOW PROFILE CONCRETE BARRIER (LPCB)

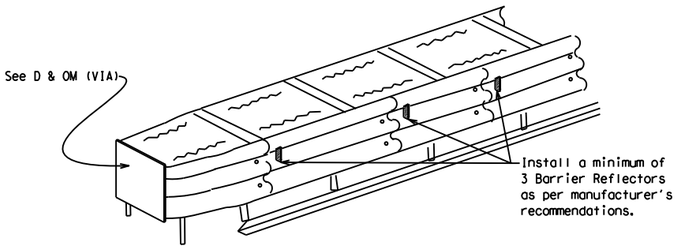


DELINEATION OF END TREATMENTS


END TREATMENTS FOR
CTB'S USED
IN WORK ZONES

End treatments used on CTB's in work zones shall meet crashworthy standards as defined in the National Cooperative Highway Research Report 350. Refer to the CWZTCD List for approved end treatments and manufacturers.

BARRIER REFLECTORS FOR CONCRETE TRAFFIC BARRIER AND ATTENUATORS



Type C Warning Light or approved substitute mounted on a drum adjacent to the travel way.



Warning reflector may be round or square. Must have a yellow reflective surface area of at least 30 square inches

WARNING LIGHTS

1. Warning lights shall meet the requirements of the TMUTCD.
2. Warning lights shall NOT be installed on barricades.
3. Type A-Low Intensity Flashing Warning Lights are commonly used with drums. They are intended to warn of or mark a potentially hazardous area. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "FL". The Type A Warning Lights shall not be used with signs manufactured with Type B_{FL} or C_{FL} Sheeting meeting the requirements of Departmental Material Specification DMS-8300.
4. Type-C and Type D 360 degree Steady Burn Lights are intended to be used in a series for delineation to supplement other traffic control devices. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "SB".
5. The Engineer/Inspector or the plans shall specify the location and type of warning lights to be installed on the traffic control devices.
6. When required by the Engineer, the Contractor shall furnish a copy of the warning lights certification. The warning light manufacturer will certify the warning lights meet the requirements of the latest ITE Purchase Specifications for Flashing and Steady-Burn Warning Lights.
7. When used to delineate curves, Type-C and Type D Steady Burn Lights should only be placed on the outside of the curve, not the inside.
8. The location of warning lights and warning reflectors on drums shall be as shown elsewhere in the plans.

WARNING LIGHTS MOUNTED ON PLASTIC DRUMS


1. Type A flashing warning lights are intended to warn drivers that they are approaching or are in a potentially hazardous area.
2. Type A random flashing warning lights are not intended for delineation and shall not be used in a series.
3. A series of sequential flashing warning lights placed on channelizing devices to form a merging taper may be used for delineation. If used, the successive flashing of the sequential warning lights should occur from the beginning of the taper to the end of the merging taper in order to identify the desired vehicle path. The rate of flashing for each light shall be 65 flashes per minute, plus or minus 10 flashes.
4. Type C and D steady-burn warning lights are intended to be used in a series to delineate the edge of the travel lane on detours, on lane changes, on lane closures, and on other similar conditions.
5. Type A, Type C and Type D warning lights shall be installed at locations as detailed on other sheets in the plans.
6. Warning lights shall not be installed on a drum that has a sign, chevron or vertical panel.
7. The maximum spacing for warning lights on drums should be identical to the channelizing device spacing.

WARNING REFLECTORS MOUNTED ON PLASTIC DRUMS AS A SUBSTITUTE FOR TYPE C (STEADY BURN) WARNING LIGHTS

1. A warning reflector or approved substitute may be mounted on a plastic drum as a substitute for a Type C, steady burn warning light at the discretion of the Contractor unless otherwise noted in the plans.
2. The warning reflector shall be yellow in color and shall be manufactured using a sign substrate approved for use with plastic drums listed on the CWZTCD.
3. The warning reflector shall have a minimum retroreflective surface area (one-side) of 30 square inches.
4. Round reflectors shall be fully reflectorized, including the area where attached to the drum.
5. Square substrates must have a minimum of 30 square inches of reflectorized sheeting. They do not have to be reflectorized where it attaches to the drum.
6. The side of the warning reflector facing approaching traffic shall have sheeting meeting the color and retroreflectivity requirements for DMS 8300-Type B or Type C.
7. When used near two-way traffic, both sides of the warning reflector shall be reflectorized.
8. The warning reflector should be mounted on the side of the handle nearest approaching traffic.
9. The maximum spacing for warning reflectors should be identical to the channelizing device spacing requirements.

Arrow Boards may be located behind channelizing devices in place for a shoulder taper or merging taper, otherwise they shall be delineated with four (4) channelizing devices placed perpendicular to traffic on the upstream side of traffic.

1. The Flashing Arrow Board should be used for all lane closures on multi-lane roadways, or slow moving maintenance or construction activities on the travel lanes.
2. Flashing Arrow Boards should not be used on two-lane, two-way roadways, detours, diversions or work on shoulders unless the "CAUTION" display (see detail below) is used.
3. The Engineer/Inspector shall choose all appropriate signs, barricades and/or other traffic control devices that should be used in conjunction with the Flashing Arrow Board.
4. The Flashing Arrow Board should be able to display the following symbols:

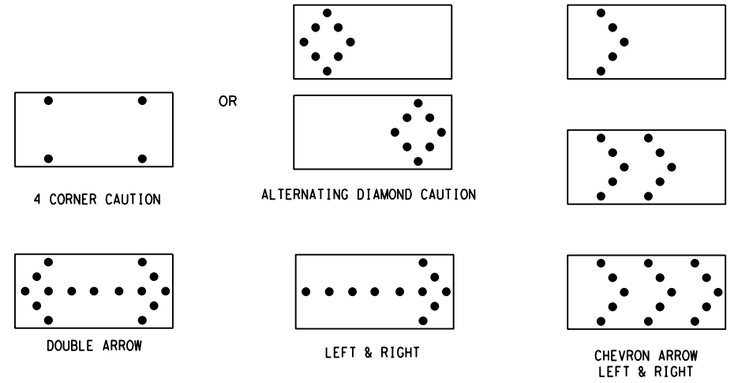

5. The "CAUTION" display consists of four corner lamps flashing simultaneously, or the Alternating Diamond Caution mode as shown.
6. The straight line caution display is NOT ALLOWED.
7. The Flashing Arrow Board shall be capable of minimum 50 percent dimming from rated lamp voltage. The flashing rate of the lamps shall not be less than 25 nor more than 40 flashes per minute.
8. Minimum lamp "on time" shall be approximately 50 percent for the flashing arrow and equal intervals of 25 percent for each sequential phase of the flashing chevron.
9. The sequential arrow display is NOT ALLOWED.
10. The flashing arrow display is the TxDOT standard; however, the sequential Chevron display may be used during daylight operations.
11. The Flashing Arrow Board shall be mounted on a vehicle, trailer or other suitable support.
12. A Flashing Arrow Board SHALL NOT BE USED to laterally shift traffic.
13. A full matrix PCMS may be used to simulate a Flashing Arrow Board provided it meets visibility, flash rate and dimming requirements on this sheet for the same size arrow.
14. Minimum mounting height of trailer mounted Arrow Boards should be 7 feet from roadway to bottom of panel.

REQUIREMENTS			
TYPE	MINIMUM SIZE	MINIMUM NUMBER OF PANEL LAMPS	MINIMUM VISIBILITY DISTANCE
B	30 x 60	13	3/4 mile
C	48 x 96	15	1 mile

ATTENTION
Flashing Arrow Boards shall be equipped with automatic dimming devices.

WHEN NOT IN USE, REMOVE THE ARROW BOARD FROM THE RIGHT-OF-WAY OR PLACE THE ARROW BOARD BEHIND CONCRETE TRAFFIC BARRIER OR GUARDRAIL.

FLASHING ARROW BOARDS

TRUCK-MOUNTED ATTENUATORS

1. Truck-mounted attenuators (TMA) used on TxDOT facilities must meet the requirements outlined in the National Cooperative Highway Research Report No. 350 (NCHRP 350) or the Manual for Assessing Safety Hardware (MASH).
2. Refer to the CWZTCD for the requirements of Level 2 or Level 3 TMAs.
3. Refer to the CWZTCD for a list of approved TMAs.
4. TMAs are required on freeways unless otherwise noted in the plans.
5. A TMA should be used anytime that it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the work performance.
6. The only reason a TMA should not be required is when a work area is spread down the roadway and the work crew is an extended distance from the TMA.

BARRICADE AND CONSTRUCTION ARROW PANEL, REFLECTORS, WARNING LIGHTS & ATTENUATOR

BC(7)-14

FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
9-07 8-14	DIST	COUNTY		SHEET NO.
7-13	AUS	WILLIAMSON		18

101

DATE: 12/21/2017 9:16:54 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:16:55 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn

GENERAL NOTES

1. For long term stationary work zones on freeways, drums shall be used as the primary channelizing device.
2. For intermediate term stationary work zones on freeways, drums should be used as the primary channelizing device but may be replaced in tangent sections by vertical panels, or 42" two-piece cones. In tangent sections one-piece cones may be used with the approval of the Engineer but only if personnel are present on the project at all times to maintain the cones in proper position and location.
3. For short term stationary work zones on freeways, drums are the preferred channelizing device but may be replaced in tapers, transitions and tangent sections by vertical panels, two-piece cones or one-piece cones as approved by the Engineer.
4. Drums and all related items shall comply with the requirements of the current version of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
5. Drums, bases, and related materials shall exhibit good workmanship and shall be free from objectionable marks or defects that would adversely affect their appearance or serviceability.
6. The Contractor shall have a maximum of 24 hours to replace any plastic drums identified for replacement by the Engineer/Inspector. The replacement device must be an approved device.

GENERAL DESIGN REQUIREMENTS

Pre-qualified plastic drums shall meet the following requirements:


1. Plastic drums shall be a two-piece design; the "body" of the drum shall be the top portion and the "base" shall be the bottom.
2. The body and base shall lock together in such a manner that the body separates from the base when impacted by a vehicle traveling at a speed of 20 MPH or greater but prevents accidental separation due to normal handling and/or air turbulence created by passing vehicles.
3. Plastic drums shall be constructed of lightweight flexible, and deformable materials. The Contractor shall NOT use metal drums or single piece plastic drums as channelization devices or sign supports.
4. Drums shall present a profile that is a minimum of 18 inches in width at the 36 inch height when viewed from any direction. The height of drum unit (body installed on base) shall be a minimum of 36 inches and a maximum of 42 inches.
5. The top of the drum shall have a built-in handle for easy pickup and shall be designed to drain water and not collect debris. The handle shall have a minimum of two widely spaced 9/16 inch diameter holes to allow attachment of a warning light, warning reflector unit or approved compliant sign.
6. The exterior of the drum body shall have a minimum of four alternating orange and white retroreflective circumferential stripes not less than 4 inches nor greater than 8 inches in width. Any non-reflectorized space between any two adjacent stripes shall not exceed 2 inches in width.
7. Bases shall have a maximum width of 36 inches, a maximum height of 4 inches, and a minimum of two footholds of sufficient size to allow base to be held down while separating the drum body from the base.
8. Plastic drums shall be constructed of ultra-violet stabilized, orange, high-density polyethylene (HDPE) or other approved material.
9. Drum body shall have a maximum unballasted weight of 11 lbs.
10. Drum and base shall be marked with manufacturer's name and model number.


RETROREFLECTIVE SHEETING

1. The stripes used on drums shall be constructed of sheeting meeting the color and retroreflectivity requirements of Departmental Materials Specification DMS-8300, "Sign Face Materials." Type A reflective sheeting shall be supplied unless otherwise specified in the plans.
2. The sheeting shall be suitable for use on and shall adhere to the drum surface such that, upon vehicular impact, the sheeting shall remain adhered in-place and exhibit no delaminating, cracking, or loss of retroreflectivity other than that loss due to abrasion of the sheeting surface.

BALLAST

1. Unballasted bases shall be large enough to hold up to 50 lbs. of sand. This base, when filled with the ballast material, should weigh between 35 lbs (minimum) and 50 lbs (maximum). The ballast may be sand in one to three sandbags separate from the base, sand in a sand-filled plastic base, or other ballasting devices as approved by the Engineer. Stacking of sandbags will be allowed, however height of sandbags above pavement surface may not exceed 12 inches.
2. Bases with built-in ballast shall weigh between 40 lbs. and 50 lbs. Built-in ballast can be constructed of an integral crumb rubber base or a solid rubber base.
3. Recycled truck tire sidewalls may be used for ballast on drums approved for this type of ballast on the CWZTCD list.
4. The ballast shall not be heavy objects, water, or any material that would become hazardous to motorists, pedestrians, or workers when the drum is struck by a vehicle.
5. When used in regions susceptible to freezing, drums shall have drainage holes in the bottoms so that water will not collect and freeze becoming a hazard when struck by a vehicle.
6. Ballast shall not be placed on top of drums.
7. Adhesives may be used to secure base of drums to pavement.

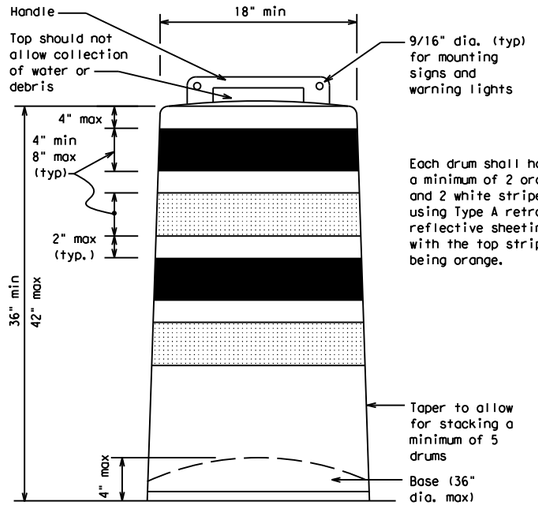


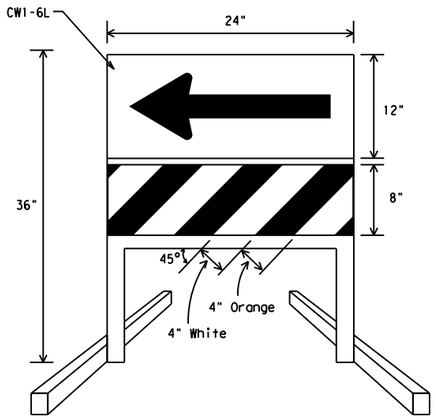

DIRECTION INDICATOR BARRICADE


1. The Direction Indicator Barricade may be used in tapers, transitions, and other areas where specific directional guidance to drivers is necessary.
2. If used, the Direction Indicator Barricade should be used in series to direct the driver through the transition and into the intended travel lane.
3. The Direction Indicator Barricade shall consist of One-Direction Large Arrow (CW1-6) sign in the size shown with a black arrow on a background of Type B_{FL} or Type C_{FL} Orange retroreflective sheeting above a rail with Type A retroreflective sheeting in alternating 4" white and orange stripes sloping downward at an angle of 45 degrees in the direction road users are to pass. Sheeting types shall be as per DMS 8300.
4. Double arrows on the Direction Indicator Barricade will not be allowed.
5. Approved manufacturers are shown on the CWZTCD List. Ballast shall be as approved by the manufacturers instructions.

This detail is not intended for fabrication. See note 3 and the CWZTCD list for providers of approved Detectable Pedestrian Barricades

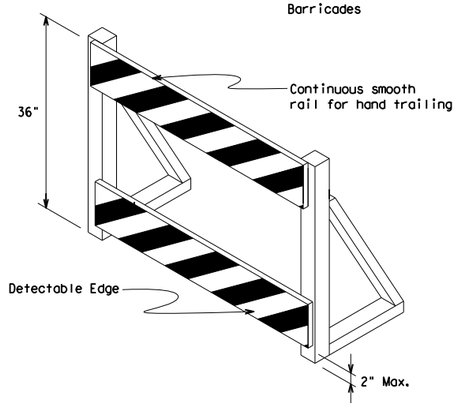


DETECTABLE PEDESTRIAN BARRICADES

1. When existing pedestrian facilities are disrupted, closed, or relocated in a TTC zone, the temporary facilities shall be detectable and include accessibility features consistent with the features present in the existing pedestrian facility.
2. Where pedestrians with visual disabilities normally use the closed sidewalk, a device that is detectable by a person with a visual disability traveling with the aid of a long cane shall be placed across the full width of the closed sidewalk.
3. Detectable pedestrian barricades similar to the one pictured above, longitudinal channelizing devices, some concrete barriers, and wood or chain link fencing with a continuous detectable edging can satisfactorily delineate a pedestrian path.
4. Tape, rope, or plastic chain strung between devices are not detectable, do not comply with the design standards in the "Americans with Disabilities Act Accessibility Guidelines for Buildings and Facilities (ADAAG)" and should not be used as a control for pedestrian movements.
5. Warning lights shall not be attached to detectable pedestrian barricades.
6. Detectable pedestrian barricades may use 8" nominal barricade rails as shown on BC(10) provided that the top rail provides a smooth continuous rail suitable for hand trailing with no splinters, burrs, or sharp edges.



18" x 24" Sign
(Maximum Sign Dimension)
Chevron CW1-8, Opposing Traffic Lane Divider, Driveway sign D70a, Keep Right R4 series or other signs as approved by Engineer



12" x 24"
Vertical Panel
mount with diagonals sloping down towards travel way

Plywood, Aluminum or Metal sign substrates shall NOT be used on plastic drums

SIGNS, CHEVRONS, AND VERTICAL PANELS MOUNTED ON PLASTIC DRUMS

1. Signs used on plastic drums shall be manufactured using substrates listed on the CWZTCD.
2. Chevrons and other work zone signs with an orange background shall be manufactured with Type B_{FL} or Type C_{FL} Orange sheeting meeting the color and retroreflectivity requirements of DMS-8300, "Sign Face Material," unless otherwise specified in the plans.
3. Vertical Panels shall be manufactured with orange and white sheeting meeting the requirements of DMS-8300 Type A Diagonal stripes on Vertical Panels shall slope down toward the intended traveled lane.
4. Other sign messages (text or symbolic) may be used as approved by the Engineer. Sign dimensions shall not exceed 18 inches in width or 24 inches in height, except for the R9 series signs discussed in note 8 below.
5. Signs shall be installed using a 1/2 inch bolt (nominal) and nut, two washers, and one locking washer for each connection.
6. Mounting bolts and nuts shall be fully engaged and adequately torqued. Bolts should not extend more than 1/2 inch beyond nuts.
7. Chevrons may be placed on drums on the outside of curves, on merging tapers or on shifting tapers. When used in these locations they may be placed on every drum or spaced not more than on every third drum. A minimum of three (3) should be used at each location called for in the plans.
8. R9-9, R9-10, R9-11 and R9-11a Sidewalk Closed signs which are 24 inches wide may be mounted on plastic drums, with approval of the Engineer.

SHEET 8 OF 12

Texas Department of Transportation | Traffic Operations Division Standard

BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES


BC(8)-14

FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
4-03 7-13	DIST	COUNTY		SHEET NO.
9-07 8-14	AUS	WILLIAMSON		19

102


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:16:55 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn

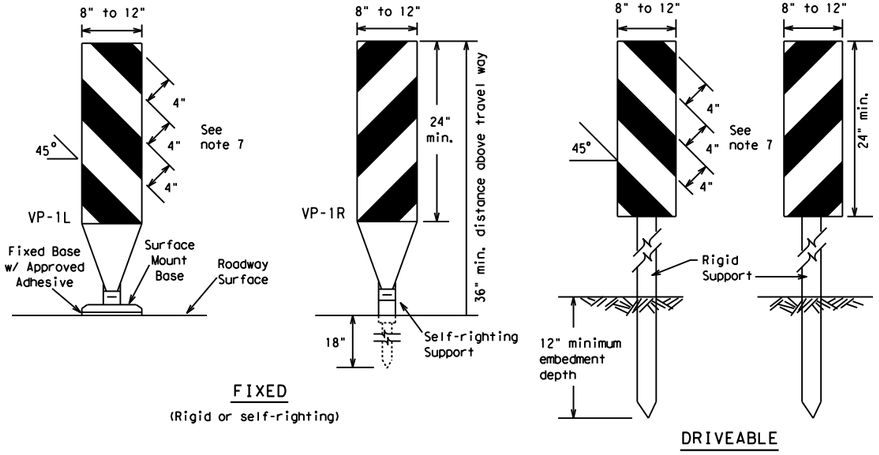

FIXED
(Rigid or self-righting)

DRIVEABLE

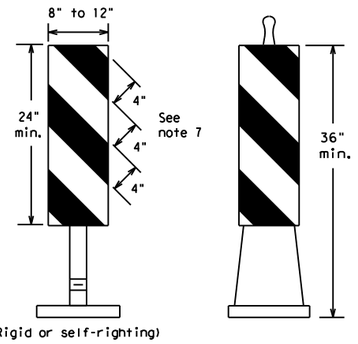


(Rigid or self-righting)

PORTABLE


VERTICAL PANELS (VPs)

1. Vertical Panels (VP's) are normally used to channelize traffic or divide opposing lanes of traffic.
2. VP's may be used in daytime or nighttime situations. They may be used at the edge of shoulder drop-offs and other areas such as lane transitions where positive daytime and nighttime delineation is required. The Engineer/Inspector shall refer to the Roadway Design Manual Appendix B "Treatment of Pavement Drop-offs in Work Zones" for additional guidelines on the use of VP's for drop-offs.
3. VP's should be mounted back to back if used at the edge of cuts adjacent to two-way two lane roadways. Stripes are to be reflective orange and reflective white and should always slope downward toward the travel lane.
4. VP's used on expressways and freeways or other high speed roadways, may have more than 270 square inches of retroreflective area facing traffic.
5. Self-righting supports are available with portable base. See "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
6. Sheeting for the VP's shall be retroreflective Type A conforming to Departmental Material Specification DMS-8300, unless noted otherwise.
7. Where the height of reflective material on the vertical panel is 36 inches or greater, a panel stripe of 6 inches shall be used.

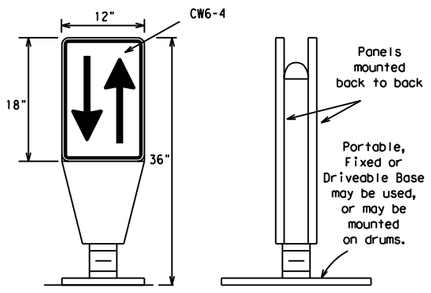

OPPOSING TRAFFIC LANE DIVIDERS (OTLD)

1. Opposing Traffic Lane Dividers (OTLD) are delineation devices designed to convert a normal one-way roadway section to two-way operation. OTLD's are used on temporary centerlines. The upward and downward arrows on the sign's face indicate the direction of traffic on either side of the divider. The base is secured to the pavement with an adhesive or rubber weight to minimize movement caused by a vehicle impact or wind gust.
2. The OTLD may be used in combination with 42" cones or VPs.
3. Spacing between the OTLD shall not exceed 500 feet. 42" cones or VPs placed between the OTLD's should not exceed 100 foot spacing.
4. The OTLD shall be orange with a black non-reflective legend. Sheeting for the OTLD shall be retroreflective Type B_{FL} or Type C_{FL} conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.

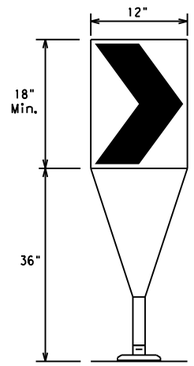


Fixed Base w/ Approved Adhesive
(Driveable Base, or Flexible Support can be used)

1. The chevron shall be a vertical rectangle with a minimum size of 12 by 18 inches.
2. Chevrons are intended to give notice of a sharp change of alignment with the direction of travel and provide additional emphasis and guidance for vehicle operators with regard to changes in horizontal alignment of the roadway.
3. Chevrons, when used, shall be erected on the outside of a sharp curve or turn, or on the far side of an intersection. They shall be in line with and at right angles to approaching traffic. Spacing should be such that the motorist always has three in view, until the change in alignment eliminates its need.
4. To be effective, the chevron should be visible for at least 500 feet.
5. Chevrons shall be orange with a black nonreflective legend. Sheeting for the chevron shall be retroreflective Type B_{FL} or Type C_{FL} conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.
6. For Long Term Stationary use on tapers or transitions on freeways and divided highways self-righting chevrons may be used to supplement plastic drums but not to replace plastic drums.

CHEVRONS

GENERAL NOTES

1. Work Zone channelizing devices illustrated on this sheet may be installed in close proximity to traffic and are suitable for use on high or low speed roadways. The Engineer/Inspector shall ensure that spacing and placement is uniform and in accordance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
2. Channelizing devices shown on this sheet may have a driveable, fixed or portable base. The requirement for self-righting channelizing devices must be specified in the General Notes or other plan sheets.
3. Channelizing devices on self-righting supports should be used in work zone areas where channelizing devices are frequently impacted by errant vehicles or vehicle related wind gusts making alignment of the channelizing devices difficult to maintain. Locations of these devices shall be detailed elsewhere in the plans. These devices shall conform to the TMUTCD and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
4. The Contractor shall maintain devices in a clean condition and replace damaged, nonreflective, faded, or broken devices and bases as required by the Engineer/Inspector. The Contractor shall be required to maintain proper device spacing and alignment.
5. Portable bases shall be fabricated from virgin and/or recycled rubber. The portable bases shall weigh a minimum of 30 lbs.
6. Pavement surfaces shall be prepared in a manner that ensures proper bonding between the adhesives, the fixed mount bases and the pavement surface. Adhesives shall be prepared and applied according to the manufacturer's recommendations.
7. The installation and removal of channelizing devices shall not cause detrimental effects to the final pavement surfaces, including pavement surface discoloration or surface integrity. Driveable bases shall not be permitted on final pavement surfaces. The Engineer/Inspector shall approve all application and removal procedures of fixed bases.



LONGITUDINAL CHANNELIZING DEVICES (LCD)

1. LCDs are crashworthy, lightweight, deformable devices that are highly visible, have good target value and can be connected together. They are not designed to contain or redirect a vehicle on impact.
2. LCDs may be used instead of a line of cones or drums.
3. LCDs shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
4. LCDs should not be used to provide positive protection for obstacles, pedestrians or workers.
5. LCDs shall be supplemented with retroreflective delineation as required for temporary barriers on BC(7) when placed roughly parallel to the travel lanes.
6. LCDs used as barricades placed perpendicular to traffic should have at least one row of reflective sheeting meeting the requirements for barricade rails as shown on BC(10) placed near the top of the LCD along the full length of the device.

WATER BALLASTED SYSTEMS USED AS BARRIERS

1. Water ballasted systems used as barriers shall not be used solely to channelize road users, but also to protect the work space per the appropriate NCHRP 350 crashworthiness requirements based on roadway speed and barrier application.
2. Water ballasted systems used to channelize vehicular traffic shall be supplemented with retroreflective delineation or channelizing devices to improve daytime/nighttime visibility. They may also be supplemented with pavement markings.
3. Water ballasted systems used as barriers shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
4. Water ballasted systems used as barriers should not be used for a merging taper except in low speed (less than 45 MPH) urban areas. When used on a taper in a low speed urban area, the taper shall be delineated and the taper length should be designed to optimize road user operations considering the available geometric conditions.
5. When water ballasted systems used as barriers have blunt ends exposed to traffic, they should be attenuated as per manufacturer recommendations or flared to a point outside the clear zone.

If used to channelize pedestrians, longitudinal channelizing devices or water ballasted systems must have a continuous detectable bottom for users of long canes and the top of the unit shall not be less than 32 inches in height.

HOLLOW OR WATER BALLASTED SYSTEMS USED AS LONGITUDINAL CHANNELIZING DEVICES OR BARRIERS

Posted Speed *	Formula	Minimum Desirable Taper Lengths ** 10' Offset	11' Offset	12' Offset	Suggested Maximum Spacing of Channelizing Devices: On a Taper	On a Tangent
30	$L = \frac{WS^2}{60}$	150'	165'	180'	30'	60'
35		205'	225'	245'	35'	70'
40		265'	295'	320'	40'	80'
45	L = WS	450'	495'	540'	45'	90'
50		500'	550'	600'	50'	100'
55		550'	605'	660'	55'	110'
60		600'	660'	720'	60'	120'
65		650'	715'	780'	65'	130'
70		700'	770'	840'	70'	140'
75		750'	825'	900'	75'	150'
80		800'	880'	960'	80'	160'

** Taper lengths have been rounded off.
L=Length of Taper (FT.) W=Width of Offset (FT.)
S=Posted Speed (MPH)

SUGGESTED MAXIMUM SPACING OF CHANNELIZING DEVICES AND MINIMUM DESIRABLE TAPER LENGTHS

SHEET 9 OF 12

Texas Department of Transportation | Traffic Operations Division Standard

BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES

BC(9)-14

FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
9-07 8-14	DIST	COUNTY		SHEET NO.
7-13	AUS	WILLIAMSON		20


103

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


TYPE 3 BARRICADES

1. Refer to the Compliant Work Zone Traffic Control Devices List (CWZTCD) for details of the Type 3 Barricades and a list of all materials used in the construction of Type 3 Barricades.
2. Type 3 Barricades shall be used at each end of construction projects closed to all traffic.
3. Barricades extending across a roadway should have stripes that slope downward in the direction toward which traffic must turn in detouring. When both right and left turns are provided, the chevron striping may slope downward in both directions from the center of the barricade. Where no turns are provided at a closed road striping should slope downward in both directions toward the center of roadway.
4. Striping of rails, for the right side of the roadway, should slope downward to the left. For the left side of the roadway, striping should slope downward to the right.
5. Identification markings may be shown only on the back of the barricade rails. The maximum height of letters and/or company logos used for identification shall be 1".
6. Barricades shall not be placed parallel to traffic unless an adequate clear zone is provided.
7. Warning lights shall NOT be installed on barricades.
8. Where barricades require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand is recommended. The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight. Sand bags shall not be stacked in a manner that covers any portion of a barricade rails reflective sheeting. Rock, concrete, iron, steel or other solid objects will NOT be permitted. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs. Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall not be used for sandbags. Sandbags shall only be placed along or upon the base supports of the device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners.
9. Sheeting for barricades shall be retroreflective Type A conforming to Departmental Material Specification DMS-8300 unless otherwise noted.

Barricades shall NOT be used as a sign support.




TYPICAL STRIPING DETAIL FOR BARRICADE RAIL

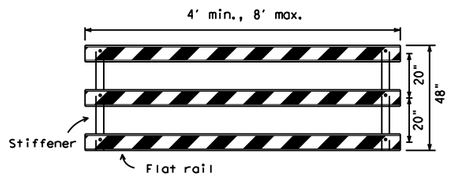

Stiffener may be inside or outside of support, but no more than 2 stiffeners shall be allowed on one barricade.


TYPICAL PANEL DETAIL
FOR SKID OR POST TYPE BARRICADES

Each roadway of a divided highway shall be barricaded in the same manner.

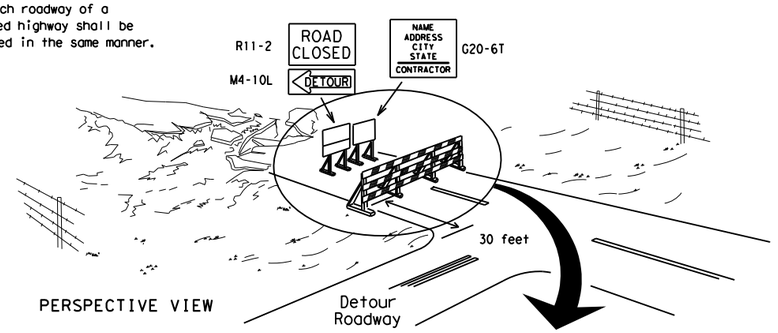

PERSPECTIVE VIEW


The three rails on Type 3 barricades shall be reflectorized orange and reflective white stripes on one side facing one-way traffic and both sides for two-way traffic.
Barricade striping should slant downward in the direction of detour.

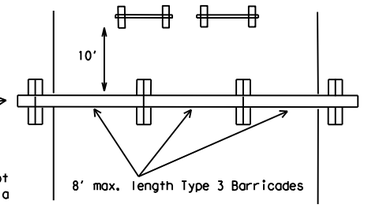

PLAN VIEW


1. Signs should be mounted on independent supports at a 7 foot mounting height in center of roadway. The signs should be a minimum of 10 feet behind Type 3 Barricades.
2. Advance signing shall be as specified elsewhere in the plans.

TYPE 3 BARRICADE (POST AND SKID) TYPICAL APPLICATION

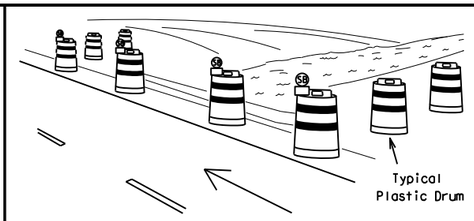

PERSPECTIVE VIEW


1. Where positive redirectional capability is provided, drums may be omitted.
2. Plastic construction fencing may be used with drums for safety as required in the plans.
3. Vertical Panels on flexible support may be substituted for drums when the shoulder width is less than 4 feet.
4. When the shoulder width is greater than 12 feet, steady-burn lights may be omitted if drums are used.
5. Drums must extend the length of the culvert widening.

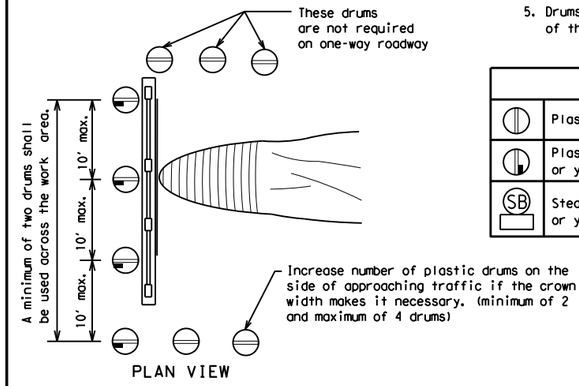

PLAN VIEW

LEGEND	
	Plastic drum
	Plastic drum with steady burn light or yellow warning reflector
SB	Steady burn warning light or yellow warning reflector

CULVERT WIDENING OR OTHER ISOLATED WORK WITHIN THE PROJECT LIMITS

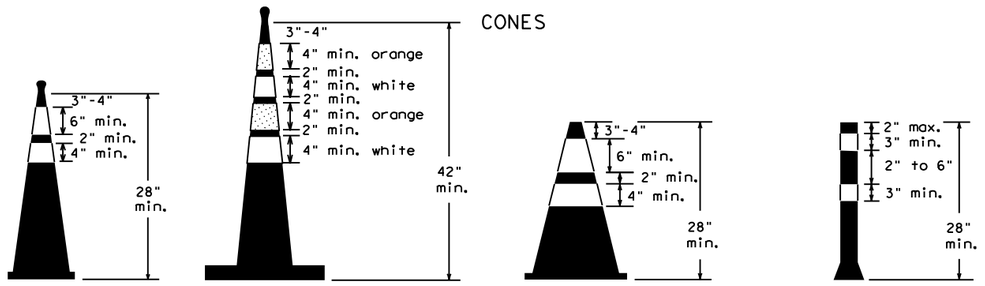


Two-Piece cones | One-Piece cones | Tubular Marker

28" Cones shall have a minimum weight of 9 1/2 lbs.


42" 2-piece cones shall have a minimum weight of 30 lbs. including base.

1. Traffic cones and tubular markers shall be predominantly orange, and meet the height and weight requirements shown above.
2. One-piece cones have the body and base of the cone molded in one consolidated unit. Two-piece cones have a cone shaped body and a separate rubber base, or ballast, that is added to keep the device upright and in place.
3. Two-piece cones may have a handle or loop extending up to 8" above the minimum height shown, in order to aid in retrieving the device.
4. Cones or tubular markers used at night shall have white or white and orange reflective bands as shown above. The reflective bands shall have a smooth, sealed outer surface and meet the requirements of Departmental Material Specification DMS-8300 Type A.
5. 28" cones and tubular markers are generally suitable for short duration and short-term stationary work as defined on BC(4). These should not be used for intermediate-term or long-term stationary work unless personnel is on-site to maintain them in their proper upright position.
6. 42" two-piece cones, vertical panels or drums are suitable for all work zone durations.
7. Cones or tubular markers used on each project should be of the same size and shape.

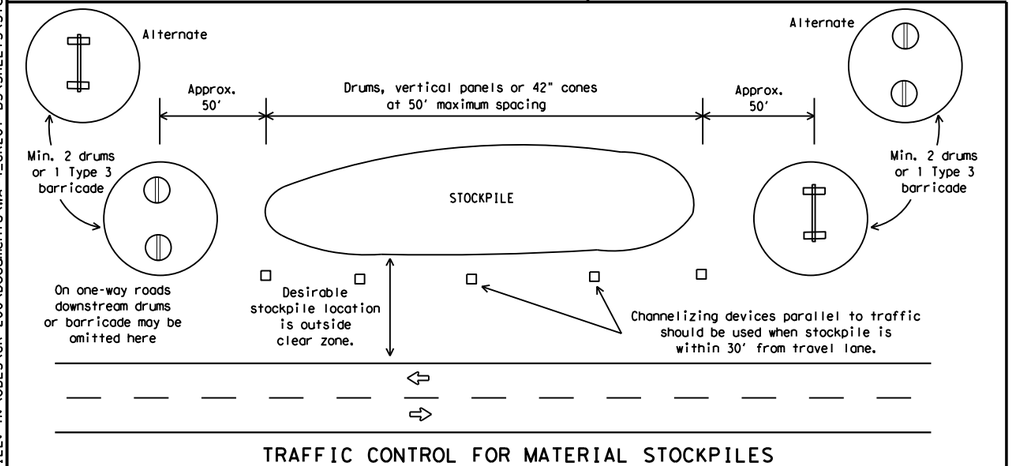

TRAFFIC CONTROL FOR MATERIAL STOCKPILES

THIS DEVICE SHALL NOT BE USED ON PROJECTS LET AFTER MARCH 2014.

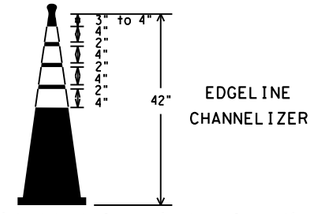

EDGELINE CHANNELIZER

1. This device is intended only for use in place of a vertical panel to channelize traffic by indicating the edge of the travel lane. It is not intended to be used in transitions or tapers.
2. This device shall not be used to separate lanes of traffic (opposing or otherwise) or warn of objects.
3. This device is based on a 42 inch, two-piece cone with an alternate striping pattern: four 4 inch retroreflective bands, with an approximate 2 inch gap between bands. The color of the band should correspond to the color of the edgeline (yellow for left edgeline, white for right edgeline) for which the device is substituted or for which it supplements. The reflectorized bands shall be retroreflective Type A conforming to Departmental Material Specification DMS-8300, unless otherwise noted.
4. The base must weigh a minimum of 30 lbs.

SHEET 10 OF 12

Texas Department of Transportation | Traffic Operations Division Standard

BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES

BC(10)-14

FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS 9-07 8-14 7-13	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		21

104

DATE: 12/21/2017 9:16:56 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:16:56 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn

WORK ZONE PAVEMENT MARKINGS

GENERAL

1. The Contractor shall be responsible for maintaining work zone and existing pavement markings, in accordance with the standard specifications and special provisions, on all roadways open to traffic within the CSJ limits unless otherwise stated in the plans.
2. Color, patterns and dimensions shall be in conformance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
3. Additional supplemental pavement marking details may be found in the plans or specifications.
4. Pavement markings shall be installed in accordance with the TMUTCD and as shown on the plans.
5. When short term markings are required on the plans, short term markings shall conform with the TMUTCD, the plans and details as shown on the Standard Plan Sheet WZ(STPM).
6. When standard pavement markings are not in place and the roadway is opened to traffic, DO NOT PASS signs shall be erected to mark the beginning of the sections where passing is prohibited and PASS WITH CARE signs at the beginning of sections where passing is permitted.
7. All work zone pavement markings shall be installed in accordance with Item 662, "Work Zone Pavement Markings."

RAISED PAVEMENT MARKERS

1. Raised pavement markers are to be placed according to the patterns on BC(12).
2. All raised pavement markers used for work zone markings shall meet the requirements of Item 672, "RAISED PAVEMENT MARKERS" and Departmental Material Specification DMS-4200 or DMS-4300.

PREFABRICATED PAVEMENT MARKINGS

1. Removable prefabricated pavement markings shall meet the requirements of DMS-8241.
2. Non-removable prefabricated pavement markings (foil back) shall meet the requirements of DMS-8240.


MAINTAINING WORK ZONE PAVEMENT MARKINGS

1. The Contractor will be responsible for maintaining work zone pavement markings within the work limits.
2. Work zone pavement markings shall be inspected in accordance with the frequency and reporting requirements of work zone traffic control device inspections as required by Form 599.
3. The markings should provide a visible reference for a minimum distance of 300 feet during normal daylight hours and 160 feet when illuminated by automobile low-beam headlights at night, unless sight distance is restricted by roadway geometrics.
4. Markings failing to meet this criteria within the first 30 days after placement shall be replaced at the expense of the Contractor as per Specification Item 662.

REMOVAL OF PAVEMENT MARKINGS

1. Pavement markings that are no longer applicable, could create confusion or direct a motorist toward or into the closed portion of the roadway shall be removed or obliterated before the roadway is opened to traffic.
2. The above shall not apply to detours in place for less than three days, where flaggers and/or sufficient channelizing devices are used in lieu of markings to outline the detour route.
3. Pavement markings shall be removed to the fullest extent possible, so as not to leave a discernable marking. This shall be by any method approved by TxDOT Specification Item 677 for "Eliminating Existing Pavement Markings and Markers".
4. The removal of pavement markings may require resurfacing or seal coating portions of the roadway as described in Item 677.
5. Subject to the approval of the Engineer, any method that proves to be successful on a particular type pavement may be used.
6. Blast cleaning may be used but will not be required unless specifically shown in the plans.
7. Over-painting of the markings SHALL NOT BE permitted.
8. Removal of raised pavement markers shall be as directed by the Engineer.
9. Removal of existing pavement markings and markers will be paid for directly in accordance with Item 677, "ELIMINATING EXISTING PAVEMENT MARKINGS AND MARKERS," unless otherwise stated in the plans.
10. Black-out marking tape may be used to cover conflicting existing markings for periods less than two weeks when approved by the Engineer.

Temporary Flexible-Reflective Roadway Marker Tabs

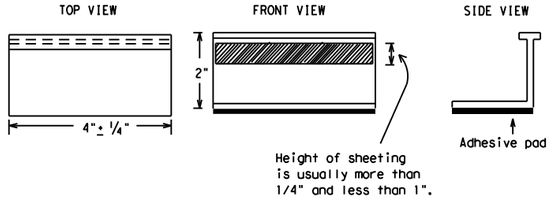

STAPLES OR NAILS SHALL NOT BE USED TO SECURE TEMPORARY FLEXIBLE-REFLECTIVE ROADWAY MARKER TABS TO THE PAVEMENT SURFACE

1. Temporary flexible-reflective roadway marker tabs used as guidemarks shall meet the requirements of DMS-8242.
2. Tabs detailed on this sheet are to be inspected and accepted by the Engineer or designated representative. Sampling and testing is not normally required, however at the option of the Engineer, either "A" or "B" below may be imposed to assure quality before placement on the roadway.
   A. Select five (5) or more tabs at random from each lot or shipment and submit to the Construction Division, Materials and Pavement Section to determine specification compliance.
   B. Select five (5) tabs and perform the following test. Affix five (5) tabs at 24 inch intervals on an asphaltic pavement in a straight line. Using a medium size passenger vehicle or pickup, run over the markers with the front and rear tires at a speed of 35 to 40 miles per hour, four (4) times in each direction. No more than one (1) out of the five (5) reflective surfaces shall be lost or displaced as a result of this test.
3. Small design variances may be noted between tab manufacturers.
4. See Standard Sheet WZ(STPM) for tab placement on new pavements. See Standard Sheet TCP(7-1) for tab placement on seal coat work.

RAISED PAVEMENT MARKERS USED AS GUIDEMARKS

1. Raised pavement markers used as guidemarks shall be from the approved product list, and meet the requirements of DMS-4200.
2. All temporary construction raised pavement markers provided on a project shall be of the same manufacturer.
3. Adhesive for guidemarks shall be bituminous material hot applied or butyl rubber pad for all surfaces, or thermoplastic for concrete surfaces.

Guidemarks shall be designated as:
YELLOW - (two amber reflective surfaces with yellow body).
WHITE - (one silver reflective surface with white body).

DEPARTMENTAL MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
TRAFFIC BUTTONS	DMS-4300
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240
TEMPORARY REMOVABLE, PREFABRICATED PAVEMENT MARKINGS	DMS-8241
TEMPORARY FLEXIBLE, REFLECTIVE ROADWAY MARKER TABS	DMS-8242

A list of prequalified reflective raised pavement markers, non-reflective traffic buttons, roadway marker tabs and other pavement markings can be found at the Material Producer List web address shown on BC(1).

Texas Department of Transportation — Traffic Operations Division Standard

BARRICADE AND CONSTRUCTION PAVEMENT MARKINGS

BC(11)-14

FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
2-98 9-07	DIST	COUNTY		SHEET NO.
1-02 7-13	AUS	WILLIAMSON		22
11-02 8-14				

105


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:16:57 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\bc-14.dgn


PAVEMENT MARKING PATTERNS




REFLECTORIZED PAVEMENT MARKINGS - PATTERN A



RAISED PAVEMENT MARKERS - PATTERN A




REFLECTORIZED PAVEMENT MARKINGS - PATTERN B

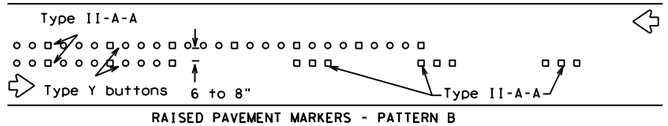


RAISED PAVEMENT MARKERS - PATTERN B

Pattern A is the TXDOT Standard, however Pattern B may be used if approved by the Engineer.
Prefabricated markings may be substituted for reflectorized pavement markings.

CENTER LINE & NO-PASSING ZONE BARRIER LINES FOR TWO-LANE, TWO-WAY HIGHWAYS

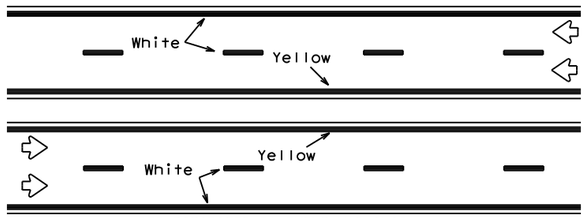


REFLECTORIZED PAVEMENT MARKINGS

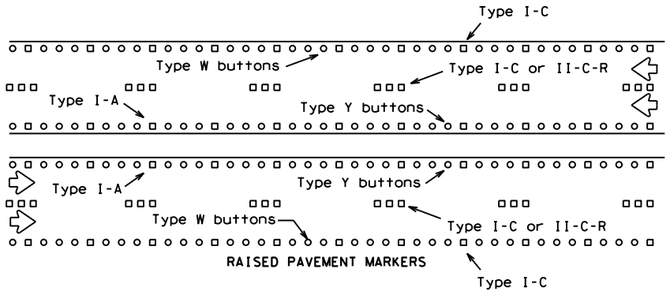


RAISED PAVEMENT MARKERS

Prefabricated markings may be substituted for reflectorized pavement markings.

EDGE & LANE LINES FOR DIVIDED HIGHWAY

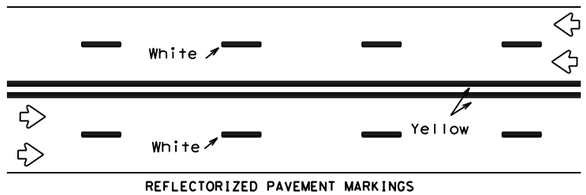


REFLECTORIZED PAVEMENT MARKINGS

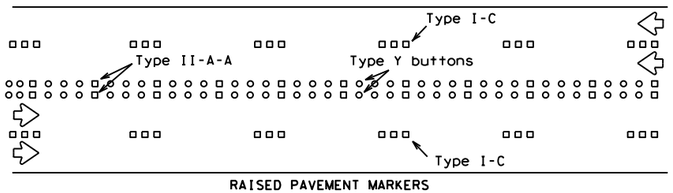


RAISED PAVEMENT MARKERS

Prefabricated markings may be substituted for reflectorized pavement markings.

LANE & CENTER LINES FOR MULTILANE UNDIVIDED HIGHWAYS

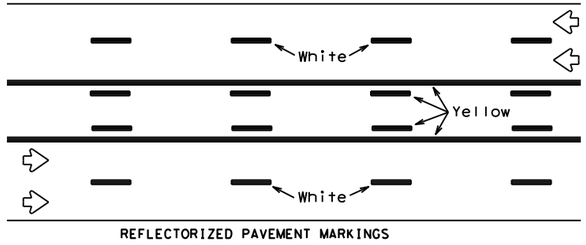

REFLECTORIZED PAVEMENT MARKINGS

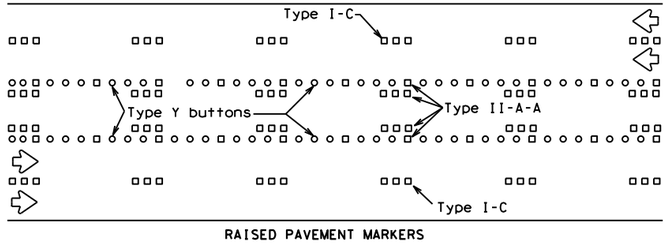



RAISED PAVEMENT MARKERS

Prefabricated markings may be substituted for reflectorized pavement markings.

TWO-WAY LEFT TURN LANE


STANDARD WORK ZONE PAVEMENT MARKINGS DETAILS

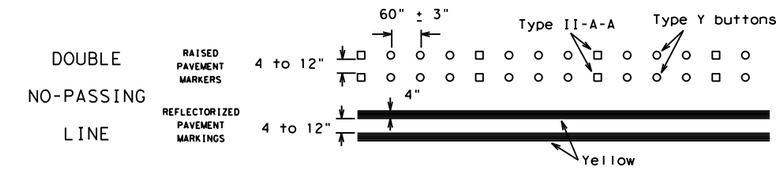

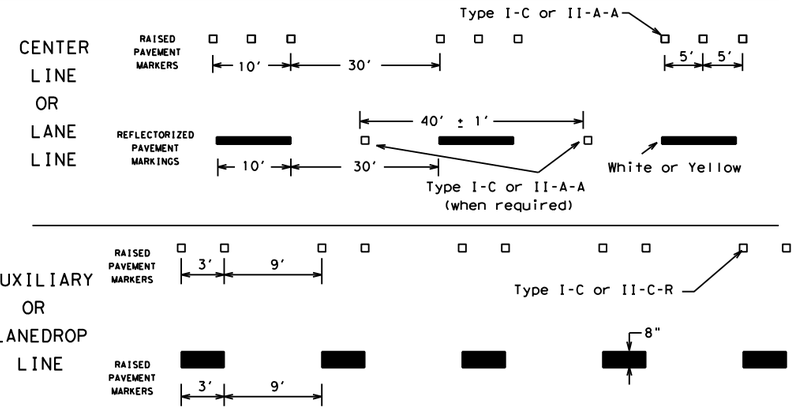

REMOVABLE MARKINGS WITH RAISED PAVEMENT MARKERS

If raised pavement markers are used to supplement REMOVABLE markings, the markers shall be applied to the top of the tape at the approximate mid length of tape used for broken lines or at 20 foot spacing for solid lines. This allows an easier removal of raised pavement markers and tape.

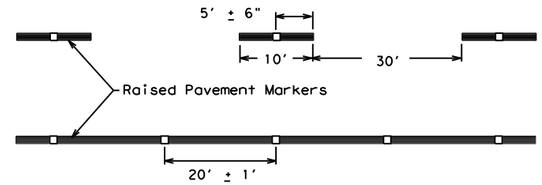

Centerline only - not to be used on edge lines

Raised pavement markers used as standard pavement markings shall be from the approved products list and meet the requirements of Item 672 "RAISED PAVEMENT MARKERS."

Texas Department of Transportation

Traffic Operations Division Standard

BARRICADE AND CONSTRUCTION PAVEMENT MARKING PATTERNS


BC(12)-14

FILE: bc-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
1-97 9-07	DIST	COUNTY		SHEET NO.
2-98 7-13	AUS	WILLIAMSON		23
11-02 8-14				

106

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


12/21/2017 9:16:57 PM
H:\OBES\CR 200\Documents\WA-4*CR201-BS\SHEETS\Standards\TrafficControl\tcp1-2.dgn

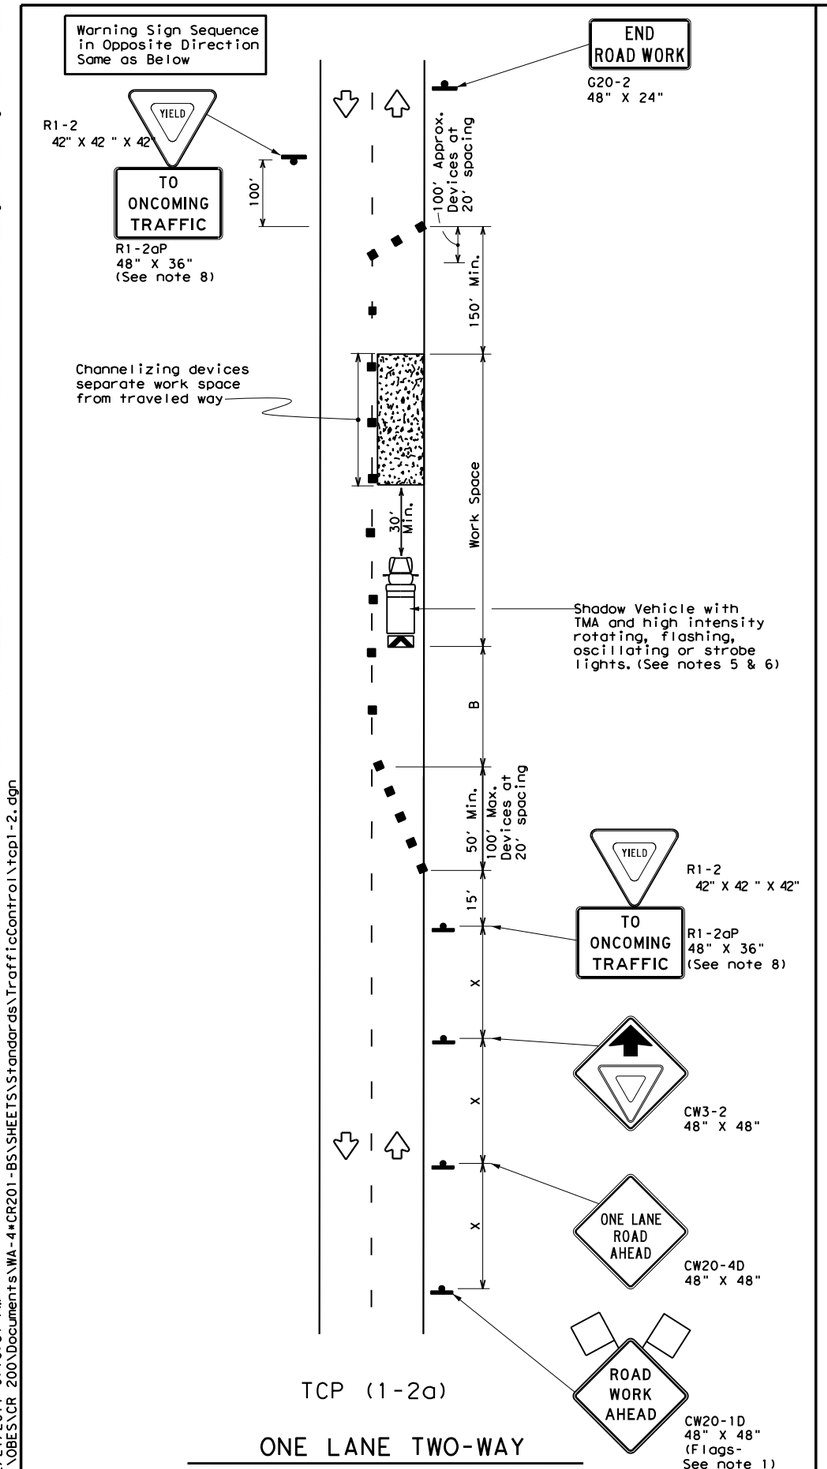

TCP (1-2a)

ONE LANE TWO-WAY CONTROL WITH YIELD SIGNS

(Less than 2000 ADT - See note 7)

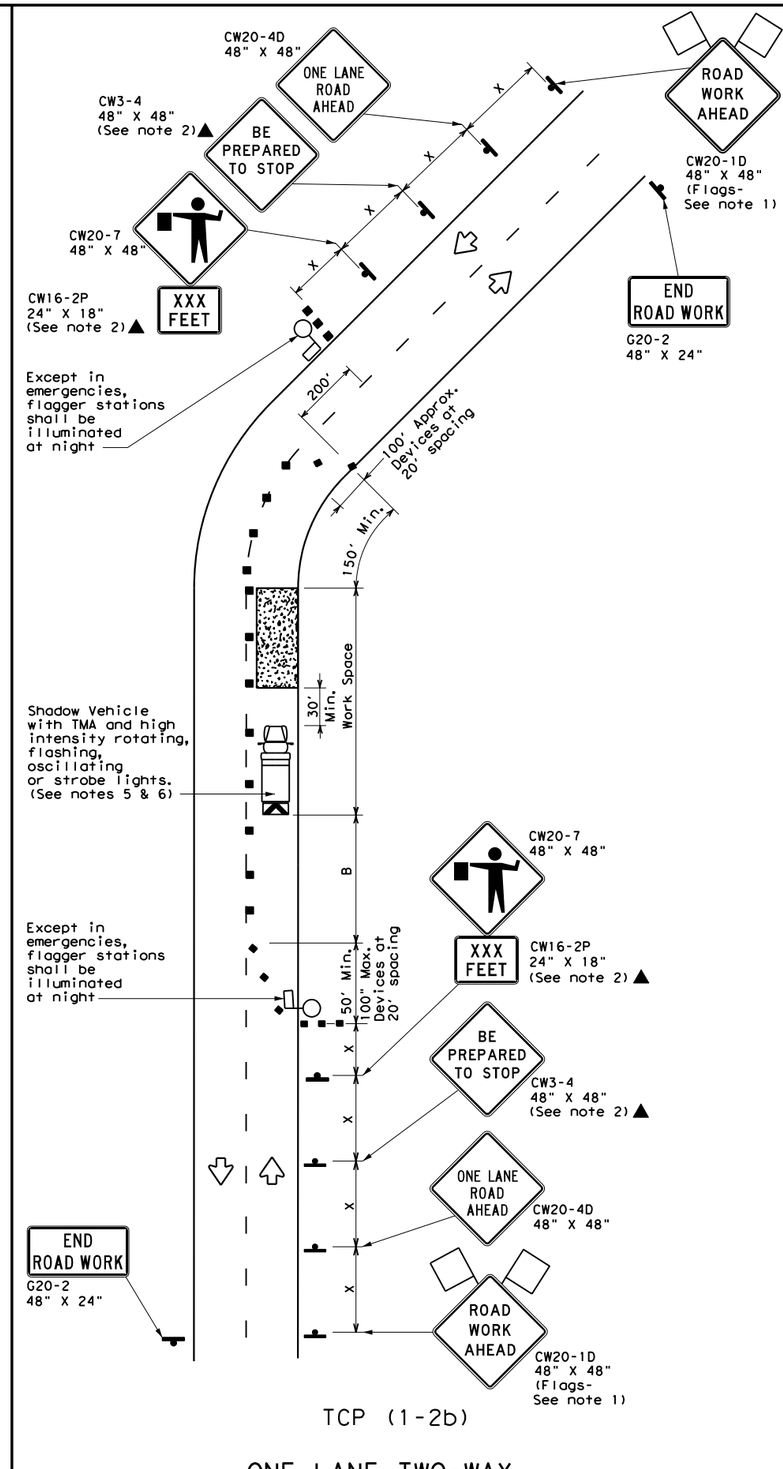

TCP (1-2b)

ONE LANE TWO-WAY CONTROL WITH FLAGGERS

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board	M	Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths ** 10' Offset	11' Offset	12' Offset	Suggested Maximum Spacing of Channelizing Devices: On a Taper	On a Tangent	Minimum Sign Spacing "X" Distance	Suggested Longitudinal Buffer Space "B"	Stopping Sight Distance
30	$L=\frac{WS^2}{60}$	150'	165'	180'	30'	60'	120'	90'	200'
35		205'	225'	245'	35'	70'	160'	120'	250'
40		265'	295'	320'	40'	80'	240'	155'	305'
45	L=WS	450'	495'	540'	45'	90'	320'	195'	360'
50		500'	550'	600'	50'	100'	400'	240'	425'
55		550'	605'	660'	55'	110'	500'	295'	495'
60		600'	660'	720'	60'	120'	600'	350'	570'
65		650'	715'	780'	65'	130'	700'	410'	645'
70		700'	770'	840'	70'	140'	800'	475'	730'
75		750'	825'	900'	75'	150'	900'	540'	820'

* Conventional Roads Only
** Taper lengths have been rounded off.
L=Length of Taper(FT) W=Width of Offset(FT) S=Posted Speed(MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓		

GENERAL NOTES

1. Flags attached to signs where shown are REQUIRED.
2. All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated elsewhere in the plans, or for routine maintenance work, when approved by the Engineer.
3. The CW3-4 "BE PREPARED TO STOP" sign may be installed after the CW20-4D "ONE LANE ROAD AHEAD" sign, but proper sign spacing shall be maintained.
4. Sign spacing may be increased or an additional CW20-1D "ROAD WORK AHEAD" sign may be used if advance warning ahead of the flagger or R1-2 "YIELD" sign is less than 1500 feet.
5. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
6. Additional Shadow Vehicles with TMAs may be positioned off the paved surface, next to those shown in order to protect wider work spaces.

TCP (1-2a)

7. R1-2 "YIELD" sign traffic control may be used on projects with approaches that have adequate sight distance. For projects in urban areas, work spaces should be no longer than one half city block. In rural areas on roadways with less than 2000 ADT, work spaces should be no longer than 400 feet.
8. R1-2 "YIELD" sign with R1-2aP "TO ONCOMING TRAFFIC" plaque shall be placed on a support at a 7 foot minimum mounting height.

TCP (1-2b)

9. Flaggers should use two-way radios or other methods of communication to control traffic.
10. Length of work space should be based on the ability of flaggers to communicate.
11. If the work space is located near a horizontal or vertical curve, the buffer distances should be increased in order to maintain adequate stopping sight distance to the flagger and a queue of stopped vehicles (see table above).
12. Channelizing devices on the center-line may be omitted when a pilot car is leading traffic and approved by the Engineer.
13. Flaggers should use 24" STOP/SLOW paddles to control traffic. Flags should be limited to emergency situations.

For construction or maintenance contract work, specific project requirements for shadow vehicles can be found in the project GENERAL NOTES for Item 502, Barricades, Signs and Traffic Handling.

Texas Department of Transportation
Traffic Operations Division

TRAFFIC CONTROL PLAN ONE-LANE TWO-WAY TRAFFIC CONTROL

TCP(1-2)-12


©TxDOT December 1985

REVISIONS		DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
4-90 2-12		CONT	SECT	JOB	HIGHWAY
2-94		TBD	TBD	TBD	CR 200
1-97		DIST	COUNTY		SHEET NO.
4-98		AUS	WILLIAMSON		24

152


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

12/21/2017 9:16:57 PM
H:\OBES\CR 200\Documents\WA-4*CR201-BS\SHEETS\Standards\TrafficControl\tcp2-1.dgn

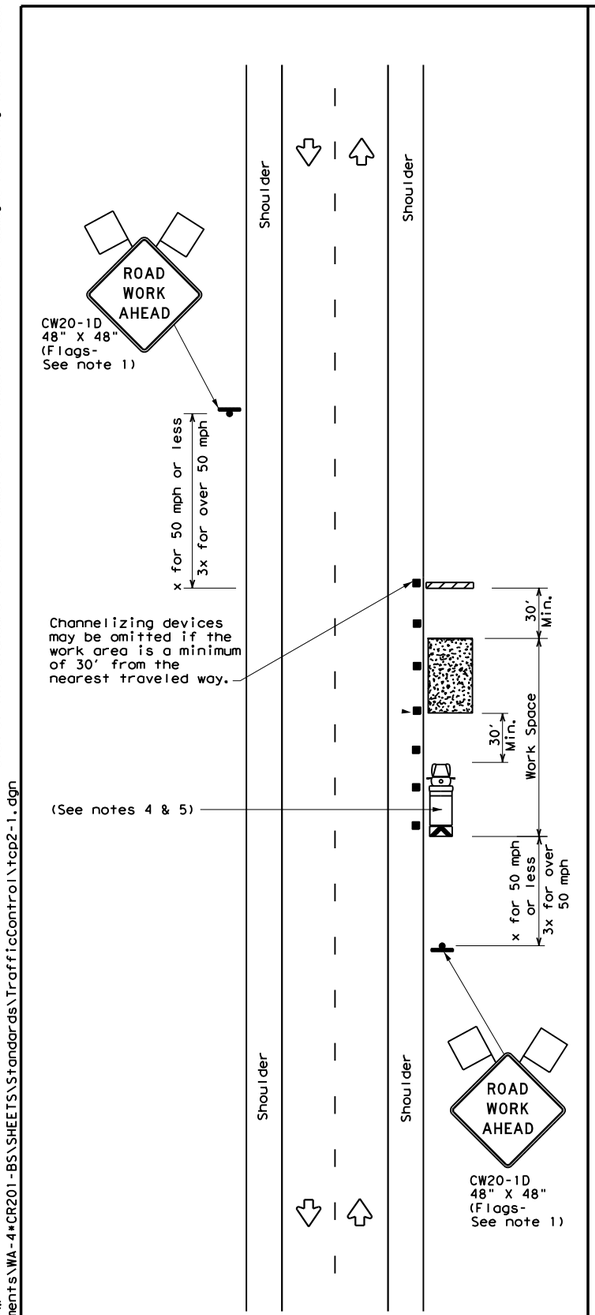


TCP (2-1a)

WORK SPACE NEAR SHOULDER
Conventional Roads

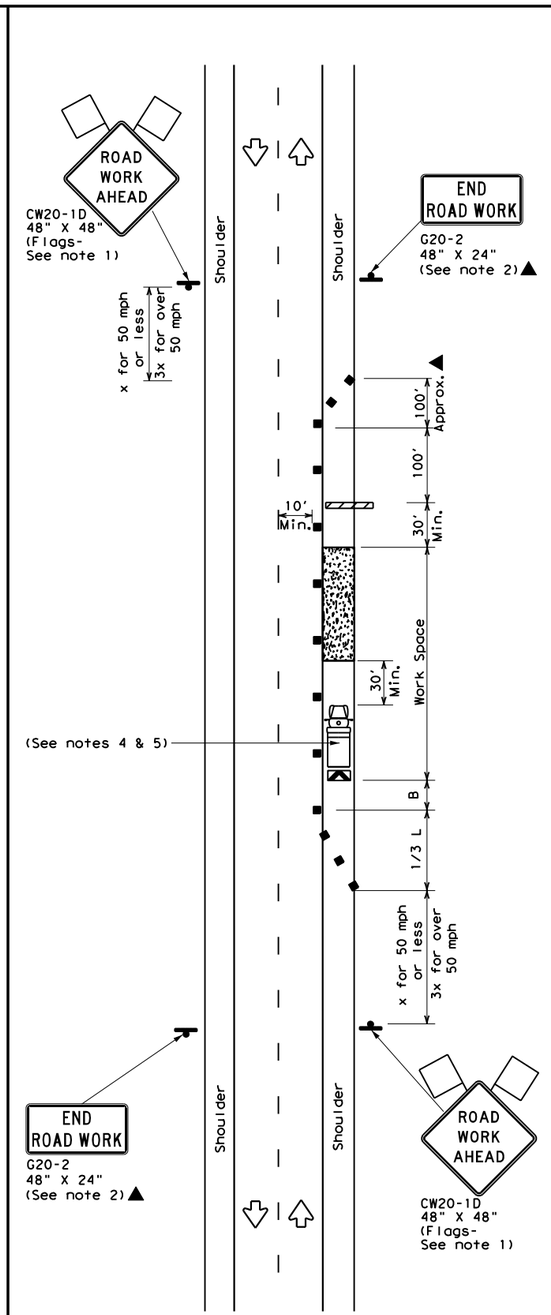

TCP (2-1b)

WORK SPACE ON SHOULDER
Conventional Roads

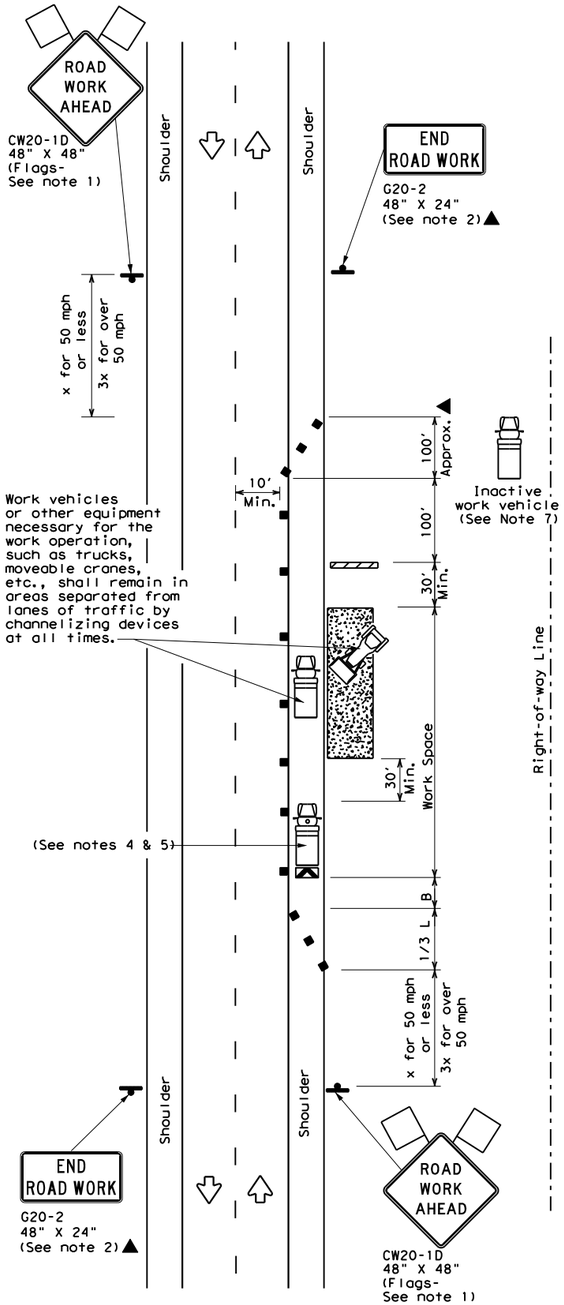

TCP (2-1c)

WORK VEHICLES ON SHOULDER
Conventional Roads

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board	M	Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths ** 10' Offset	11' Offset	12' Offset	Suggested Maximum Spacing of Channelizing Devices On a Taper	On a Tangent	Minimum Sign Spacing "X" Distance	Suggested Longitudinal Buffer Space "B"
30	$L=\frac{WS^2}{60}$	150'	165'	180'	30'	60'	120'	90'
35		205'	225'	245'	35'	70'	160'	120'
40		265'	295'	320'	40'	80'	240'	155'
45	L=WS	450'	495'	540'	45'	90'	320'	195'
50		500'	550'	600'	50'	100'	400'	240'
55		550'	605'	660'	55'	110'	500'	295'
60		600'	660'	720'	60'	120'	600'	350'
65		650'	715'	780'	65'	130'	700'	410'
70		700'	770'	840'	70'	140'	800'	475'
75		750'	825'	900'	75'	150'	900'	540'

* Conventional Roads Only

** Taper lengths have been rounded off.
L=Length of Taper(FT) W=Width of Offset(FT) S=Posted Speed(MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓	✓	✓

GENERAL NOTES

1. Flags attached to signs where shown, are REQUIRED.
2. All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated in the plans, or for routine maintenance work, when approved by the Engineer.
3. Stockpiled material should be placed a minimum of 30 feet from nearest traveled way.
4. Shadow Vehicle with TMA and high intensity rotating, flashing, oscillating or strobe lights. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
5. Additional Shadow Vehicles with TMAs may be positioned off the paved surface, next to those shown in order to protect a wider work space.
6. See TCP(5-1) for shoulder work on divided highways, expressways and freeways.
7. Inactive work vehicles or other equipment should be parked near the right-of-way line and not parked on the paved shoulder.
8. CW21-5 "SHOULDER WORK" signs may be used in place of CW21-1D "ROAD WORK AHEAD" signs for shoulder work on conventional roadways.

For construction or maintenance contract work, specific project requirements for shadow vehicles can be found in the project GENERAL NOTES for Item 502, Barricades, Signs and Traffic Handling.

Texas Department of Transportation
Traffic Operations Division

TRAFFIC CONTROL PLAN CONVENTIONAL ROAD SHOULDER WORK

TCP(2-1)-12


© TxDOT December 1985

DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT

REVISIONS	CONT	SECT	JOB	HIGHWAY
2-94 2-12	TBD	TBD	TBD	CR 200
8-95	DIST	COUNTY		SHEET NO.
1-97	AUS	WILLIAMSON		25
4-98				


161

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

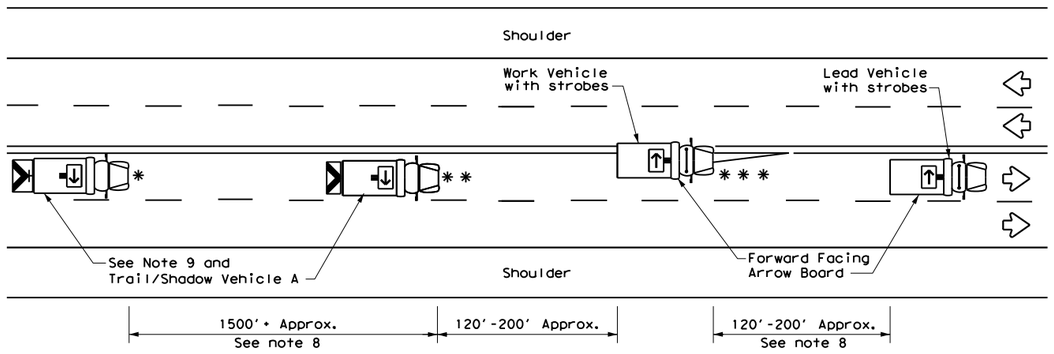


TCP (3-1a)

UNDIVIDED MULTILANE ROADWAY




TRAIL/SHADOW VEHICLE A

with RIGHT Directional display Flashing Arrow Board

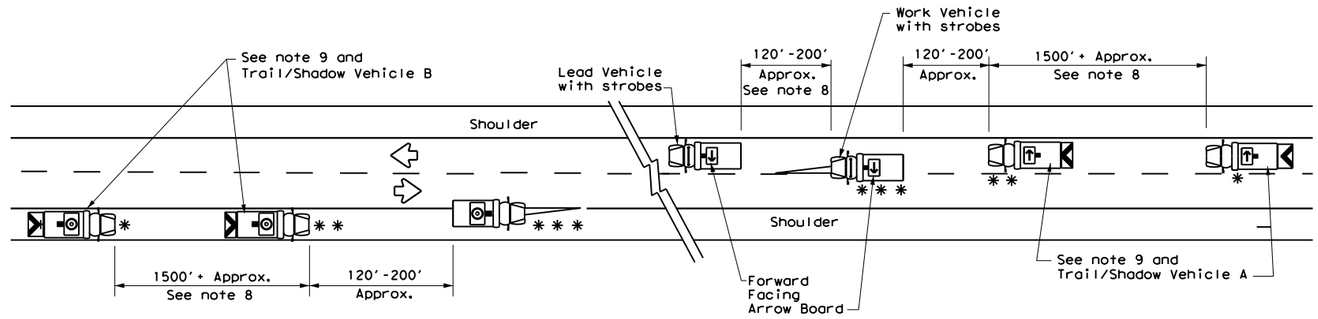


TCP (3-1b)

TWO-WAY ROADWAY WITH PAVED SHOULDERS

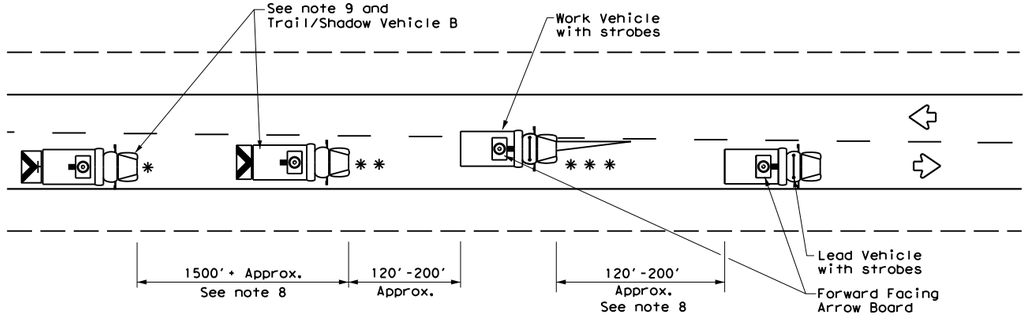

TCP (3-1c)

TWO-WAY ROADWAY WITHOUT PAVED SHOULDERS

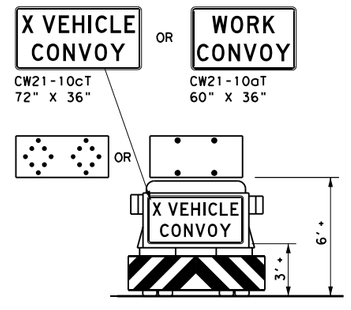

TRAIL/SHADOW VEHICLE B


with Flashing Arrow Board in CAUTION display

LEGEND			
*	Trail Vehicle	ARROW BOARD DISPLAY	
* *	Shadow Vehicle		
* * *	Work Vehicle		RIGHT Directional
	Heavy Work Vehicle		LEFT Directional
	Truck Mounted Attenuator (TMA)		Double Arrow
	Traffic Flow		CAUTION (Alternating Diamond or 4 Corner Flash)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
✓				

GENERAL NOTES

1. TRAIL, SHADOW, and LEAD vehicles shall be equipped with arrow boards as illustrated. When a LEAD vehicle is not used the WORK vehicle must be equiped with an arrow board. The Engineer will determine if the LEAD VEHICLE and/or TRAIL VEHICLE are required based on prevailing roadway conditions, traffic volume, and sight distance restrictions.
2. The use of amber high intensity rotating, flashing, oscillating, or strobe lights on vehicles are required. Blue high intensity rotating, flashing, oscillating or strobe lights when mounted on the driver's side of the vehicle may be operated simultaneously with the amber beacons or strobe lights.
3. The use of truck mounted attenuators (TMA) on the SHADOW VEHICLE and TRAIL VEHICLE are required.
4. Reflective sheeting on the rear of the TMA shall meet or exceed the reflectivity and color requirements of DEPARTMENTAL MATERIAL SPECIFICATION DMS 8300, Type A.
5. Flashing arrow boards shall be Type B or Type C as per the Barricade and Construction (BC) standards. The board shall be controlled from inside the vehicle.
6. Each vehicle shall have two-way radio communication capability.
7. When work convoys must change lanes, the TRAIL VEHICLE should change lanes first to shadow the other convoy vehicles.
8. Vehicle spacing between the TRAIL VEHICLE and the SHADOW VEHICLE will vary depending on sight distance restrictions. Motorists approaching the work convoy should be able to see the TRAIL VEHICLE in time to slow down and/or change lanes as they approach the TRAIL VEHICLE. Vehicle spacing between the WORK VEHICLE and SHADOW VEHICLE and vehicle spacing between WORK VEHICLE and LEAD VEHICLE may vary according to terrain, work activity and other factors.
9. "X VEHICLE CONVOY" (CW21-10cT) or "WORK CONVOY" (CW21-10aT) signs shall be used on TRAIL VEHICLES and SHADOW VEHICLES as shown. As an option 48" X 48" diamond shaped "WORK CONVOY"(CW21-10T) or "X VEHICLE CONVOY" (CW21-10bT) signs may be used where adequate mounting space exists. When used, the X VEHICLE CONVOY sign shall have the number of the convoy vehicles displayed on the sign in the number designation "X" location. The "X VEHICLE CONVOY" sign shall not be used on the SHADOW VEHICLE if a TRAIL VEHICLE is used.
10. On two-lane two-way roadways, the work and protection vehicles should pull over periodically to allow motor vehicle traffic to pass. If motorists are not allowed to pass the work convoy, a "DO NOT PASS" (R4-1) sign should be placed on the back of the rearmost protection vehicle.

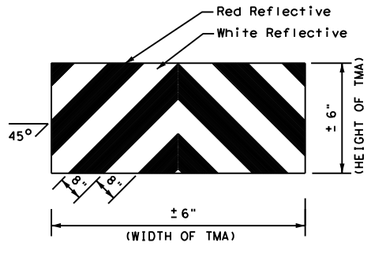

STRIPING FOR TMA

Texas Department of Transportation — Traffic Operations Division Standard

TRAFFIC CONTROL PLAN MOBILE OPERATIONS UNDIVIDED HIGHWAYS


TCP(3-1)-13

FILE: tcp3-1.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT December 1985	CONT	SECT	JOB	HIGHWAY
REVISIONS 2-94 4-98 8-95 7-13 1-97	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		26

175

12/21/2017 9:16:58 PM
H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\tcp3-1.dgn

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

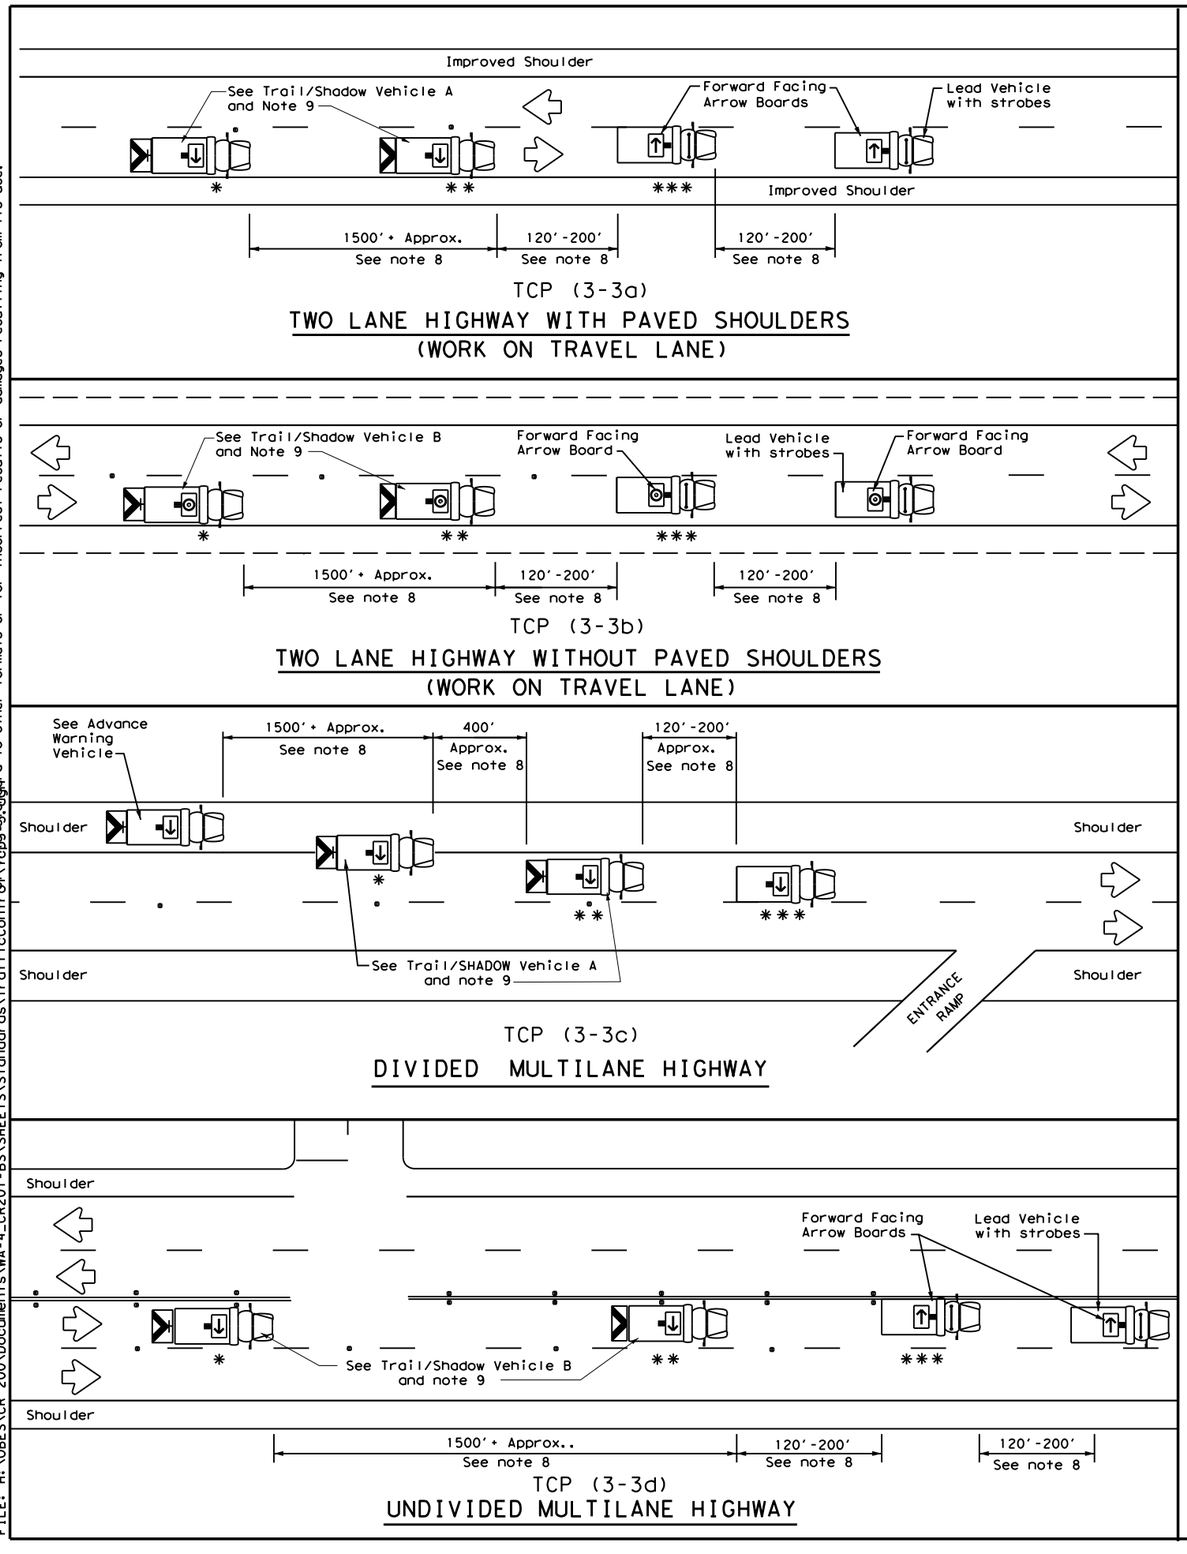

TCP (3-3a)

TWO LANE HIGHWAY WITH PAVED SHOULDERS
(WORK ON TRAVEL LANE)

TCP (3-3b)


TWO LANE HIGHWAY WITHOUT PAVED SHOULDERS
(WORK ON TRAVEL LANE)

TCP (3-3c)

DIVIDED MULTILANE HIGHWAY


TCP (3-3d)

UNDIVIDED MULTILANE HIGHWAY

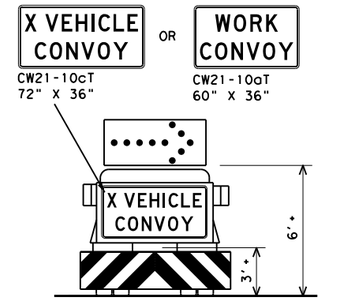


TRAIL/SHADOW VEHICLE A

with RIGHT Directional display
Flashing Arrow Board

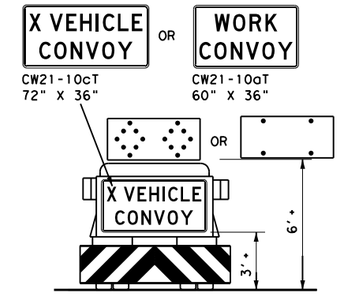


TRAIL/SHADOW VEHICLE B

with Flashing Arrow Board
in Caution Mode

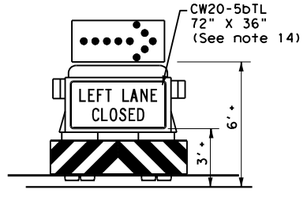

ADVANCE WARNING VEHICLE

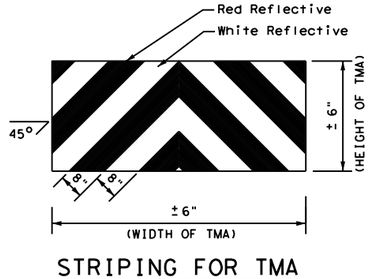

STRIPING FOR TMA

LEGEND			
*	Trail Vehicle	ARROW BOARD DISPLAY	
**	Shadow Vehicle		
***	Work Vehicle		RIGHT Directional
	Heavy Work Vehicle		LEFT Directional
	Truck Mounted Attenuator (TMA)		Double Arrow
	Traffic Flow		CAUTION (Alternating Diamond or 4 Corner Flash)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
✓				

GENERAL NOTES

1. TRAIL, SHADOW, and LEAD vehicles shall be equipped with arrow boards as illustrated. When a LEAD vehicle is not used on two way roads the WORK vehicle must have an arrow board. For divided roadways, the arrow board on the WORK vehicle is optional based on the type of work being performed. The Engineer will determine if the LEAD vehicle and/or TRAIL vehicle are required based on prevailing roadway conditions, traffic volume, and sight distance restrictions.
2. The use of amber high intensity rotating, flashing, oscillating, or strobe lights on vehicles are required. Blue high intensity rotating, flashing, oscillating, or strobe lights when mounted on the driver's side of the vehicle may be operated simultaneously with the amber beacons or strobe lights.
3. The use of truck mounted attenuators (TMA) on the SHADOW VEHICLE, ADVANCE WARNING and TRAIL VEHICLE are required.
4. Reflective sheeting on the rear of the TMA shall meet or exceed the reflectivity and color requirements of DEPARTMENTAL MATERIAL SPECIFICATION DMS 8300, Type A.
5. Flashing arrow boards shall be Type B or Type C as per the Barricade and Construction (BC) standards. The board shall be controlled from inside the vehicle.
6. Each vehicle shall have two-way radio communication capability.
7. When work convoys must change lanes, the TRAIL VEHICLE should change lanes first to shadow the other convoy vehicles.
8. Vehicle spacing between the TRAIL VEHICLE and the SHADOW VEHICLE will vary depending on sight distance restrictions. Motorists approaching the convoy should be able to see the TRAIL VEHICLE in time to slow down and/or change lanes as they approach the TRAIL VEHICLE. Vehicle spacing between the WORK VEHICLE and SHADOW VEHICLE and vehicle spacing between WORK VEHICLE and LEAD VEHICLE may vary according to terrain, work activity and other factors.
9. X VEHICLE CONVOY (CW21-10cT) or WORK CONVOY (CW21-10aT) signs shall be used on TRAIL VEHICLES and SHADOW VEHICLES as shown. As an option 48" x 48" diamond shaped WORK CONVOY (CW21-10T) or X VEHICLE CONVOY (CW21-10bT) signs may be used where adequate mounting space exists. When used, the X VEHICLE CONVOY sign shall have the number of the convoy vehicles displayed on the sign in the number designation "X" location. The X VEHICLE CONVOY sign shall not be used on the SHADOW VEHICLE if a TRAIL VEHICLE is used.
10. For divided highways with two or three lanes in one direction, the appropriate LEFT LANE CLOSED (CW20-5bTL), RIGHT LANE CLOSED (CW20-5bTR), or CENTER LANE CLOSED (CW20-5dT) sign should be used on the Advance Warning Vehicle. As an option, a portable changeable message sign (PCMS) or truck mounted changeable message sign (TMCMS) with a minimum character height of 12", and displaying the same legend may be substituted for these signs. An appropriate directional arrow display, simulating the size and legibility of the flashing arrow board may be used in the second phase of the PCMS/TMCMS message. When this is done, the arrow board will not be required on the Advance Warning Vehicle.
11. A double arrow shall not be displayed on the arrow board on the Advance Warning Vehicle.
12. For divided highways with three or four lanes in each direction, use TCP(3-2).
13. Standard diamond shape versions of the CW20-5 series signs may be used as an option if the rectangular signs shown are not available.
14. The Advance Warning Vehicle may straddle the edgeline when Shoulder width makes it necessary.
15. On two-lane two-way roadways, the work and protection vehicles should pull over periodically to allow motor vehicle traffic to pass. If motorists are not allowed to pass the work convoy, a DO NOT PASS (R4-1) sign should be placed on the back of the rearmost protection vehicle.

Texas Department of Transportation — Traffic Operations Division Standard

TRAFFIC CONTROL PLAN MOBILE OPERATIONS RAISED PAVEMENT MARKER INSTALLATION/ REMOVAL
TCP(3-3)-14


FILE: tcp3-3.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT September 1987	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
2-94 4-98	DIST	COUNTY		SHEET NO.
8-95 7-13	AUS	WILLIAMSON		27
1-97 7-14				

177

DATE: 12/21/2017 9:16:58 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControlPlan\tcp3-3.dgn

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


12/21/2017 9:16:58 PM
H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\tcp71.dgn

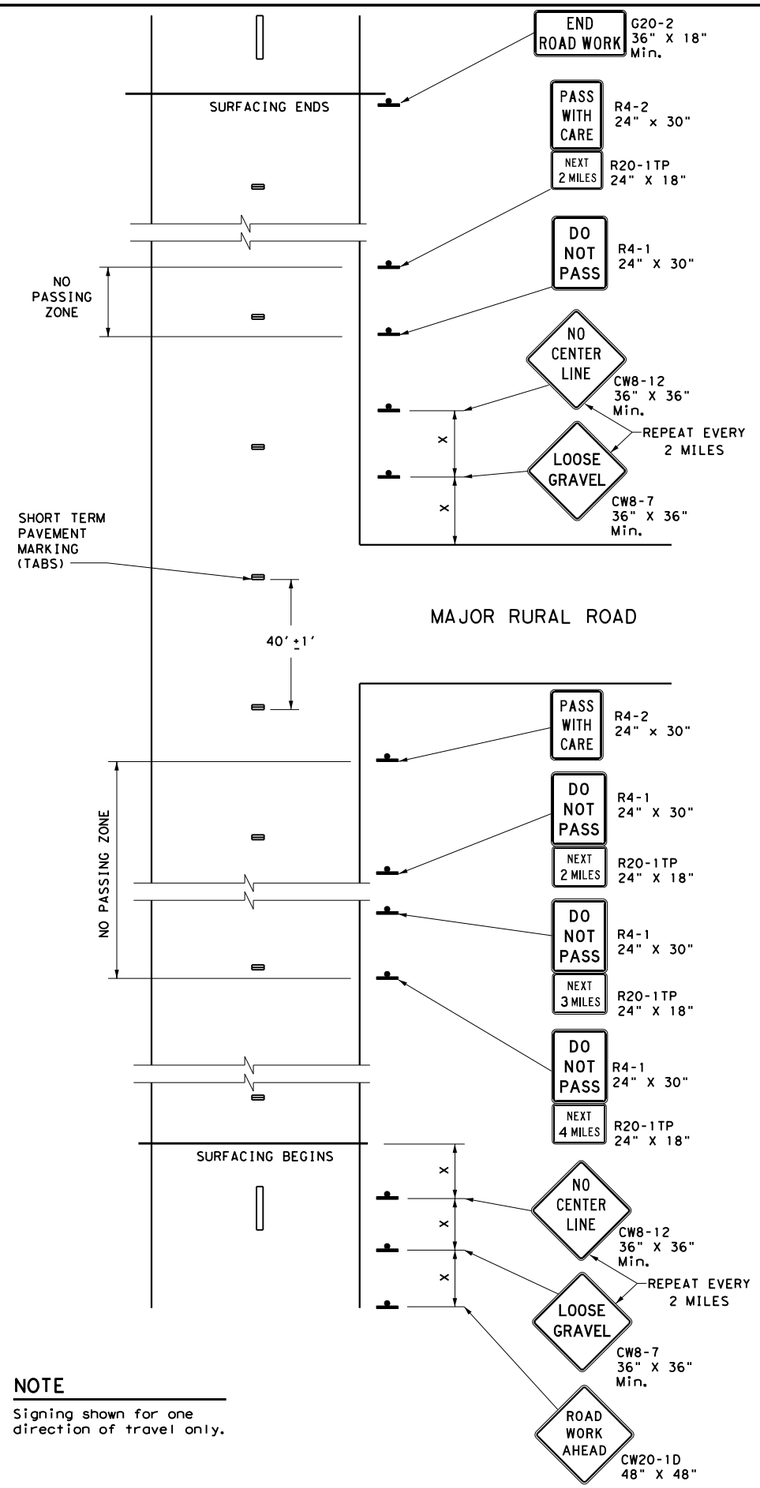

NOTE

Signing shown for one direction of travel only.

NO PASSING ZONES ON TWO-LANE TWO-WAY ROADS

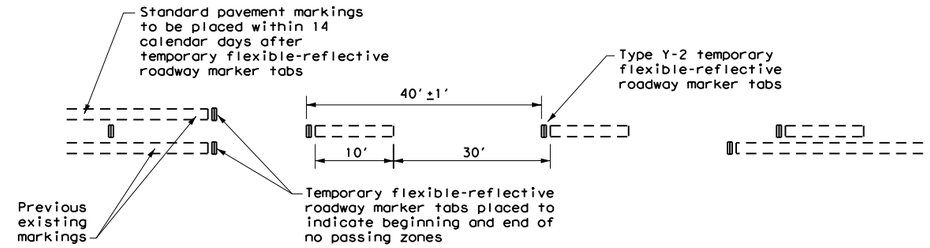

TABS ON CENTERLINES OF TWO-LANE TWO-WAY ROADS

For seal coat, micro-surface or similar operations

"DO NOT PASS" SIGN (R4-1) and NO-PASSING ZONES

A. Prior to the beginning of construction, all currently striped no-passing zones shall be signed with the DO NOT PASS (R4-1) signs and PASS WITH CARE (R4-2) signs placed at the beginning and end of each zone for each direction of travel except as otherwise provided herein. Signs marking these individual no-passing zones need not be covered prior to construction if the signs supplement the existing pavement markings.

B. At the discretion of the Engineer, in areas of numerous no-passing zones, several zones may be combined as a single zone. If passing is to be prohibited over one or more lengthy sections, a DO NOT PASS sign and a NEXT XX MILES (R20-1TP) plaque may be used at the beginning of such zones. The DO NOT PASS sign and the NEXT XX MILES plaque should be repeated every mile to the end of the no-passing zone. In areas where there is considerable distance between no-passing zones, the end of the no-passing zone may be signed with a PASS WITH CARE sign and a NEXT XX MILES plaque.

C. Depending on traffic volumes and length of sections, it may be desirable to prohibit passing throughout the project to prevent damage to windshield and lights. The DO NOT PASS sign and NEXT XX MILES plaque should be used and repeated as often as necessary for this purpose. Where several existing zones are to be combined into one idividual no-passing zone, the sign at the beginning of the zone should be covered until the surfacing operation has passed this location so as not to have the DO NOT PASS sign conflict with the existing pavement markings. Also, unless one days operation completes the entire length of such combined zones, appropriate DO NOT PASS and PASS WITH CARE signs should be placed at the beginning and end of the no-passing zones where the surfacing operation has stopped for the day.

D. R4-1 and R4-2 are to remain in place until standard pavement markings are installed.

"NO CENTER LINE" SIGN (CW8-12)

A. Center line markings are yellow pavement markings that delineate the separation of travel lanes that have opposite directions of travel on a roadway. Divided highways do not typically have center line markings.

B. At the time construction activity obliterates the existing center line markings(low volume roads may not have an existing centerline), a NO CENTER LINE (CW8-12) sign should be erected at the beginning of the work area, at approximately 2 mile intervals within the work area, beyond major intersections and other locations deemed necessary by the Engineer.

C. The NO CENTER LINE signs are to remain in place until standard pavement markings are installed.

"LOOSE GRAVEL" SIGN (CW8-7)

A. When construction begins, a LOOSE GRAVEL (CW8-7) sign should be erected at each end of the work area and repeated at intervals of approximately 2 miles in rural areas and closer in urban areas.

B. The LOOSE GRAVEL signs are to remain in place until the condition no longer exists.

PAVEMENT MARKINGS

A. Temporary markings for surfacing projects shall be Temporary Flexible-reflective Roadway Marker Tabs unless otherwise approved by the Engineer. Tabs are to be installed to provide true alignment for striping crews or as directed by the Engineer. Tabs will be placed at the spacing indicated. Tabs should be applied to the pavement
no more than two (2) days before the surfacing is applied. After the surfacing is rolled and swept, the cover over the reflective strip shall be removed.

B. Tabs shall not be used to simulate edge lines.

C. Tab placement for overlay/inlay operations shall be as shown on the WZ(STPM) standard sheet.

COORDINATION OF SIGN LOCATIONS

A. The location of warning signs at the beginning and end of a work area are to be coordinated with other signing typically shown on the Barricade and Construction Standards for project limits to ensure adequate sign spacing.

B. Where possible the ROAD WORK AHEAD (CW20-1D), LOOSE GRAVEL (CW8-7), and NO CENTER LINE (CW8-12) signs should be placed in the sequence shown following the OBEY WARNING SIGNS STATE LAW (R20-3T) and the TRAFFIC FINES DOUBLE (R20-5T) sign, and one "X" sign spacing prior to the CONTRACTOR (G20-6T)sign typically located at or near the limits of surfacing. LOOSE GRAVEL and NO CENTER LINE signs will then be repeated as described above.

Posted Speed *	Minimum Sign Spacing "X" Distance
30	120'
35	160'
40	240'
45	320'
50	400'
55	500'
60	600'
65	700'
70	800'
75	900'

* Conventional Roads Only

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
			✓	✓

GENERAL NOTES

1. The traffic control devices detailed on this sheet will be furnished and erected as directed by the Engineer on sections of roadway where tabs must be placed prior to the surfacing operation which will cover or obliterate the existing pavement markings.
2. The devices shown on this sheet are to be used to supplement those required by the BC Standards or others required elsewhere in the plans.
3. Signs shall be erected as detailed on the BC Standards or the Compliant Work Zone Traffic Control Devices List (CWZTCD) on supports approved for Long-Term / Intermediate-Term Work Zone Sign Supports.
4. When surfacing operations take place on divided highways, freeways or expressways, the size of diamond shaped construction warning signs shall be 48" x 48".
5. Signs on divided highways, freeways and expressways will be placed on both right and left sides of the roadway based on roadway conditions as directed by the Engineer.

Texas Department of Transportation — Traffic Operations Division Standard

TRAFFIC CONTROL DETAILS FOR SURFACING OPERATIONS


TCP(7-1)-13

FILE: tcp7-1.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT March 1991	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
4-92 4-98	DIST	COUNTY		SHEET NO.
1-97 7-13	AUS	WILLIAMSON		28


210

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

12/21/2017 9:16:59 PM
H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\wzbrk.dgn

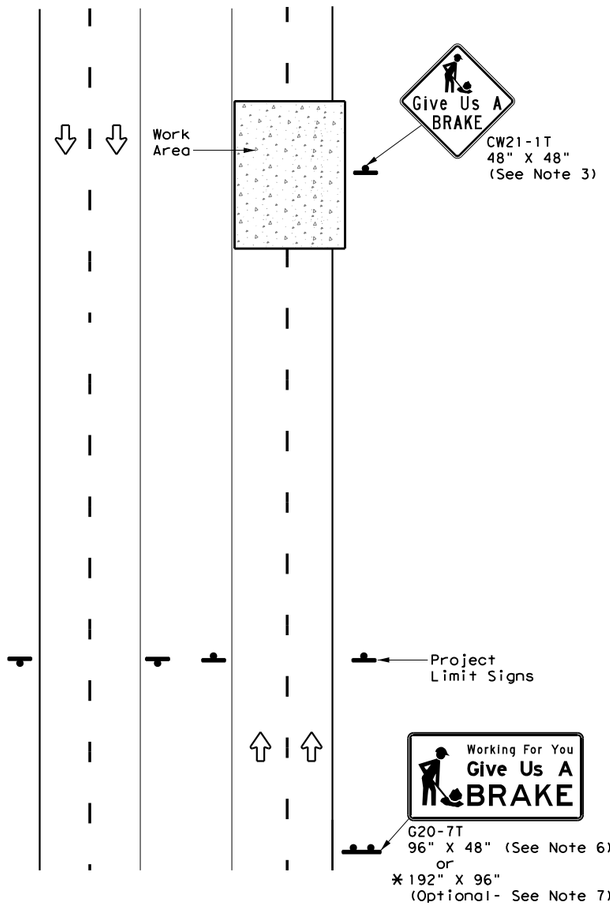

DIVIDED HIGHWAY

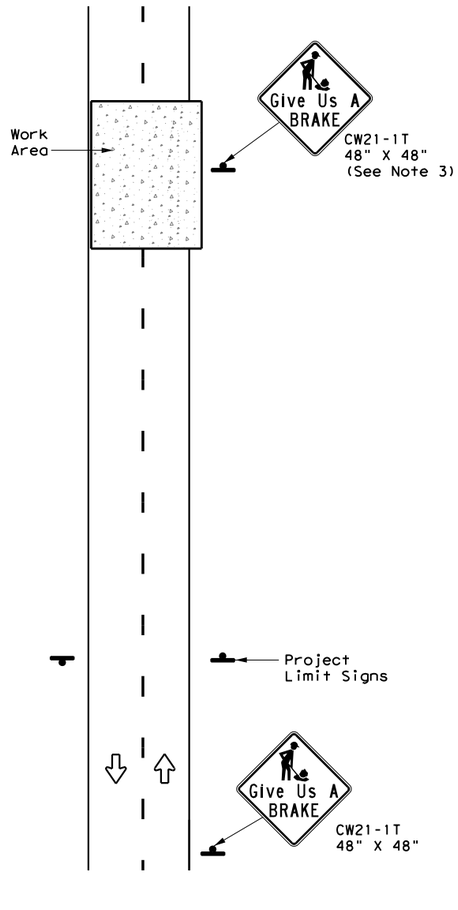

UNDIVIDED HIGHWAY

SIGNS ARE SHOWN FOR ONE DIRECTION OF TRAVEL

* When the optional larger WORKING FOR YOU GIVE US A BRAKE (G20-7T) 192" x 96" sign is required, the locations shall be noted elsewhere in the plans.

SUMMARY OF LARGE SIGNS

BACKGROUND COLOR	SIGN DESIGNATION	SIGN	SIGN DIMENSIONS	REFLECTIVE SHEETING	SQ FT	GALVANIZED STRUCTURAL STEEL			DRILLED SHAFT 24" DIA. (LF)
						Size	(LF) ①	(LF) ②	
Orange	G20-7T	Working For You Give Us A BRAKE	96" X 48"	Type B_{FL} or C_{FL}	32	▲	▲	▲	▲
Orange	G20-7T	Working For You Give Us A BRAKE	192" X 96"	Type B_{FL} or C_{FL}	128	W8x18	16	17	12

▲ See Note 6 Below

LEGEND	
	Sign
	Large Sign
	Traffic Flow

DEPARTMENTAL MATERIAL SPECIFICATIONS

PLYWOOD SIGN BLANKS	DMS-7100
ALUMINUM SIGN BLANKS	DMS-7110
SIGN FACE MATERIALS	DMS-8300

COLOR	USAGE	SHEETING MATERIAL
ORANGE	BACKGROUND	TYPE B_{FL} OR TYPE C_{FL}
BLACK	LEGEND & BORDERS	NON-REFLECTIVE ACRYLIC FILM

GENERAL NOTES

1. See BC and SMD sheets for additional sign support details.
2. Sign locations shall be approved by the Engineer.
3. For projects more than two miles in length, Give Us a BRAKE signs should be repeated halfway through the project. The Give Us a Brake (CW21-1T) may be used for this purpose.
4. Work zone speed limits are sometimes used in conjunction with GIVE US A BRAKE signing. See BC(3) for location and spacing of construction speed zone signing when required.
5. Give Us a Brake (CW21-1T) signs and supports shall be considered subsidiary to Item 502, "Barricades, Signs and Traffic Handling."
6. The 96" X 48" Working For You Give Us A BRAKE (G20-7T) may use a 1/2" or 5/8" plywood substrate or 0.125" aluminum sheeting substrate and may be supported by two 4" x 6" wood posts with drilled holes for breakaway as per BC(5) and will be subsidiary to Item 502.
7. The Working For You Give Us A BRAKE (G20-7T) 192" X 96" sign shall be paid for under the following specification items:
   Item 636 - Aluminum Signs
   Item 647 - Large Roadside Sign Supports and Assemblies.
   Item 416 - Drilled Shaft Foundations
8. All signs shall be constructed in accordance with the details found in the "Standard Highway Sign Designs for Texas," latest edition. Sign details not shown in this manual shall be shown in the plans or the Engineer shall provide a detail to the Contractor before the sign is manufactured.

Texas Department of Transportation

Traffic Operations Division Standard

WORK ZONE "GIVE US A BRAKE" SIGNS

WZ(BRK)-13

FILE: wzbrk-13.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT August 1995	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
6-96 5-98 7-13	DIST	COUNTY		SHEET NO.
8-96 3-03	AUS	WILLIAMSON		29


116

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:16:59 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\WZRS16.dgn


Warning sign and rumble strip sequence in opposite direction is same as below

TABLE 1		
Flagger to Flagger (Length of Work Area)	ADT	# of Rumble Strip Arrays
1/8 Mile	< 4,500	1
	≥ 4,500	2
1/4 Mile	< 3,500	1
	≥ 3,500	2
1/2 Mile	< 2,600	1
	≥ 2,600	2
1 Mile	< 1,600	1
	≥ 1,600	2
> 1 Mile	N/A	2

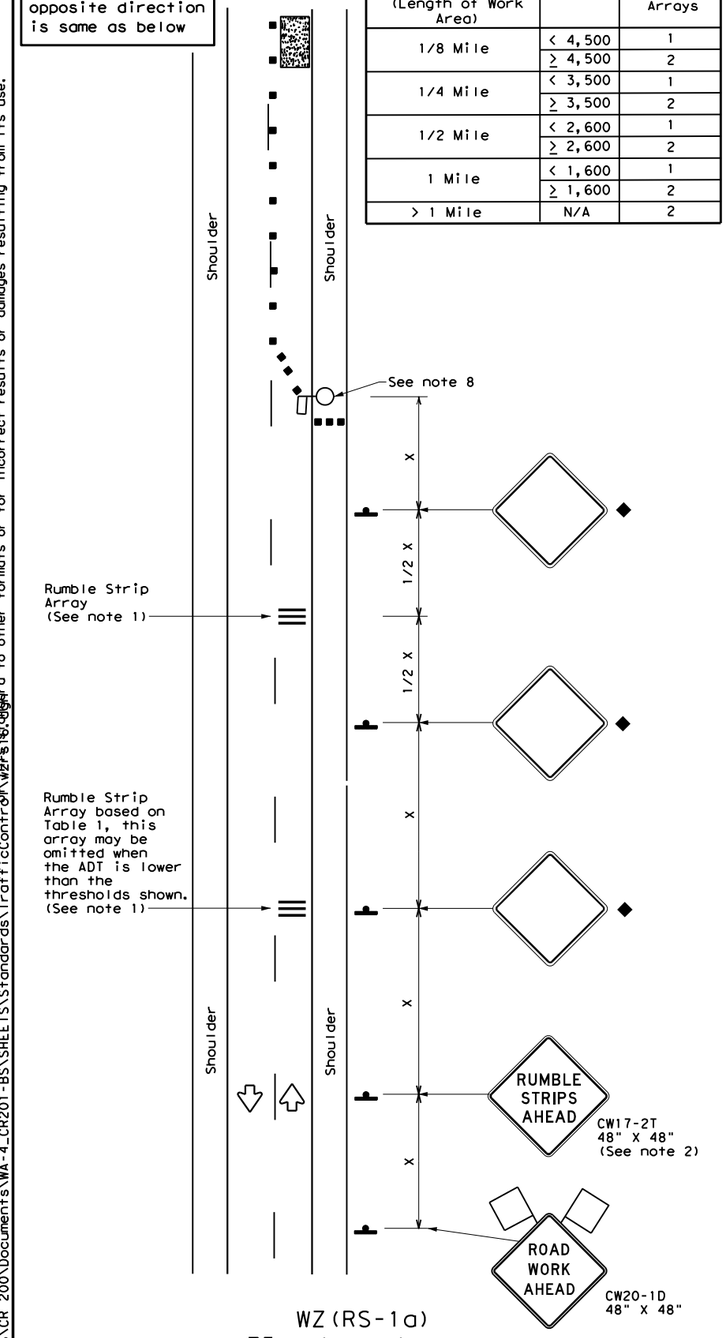

WZ(RS-1a)
75 mph or Less

RUMBLE STRIPS ON ONE-LANE TWO-WAY APPLICATION

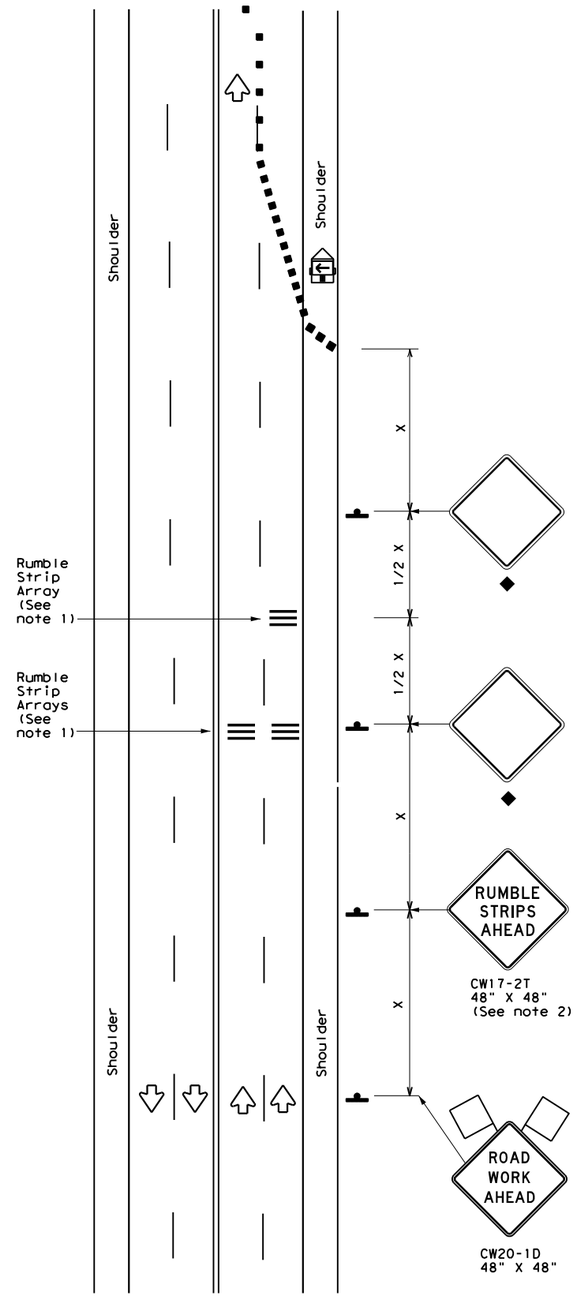

WZ(RS-1b)
75 mph or Less

RUMBLE STRIPS FOR LANE CLOSURE ON CONVENTIONAL ROADWAY

GENERAL NOTES

1. Each Rumble Strip Array should consist of three rumble strips spaced center to center at the spacing shown in Table 2, placed transverse across the lane at locations shown.
2. The CW17-2T "RUMBLE STRIPS AHEAD" sign should be located after the CW20-1D "ROAD WORK AHEAD sign and spaced as shown. If traffic is observed to be queuing, or is expected to queue beyond the Rumble Strips, the CW17-2T sign and the first Rumble Strip Array may be located upstream of the CW20-1D sign as necessary to provide needed warning.
3. Temporary Rumble Strips will be considered subsidiary to Item 502, and shall be a product listed on the Compliant Work Zone Traffic Control Devices.
4. Removal of the Temporary Rumble Strips should be accomplished before removing the advance warning signs.
5. Temporary Rumble Strips should not be used on horizontal curves, loose gravel, soft or bleeding asphalt, heavily rutted pavements or unpaved surfaces.
6. Temporary Rumble Strips shall be installed and maintained as per manufacturer's recommendations.
7. This standard sheet shall be used in conjunction with other appropriate TCP standard, TMUTCD typical application or project specific detail for the project.
8. The one-lane two-way application may utilize a flagger, an AFAD or a portable traffic signal.
9. Temporary Rumble Strips may be used on freeways or expressways based on engineering judgment.

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Panel	(M)	Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths ** 10' Offset	11' Offset	12' Offset	Suggested Maximum Spacing of Channelizing Devices On a Taper	On a Tangent	Minimum Sign Spacing "X" Distance	Suggested Longitudinal Buffer Space "B"
30	$L=\frac{WS^2}{60}$	150'	165'	180'	30'	60'	120'	90'
35		205'	225'	245'	35'	70'	160'	120'
40		265'	295'	320'	40'	80'	240'	155'
45	L=WS	450'	495'	540'	45'	90'	320'	195'
50		500'	550'	600'	50'	100'	400'	240'
55		550'	605'	660'	55'	110'	500'	295'
60		600'	660'	720'	60'	120'	600'	350'
65		650'	715'	780'	65'	130'	700'	410'
70		700'	770'	840'	70'	140'	800'	475'
75		750'	825'	900'	75'	150'	900'	540'

* Conventional Roads Only

** Taper lengths have been rounded off.
L=Length of Taper(FT) W=Width of Offset(FT)
S=Posted Speed(MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓		

◆ Signs are for illustrative purposes only. Signs required may vary depending on the TCP, TMUTCD Typical Application, or project specific details for the project.

TABLE 2	
Speed	Approximate distance between strips in an Array
≤ 40 MPH	10'
> 40 MPH & ≤ 55 MPH	15'
> 55 MPH	20'

Texas Department of Transportation

Traffic Operations Division Standard

TEMPORARY RUMBLE STRIPS

WZ(RS)-16

FILE: wzrs16.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT November 2012	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
2-14	DIST	COUNTY		SHEET NO.
4-16	AUS	WILLIAMSON		30

118


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

12/21/2017 9:17:00 PM
H:\OBESCR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\wzstpm.dgn


WORK ZONE SHORT TERM PAVEMENT MARKINGS DETAILS

SOLID LINES

DOUBLE NO-PASSING LINE

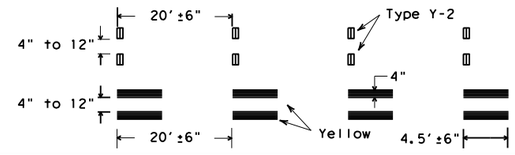


SINGLE NO-PASSING LINE or CHANNELIZATION LINE

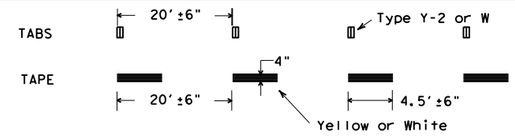


BROKEN LINES

(FOR CENTER LINE OR LANE LINE)

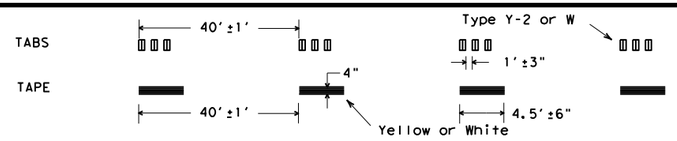


WIDE DOTTED LINES

(FOR LANE DROP LINES)

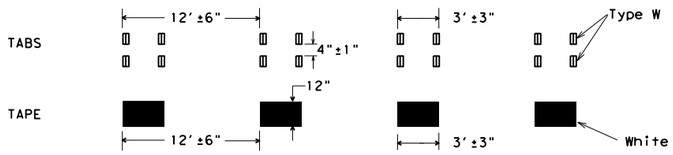

WIDE GORE MARKINGS

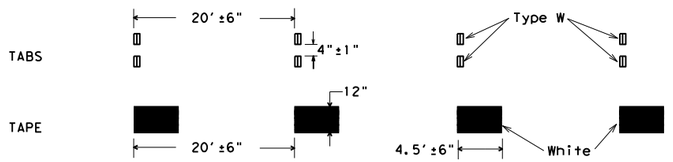


NOTES:

1. Short term pavement markings may be prefabricated markings (stick down tape) or temporary flexible-reflective roadway marker tabs unless otherwise specified elsewhere in plans.
2. Short term pavement markings shall NOT be used to simulate edge lines.
3. Dimensions indicated on this sheet are typical and approximate. Variations in size and height may occur between markers or devices made by manufacturers, by as much as 1/4 inch, unless otherwise noted.
4. Temporary flexible-reflective roadway marker tabs will require normal maintenance replacement when used on roadways with an ADT per lane of up to 7500 vehicles with no more than 10% truck mix. When roadways exceed these values, additional maintenance replacement of devices should be planned.
5. No segment of roadway open to traffic shall remain without permanent pavement markings for a period greater than 14 calendar days. The Contractor will be responsible for maintaining short term pavement markings until permanent pavement markings are in place. When the Contractor is responsible for placement of permanent pavement markings, no segment of roadway shall remain without permanent pavement markings for a period greater than 14 calendar days unless weather conditions prohibit placement. Permanent pavement markings shall be placed as soon as weather permits.
6. For two lane, two-way roadways, DO NOT PASS signs shall be erected to mark the beginning of sections where passing is prohibited and PASS WITH CARE signs shall be erected to mark the beginning of sections where passing is permitted. Signs shall be in accordance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) and may be used to indicate the limits of no-passing zones for up to 14 calendar days. Permanent pavement markings should then be placed.
7. For low volume two lane, two-way roadways of 4000 ADT or less, no-passing lines may be omitted when approved by the Engineer. DO NOT PASS and PASS WITH CARE signs shall be erected (see note 6).
8. For exit gores where a lane is being dropped place wide gore markings or retroreflective channelizing devices to guide motorist through the exit. If channelizing devices are to be used it should be noted elsewhere in the plans. One piece cones are not allowed for this purpose.


TEMPORARY FLEXIBLE, REFLECTIVE ROADWAY MARKER TABS (TABS)

1. Temporary flexible-reflective roadway marker tabs detailed on this sheet will be designated Type Y-2 (two amber reflective surfaces with yellow body); Type Y (one amber reflective surface with yellow body); and Type W (one white or silver reflective surface with white body). Additional details may be found on BC(11).
2. Tabs shall meet requirements of Departmental Material Specification DMS-8242.
3. When dry, tabs shall be visible for a minimum distance of 200 feet during normal daylight hours and when illuminated by automobile low-beam head light at night, unless sight distance is restricted by roadway geometrics.
4. No two consecutive tabs nor four tabs per 1000 feet of line shall be missing or fail to meet the visual performance requirements of Note 3.


WORK ZONE SHORT TERM PAVEMENT MARKINGS PATTERNS

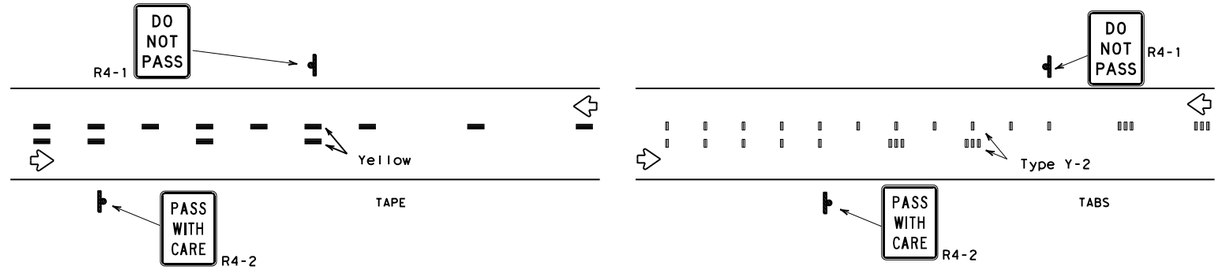


CENTER LINE & NO-PASSING ZONE BARRIER LINES FOR TWO LANE TWO-WAY HIGHWAYS

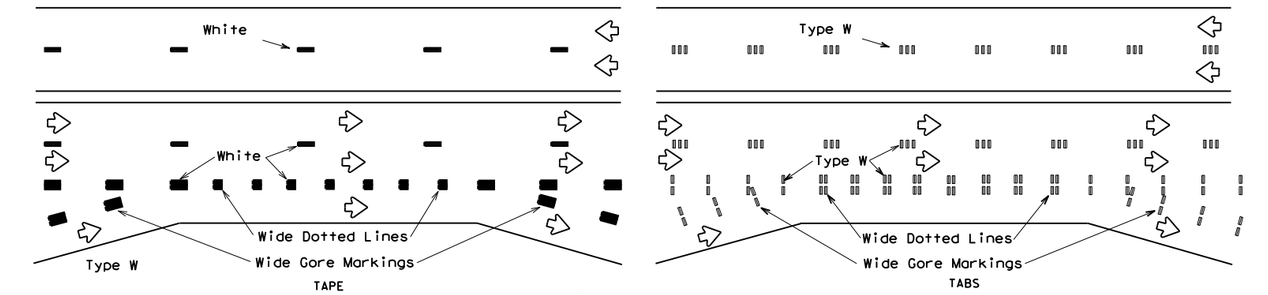


LANE LINES FOR DIVIDED HIGHWAY

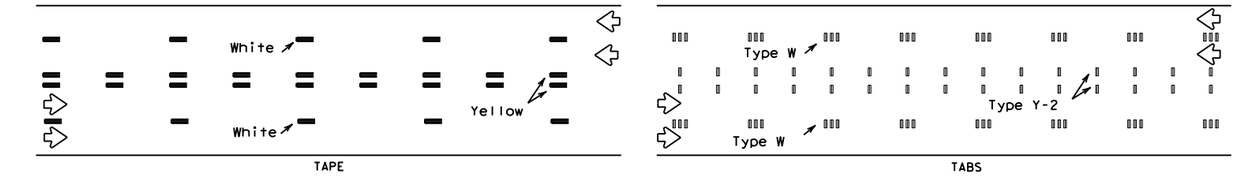

LANE & CENTER LINES FOR MULTILANE UNDIVIDED HIGHWAYS

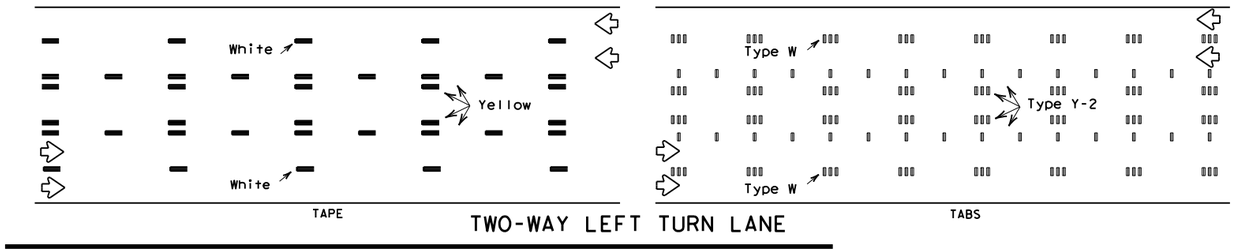

TWO-WAY LEFT TURN LANE



If raised pavement markers are used to supplement REMOVABLE short term markings, the markers shall be applied to the top of the tape at the approximate mid length of the tape. This allows an easier removal of raised markers and tape.

PREFABRICATED PAVEMENT MARKINGS

1. Temporary Removable Prefabricated Pavement Markings shall meet the requirements of DMS-8241.
2. Non-removable Prefabricated Pavement Markings shall meet the requirements of either DMS-8240 "Permanent Prefabricated Pavement Markings" or DMS-8243 "Temporary Costruction-Grade Prefabricated Pavement Markings."

RAISED PAVEMENT MARKERS

1. All raised pavement markers used for work zone markings shall meet the requirements of Item 672, "RAISED PAVEMENT MARKERS" and DMS-4200.

DEPARTMENTAL MATERIAL SPECIFICATIONS (DMS) & MATERIAL PRODUCER LISTS (MPL)

1. DMSs referenced above can be found along with embedded links to their respective MPLs at the following website:
   http://www.txdot.gov/business/contractors_consultants/material_specifications/default.htm

Texas Department of Transportation

Traffic Operations Division Standard

WORK ZONE SHORT TERM PAVEMENT MARKINGS


WZ(STPM)-13

FILE: wzstpm-13.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT April 1992	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
1-97	DIST	COUNTY		SHEET NO.
3-03	AUS	WILLIAMSON		31
7-13				


111

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 12/21/2017 9:17:00 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\TrafficControl\WZUL13.dgn

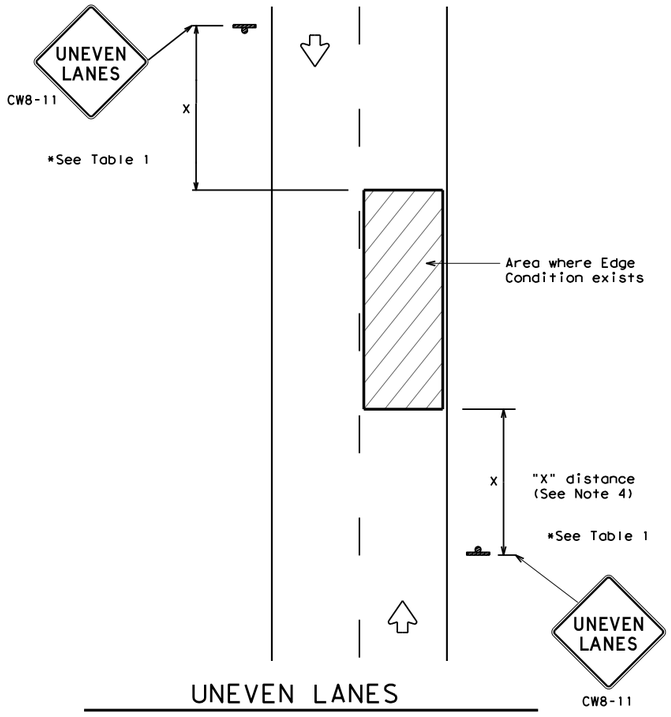


UNEVEN LANES
TWO LANE CONVENTIONAL ROAD

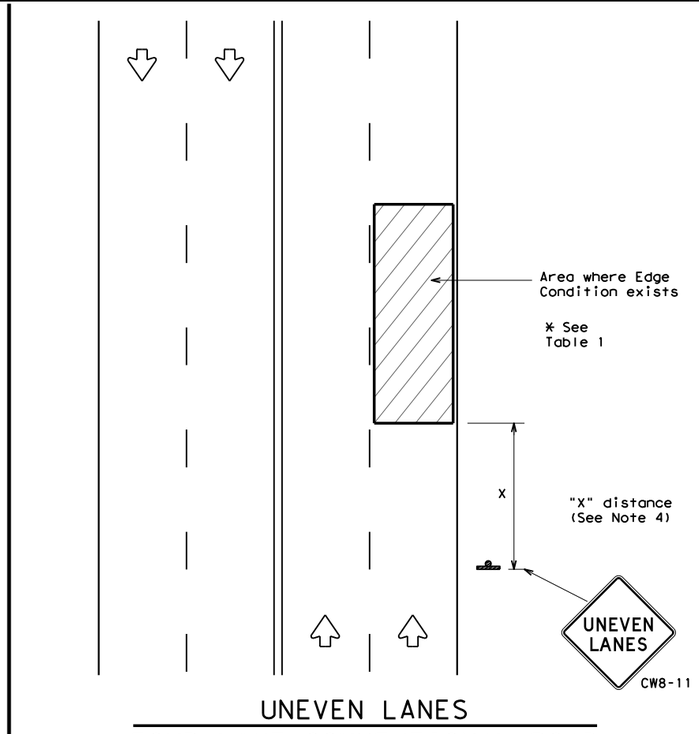

UNEVEN LANES
FOUR LANE CONVENTIONAL ROAD

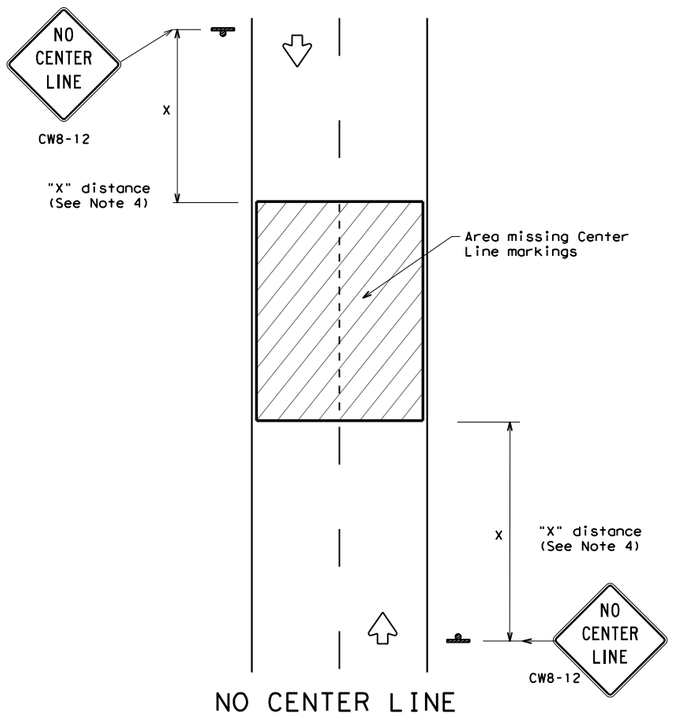

NO CENTER LINE
TWO LANE CONVENTIONAL ROAD

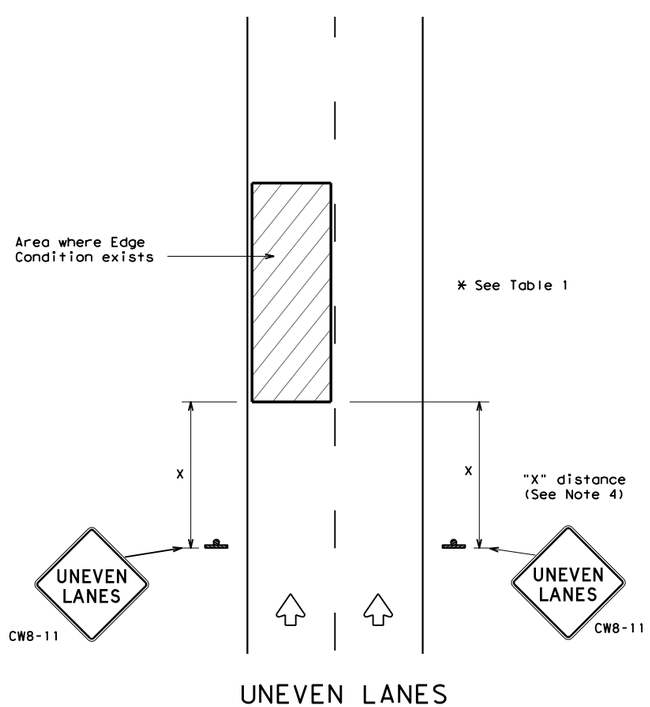

UNEVEN LANES
DIVIDED ROADWAY




DEPARTMENTAL MATERIAL SPECIFICATIONS	
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240
TEMPORARY (REMOVABLE) PREFABRICATED PAVEMENT MARKINGS	DMS-8241
SIGN FACE MATERIALS	DMS-8300

COLOR	USAGE	SHEETING MATERIAL
ORANGE	BACKGROUND	TYPE B_{FL} OR TYPE C_{FL} SHEETING
BLACK	LEGEND & BORDERS	ACRYLIC NON-REFLECTIVE SHEETING

GENERAL NOTES

1. If spalling or holes occur, ROUGH ROAD (CW8-8) signs should be placed in advance of the condition and be repeated every two miles where the condition persists.
2. UNEVEN LANES (CW8-11) signs shall be installed in advance of the condition and repeated every mile. Signs installed along the uneven lane condition may be supplemented with the NEXT XX MILES (CW7-3aP) plaque or Advisory Speed (CW13-1P) plaque.
3. NO CENTER LINE (CW8-12) signs and temporary pavement markings as per the WZ(STPM) standard shall be installed if yellow centerlines separating two way traffic are obscured or obliterated. Repeat NO CENTER LINE signs every two miles where the center line markings are not in place. The signs and markings shall remain in place until permanent pavement markings are installed.
4. Signs shall be spaced at the distances recommended as per BC standards.
5. Additional signs may be required as directed by the Engineer. Signs shall remain in place until final surface is applied. Signs shall be considered subsidiary to Item 502 "BARRICADES, SIGNS AND TRAFFIC HANDLING."
6. Signs shall be fabricated and mounted on supports as shown on the BC standards and/or listed on the "Compliant Work Zone Traffic Control Devices" list.
7. Short term markings shall not be used to simulate edge lines.
8. All signs shall be constructed in accordance with the details found in the "Standard Highway Sign Designs for Texas," latest edition.

TABLE 1

Edge Condition	Edge Height (D)	* Warning Devices
① 	Less than or equal to: 1¼" (maximum-planing) 1½" (typical-overlay)	Sign: CW8-11
	Distance "D" may be a maximum of 1 1/4 " for planing operations and 2" for overlay operations if uneven lanes with edge condition 1 are open to traffic after work operations cease.	
② 	Less than or equal to 3"	Sign: CW8-11
③  Notched Wedge Joint	Distance "D" may be a maximum of 3" if uneven lanes with edge condition 2 or 3 are open to traffic after work operations cease. Uneven lanes should not be open to traffic when "D" is greater than 3".	

TRAFFIC CONTROL DURING PLANING, OVERLAY AND LEVELING OPERATIONS ARE SHOWN ELSEWHERE IN THE PLANS.

MINIMUM WARNING SIGN SIZE	
Conventional roads	36" x 36"
Freeways/expressways, divided roadways	48" x 48"

Texas Department of Transportation

Traffic Operations Division Standard

SIGNING FOR UNEVEN LANES

WZ(UL)-13

FILE:	wzul-13.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT	April 1992	CONT	SECT	JOB	HIGHWAY
REVISIONS		TBD	TBD	TBD	CR 200
8-95 2-98 7-13		DIST	COUNTY		SHEET NO.
1-97 3-03		AUS	WILLIAMSON		32

112

HORIZONTAL ALIGNMENT DATA (CR200E)(PARTIAL)

Curve Data

Curve CR200E-12
P.I. Station 255+42.68 X 3,052,794.3201 Y 10,233,614.4741
Delta = 15° 45′ 35.64" (LT)
Degree = 7° 54′ 52.99"
Tangent = 100.1932
Length = 199.1214
Radius = 723.9141
External = 6.9007
Long Chord = 198.4943
Mid. Ord. = 6.8356
P.C. Station 254+42.49 X 3,052,819.0967 Y 10,233,517.3927
P.T. Station 256+41.61 X 3,052,744.1070 Y 10,233,701.1766
C.C. X 3,052,117.6658 Y 10,233,338.3776
Back = N 14° 19′ 01.45" W
Ahead = N 30° 04′ 37.10" W
Chord Bear = N 22° 11′ 49.27" W

Curve Data

Curve CR200E-13
P.I. Station 260+11.70 X 3,052,558.6324 Y 10,234,021.4337
Delta = 3° 09′ 51.48" (LT)
Degree = 1° 54′ 35.49"
Tangent = 82.8623
Length = 165.6824
Radius = 3,000.0000
External = 1.1441
Long Chord = 165.6614
Mid. Ord. = 1.1437
P.C. Station 259+28.84 X 3,052,600.1599 Y 10,233,949.7286
P.T. Station 260+94.52 X 3,052,513.2101 Y 10,234,090.7372
C.C. X 3,050,004.1011 Y 10,232,446.2397
Back = N 30° 04′ 37.10" W
Ahead = N 33° 14′ 28.58" W
Chord Bear = N 31° 39′ 32.84" W

Course from PT CR200E-13 to PC CR200E-14 N 33° 14′ 28.58" W Dist 59.8167

Curve Data

Curve CR200E-14
P.I. Station 263+44.57 X 3,052,376.1401 Y 10,234,299.8732
Delta = 12° 45′ 38.57" (RT)
Degree = 3° 22′ 04.29"
Tangent = 190.2354
Length = 378.8969
Radius = 1,701.2520
External = 10.6031
Long Chord = 378.1143
Mid. Ord. = 10.5374
P.C. Station 261+54.33 X 3,052,480.4206 Y 10,234,140.7661
P.T. Station 265+33.23 X 3,052,309.5787 Y 10,234,478.0841
C.C. X 3,053,903.2962 Y 10,235,073.3343
Back = N 33° 14′ 28.58" W
Ahead = N 20° 28′ 50.01" W
Chord Bear = N 26° 51′ 39.29" W

Course from PT CR200E-14 to PC CR200E-15 N 20° 28′ 50.01" W Dist 158.9107

Curve Data

Curve CR200E-15
P.I. Station 267+25.95 X 3,052,242.1470 Y 10,234,658.6250
Delta = 1° 32′ 59.05" (RT)
Degree = 2° 17′ 30.59"
Tangent = 33.8121
Length = 67.6200
Radius = 2,500.0000
External = 0.2286
Long Chord = 67.6180
Mid. Ord. = 0.2286
P.C. Station 266+92.14 X 3,052,253.9775 Y 10,234,626.9501
P.T. Station 267+59.76 X 3,052,231.1775 Y 10,234,690.6082
C.C. X 3,054,595.9549 Y 10,235,501.6739
Back = N 20° 28′ 50.01" W
Ahead = N 18° 55′ 50.95" W
Chord Bear = N 19° 42′ 20.48" W

Course from PT CR200E-15 to E1012 N 18° 55′ 50.95" W Dist 210.6718

Point E1012 X 3,052,162.8300 Y 10,234,889.8850 Sta 269+70.43

STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED
PROFESSIONAL ENGINEER

Daniel A. Rogers

12/18/2017

WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC — TBPE FIRM # 14060

Rogers Design Services Transportation Engineering — ROGERS DESIGN SERVICES FIRM # 9994


CR 200
AT BOLD SUNDOWN
HORIZONTAL ALIGNMENT DATA

SHEET 1 OF 1 | SHEET # 33

$$DATE,$$TIME
12/18/2017 2:14:18 PM
J:\Projects\CR 200\WA-44CR201-BS\SHEETS\General\CR200-WA4b-HAD.dgn

HORIZONTAL AND VERTICAL CONTROL DATA

POINT	X	Y	ELEV	DESC.
CTRL30	3,052,399.4500	10,234,322.2700	978.9400	TPT-IRSC
CTRL31	3,052,163.8900	10,234,788.3900	994.7300	TPT-IRSC

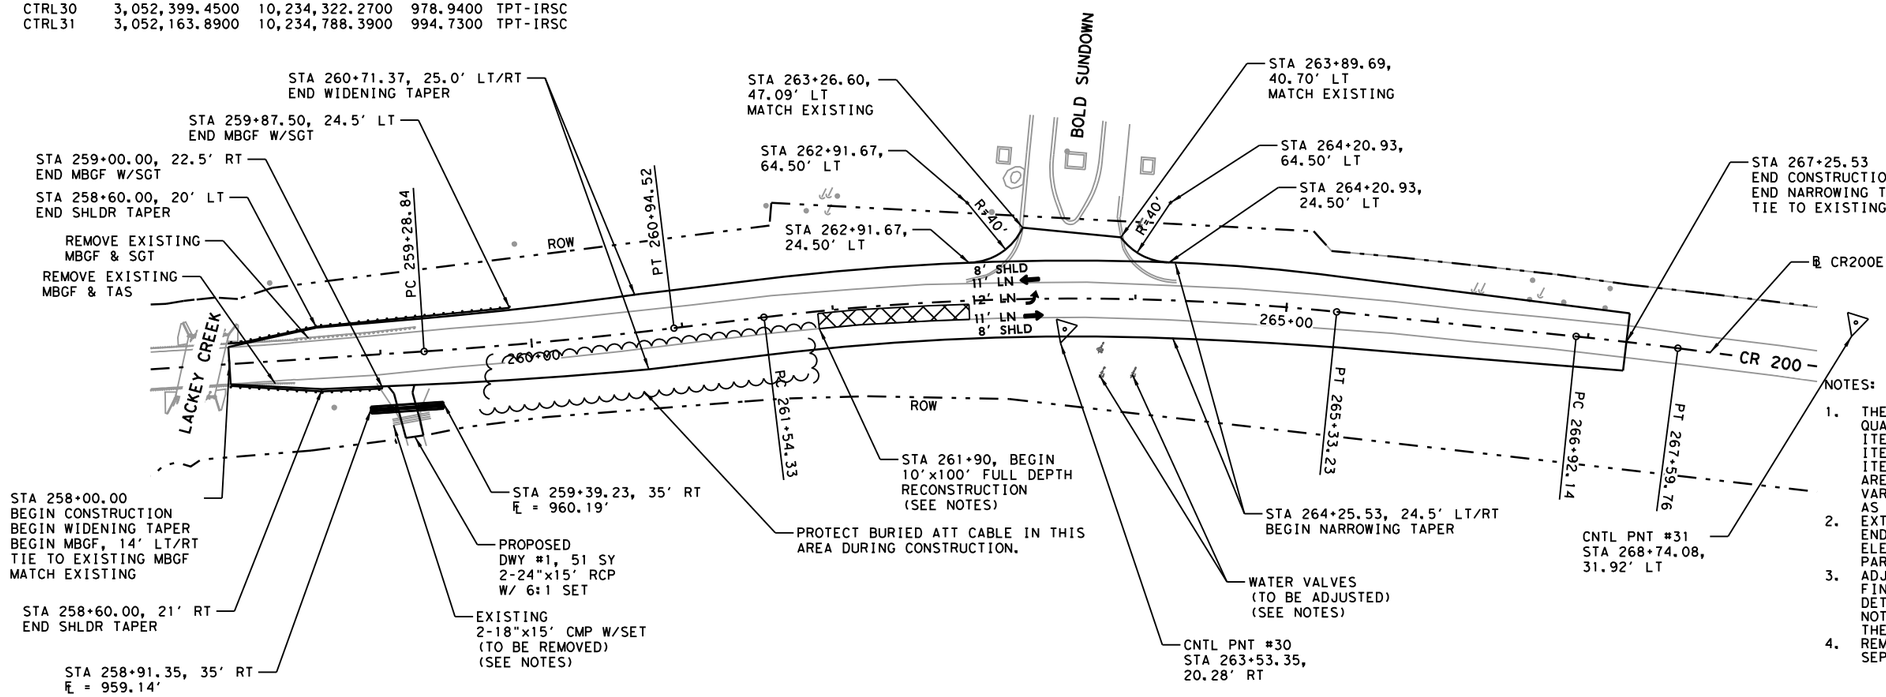



0 50 100
SCALE: 1"=100'

LEGEND:


AREA OF FULL DEPTH PAVEMENT REPAIR

NOTES:

1. THE FOLLOWING QUANTITIES WERE INCLUDED IN THE PROJECT QUANTITIES FOR PAVEMENT REPAIR:
   ITEM 110-6001 - EXCAVATION 47 CY
   ITEM 340-60XX - HMACP TY B 19 TON
   ITEM 340-60XX - HMACP TY D 13 TON
   AREA AND QUANTITY SHOWN ARE FOR ESTIMATING PURPOSES AND MAY VARY. REPAIR SHALL UTILIZE THE SAME PAVEMENT STRUCTURE AS THE WIDENING SECTION.
2. EXTEND FULL WIDTH OF S.E.T. HEADWALL APRON TO 5' BEYOND END OF PIPE AND SHAPE TO CONFORM AND MATCH DITCH ELEVATIONS. ADDITIONAL CONCRETE SHALL BE CONSIDERED PART OF PRICE BID FOR S.E.T. ITEM.
3. ADJUST EXISTING WATER VALVE COVERS TO MATCH PROPOSED FINISHED GRADE. UTILIZE VALVE COVER PLACEMENT PORTION DETAILS NOTED ON UTILITY DETAILS SHEET. THIS WORK SHALL NOT BE PAID FOR SEPARATELY AND CONSIDERED SUBSIDIARY TO THE PREP ROW ITEM.
4. REMOVAL OF EXISTING PIPE AND SET WILL NOT BE PAID FOR SEPARATELY, AND CONSIDERED SUBSIDIARY TO THE PREP ROW ITEM.

VERTICAL ALIGNMENT LAYOUT & DATA DEPICTED BELOW DERIVED FROM BEST FIT PROFILE MATCHING EXISTING ELEVATIONS.
FOR ADDITIONAL INFORMATION, REFER TO CROSS SECTIONS.
PROFILE SHOWN FOR INFORMATION ONLY.
NO MILLING OR OVERLAY PAVING OVER 2" IN THICKNESS ON EXISTING PAVEMENT PROPOSED FOR THIS PROJECT.

ALL BEARINGS ARE BASED ON THE TEXAS STATE PLANE COORDINATE SYSTEM, CENTRAL ZONE, NAD-83(93). ALL DISTANCES AND COORDINTES ARE ADJUSTED TO THE SURFACE BY THE PROJECT SURFACE ADJUSTMENT FACTOR OF 0.99985.

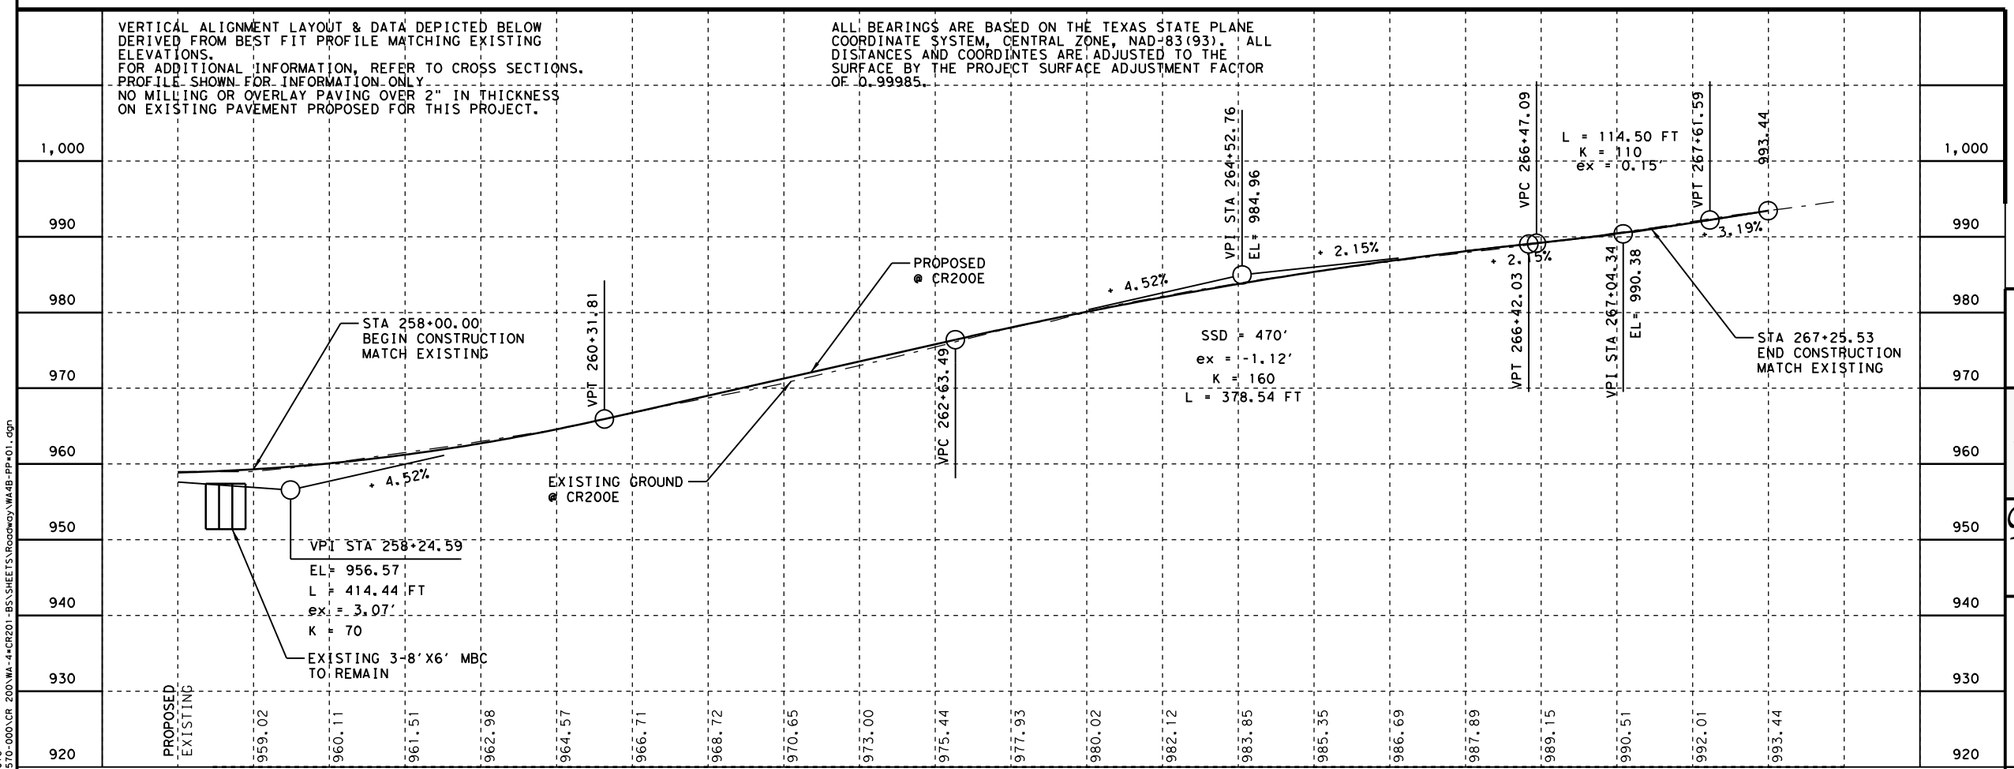



3/13/2018

WILLIAMSON COUNTY PRECINCT #2


O'BRIEN Engineering Services LLC — TBPE FIRM # 14060

Rogers Design Services Transportation Engineering — ROGERS DESIGN SERVICES FIRM # 9994


CR 200
AT BOLD SUNDOWN
PLAN AND PROFILE
STA 258+00.00 TO STA 267+25.53

SHEET 1 OF 1 | SHEET # 34

$$PLTDRVS$
3:34:10 AM
3/13/2018
601570-000\CR 200\WA-4-CR201-BS\SHEETS\Roadway\WA4B-PP-01.dgn

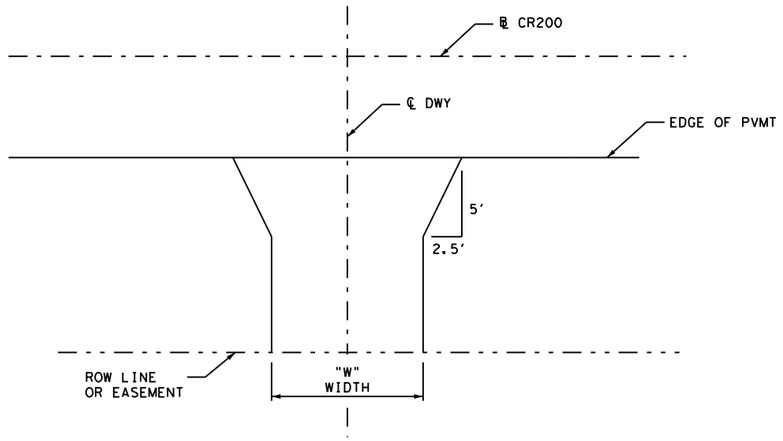

TYPICAL ASPHALT DRIVEWAY PLAN
CR 200

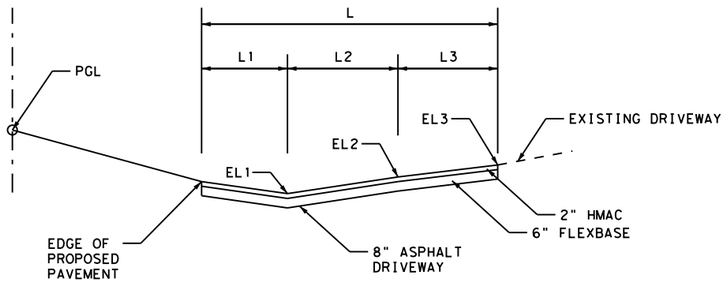

TYPICAL ASPHALT DRIVEWAY PROFILE

SUMMARY OF DRIVEWAY DETAILS

P&P SHEET NO.	DRIVEWAY ID	CL STATION	RT/LT	W (FT)	L (FT)	RDWY GRADE (%)	EOP ELEV (FT)	L1 (FT)	EL1 (FT)	GRADE1 (%)	L2 (FT)	EL2 (FT)	GRADE2 (%)	L3 (FT)	ELEV 3 (FT)	GRADE3 (%)	APSH DWY (SY)	CULV
1	DWY 1	259+10.50	RT	12.00	34.0	-2.0	961.67	18.0	961.96	1.6	16.0	962.84	5.5				48	2-24"x15' RCP

STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED
PROFESSIONAL ENGINEER

12/18/2017

WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC — TBPE FIRM # 14060


Rogers Design Services Transportation Engineering — ROGERS DESIGN SERVICES FIRM # 9994

CR 200

DRIVEWAY DETAILS

SHEET 1 OF 1 | SHEET # 35

$$PLTDRVS$
12/18/2017 13:31 PM
C:\Users\Projects\CR 200\WA-4-CR201-BS\SHEETS\Driveways\WA4b-DWY-01.dgn

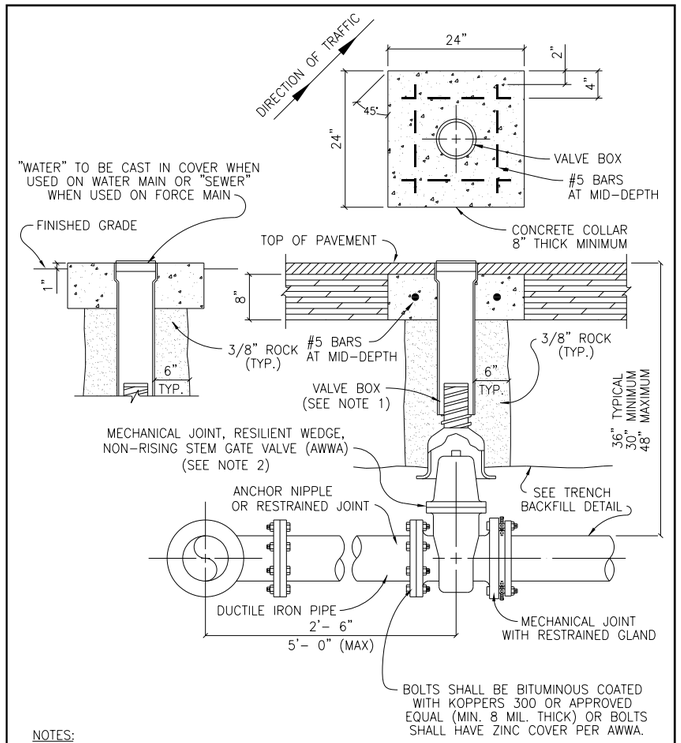

NOTES:

1. VALVE BOX SHALL BE 5 1/4" CAST IRON ADJUSTABLE HAVING AN ADJUSTABLE RANGE OF + OR - 6 INCHES FROM INSTALLED FINISH GRADE.
2. ACCEPTABLE GATE VALVES ARE:
   A. AMERICAN FLOW CONTROL - SERIES 2500
   B. MUELLER - 2360 SERIES
   C. CLOW

The Architect/Engineer assumes responsibility for appropriate use of this standard.


REVISION NOTE: ADOPTED 6/21/2006

GEORGETOWN TEXAS Georgetown Utility Systems Your Community Owned Utility

CITY OF GEORGETOWN
CONSTRUCTION STANDARDS AND DETAILS
TYPICAL VALVE SETTING

DRAWING NAME: W07

SCALE:	DATE:
NTS	1/2003
DRAWN BY:	APPROVED BY:
MRS	TRB

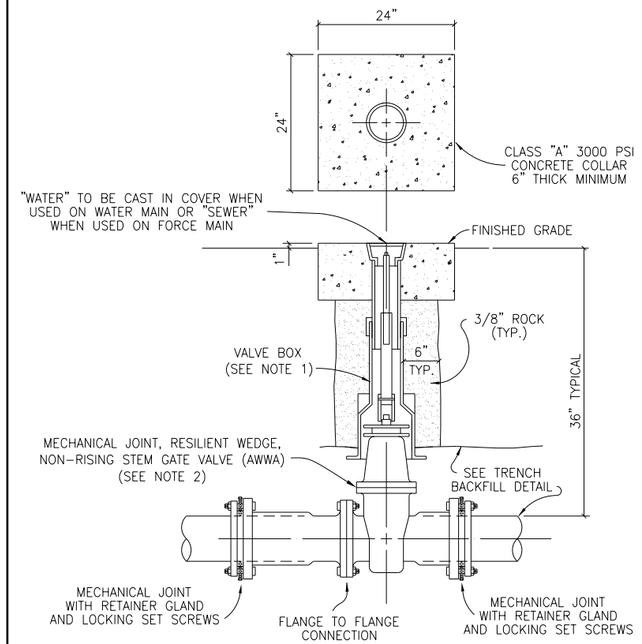

NOTES:

1. SEE VALVE SETTING DETAIL, DWG. #W-07.
2. ACCEPTABLE GATE VALVES ARE:
   A. MUELLER - 2360 SERIES
   B. CLOW

The Architect/Engineer assumes responsibility for appropriate use of this standard.

REVISION NOTE: ADOPTED 6/21/2006

GEORGETOWN TEXAS Georgetown Utility Systems Your Community Owned Utility

CITY OF GEORGETOWN
CONSTRUCTION STANDARDS AND DETAILS
INLINE VALVE INSTALLATION

DRAWING NAME: W21

SCALE:	DATE:
NTS	1/2003
DRAWN BY:	APPROVED BY:
MRS	TRB

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED PROFESSIONAL ENGINEER
12/21/2017

WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2

O'BRIEN LLC Engineering Services
TBPE FIRM # 14060


Rogers Design Services Transportation Engineering
ROGERS DESIGN SERVICES FIRM # 9994

CR 200
AT BOLD SUNDOWN

UTILITY DETAILS

SHEET 1 OF 1 | SHEET # 36


CR200 PDF - GS.pltcfg
3/15/2018 7:39 AM
12/21/2017 11:17:01 PM
C:\DGS\CR 200\Documents\WA-4\CR201-BS\SHEETS\Utilities\CR200-Util Details.dgn

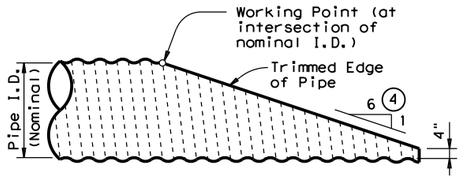


NOTE: All Cross Pipes, calculations, and dimensions are based on the pipe culverts mitered as shown in this detail. Alternate styles of mitered ends will require that appropriate adjustments be made to the values presented on this standard.

SIDE ELEVATION OF TYPICAL PIPE CULVERT MITER


(Showing Corrugated Metal Pipe Culvert.)
(Details at Concrete Pipe Culvert are similar.)

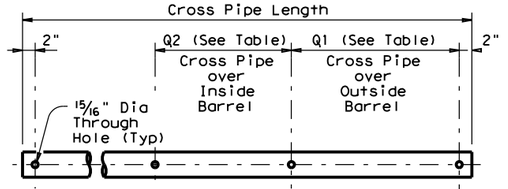


PIPE W/ BOLTED ANCHOR

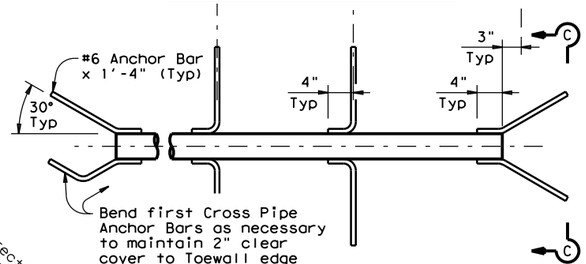

PIPE W/ ANCHOR BARS

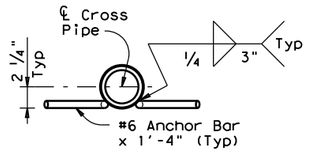


SECTION C-C

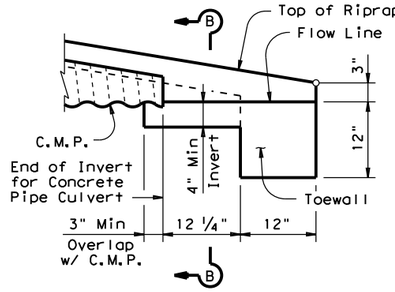

DETAIL "A"


(Showing Invert with Corrugated Metal Pipe Culvert. Concrete Pipe Culvert details are similar. Cross Pipes not shown for clarity.)

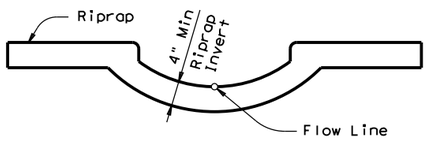


SECTION B-B

(Cross Pipes not shown for clarity.)

CROSS PIPE DETAILS

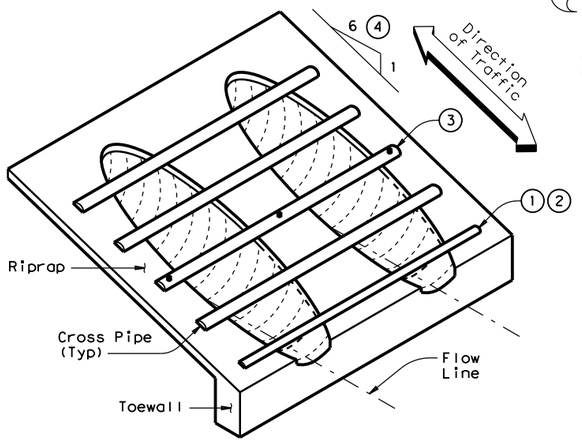


ISOMETRIC VIEW OF TYPICAL INSTALLATION

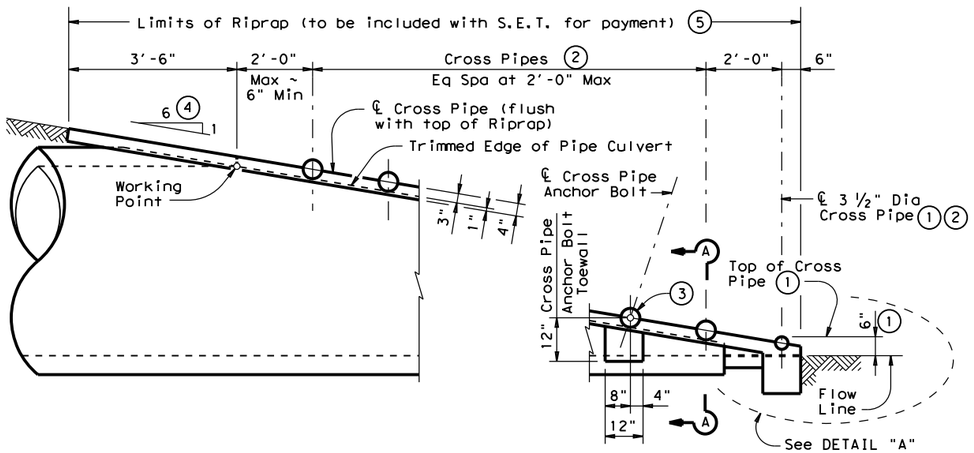


SIDE ELEVATION OF CAST-IN-PLACE CONCRETE

(Showing Concrete Pipe Culvert.)
(Details at Corrugated Metal Pipe Culvert are similar.)

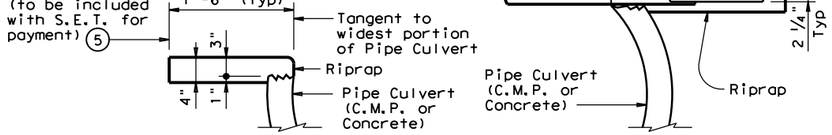

SHOWING TYPICAL PIPE CULVERT & RIPRAP

SHOWING CROSS PIPE WITH ANCHOR BAR

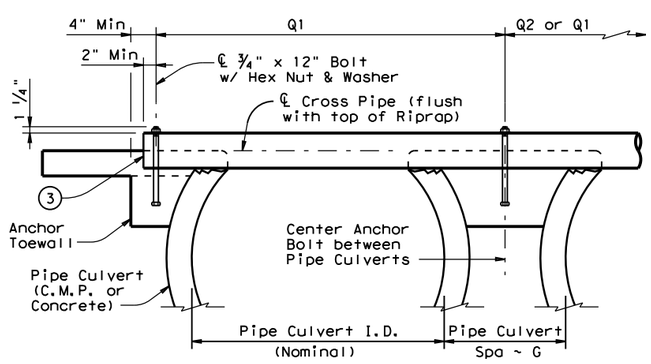

SHOWING CROSS PIPE WITH BOLTED ANCHOR

SECTION A-A

CROSS PIPE LENGTHS, REQUIRED PIPE SIZES, & RIPRAP QUANTITIES 2

Nominal Culvert I.D.	Conc Riprap (CY) 6	Pipe Culvert Spa ~ G	Single Barrel ~ Q1	Multi-Barrel ~ Q1	Q2	Conditions for use of Cross Pipes	Cross Pipe Size
12"	0.6	9"	N/A	2'- 1"	1'- 9"	3 or more Pipe Culverts	3" Std (3.500" O.D.)
15"	0.7	11"	N/A	2'- 5"	2'- 2"		
18"	0.8	1'- 2"	N/A	2'-10"	2'- 8"		
21"	0.9	1'- 4"	N/A	3'- 2"	3'- 1"		
24"	0.9	1'- 7"	N/A	3'- 6"	3'- 7"		
27"	1.0	1'- 8"	N/A	3'-10"	3'-11"	3 or more Pipe Culverts	3 1/2" Std (4.000" O.D.)
30"	1.1	1'-10"	N/A	4'- 2"	4'- 4"	2 or more Pipe Culverts	
33"	1.2	1'-11"	4'- 2"	4'- 5"	4'- 8"	All Pipe Culverts	
36"	1.3	2'- 1"	4'- 5"	4'- 9"	5'- 1"	All Pipe Culverts	4" Std (4.500" O.D.)
42"	1.5	2'- 4"	4'-11"	5'- 5"	5'-10"		
48"	1.7	2'- 7"	5'- 5"	6'- 0"	6'- 7"	All Pipe Culverts	5" Std (5.563" O.D.)
54"	2.0	3'- 0"	5'-11"	6'- 9"	7'- 6"		
60"	2.2	3'- 3"	6'- 5"	7'- 4"	8'- 3"		
66"	2.4	3'- 3"	6'-11"	7'-10"	8'- 9"		
72"	2.7	3'- 4"	7'- 5"	8'- 5"	9'- 4"		

1. The proper installation of the first Cross Pipe is critical for vehicle safety. The top of the first Cross Pipe must be placed at no more than 6" above the flow line.
2. Size of Cross Pipes, except the first bottom pipe, shall be as shown in the PIPE SIZE table. The first bottom pipe shall be 3 1/2" Standard Pipe (4" O.D.).
3. The third Cross Pipe from the bottom of the Culvert shall always be installed using a bolted connection. Care shall be taken to ensure that Riprap concrete does not flow into the Cross Pipe so as to permit disassembly of the bolted connection to allow cleanout access. At the Contractor's option, all other Cross Pipes may also be installed using the bolted connection details.
4. Match Cross Slope as shown elsewhere in the plans. Cross Slope of 6:1 or flatter is required for vehicle safety.
5. Riprap placed beyond the limits shown will be paid as Concrete Riprap in accordance with Item 432, "Riprap".
6. Quantities shown are for one end of one reinforced Concrete Pipe Culvert. For multiple pipe culverts or for Corrugated Metal Pipe Culverts, quantities will need to be adjusted. Riprap quantities are for Contractor's information only.

GENERAL NOTES:

Cross Pipes are designed for a traversing load of 10,000 pounds at yield as recommended by Research Report 280-2F, "Safety Treatment of Roadside Parallel-Drainage Structures", Texas Transportation Institute, March 1981.

Safety End Treatments shown herein are intended for use in those installations where out of control vehicles are likely to traverse the openings approximately perpendicular to the Cross Pipes.

Riprap and all necessary inverts shall be Concrete Riprap conforming to the requirements of Item 432, "Riprap".

Synthetic fibers listed on the "Fibers for Concrete" Material Producer List (MPL) may be used in lieu of steel reinforcing in riprap concrete unless noted otherwise.

Payment for riprap and toewall is included in the Price Bid for each Safety End Treatment.

Cross Pipes shall conform to the requirements of ASTM A53 (Type E or S, Grade B), ASTM A500 (Grade B), or API 5LX52.

Bolts and nuts shall conform to ASTM A307.

All steel components, except concrete reinforcing, shall be galvanized after fabrication. Galvanizing damaged during transport or construction shall be repaired in accordance with the specifications.

Texas Department of Transportation

Bridge Division Standard

SAFETY END TREATMENT

FOR 12" DIA TO 72" DIA
PIPE CULVERTS
TYPE II ~ PARALLEL DRAINAGE


SETP-PD

FILE: setppdse.dgn	DN: GAF	CK: CAT	DW: JRP	CK: GAF
©TxDOT February 2010	CONT	SECT	JOB	HIGHWAY
REVISIONS				CR200
11-10: Add note for synthetic fibers.	DIST	COUNTY		SHEET NO.
		WILLIAMSON		37


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/18/2017 3:15:52 PM
FILE: C:\data\Projects\CR 200\WA-4_CR201-BS\SHEETS\Standards\Roadway\setppdse.dgn


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

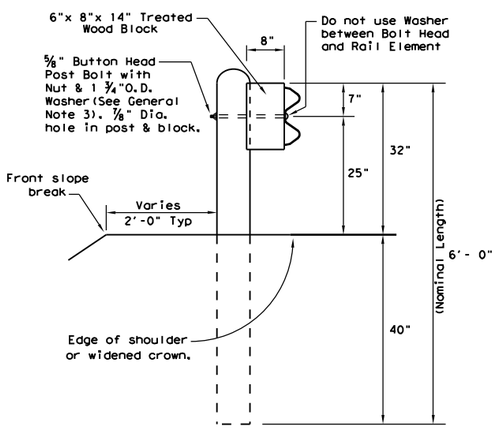


TYPICAL POST

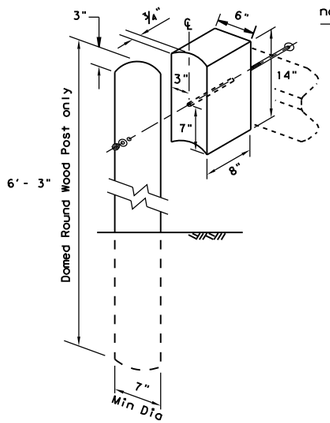

WOOD BLOCK TO ROUND WOOD POST

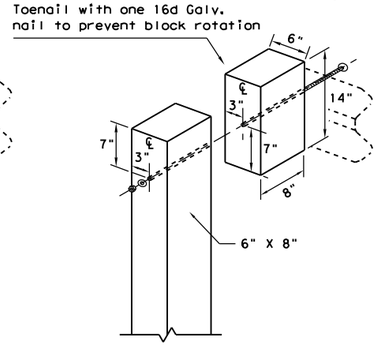


WOOD BLOCK TO RECTANGULAR WOOD POST

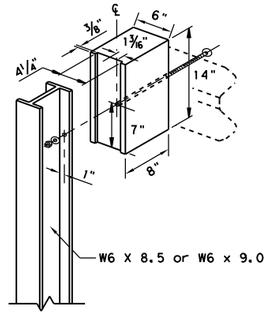

WOOD BLOCK TO STEEL POST

GENERAL NOTES


1. The type of post (round wood post, rectangular wood post, or steel post) will be as shown in the plans. The exact position of MBGF shall be shown in the plans or as directed by the Engineer. Steel posts to be galvanized in accordance with Item 445, "Galvanizing."
2. Rail element shall meet the requirements of Item 540, "Metal Beam Guard Fence" except as modified in the plans. The Contractor may furnish rail elements of 25'- 0", or 12'- 6" (nom.) lengths. Rail elements may have slotted holes at 3'-1½" C-C or 6'-3" C-C. A special length of rail may be manufactured to accommodate the downstream anchor terminal (DAT) and the transition sections of guardrail.
3. Button head "post" bolts (ASTM A307) shall be of sufficient length to extend through the full thickness of the nut (ASTM A563) and Type A (1 ¾" O.D.)washer and not more than 1" beyond it. Button head "splice" bolts (ASTM A307) are ⅝" x 1 ¼" (or 2" long at triple rail splices) with a ⅝" double recessed nut (ASTM A563). Thrie beam "connection" ⅞" dia. (ASTM A325) hex bolts shall be of sufficient length to extend through the full thickness of the rail, washers, and nuts.
4. Fittings (bolts, nuts, and washers) shall be galvanized in accordance with Item 445, "Galvanizing." Fittings shall be subsidiary to the bid item.
5. Crown shall be widened to accommodate the Metal Beam Guard Fence.
6. The lateral approach to the guard fence, shall have a maximum slope of 1V:10H.
7. If shown elsewhere in the plans or as directed by the Engineer, the guard fence may be flared at a rate of 25:1 or flatter.
8. Unless otherwise shown in the plans, guard fence placed in the vicinity of curbs shall be positioned so that the face of curb is located directly below or behind the face of the rail. Rail placed over curbs shall be installed so that the post bolt is located approximately 25 inches above the gutter pan or edge of shoulder.
9. If solid rock is encountered within 0 to 18" of the finished grade, drill a 22" dia. hole, or drill two 12" dia. front to back overlapping holes, 24" into the rock. If solid rock is encountered below 18", drill a 12" dia. hole, 12" into the rock or to the standard embedment depth, whichever maybe less. Any excess post length, after meeting these depths, may be field cut to ensure proper guardrail mounting height. Backfill with a cohesionless material.
10. Posts shall not be set in concrete, of any depth.
11. Special fabrication will be required at installations having a curvature of less than 150 ft. radius.
12. Unless otherwise shown in the plans, a composite material post and/or block that meets the requirements of DMS-7210, "Composite Material Posts and Blocks for Metal Beam Guard Fence" may be substituted for posts and/or blocks of similar dimensions. The Construction Division, TxDOT maintains a Material Producer List (MPL) for producers of materials conforming to DMS-7210. Only producers on the MPL may furnish composite material posts and/or blocks.
13. For posts located partially or wholly between precast box culvert units, the use of a cast-in-place concrete closure between boxes is required. See Detail "A" on Bridge Standard SCP-MD.

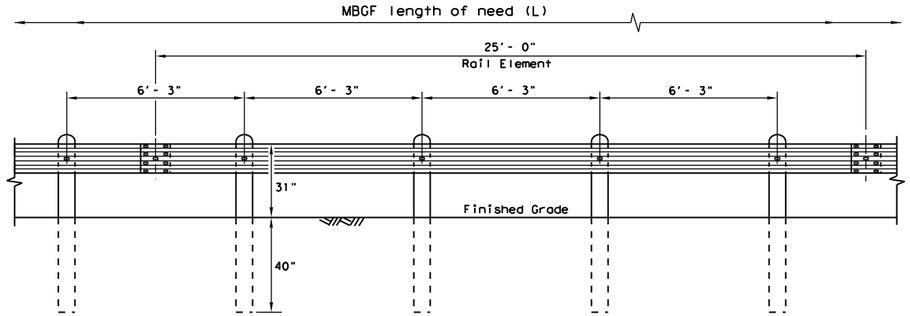

ELEVATION
MID-SPAN RAIL SPLICE

Showing a 25'- 0" section of W-Beam rail, 12'- 6" rail sections may also be supplied (See General Note 2)


Direction of Traffic

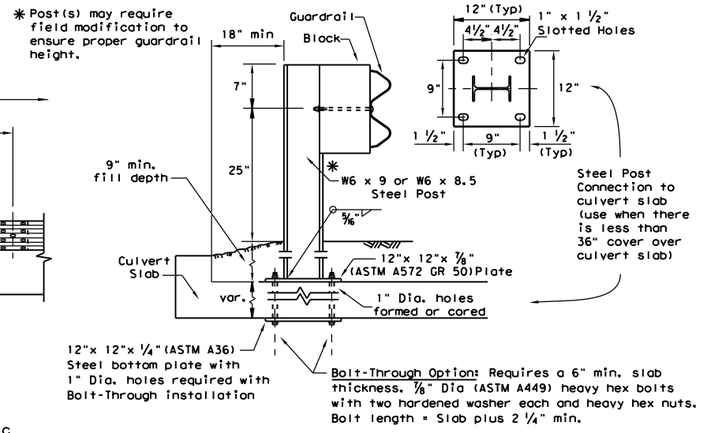

LOW FILL CULVERT POST


Culverts of 25 ft. or less, see GF(31)LS standard for "Long Span" option.

Epoxy Note:
Epoxy Anchor Option: This option may only be used if the culvert slab is 8" min. thick. Threaded anchor rods must be ⅞" Dia. ASTM A449 or A193 Grade B7 with heavy hex nut, and one hardened washer each. Embed anchor rods 6" with Hilti HIT RE 500 epoxy adhesive. Other Type III Class C epoxy adhesives meeting the requirements of DMS-6100, "Epoxies and Adhesives", may be used if it can be demonstrated that they meet or exceed the strength of Hilti HIT RE 500 with the same embedment depth and threaded rod dia. Follow the manufacturer's requirements for installing epoxied threaded rods. Extend rods ¼" min. beyond nut.

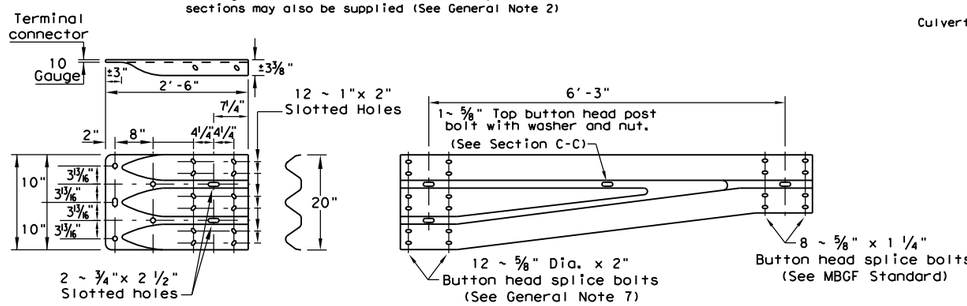


THRIE-BEAM TERMINAL CONNECTION
(SEE GENERAL NOTES 6 & 7 FOR REQUIRED HARDWARE)


NON-SYMMETRICAL TRANSITION TO W-BEAM (10 Gauge)

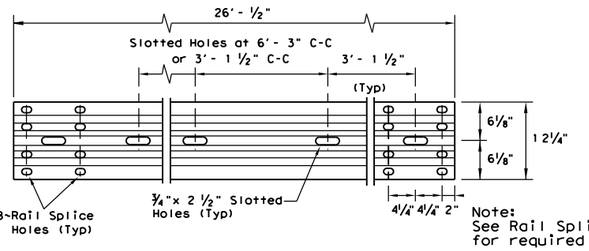

ELEVATION 25'- 0" (NOM.) W-BEAM SECTION
12'- 6" RAIL SECTIONS MAY ALSO BE SUPPLIED (SEE GENERAL NOTE 2)




BUTTON HEAD BOLT
Post and Splice Bolts (See General Note 3)

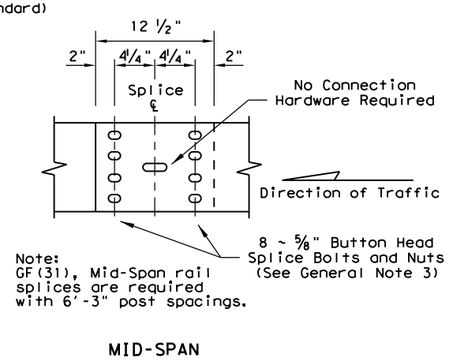

Note:
GF(31), Mid-Span rail splices are required with 6'-3" post spacings.

MID-SPAN
RAIL SPLICE DETAIL

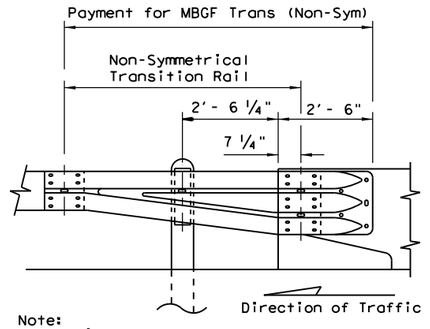

Note:
All rail elements shall be lapped in the direction of adjacent traffic.

DOWNSTREAM RAIL ATTACHMENT

Texas Department of Transportation — Design Division Standard

METAL BEAM GUARD FENCE


GF(31)-14


FILE: gf3114.dgn	DN: TxDOT	CK: AM	DW: VP	CK: CGL
©TxDOT: December 2011 REVISIONS	CONT	SECT	JOB	HIGHWAY
				CR200
	DIST	COUNTY		SHEET NO.
		WILLIAMSON		38


DATE: 12/18/2017
FILE: C:\data\Projects\CR 200\WA-4_CR201-BS\SHEETS\Standards\Roadway\gf3114.dgn


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 12/18/2017
FILE: C:\data\Projects\CR 200\WA-4_CR201-BS\SHEETS\Standards\Roadway\sgt83p4.dgn

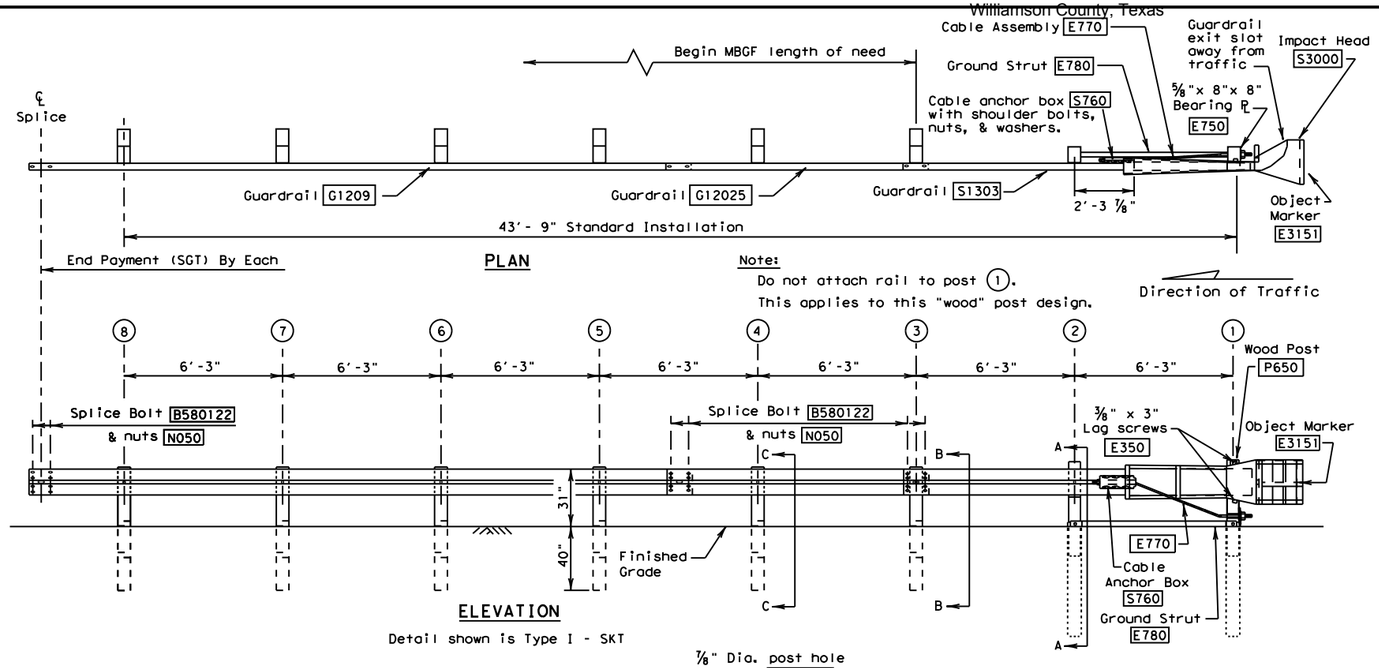


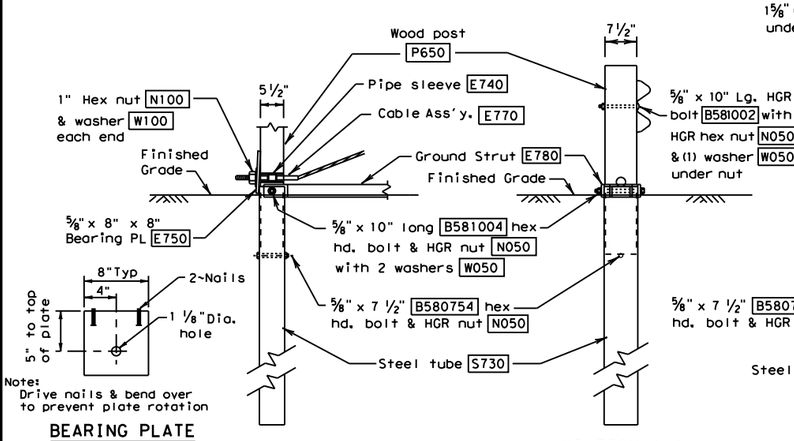

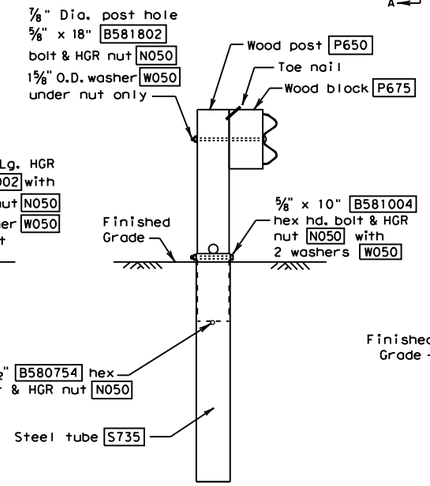

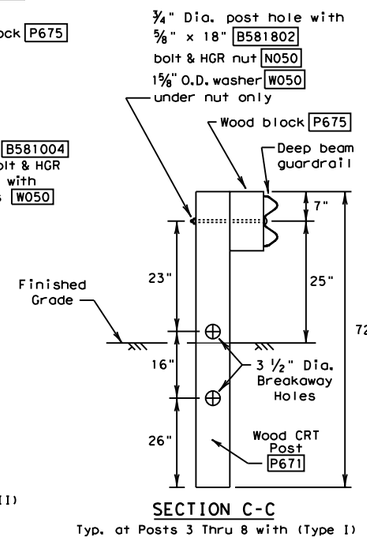



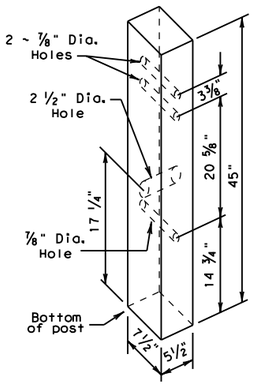


GENERAL NOTES

1. For additional information contact: Interstate Steel Inc. (432) 263-3725
2. The Type of SGT unit will be specified elsewhere in the plans. The numbers in the circles indicate post position. The Type of SGT unit chosen is a maintenance consideration and does not affect the systems performance.

	Post & Tube Options	Post Only
Type I	Posts (1) thru (2)	Posts (3) thru (8)
Type II	Posts (1) thru (4)	Posts (5) thru (8)
Type III	Posts (1) thru (8)	None

3. SGT's placed within the "minimum" 150 ft. radius, shall be installed straight. Standard rail elements may be installed within the radius, without special fabrication.
4. All bolts, nuts cable assemblies, cable anchors, steel tubes & bearing plates shall be galvanized.
5. A flare rate of 25:1 may be used over the first 50 ft. of the system to prevent the terminal head from encroaching the shoulder. The flare may be decreased or eliminated for specific installations, if directed by the Engineer.
6. The steel tubes shall not protrude more than 4 inches above ground. Site grading may be necessary to meet this requirement.
7. The steel tubes may be driven with an approved driving head. They shall not be driven with the wood post in the tube. If the steel tubes are placed in drilled holes, the backfill material must be satisfactorily compacted to prevent tube settlement.
8. If solid rock is encountered. See the Manufacturer's installation manual for the proper installation guidance.
9. The breakaway cable assembly must be taut. A locking device, (vice grips or channel lock pliers) should be used to prevent the cable from twisting when tightening the nuts.
10. The wood blocks shall be "toe nailed" to the rectangular wood posts to prevent them from turning when the wood shrinks. The bearing plate on the front post shall also be "toe nailed" to prevent rotation.
11. For curb installations, the soil tubes and posts shall be installed at the proper ground elevation behind the curb. The posts will then require field drilling new holes to accommodate the rail to post connection bolt to maintain the proper height of the rail above the gutter pan. The excess post length above the rail will be removed if directed by the Engineer.
12. An object marker shall be installed on the front of the impact head as detailed on D&OM(VIA).

	POST & TUBE OPTIONS			BILL OF MATERIAL
Item #	Type I	Type II	Type III	DESCRIPTION
S1303	1	1	1	Guardrail (12 Ga.) 12'- 6" SKT
G12025	1	1	1	Guardrail (12 Ga.) 9'- 4 ½"
G1209	1	1	1	Guardrail (12 Ga.) 25'- 0"
S730	2	2	2	Steel Tube - 6" x 8" x 72" x ⅛" min. or ⅜"
S735	0	2	6	Steel Tube - 6" x 8" x 54" x ⅛" min. or ⅜"
P650	2	4	8	Wood Posts - 5 ½" x 7 ½" x 45"
P671	6	4	0	Wood CRT Posts - 6" x 8" x 72"
P675	6	6	6	Wood Block - 6" x 8" x 14"
E740	1	1	1	Pipe Sleeve - 2" Std. Pipe x 5 ½"
E750	1	1	1	Bearing Plate - ⅝" x 8" x 8"
S760	1	1	1	Cable Anchor Box
E770	1	1	1	Cable Assembly
E780	1	1	1	Ground Strut
S3000	1	1	1	Impact Head
				HARDWARE
B580754	2	4	8	⅝" x 7 ½" Hex Hd. Bolt
B581004	2	4	8	⅝" x 10" Hex Hd. Bolt (Top of Tubes)
W050	11	15	23	⅝" Washers
B581002	1	1	1	⅝" x 10" HGR Post Bolt (Post 2)
B580122	16	16	16	⅝" x 1 ¼" HGR Splice Bolt
B581802	6	6	6	⅝" x 18" HGR Post Bolt (Posts (3) thru (8))
N050	35	39	47	⅝" HGR Nut (24-Spl, Varies-Posts, 2-Strut)
E350	2	2	2	⅜" x 3" Lag Screw
N100	2	2	2	1" Hex Nut (Anchor Cable)
W100	2	2	2	1" Washer (Anchor Cable)
SB12A	8	8	8	Cable Anchor Box Shoulder Bolts
N012A	8	8	8	½" Structural Nut
W012A	8	8	8	½" Structural Washer
E3151	1	1	1	Object Marker - (18" x 18")

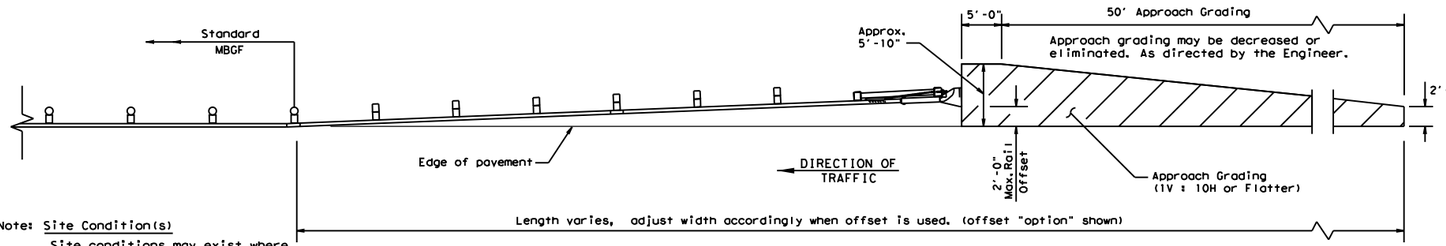

Note: Site Condition(s)
Site conditions may exist where grading is required for the proper installation of metal guard fence and end treatments.

APPROACH GRADING AT GUARDRAIL END TREATMENTS


POST & TUBE OPTIONS
Type I post (1) thru (2)
Type II post (1) thru (4)
Type III post (1) thru (8)

Texas Department of Transportation — Design Division Standard

SINGLE GUARDRAIL TERMINAL (SKT-31) (WOOD POST)

SGT(8)31-14

FILE: sgt83114.dgn	DN: TxDOT	CK: AM	DW: BD/VP	CK: VP
©TxDOT December 2011	CONT	SECT	JOB	HIGHWAY
REVISIONS				CR200
	DIST	COUNTY		SHEET NO.
		WILLIAMSON		39

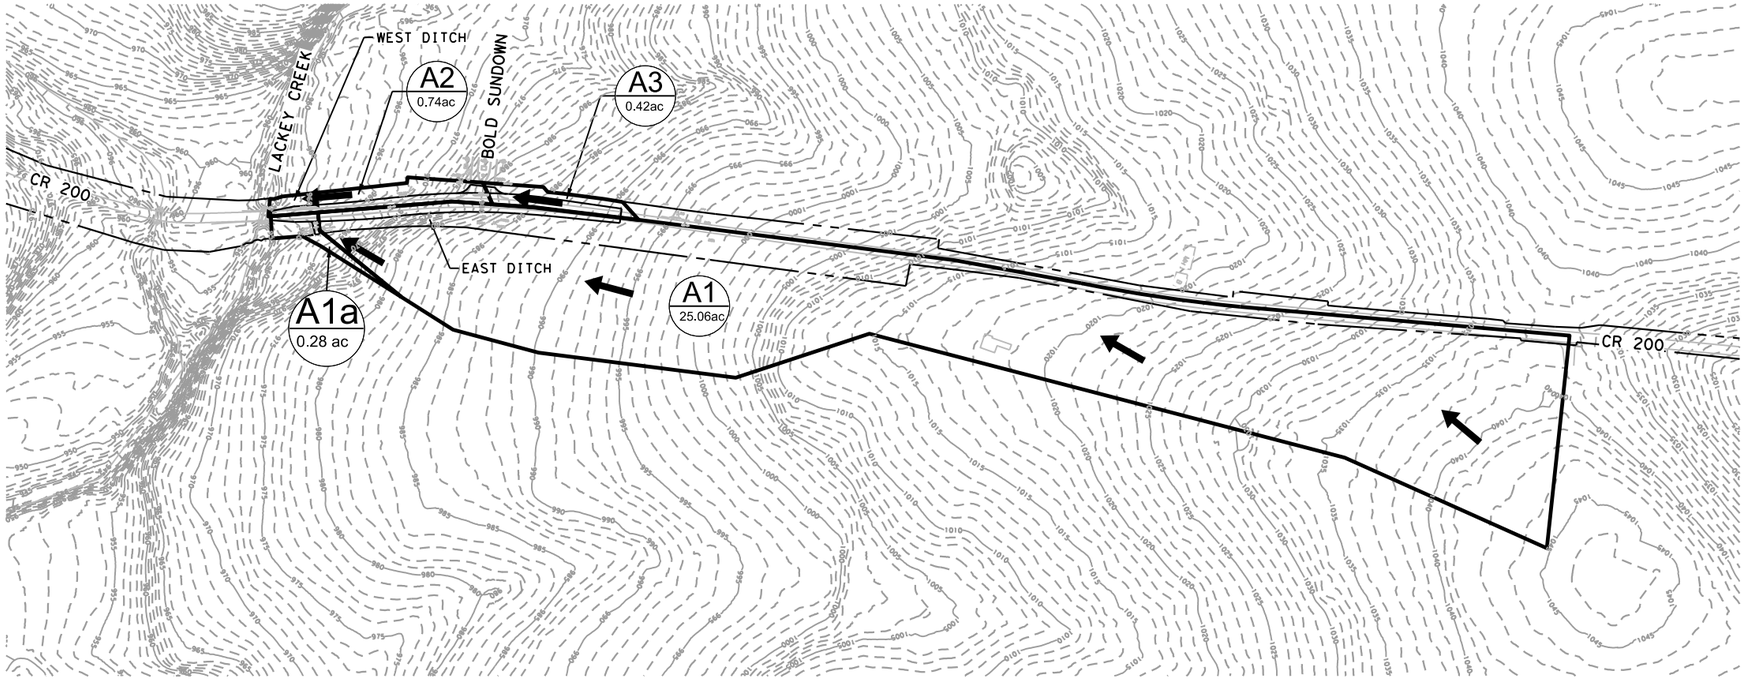

0 200 400
SCALE: 1"=400'

LEGEND

- FLOW DIRECTION
- DRAINAGE AREA BOUNDARY
- # / 77.0 ac — CULVERT DRAINAGE AREA / DRAINAGE AREA (ACRES)

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
12/21/2017

Rational Method Calculations

Drainage Area	Area (acres)	Undev (acres)	Res (acres)	Streets (acres)	I.C.** (%)	Flow Travel Times Sheet	Shallow	Channel	Tc* (min)	2-year C**	2-year i (in/hr)	2-year Q (cfs)	5-year C**	5-year i (in/hr)	5-year Q (cfs)	10-year C**	10-year i (in/hr)	10-year Q (cfs)	25-year C**	25-year i (in/hr)	25-year Q (cfs)	100-year C**	100-year i (in/hr)	100-year Q (cfs)
A1a	0.28	0.00	0.09	0.19	25.0%	9.9	1.5	0.0	11	0.73	4.3	0.9	0.73	5.5	1.1	0.73	6.4	1.3	0.77	7.6	1.6	0.77	9.8	2.1
A1b	25.06	0.00	23.56	1.50	0.0%	14.6	18.3	0.0	33	0.39	2.5	24.8	0.39	3.3	32.2	0.39	3.9	37.9	0.41	4.6	48.1	0.43	6.2	67.1
A2	0.74	0.40	0.00	0.34	0.0%	1.4	3.0	0.0	10	0.55	4.5	1.8	0.55	5.8	2.4	0.55	6.7	2.7	0.59	7.9	3.4	0.61	10.2	4.6
A3	0.42	0.15	0.00	0.27	0.0%	1.4	2.1	0.0	10	0.66	4.5	1.2	0.66	5.8	1.6	0.66	6.7	1.9	0.70	7.9	2.3	0.72	10.2	3.1

* Tc CALCULATED USING NRCS METHOD.
** VALUES PROVIDED THROUGH DRAINAGE APPROACH TECHNICAL REPORT.

East Ditch

Station	Ditch Flowline Elev.	LT Side Slope 1 (X:1)	LT Side Slope 2 (X:1)	RT Side Slope 1 (X:1)	Base Width (ft)	Ditch 5yr-Flow (cfs)	Flow Depth (ft)	Velocity (ft/s)	EOP Elev.	Dist to EOP (ft)	Notes
267+25.23	989.94						0.95		991.01	0.12	
		3	20	3	4	32.2		4.81			
263+00	975.54						0.99		977.60	1.07	
		3	20	3	4	32.2		5.48			
262+50	974.17						0.78		975.10	0.15	
		6	6	3	4	32.2		4.81			
262+00	971.54						0.93		972.67	0.20	
		4	4	4	4	32.2		5.35			
261+50	969.32						0.97		970.32	0.03	
		3	6	3	2	32.2		5.35			
260+50	963.66						1.14		966.39	1.59	
		3	6	3	2	32.2		6.4			
259+50	960.45						1.00		962.70	1.25	
		3	6	3	2	32.2		8.08			
259+39.23	958.3						0.55		962.60	3.75	US Driveway Pipe
		3	6	3	4	32.2		5.68			
258+91.35	958						1.38		962.50	3.12	DS Driveway Pipe
		3	6	3	4	33.3		5.40			
258+50	957.62						0.90		959.89	1.37	
		3	6	3	2	33.3		7.95			
258+00	952.00						0.89		959.00	6.11	

West Ditch

Station	Ditch Flowline Elev.	LT Side Slope 1 (X:1)	LT Side Slope 2 (X:1)	RT Side Slope 1 (X:1)	Base Width (ft)	Ditch 5yr-Flow (cfs)	Flow Depth (ft)	Velocity (ft/s)	EOP Elev.	Dist to EOP (ft)
267+25.23	989.65						0.48		991.0	0.87
		4	4	3	n/a	1.6		2.32		
263+89	980.20						0.48		981.1	0.42
263+00	975.82						0.58		977.6	1.20
		3	20	3	n/a	2.4				
262+50	973.42						0.17		975.1	1.51
		3	20	3	6	2.4		2.18		
258+50	957.00						0.17		959.9	2.73


WILLIAMSON COUNTY 1848
WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC
TBPE FIRM # 14060

CR 200 AT BOLD SUNDOWN DRAINAGE AREA MAP

SHEET 1 OF 1 | SHEET # 40

3/15/2018 7:39 AM
C:\Users\kobrien\Documents\WM-44CR201-BSS\SHEETS\Drainage\CR200WA4-DA Data+02.dgn
CR200 PDF - GS.pltcfg
12/21/2017 17:03 PM

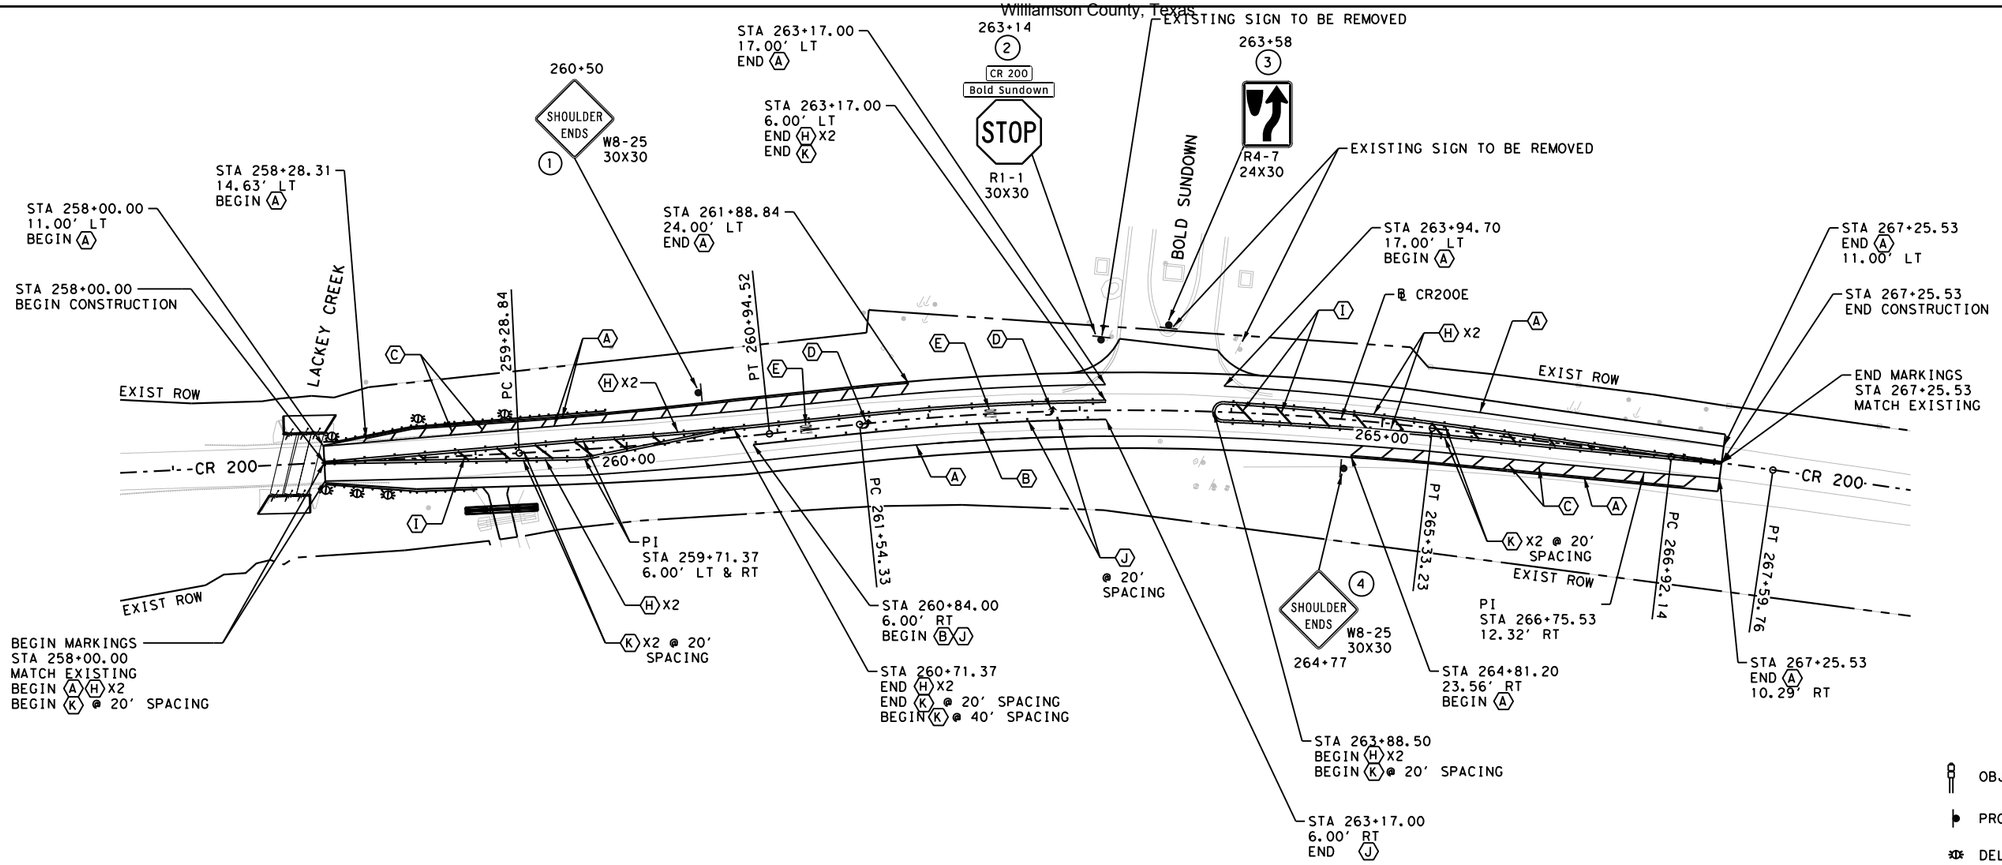

LEGEND

A	W 4" SOLID
B	W 8" SOLID
C	W 24" SOLID
D	W ARROW
E	W WORD
F	W RR XING
H	Y 4" SOLID
I	Y 12" SOLID
J	TY I-C
K	TY II-A-A

OBJECT MARKER (OM-2X)(WC)(GND)

PROPOSED SIGN POST

DELINEATOR (D-SW)(SZ1)(BRF)(GF2)(B1)

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
3/13/2018


WILLIAMSON COUNTY
PRECINCT #2

O'BRIEN Engineering Services LLC
TBPE FIRM # 14060


CR 200
AT BOLD SUNDOWN
SIGNING & PAVEMENT MARKINGS

SHEET 4 OF 4 | SHEET # 41

CR200 PDF - CS.pltcfg
3/13/2018 4:48:38 PM
C:\GBES\CR 200\Documents\WA-44CR201-BS\SHEETS\SPM\CR200-WA4b-SPM01.DGN



D3-1G(1) 4in; 1.0" Radius, 0.4" Border, White on Green;
[Bold Sundown] ClearviewHwy-3-W;



D3-1G(1) 4in;
1.0" Radius, 0.4" Border, White on Green;
[CR 200] ClearviewHwy-3-W 90% spacing;



WILLIAMSON COUNTY 1848

WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC

TBPE FIRM # 14060

CR 200 AT BOLD SUNDOWN SIGNING DETAILS

SHEET 1 OF 1





SHEET # 42

CR200 PDF - GS.pltcfg
3/15/2018 7:39 AM
12/21/2017 5:17:05 PM
C:\OBES\CR 200\Documents\WA-44\CR201-BS\SHEETS\SPW\CR200-WA4b-Sign Details.DGN

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.




DATE: 12/21/2017 9:17:06 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\Signing_Pavement\dom1-15.dgn

REFLECTOR UNIT SIZES FOR DELINEATORS AND OBJECT MARKERS








	SIZE 1	SIZE 2	SIZE 3	SIZE 4
DEVICE				
SHEETING	Yellow, White or Red Type B or C reflective sheeting			

NOTE
1. Size 1 and 4 - Direct applied reflective sheeting for use on flexible post (flx).
2. Size 2 and 3 - For use on wing channel (wc) post only. Use approved metal, plastic or fiberglass backplate with 17/64" mounting holes.




DELINEATORS

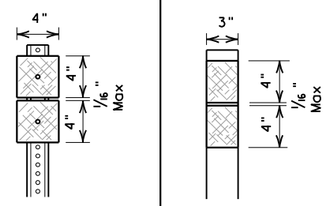DEVICE	SINGLE		DOUBLE	
	 1-Size 2 reflector unit	 1-Size 1 reflector unit	 2-Size 2 reflector units	2-Size 1 reflector units
SHEETING	Yellow, White or Red Type B or C Reflective Sheeting			
POST TYPE	WC	FLX	WC	FLX
MOUNT TYPE	GND	GND, SRF	GND	GND, SRF

OBJECT MARKERS

	Type 1 (OM-1)	Type 2 (OM-2)			Type 3 (OM-3)			Type 4 (OM-4)
	OM-1	OM-2X	OM-2Y	OM-2Z	OM-3L	OM-3R	OM-3C	OM-4
DEVICE		 3-Size 2 reflector units	 1-Size 3 reflector unit	 3-Size 1 reflector units or 1-Size 4 reflector unit				
SHEETING	Yellow-Type B_{FL} or C_{FL} Sheeting	Yellow - Type B or C Sheeting			Alternating acrylic black and retroflective yellow - Type B_{FL} or C_{FL} Sheeting			Red -Type B_{FL} or C_{FL} Sheeting
POST TYPE	TWT	WC	WC	FLX	TWT			TWT
MOUNT TYPE	WAS, WAP	GND	GND	GND, SRF	WAS, WAP			WAS, WAP


BARRIER REFLECTORS (BRF)

	GF1	GF2	CTB
DEVICE			

1. Barrier reflectors shall meet the requirements of DMS 8600.
2. Approved Barrier Reflectors are listed on the "Barrier Reflectors" Material Producer List at: www.txdot.gov.


SHEETING	Yellow, White, Red
NOTE	1. Minimum 9 square inches of reflective sheeting surface area.

CHEVRONS

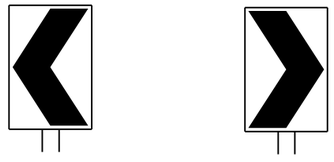DEVICE	 W1-8			
SIZE (W x L)	18"x 24" (Conventional)	24"x 30" (Conventional Oversize)	30"x 36" (Expressway)	36" x 48" (Freeway)
MOUNTING HEIGHT	4'-0" or 7'-0"		7'-0" Only	

NOTE
1. CHEVRON (W1-8) signs and ONE DIRECTION LARGE ARROW (W1-6) Signs shall be installed per Sign Mounting Details (SMD) Standard Sheets and paid under Item 644 (Small Roadside Sign Assemblies).
2. The Texas version of the ONE DIRECTION LARGE ARROW sign (W1-9T) may be used instead of the ONE DIRECTIONAL LARGE ARROW (W1-6).

ONE DIRECTION LARGE ARROW

DEVICE	 W1-6	
SIZE (W x L)	48" x 24" (Conventional)	60" x 30" (Expressway & Freeway)
MOUNTING HEIGHT	7'-0"	

D & OM DESCRIPTIVE CODES

INSTL DEL ASSM (D-XX)SZ X (XXX)XXX(XX)

NUMBER OF REFLECTORS
- S = Single
- D = Double

COLOR OF REFLECTORS
- W = White
- Y = Yellow
- R = Red

REFLECTOR UNIT SIZE
- 1 or 2

TYPE OF POST OR DELINEATOR
- WC = Wing Channel Post
- FLX = Flexible Post
- BRF = Barrier Reflector

TYPE OF MOUNT
- GND = Embedded (drivable or set in concrete)
- CTB = Concrete Barrier Mount
- GF1 or GF2 = Guard Fence Attachment
- SRF = Surface Mount

DIRECTION
- If Required
- BI = Bi-Directional
- BR = Bi-Directional with red on back

INSTL OM ASSM (OM-XX) (XXX)XXX(XX)

TYPE OF OBJECT MARKER
- 1, 2, 3, or 4

NUMBER OF REFLECTORS OR DIRECTION
- X = 3-Size 2 reflector units (Type 2 only)
- Y = 1-Size 3 reflector unit (Type 2 only)
- Z = 3-Size 1 or 1-Size 4 reflector unit(s) (Type 2 only)
- L = Left Side (Type 3 Object Marker only)
- R = Right Side (Type 3 Object Marker only)
- C = Center (Type 3 Object Marker only)

TYPE OF POST
- WC = Wing Channel Post
- FLX = Flexible Post
- TWT = Thin Walled Tubing

TYPE OF MOUNT
- GND = Embedded (drivable)
- SRF = Surface Mount
- WAS = Wedge Anchor Steel
- WAP = Wedge Anchor Plastic

DIRECTION
- If Required
- BI = Bi-Directional

DEPARTMENTAL MATERIAL SPECIFICATIONS	
FLEXIBLE DELINEATOR & OBJECT MARKER POSTS (EMBEDDED & SURFACE MOUNT TYPES)	DMS-4400
SIGN FACE MATERIALS	DMS-8300
DELINEATORS, OBJECT MARKERS AND BARRIER REFLECTORS	DMS-8600

NOTE:
Delineator and object marker backplates and sign substrates shall be 0.080" Aluminum sign blank to conform to ASTM B-209 Alloy 6061-T6 or approved alternative.

Texas Department of Transportation — Traffic Operations Division Standard

DELINEATOR & OBJECT MARKER MATERIAL DESCRIPTION
D & OM(1)-15

FILE: dom1-15.dgn	DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
©TxDOT August 2004	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
10-09 3-15	DIST	COUNTY		SHEET NO.
4-10	AUS	WILLIAMSON		43


20A

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion #MicroStation V8i formats or for incorrect results or damages resulting from its use.

POST TYPE AND SUPPORT FOUNDATION DETAILS

WING CHANNEL (WC)

GND




NOTES

1. Embedded Wing Channel (WC) post option may be used for Type 2 Object Markers and Delineators only.
2. 1.12 lbs/ft steel per ASTM A 1011 SS Gr. 50, or ASTM A499.


FLEXIBLE POSTS (FLX)

GND

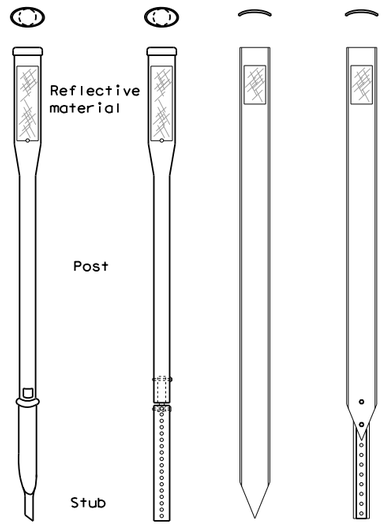

EMBEDDED

SRF

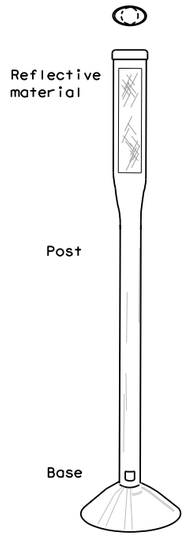


SURFACE MOUNT

NOTES

1. See "Flexible Delineator and Object Marker Posts" Material Producer List for approved devices.
2. Install per manufacturer's recommendations.
3. Post length may vary to meet field conditions.


WEDGE ANCHOR SYSTEMS

WAS

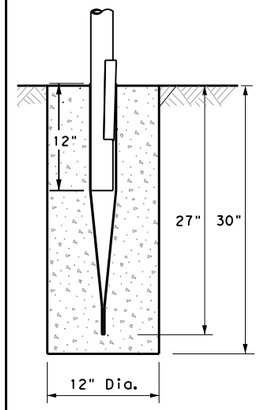

STEEL

WAP

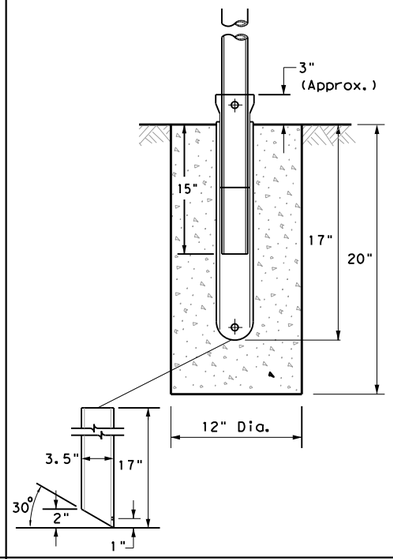

PLASTIC


NOTE

1. Install per manufacturer's recommendations.


TYPE OF BARRIER MOUNTS

GUARD FENCE ATTACHMENT

GF1




GF2

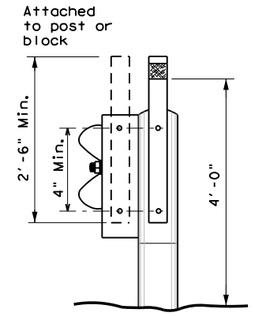

CONCRETE BARRIER / BRIDGE RAIL


CTB



GENERAL NOTES

1. Place delineators on a section of roadway at a consistent distance from the edge of pavement.
2. Where a restriction prevents consistent placement from the pavement edge, place the affected object markers in line with the innermost edge of the obstruction.
3. When Type 2 object markers and delineators are more than 8'-0" from the edge of the pavement, it may not be possible to maintain a height of approximately 4'-0". If this is the case, place the object marker or delineator as close to the desired height as possible.
4. Install all delineators, object markers and barrier reflectors in accordance with the manufacturer's recommendation.
5. Barrier reflectors should be installed a minimum of 18 inches above the edge of the pavement surface.


TYPES 1, 3, AND 4 OBJECT MARKERS AND CHEVRONS

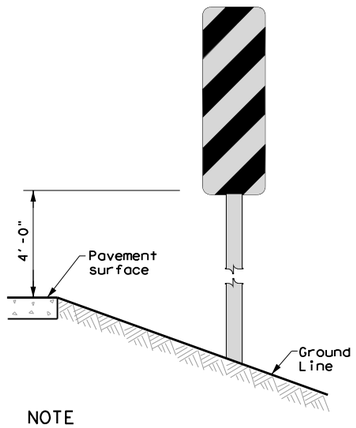

NOTE

Mounting at 4 feet to the bottom of the chevron is permitted for chevrons that will not exceed a height of 6'-6" to the top of the chevron (sizes 24" x 30" and smaller)


CHEVRONS AND ONE DIRECTION LARGE ARROW SIGN

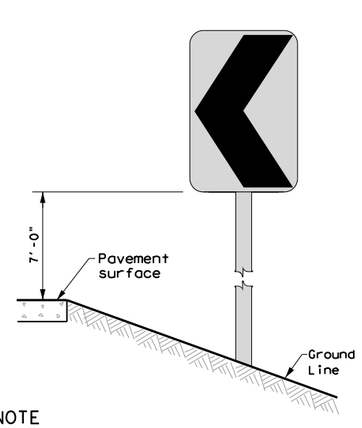

NOTE

Chevrons 30" x 36" and larger shall be mounted at a height of 7' to the bottom of the chevron. Chevron sign and ONE DIRECTIONAL LARGE ARROW sign (W1-9T) shall be installed per SMD standard sheets and paid under item 644.

DELINEATORS AND TYPE 2 OBJECT MARKERS

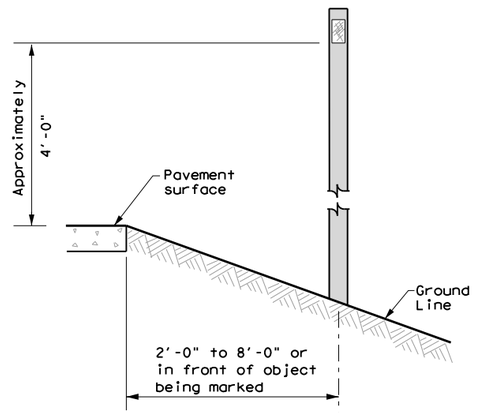

See general notes 1, 2 and 3.

Texas Department of Transportation

Traffic Operations Division Standard

DELINEATOR & OBJECT MARKER INSTALLATION

D & OM(2)-15

FILE: dom2-15.dgn	DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
©TxDOT August 2004	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
10-09 3-15	DIST	COUNTY		SHEET NO.
4-10	AUS	WILLIAMSON		44

20B

DATE: 12/21/2017 9:17:06 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\Signing_Pavement\MOFTYP04.dgn


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:17:06 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\Signing_Pavement_Markings\dom3-15b.dgn

USE OF WARNING DEVICES AT CURVES WITH ADVISORY SPEED LIMITS

Amount by which Advisory Speed Is less than Posted Speed	Warning Devices Needed
5 MPH & 10 MPH	RPMs
15 MPH & 20 MPH	RPMs, and Delineators or RPMs and ONE DIRECTION LARGE ARROW (W1-6) or (W1-9T) sign
25 MPH & Greater	RPMs and Chevrons

SUGGESTED SPACING FOR DELINEATORS ON HORIZONTAL CURVES

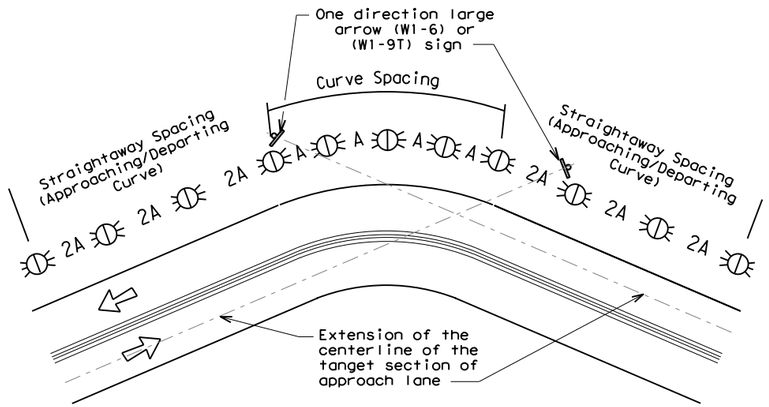


Curves less than 1 degree do not normally require delineators.

NOTE

ONE DIRECTIONAL LARGE ARROW (W1-6) or(W1-9T) sign should be located at approximately and perpendicular to the extension of the centerline of the tangent section of approach lane.

SUGGESTED SPACING FOR CHEVRONS ON HORIZONTAL CURVES

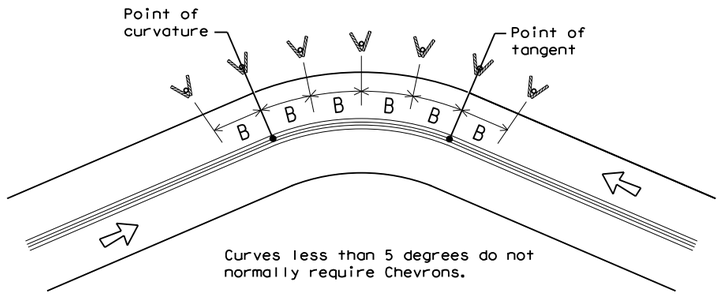

Curves less than 5 degrees do not normally require Chevrons.

DELINEATOR AND CHEVRON SPACING

WHEN DEGREE OF CURVE OR RADIUS IS KNOWN

Degree of Curve	FEET			
	Radius of Curve	Spacing in Curve	Spacing in Straightaway	Chevron Spacing in Curve
		A	2A	B
1	5730	225	450	——
2	2865	160	320	——
3	1910	130	260	200
4	1433	110	220	160
5	1146	100	200	160
6	955	90	180	160
7	819	85	170	160
8	716	75	150	160
9	637	75	150	120
10	573	70	140	120
11	521	65	130	120
12	478	60	120	120
13	441	60	120	120
14	409	55	110	80
15	382	55	110	80
16	358	55	110	80
19	302	50	100	80
23	249	40	80	80
29	198	35	70	40
38	151	30	60	40
57	101	20	40	40

Curve delineator approach and departure spacing should include 3 delineators spaced at 2A. This spacing should be used during design preparation or when the degree of curve is known.

DELINEATOR AND CHEVRON SPACING

WHEN DEGREE OF CURVE OR RADIUS IS NOT KNOWN

Advisory Speed (MPH)	Spacing in Curve	Spacing in Straightaway	Chevron Spacing in Curve
	A	2xA	B
65	130	260	200
60	110	220	160
55	100	200	160
50	85	170	160
45	75	150	120
40	70	140	120
35	60	120	120
30	55	110	80
25	50	100	80
20	40	80	80
15	35	70	40

If the degree of curve is not known, delineator spacing may be determined based on the Advisory Speed of the curve. Use the delineator curve spacing for each Advisory Speed (MPH).

DELINEATOR AND OBJECT MARKER APPLICATION AND SPACING

CONDITION	REQUIRED TREATMENT	MINIMUM SPACING
Frwy./Exp. Tangent	RPMs	See PM-series and FPM-series standard sheets
Frwy./Exp. Curve[1]	Single delineators on right side	See delineator spacing table
FRWY/EXP. Ramp	Single delineators on at least one side of ramp (should be on outside of curves) (see Detail 4 on D&OM(4))	100 feet on ramp tangents. Use delineator spacing table for ramp curves ("straightway spacing" does not apply to ramp curves).
Acceleration/Deceleration Lane	Double delineators (see Detail 4 on D&OM(4))	100 feet (See Detail 4 on D & OM (4))
Truck Escape Ramp	Single red delineators on both sides	50 feet
Bridge Rail (steel or concrete)and Metal Beam Guard Fence or CTB	Bi-Directional Delineators when undivided with one lane each direction Single Delineators when multiple lanes each direction	Equal spacing (100'max) but not less than 3 delineators
Guard Rail Terminus/Impact Head	Divided highway - Object marker on approach end. Undivided 2-lane highways - Object marker on approach and departure end.	Requires Type 3 Object Marker or reflective sheeting provided by manufacturer per D & OM(VIA).
Bridges with no Approach Rail	Type 3 Object Marker at end of rail and 3 single delineators approaching rail.	See Detail 2 on D & OM(4)
Reduced Width Approaches to Bridge Rail	Type 2 Object Markers and 3 single delineators approaching bridge.	See Detail 1 on D & OM(4)
Culverts without MBGF	Type 2 Object Markers	See Detail 3 on D & OM(4)
Crossovers	Double yellow delineators or RPM's	See Detail 5 on D & OM (4)
Pavement Narrowing (lane merge) on Freeways/Expressway	Single delineators adjacent to affected lane for full length of transition	100 feet

NOTES

1. Delineators not required in urban areas with continuous illumination.
2. Unless indicated otherwise, the delineator or barrier reflector color shall conform to the color of the pavement edge line on the side of the road where the delineators or barrier reflectors are placed.
3. Barrier reflectors may be used to replace required delineators.
4. Single red delineators may be mounted on the back side of delineator posts for wrong way driver applications

LEGEND

	Bi-directional Delineator
	Delineator
	Sign

Texas Department of Transportation | Traffic Operations Division Standard

DELINEATOR & OBJECT MARKER PLACEMENT DETAILS

D & OM(3)-15B


FILE: dom3-15b.dgn	DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
©TxDOT August 2004	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
3-15 8-15	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		45

20C

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 12/21/2017 9:17:07 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\Signing_Pavement_Markings\dom4-15.dgn

TWO-WAY, TWO LANE ROADWAY WITH REDUCED WIDTH APPROACH

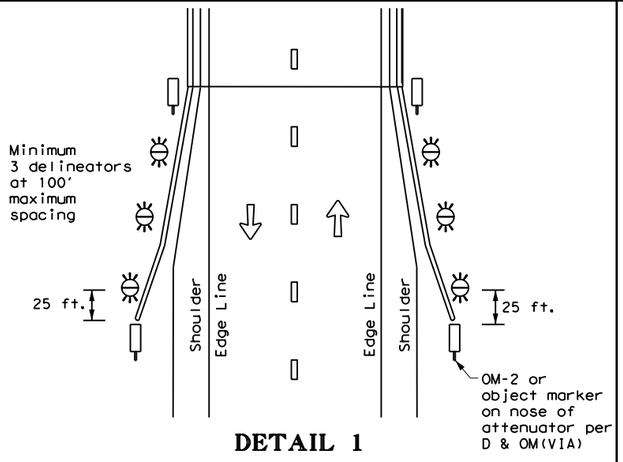


DETAIL 1

TWO-WAY, TWO LANE ROADWAY BRIDGE WITH NO APPROACH RAIL

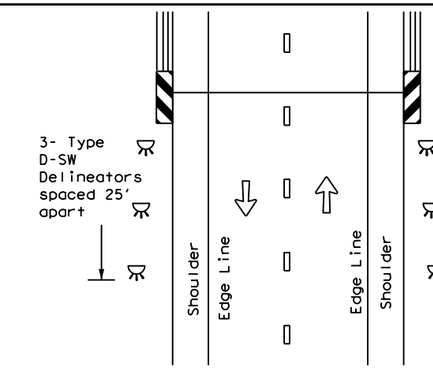


DETAIL 2

FOR CULVERTS WITHOUT MBGF

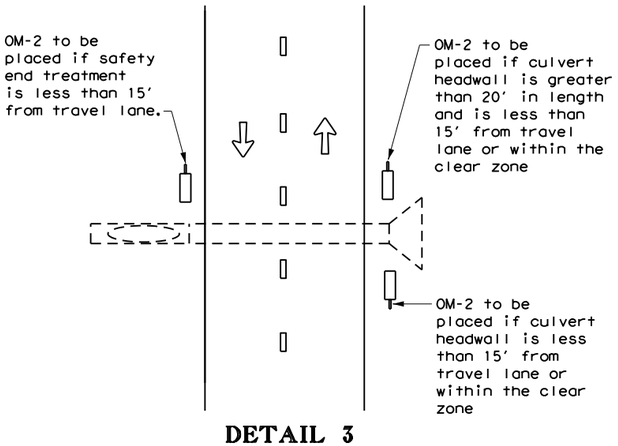


DETAIL 3

FREEWAY DELINEATION FOR RAMPS AND ACCELERATION/DECELERATION LANES

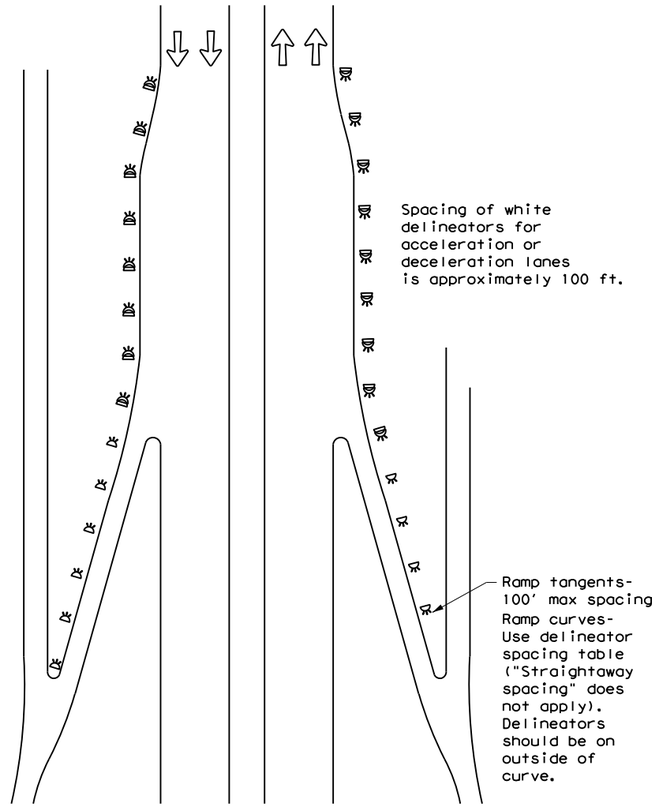


DETAIL 4

CROSSOVERS

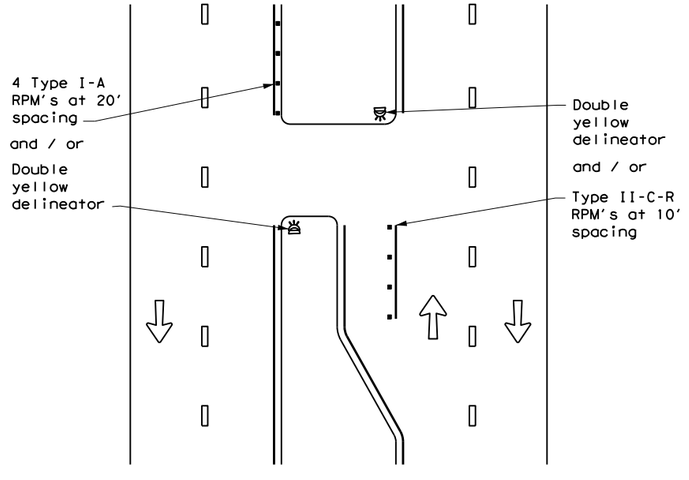


DETAIL 5

TYPICAL APPLICATION OF DEAD END BARRICADE

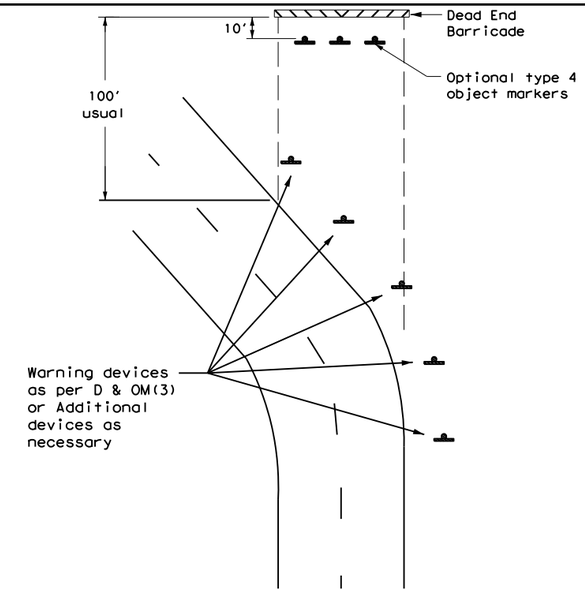

DETAIL 6

TYPICAL DEAD END BARRICADE INSTALLATION

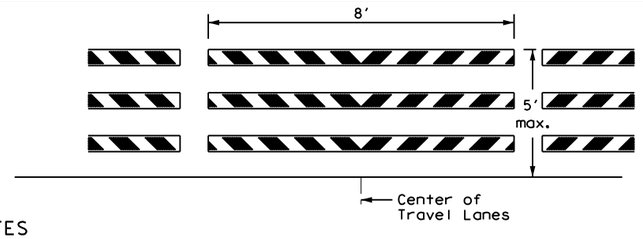

NOTES

1. Barricade striping shall be red and white reflective sheeting for all permanent road closures.
2. Barricade striping is red and white sloping toward the center of the roadway.
3. Type 3 Barricade Supports should be anchored to soil or pavement as described in compliant Work Zone Traffic Control Devices List, section D.2.f and D.2.g.

DETAIL 7

LEGEND	
	Bidirectional Delineator
	Delineator
	OM-3
	Barricade
	Sign
	OM-2
	Double Delineator

Texas Department of Transportation

Traffic Operations Division Standard

DELINEATOR & OBJECT MARKER PLACEMENT DETAILS

D & OM(4)-15


FILE: dom4-15.dgn	DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
©TxDOT August 2004	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
3-15	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		46

20D


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:17:07 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\Signing_Pavement_Markings\dom5-15.dgn

TWO-WAY, TWO LANE ROADWAY WITH REDUCED WIDTH APPROACH RAIL

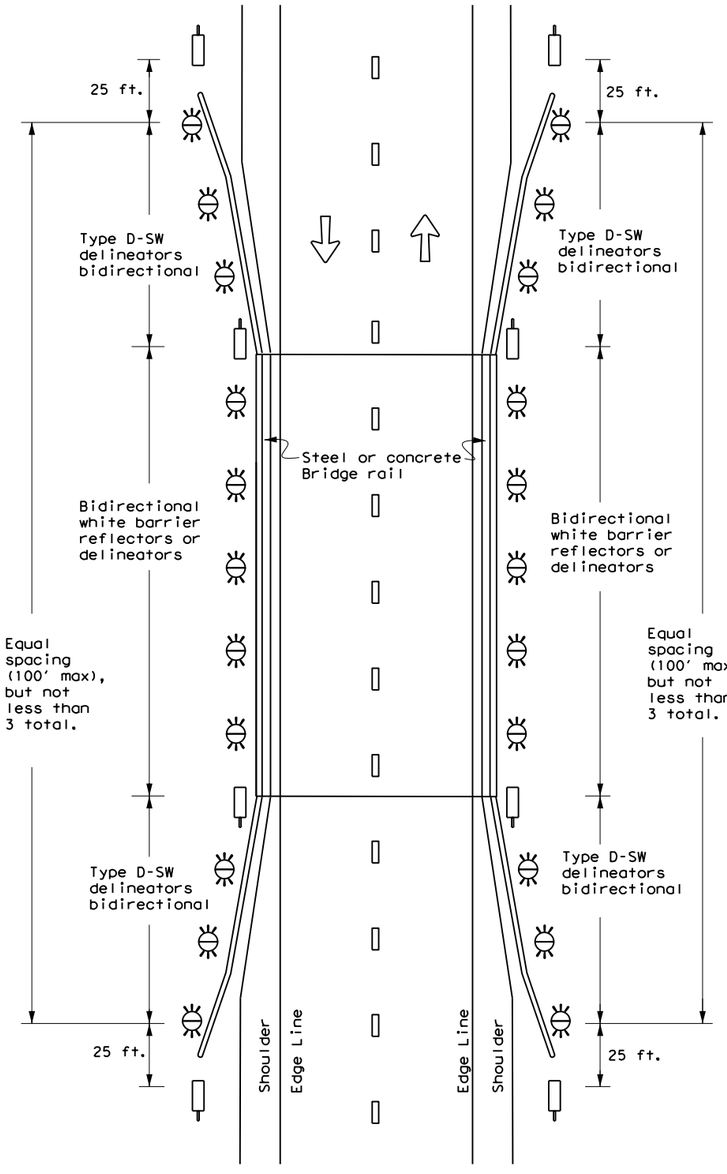


TWO-WAY, TWO LANE ROADWAY WITH METAL BEAM GUARD FENCE (MBGF)

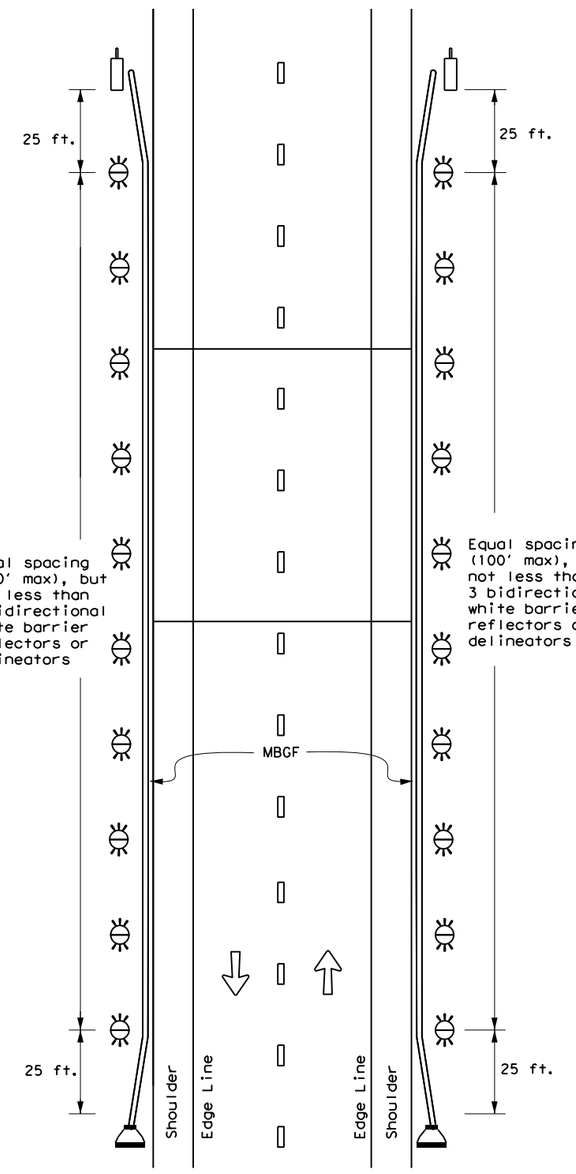

NOTE:
If terminal ends include an object marker, there is no need to install an OM-2 in front of terminal.

TWO-WAY, TWO LANE ROADWAY BRIDGE WITH NO APPROACH RAIL

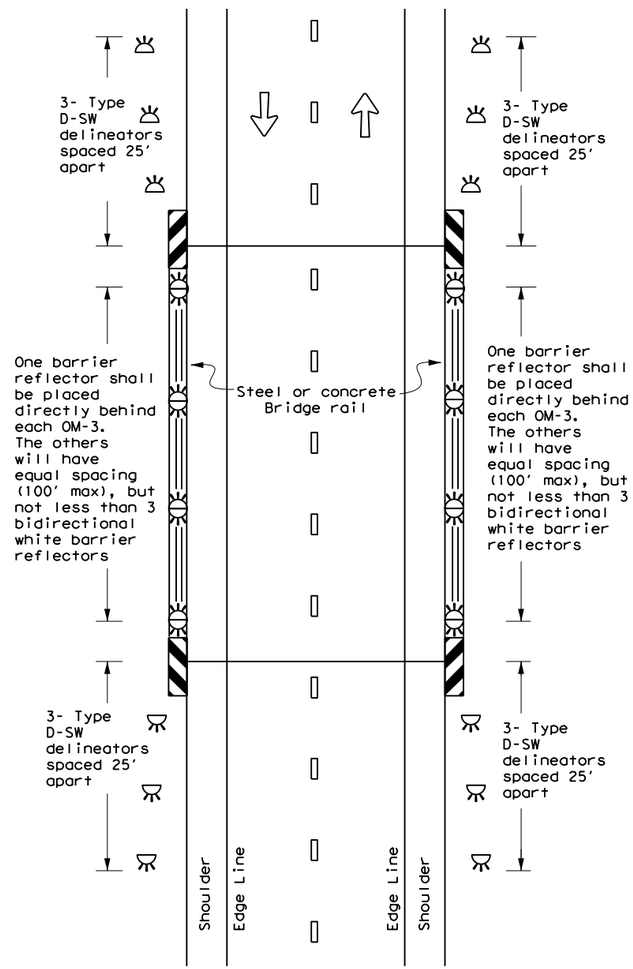

LEGEND

	Bidirectional Delineator
	Delineator
	OM-3
	OM-2
	Terminal End
	TRAFFIC FLOW

Texas Department of Transportation

Traffic Operations Division Standard


DELINEATOR & OBJECT MARKER PLACEMENT DETAILS


D & OM(5)-15


FILE: dom5-15.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT August 2015	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		47


20E


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

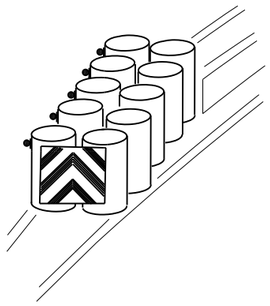


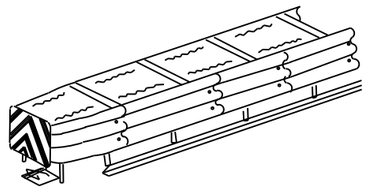


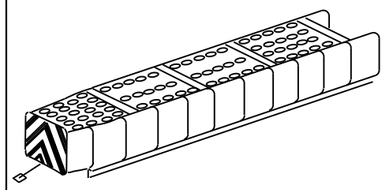

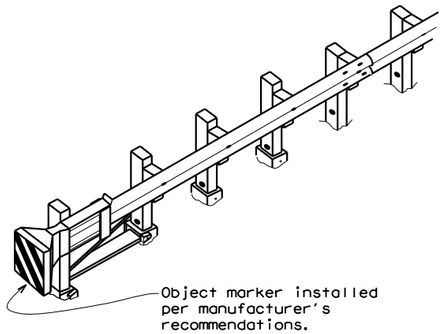


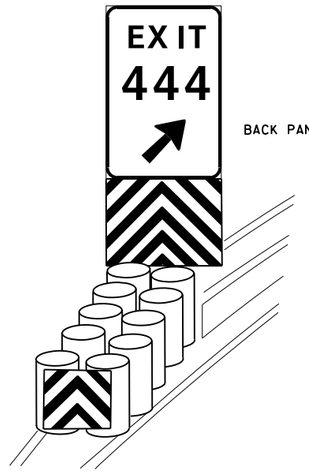

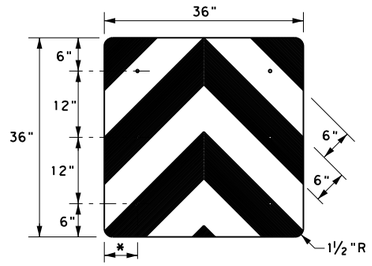


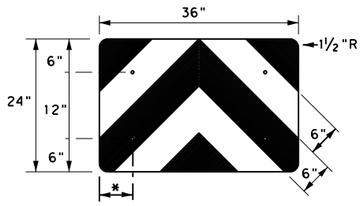



* Adjust to fit attenuator per manufacturer's recommendation, or as directed by the Engineer

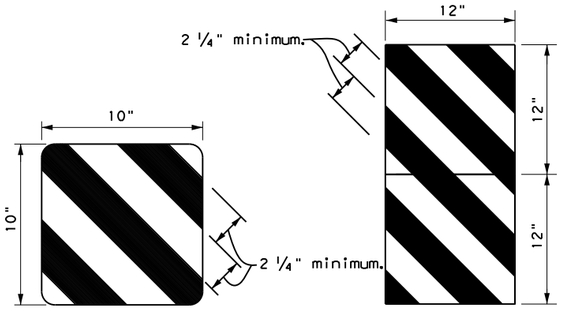


OBJECT MARKERS SMALLER THAN 3 FT^2

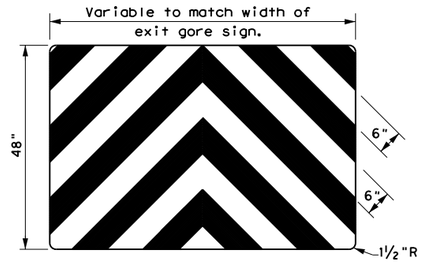

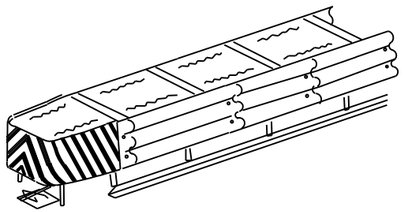

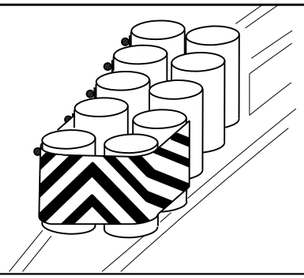

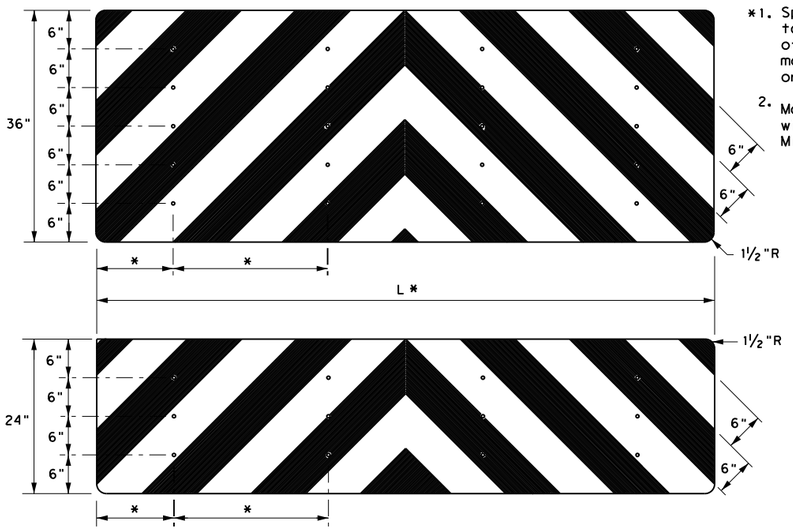

NOTES

*1. Spacing should be adjusted to attach through centerline of drum, per attenuator manufacturers recommendation, or as directed by the Engineer.

2. Mounting should be flush with top of attenuator. Minimum size 96" x 24".

NOTES

1. Object Markers shall conform to the Texas MUTCD and meet the color and reflectivity requirement of Department Material Specification DMS 8300. Background shall be yellow reflective sheeting (Type B or C) and Chevron shall be black.

2. Object Markers may be fabricated from adhesive backed reflective sheeting applied directly to guardrail end treatment, or applied directly to an "end cap" as per the manufacturer's recommendation. Direct applied sheeting shall provide a smooth surface and have no wrinkles, air bubbles, cuts or tears. A radius at the corners is not required for direct applied sheeting.

3. Object Marker size may be reduced to fit smaller devices. Width of alternating black and yellow stripes are typically 6". Object Markers smaller than 3ft may have reduced width stripes of a minimum of 2 ¼".

4. Pop rivets, screws, or nuts and bolts may be used to attach object markers and reflectors. Holes, slots or other openings may be cut or drilled through object markers to allow cable or other attachments.

5. Object Marker at nose of attenuator is subsidiary to the attenuator.

6. See D & OM (1-4) for required barrier reflectors.

Texas Department of Transportation — Traffic Operations Division Standard

DELINEATOR & OBJECT MARKER FOR VEHICLE IMPACT ATTENUATORS


D & OM(VIA)-15

FILE: domvia15.dgn	DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
©TxDOT December 1989	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
4-92 8-04	DIST	COUNTY		SHEET NO.
8-95 3-15	AUS	WILLIAMSON		48
4-98				
20G				


DATE: 12/21/2017 9:17:07 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\Signing_Pavement_Markings\domvia15.dgn

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 12/21/2017 9:17:08 PM
FILE: H:\OBES\CR 200\Documents\WA-4*CR201-BS\SHEETS\Standards\Signing*PavementMarking\PMI-12.dgn

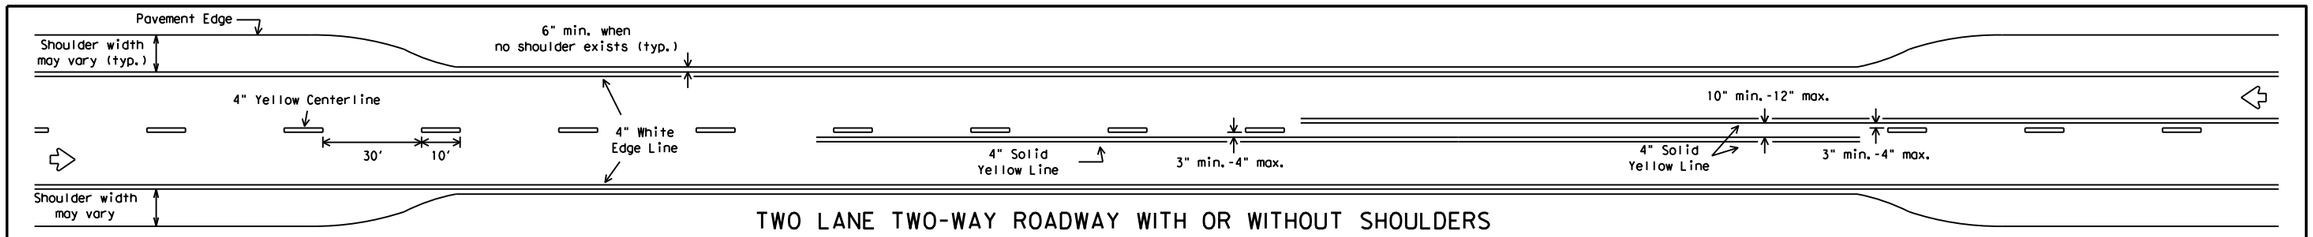


TWO LANE TWO-WAY ROADWAY WITH OR WITHOUT SHOULDERS

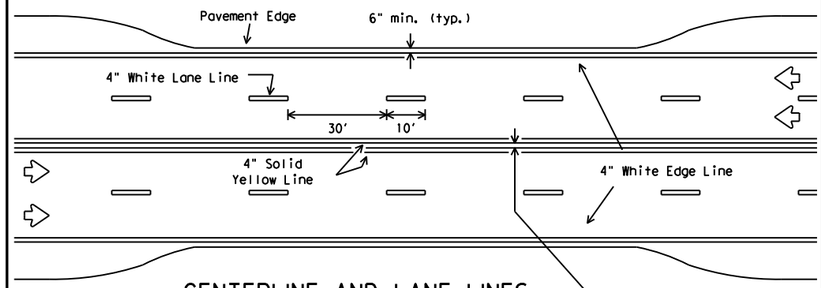

CENTERLINE AND LANE LINES
FOUR LANE TWO-WAY ROADWAY
WITH OR WITHOUT SHOULDERS

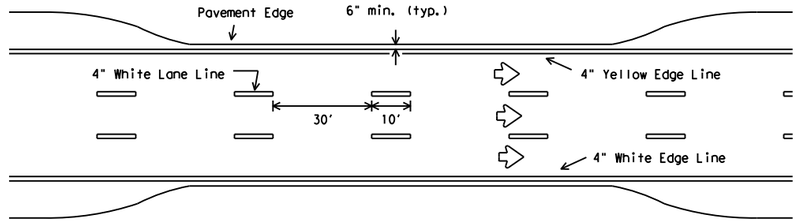


EDGE LINE AND LANE LINES
ONE-WAY ROADWAY
WITH OR WITHOUT SHOULDERS

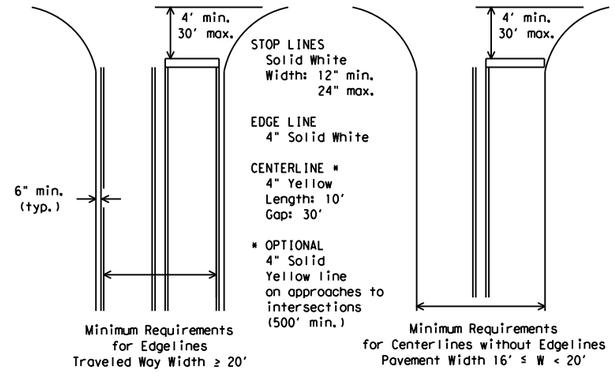


GUIDE FOR PLACEMENT OF STOP LINES, EDGE LINE & CENTERLINE

Based on Traveled Way and Pavement Widths for Undivided Highways

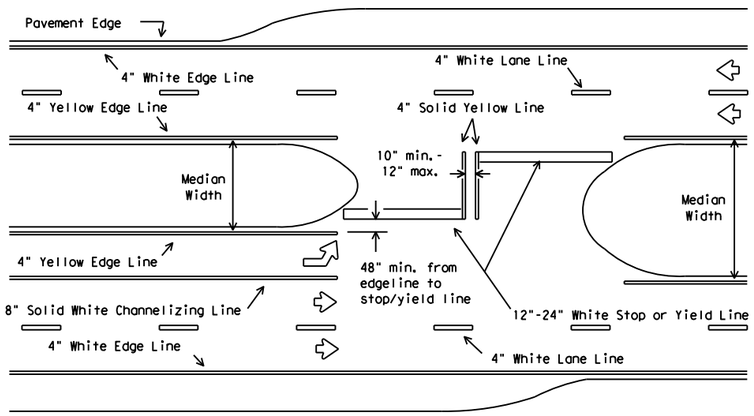

All medians shall be field measured to determine the location of necessary striping. Stop/Yield bars and centerlines shall be placed when the median width is greater than 30 ft. The median width is defined as the area between two roadways of a divided highway measured from edge of traveled way to edge of traveled way. The median excludes turn lanes. The median width might be different between intersections, interchanges and of opposite approaches of the same intersection. The narrow median width will be the controlling width to determine if markings are required.

FOUR LANE DIVIDED ROADWAY INTERSECTIONS

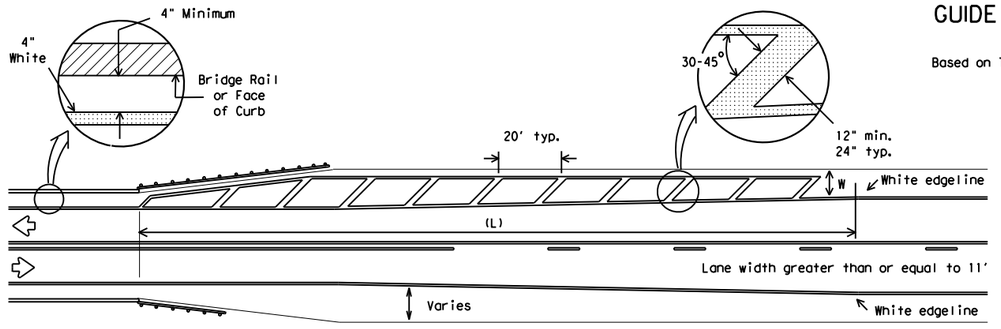

NOTES:

1. No-passing zone on bridge approach is optional but if used, it shall be a minimum 500 feet long.
2. For crosshatching length (L) see Table 1.
3. The width of the offset (W) and the required crosshatching width is the full shoulder width in advance of the bridge.
4. The crosshatching is not required if delineators or barrier reflectors are used along the structure.
5. For guard fence details, refer elsewhere in the plans.

ROADWAYS WITH REDUCED SHOULDER
WIDTHS ACROSS BRIDGE OR CULVERT

TABLE 1 - TYPICAL LENGTH (L)

Posted Speed *	Formula
≤ 40	$L = \frac{WS^2}{60}$
≥ 45	L=WS

* 85th Percentile Speed may be used on roads where traffic speeds normally exceed the posted speed limit. Crosshatching length should be rounded up to nearest 5 foot increment.

L=Length of Crosshatching (FT.) W=Width of Offset (FT.)
S=Posted Speed (MPH)

EXAMPLES:

An 8 foot shoulder in advance of a bridge reduces to 4 feet on a 70 MPH roadway. The length of the cross-hatching should be:

$L = 8 \times 70 = 560$ ft.

A 4 foot shoulder in advance of a bridge reduces to 2 feet on a 40 MPH roadway. The length of the cross-hatching should be:


$L = 4(40)^2 / 60 = 106.67$ ft. rounded to 110 ft.

GENERAL NOTES

1. Edgeline striping shall be as shown in the plans or as directed by the Engineer. The edgeline should typically be placed a minimum of 6 inches from the edge of pavement. This distance may vary due to pavement raveling or other conditions. Edgelines are not required in curb and gutter sections of roadways.
2. The traveled way includes only that portion of the roadway used for vehicular travel and not the parking lanes, sidewalks, berms and shoulders. The traveled ways shall be measured from the inside of edgeline to inside of edgeline of a two lane roadway.

MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240

All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.

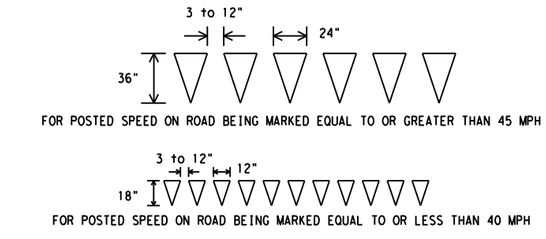

YIELD LINES

Texas Department of Transportation
Traffic Operations Division

TYPICAL STANDARD
PAVEMENT MARKINGS

PM(1)-12

© TxDOT November 1978


REVISIONS	DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
8-95 2-12	CONT	SECT	JOB	HIGHWAY
5-00	TBD	TBD	TBD	CR 200
8-00	DIST	COUNTY		SHEET NO.
3-03	AUS	WILLIAMSON		49

22A


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:17:08 PM
FILE: H:\OBES\CR 200\Documents\WA-4xCR201-BS\SHEETS\Standards\Signing+PavementMarking\PM2-12.DGN

REFLECTIVE RAISED PAVEMENT MARKERS FOR VEHICLE POSITIONING GUIDANCE

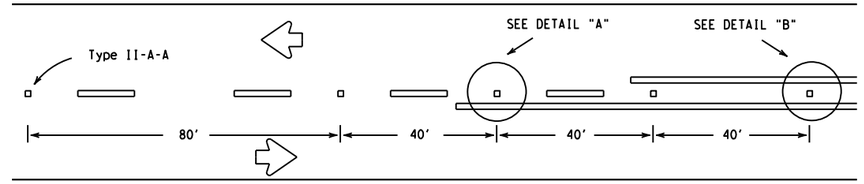


CENTERLINE FOR ALL TWO LANE ROADWAYS

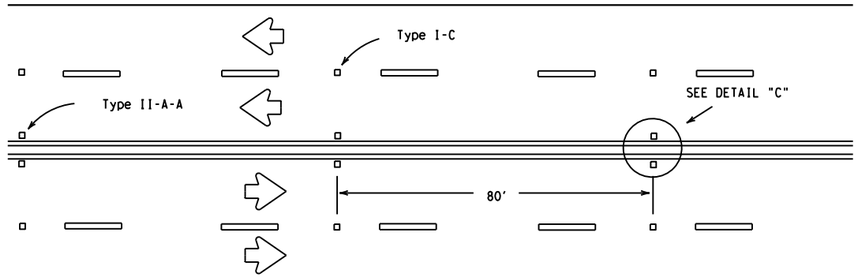


CENTERLINE & LANE LINES FOR FOUR LANE TWO-WAY HIGHWAYS

Raised pavement marker Type I-C, clear face toward normal traffic, shall be placed on 80-foot centers.

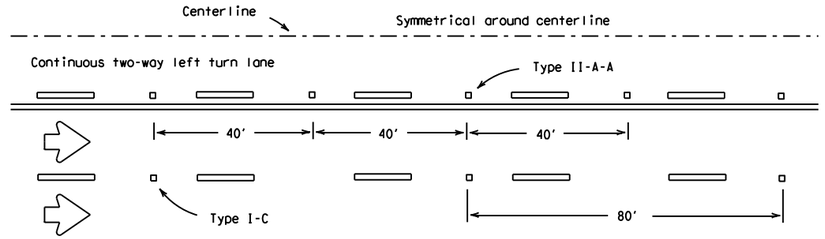



CENTERLINE AND LANE LINES FOR TWO-WAY LEFT TURN LANE

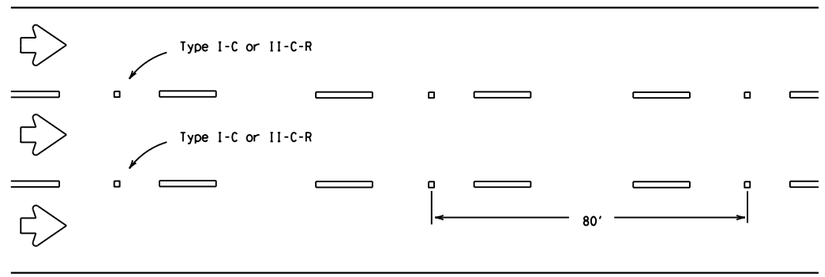

LANE LINES FOR ONE-WAY ROADWAY (NON-FREEWAY FACILITIES)

Raised pavement markers Type II-C-R shall have clear face toward normal traffic and red face toward wrong-way traffic.

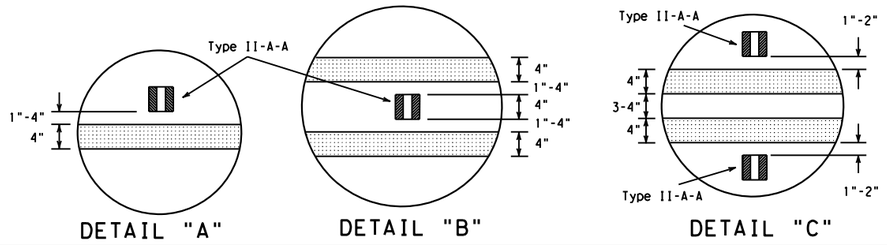

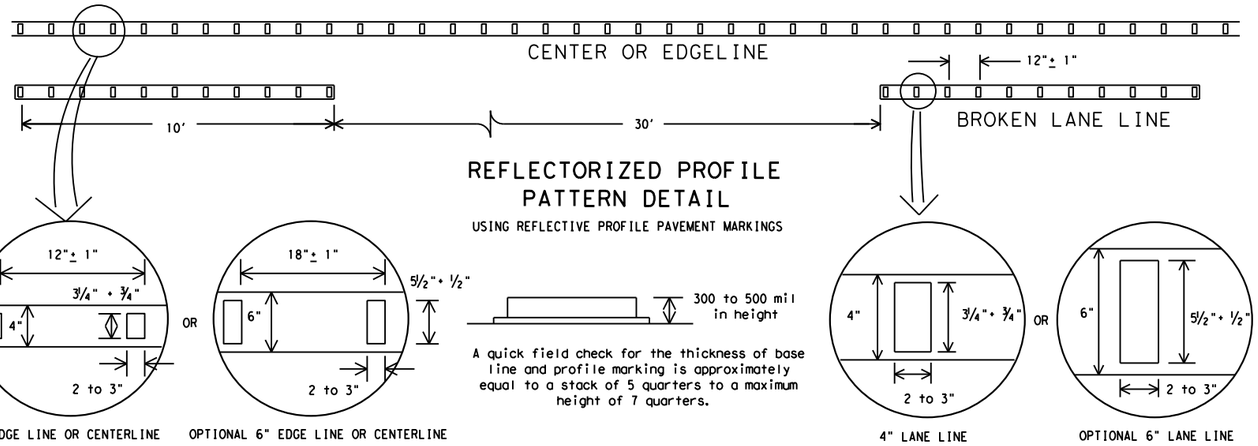

4" EDGE LINE OR CENTERLINE | OPTIONAL 6" EDGE LINE OR CENTERLINE | 4" LANE LINE | OPTIONAL 6" LANE LINE

NOTE:
Profile markings shall not be placed on roadways with a posted speed limit of 45 MPH or less.


GENERAL NOTES

All raised pavement markers placed in broken lines shall be placed in line with and midway between the stripes.


On concrete pavements the raised pavement markers should be placed to one side of the longitudinal joints.

MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240


All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.



Type I (Top View)



Type II (Top View)

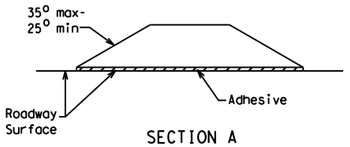

SECTION A

RAISED PAVEMENT MARKERS

Texas Department of Transportation
Traffic Operations Division

POSITION GUIDANCE USING RAISED MARKERS
REFLECTORIZED PROFILE MARKINGS
PM(2)-12


© TxDOT April 1977

REVISIONS		DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
4-92	2-10	CONT	SECT	JOB	HIGHWAY
5-00	2-12	TBD	TBD	TBD	CR 200
8-00		DIST	COUNTY		SHEET NO.
2-08		AUS	WILLIAMSON		50


22B

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 12/21/2017 9:17:08 PM
FILE: H:\OBES\CR 200\Documents\WA-4xCR201-BS\SHEETS\Standards\Signing*Pavement*Marking\PM3-12.DGN

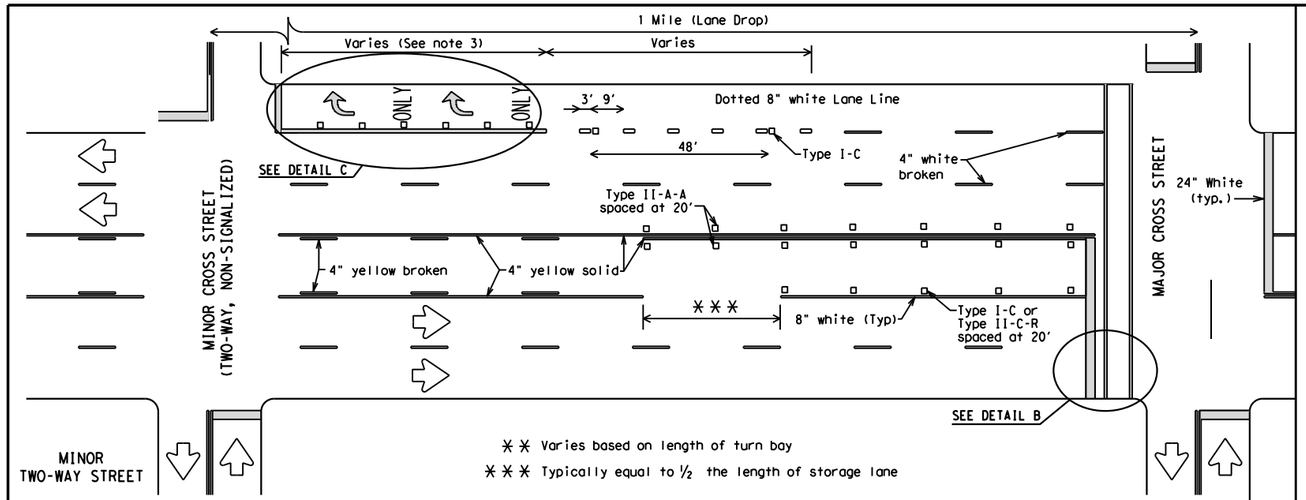


TYPICAL TWLTL AT TWO-WAY CROSS STREET AND RIGHT TURN LANE DROP

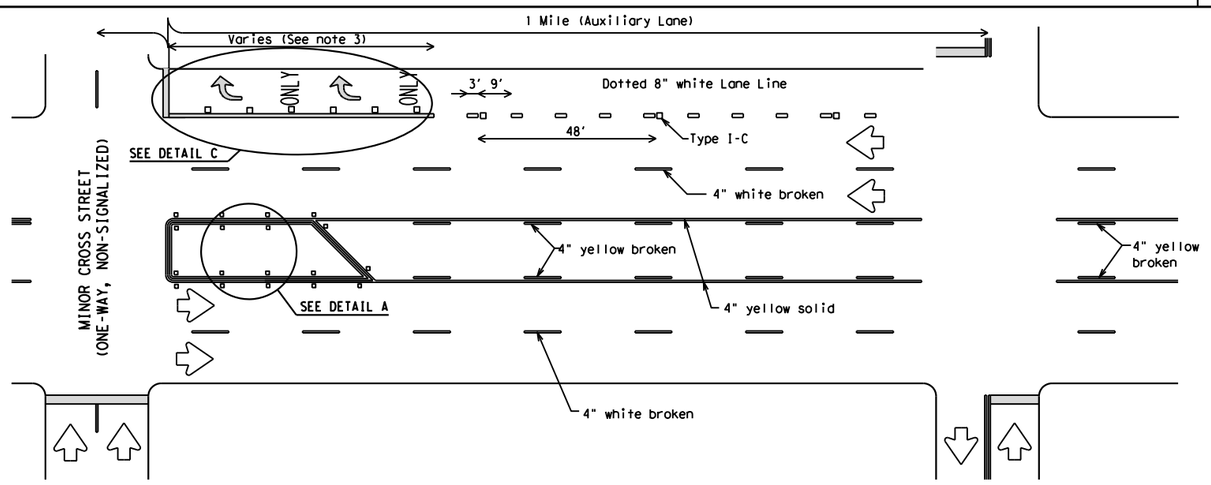


TYPICAL TWLTL AT ONE-WAY STREET AND RIGHT TURN AUXILIARY LANE

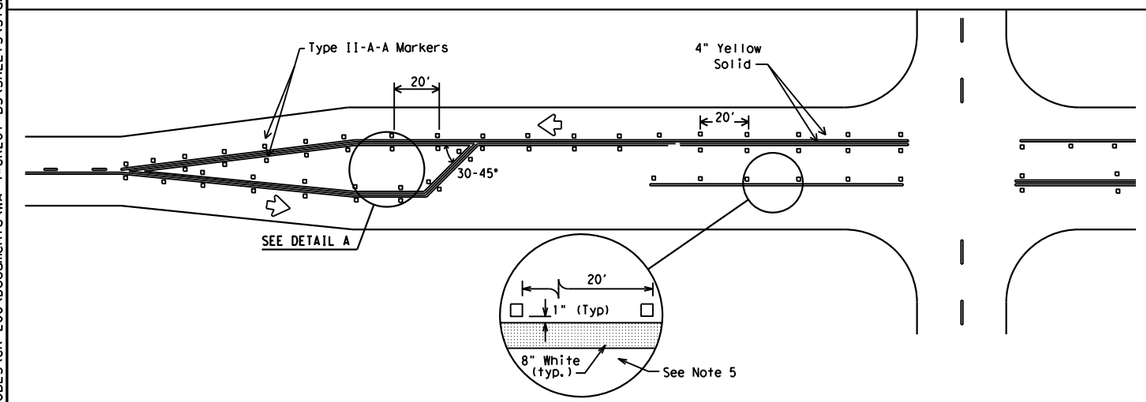

TYPICAL TWO-LANE HIGHWAY INTERSECTION WITH LEFT TURN BAYS

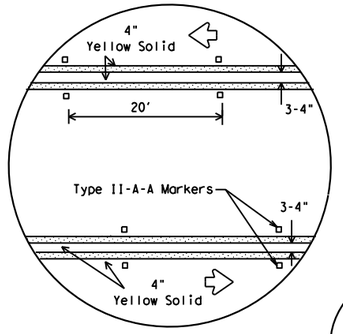


DETAIL A

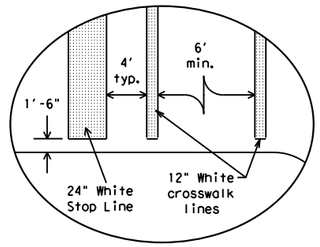

Final placement of Stop Bar and Crosswalk shall be approved by the Engineer in the field.


DETAIL B

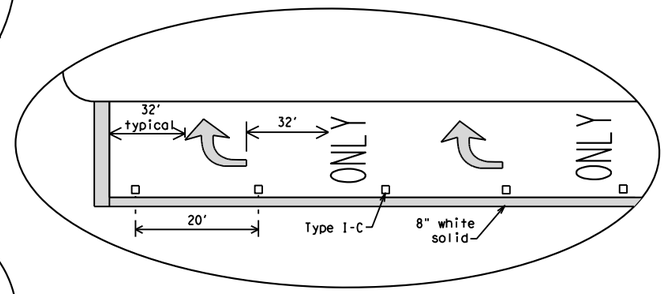

DETAIL C

MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240

All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.

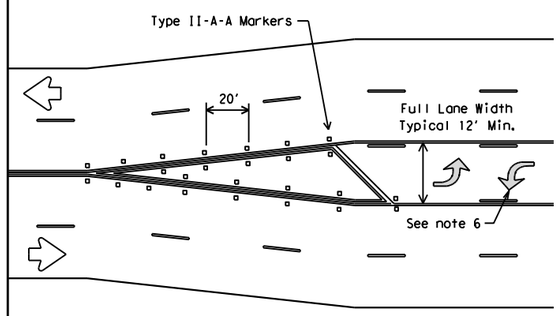

TYPICAL TRANSITION FOR TWLTL AND DIVIDED HIGHWAY

GENERAL NOTES

1. Refer elsewhere in plans for additional RPM placement and details.
2. Lane use word and arrow markings shall be used where through lanes approaching an intersection become mandatory turn lanes. Lane use word and arrow markings should be used in auxiliary lanes of substantial length. Lane use arrow markings or word and arrow markings may be used in other lanes and turn bays for emphasis. Details for words and arrows as shown in the Standard Highway Sign Designs for Texas.
3. When lane used word and arrow markings are used, two sets of arrows should be used if the length of the bay is greater than 180 feet. When a single lane use arrow or word and arrow marking is used for a short turn lane, it should be located at or near the upstream end of the full-width turn lane.
4. Other crosswalk paterns as shown in the "Texas Manual on Uniform Traffic Control Devices" may be used.
5. Raised pavement marker Type I-C with undivided highways, flush medians and two way left turn lanes. Raised pavement marker Type II-C-R with divided highways and raised medians.
6. A two-way left-turn (TWLT) lane-use arrow pavement marking should be used at or just downstream from the beginning of a two-way left-turn lane within a corridor. Repeating the marking after each intersection or dedicated turn bay is not required unless stated elsewhere in the plans.

Texas Department of Transportation
Traffic Operations Division

PAVEMENT MARKINGS FOR TWO-WAY LEFT TURN LANES DIVIDED HIGHWAYS AND RURAL LEFT TURN BAYS

PM(3)-12

© TxDOT April 1998

DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT


REVISIONS
5-00 2-12
8-00
3-03
2-10

CONT	SECT	JOB	HIGHWAY
TBD	TBD	TBD	CR 200
DIST	COUNTY		SHEET NO.
AUS	WILLIAMSON		51

22C


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:17:09 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\Signing_Pavement_Markings\rs(3)-13.dgn

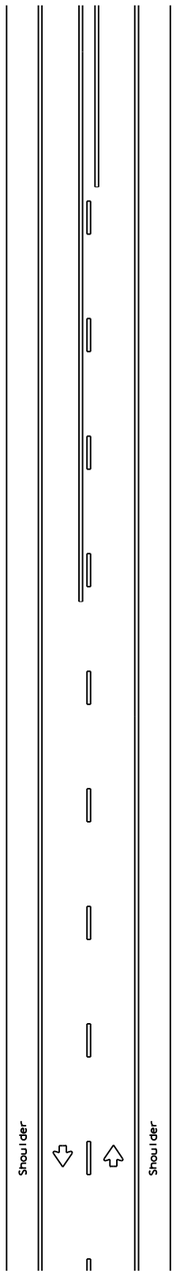


TWO LANE TWO-WAY ROADWAYS


CENTERLINE RUMBLE STRIPS

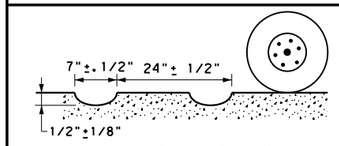


MILLED RUMBLE STRIPS

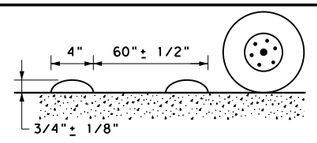

RAISED TRAFFIC BUTTONS

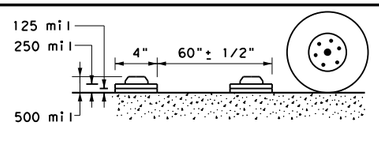


PREFORMED THERMOPLASTIC STRIPS




PROFILE MARKINGS

PROFILE VIEW

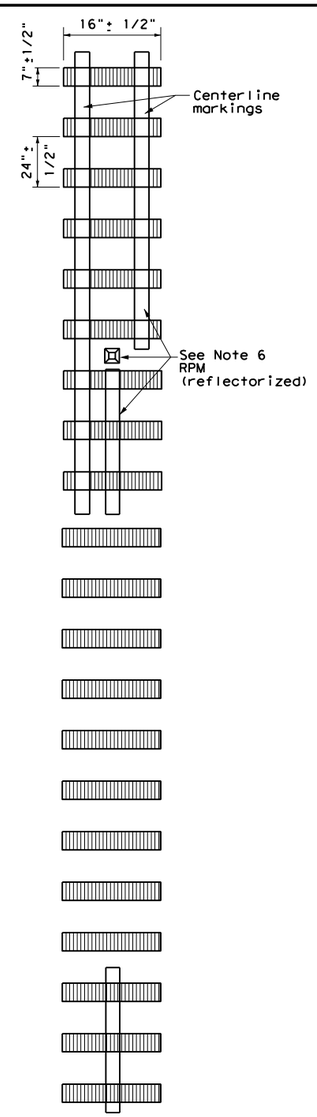


PLAN VIEW
OPTION 1

MILLED CENTERLINE RUMBLE STRIPS

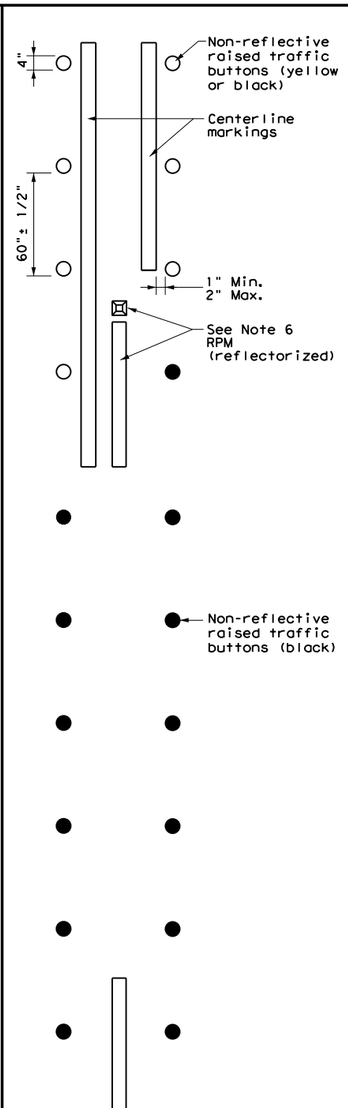


PLAN VIEW
OPTION 2

RAISED CENTERLINE RUMBLE STRIPS

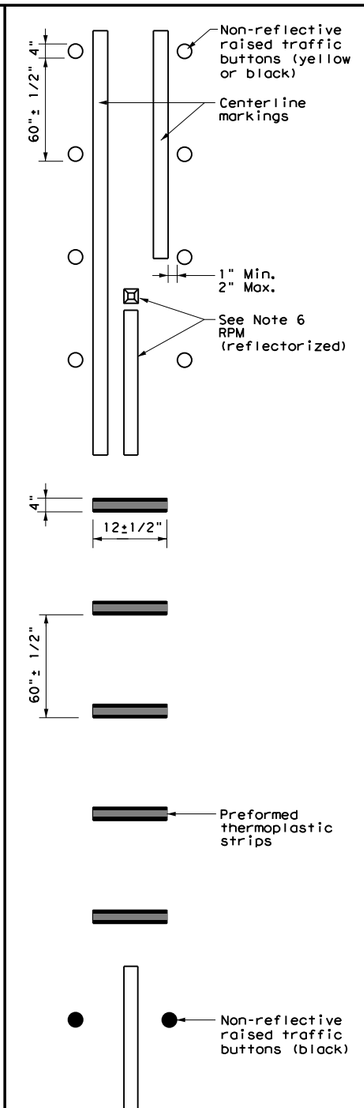

PLAN VIEW
OPTION 3

RAISED CENTERLINE RUMBLE STRIPS AND PREFORMED THERMOPLASTIC STRIPS

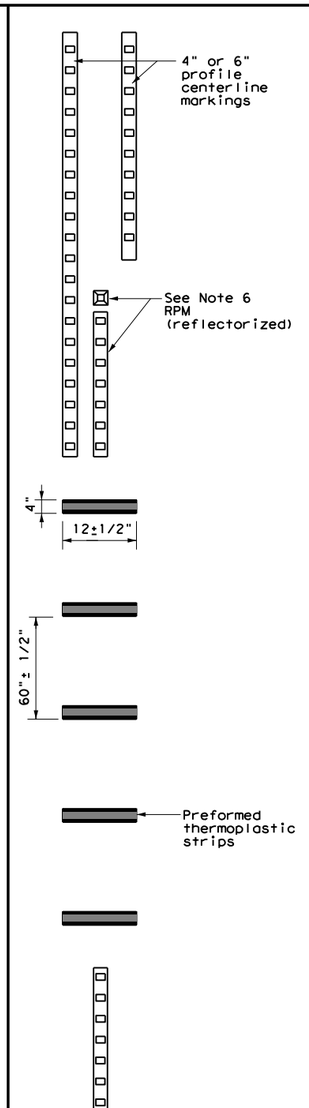

PLAN VIEW
OPTION 4

PROFILE CENTERLINE MARKINGS AND PREFORMED THERMOPLASTIC STRIPS

GENERAL NOTES

1. This standard sheet provides guidelines for installing centerline rumble strips on two-lane highways with or without shoulders.
2. Centerline and edgeline rumble strips or profile markings shall not be placed on roadways with a posted speed limit of 45 MPH or less.
3. Milled rumble strips are preferred when adequate pavement depth is available. If pavement thickness is less than 2 inches, milled rumble strips shall not be used. Rumble strips shall not be milled or depressed into bridge decks.
4. See dimensions for milled rumble strips. Other shapes and dimensions may be used if approved by the Traffic Operations Division.
5. Breaks in milled centerline rumble strips shall occur at least 50 feet and no more than 150 feet in advance of bridges, railroad crossings, intersections and driveways with high usage of large trucks.
6. Use Standard Sheet PM(2) for positioning, dimensioning, and spacing of all reflective raised pavement markers, and dimensions pavement markings and profile markings.
7. Consideration should be given to noise levels when centerline rumble strips are installed near residential areas, schools, churches, etc. A minimum of 3/8 inch depth of milled rumble strip may be considered in these areas.
8. Pavement markings must be applied over milled centerline rumble strips.

WHEN INSTALLING CENTERLINE RUMBLE STRIPS:

9. Raised rumble strips consisting of non-reflective raised traffic buttons may be used. Non-reflective raised traffic buttons can be affixed to asphalt or concrete with bitumen or adhesives, as per manufacturer's recommendations.
10. When using non-reflective raised traffic buttons as a centerline rumble strip, the button shall be placed adjacent to the pavement marking delineating the centerline. The buttons will be paid for under Item 672, "Raised Pavement Markers." Non-reflective traffic buttons must meet the requirements of DMS-4300.
11. The color of the button should be yellow for a continuous no passing roadway. Black buttons should be used in areas where passing is allowed.

WHEN INSTALLING EDGELINE RUMBLE STRIPS WITH OR WITHOUT CENTERLINE RUMBLE STRIPS ON UNDIVIDED HIGHWAYS:

12. See standard sheet RS(4).

Texas Department of Transportation®

Traffic Operations Division Standard

CENTERLINE RUMBLE STRIPS ON TWO LANE TWO-WAY HIGHWAYS


RS(3)-13

FILE: rs(3)-13.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT October 2013	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		52

92


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:17:09 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\Signing_Pavement_Markings\rs4(4)-13.dgn

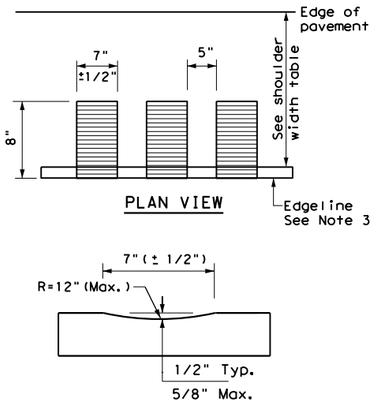

PROFILE VIEW
OPTION 1


CONTINUOUS MILLED DEPRESSIONS
(Rumble Stripes)

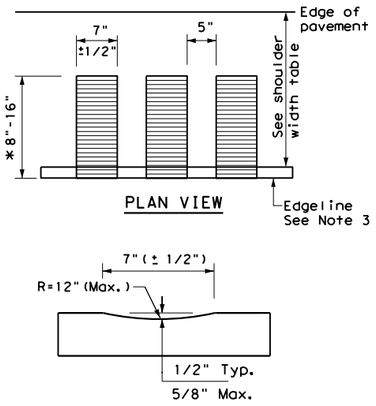

* This distance may vary based on width of shoulder

PROFILE VIEW
OPTION 2


CONTINUOUS MILLED DEPRESSIONS
(Rumble Stripes)

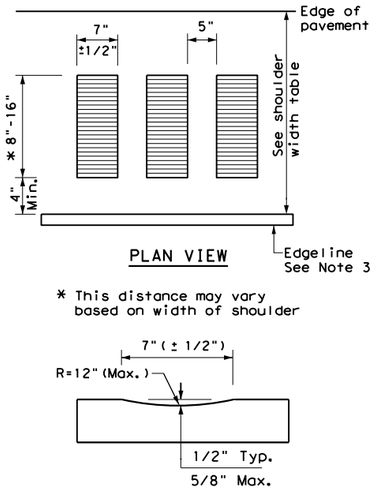

* This distance may vary based on width of shoulder


PROFILE VIEW
OPTION 3

CONTINUOUS MILLED DEPRESSIONS
(Rumble Strips)

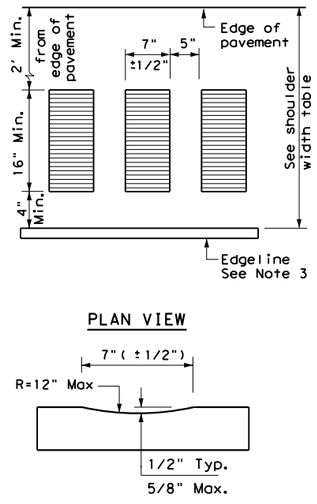


PROFILE VIEW
OPTION 4

CONTINUOUS MILLED DEPRESSIONS
(Rumble Strips)

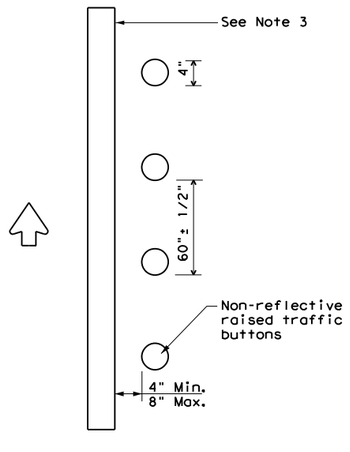

OPTION 5

RAISED EDGELINE RUMBLE STRIPS

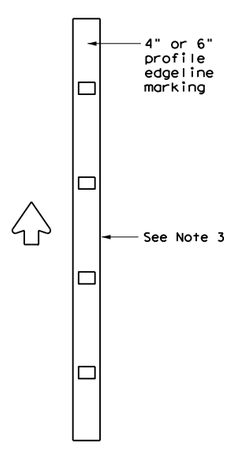

OPTION 6

PROFILE EDGELINE MARKINGS

SHOULDER WIDTH TABLE		
EQUAL TO OR LESS THAN 2 FEET	GREATER THAN 2 FEET LESS THAN 4 FEET	EQUAL TO OR GREATER THAN 4 FEET
Option 1, 5 OR 6	Option 1, 2, 3 5 OR 6	Option 2, 4, 5 OR 6

GENERAL NOTES

1. Rumble strips and profile markings shall not be placed on roadways with a posted speed limit of 45 MPH or less.
2. Milled rumble strips are preferred when adequate pavement depth is available. If pavement thickness is less than 2 inches, milled rumble strips shall not be used. Rumble strips shall not be milled or depressed into bridge decks.
3. Use Standard Sheet PM(2) for positioning, dimensioning, and spacing of all reflective raised pavement markers, pavement markings, and profile markings.
4. See the table below for determining what options may be used for edgeline rumble strips.

WHEN INSTALLING MILLED DEPRESSION EDGELINE RUMBLE STRIPS:

5. See dimensions for milled rumble strips. Other shapes and dimensions may be used if approved by the Traffic Operations Division.
6. Pavement markings can be applied over milled shoulder rumble strips to create an edgeline rumble stripe.
7. Breaks in edgeline rumble strips shall occur at least 50 feet and no more than 150 feet in advance of bridges, railroad crossings, intersections and driveways with high usage of large trucks when installed on conventional highways.
8. Rumble strips shall not be placed across exit or entrance ramps, acceleration and deceleration lanes, crossovers, gore areas or intersections with other roadways.
9. Consideration should be given to noise levels when edgeline rumble strips are installed near residential areas, schools, churches, etc. A minimum of 3/8 inches depth of milled rumble strip may be considered in these areas.
10. On roadways with high bicycle activity, consideration should be given before the installation of edgeline rumble strips. Things to consider include size of rumble strips, rumble strip material and location of rumble strips on the shoulder. If the designer determines that gaps are needed in the rumble strips due to bicycle use of the road, then follow the requirement shown in FHWA Technical Advisory T5040.39, or latest version. A detail of the spacing shall be included in the plans.

WHEN INSTALLING RAISED OR PROFILE EDGELINE RUMBLE STRIPS:

11. Raised rumble strips consisting of non-reflective raised traffic buttons may be used. Non-reflective raised traffic buttons can be affixed to asphalt or concrete with bitumen or adhesives, as per the manufacturer's recommendations.
12. Non-reflective traffic buttons shall be placed adjacent to the pavement marking delineating the edgeline when used as a rumble strip. The color of the button should match the color of the adjacent edgeline marking (white or yellow). The buttons will be paid for under Item 672, "Raised Pavement Markers." Non-reflective traffic buttons must meet the requirements of DMS-4300.
13. Non-reflective traffic buttons shall not be placed across exit or entrance ramps, acceleration and deceleration lanes, crossovers, gore areas or intersections with other roadways.
14. Breaks in edgeline rumble strips using raised traffic buttons shall occur at least 50 feet and no more than 150 feet in advance of bridges, railroad crossing, intersections and driveways with high usage of large trucks when installed on conventional highways.
15. The minimum distance between the edgeline and the buttons should be used if the shoulder is less than 8 feet in width.
16. Raised profile thermoplastic markings used as edgelines may substitute for buttons.

Texas Department of Transportation — Traffic Operations Division Standard

EDGELINE RUMBLE STRIPS ON UNDIVIDED OR TWO LANE HIGHWAYS
RS(4)-13

FILE: rs(4)-13.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT October 2013	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		53

93

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:17:09 PM
FILE: H:\OBES\CR 200\Documents\WA-4*CR201-BS\SHEETS\Standards\Signing*PavementMarking\smdgen.dgn

SIGN SUPPORT DESCRIPTIVE CODES

(Descriptive Codes correspond to project estimate and quantities sheets)

SM RD SGN ASSM TY XXXXX(X)XX(X-XXXX)

Post Type

FRP = Fiberglass Reinforced Plastic Pipe (see SMD(FRP))
TWT = Thin-Walled Tubing (see SMD(TWT))
10BWG = 10 BWG Tubing (see SMD(SLIP-1) to (SLIP-3))
S80 = Schedule 80 Pipe (see SMD(SLIP-1) to (SLIP-3))

Number of Posts (1 or 2)


Anchor Type

UA = Universal Anchor - Concreted (see SMD(FRP) and (TWT))
UB = Universal Anchor - Bolted down (see SMD(FRP) and (TWT))
WS = Wedge Anchor Steel - (see SMD(TWT))
WP = Wedge Anchor Plastic (see SMD(TWT))
SA = Slipbase - Concreted (see SMD(SLIP-1) to (SLIP-3))
SB = Slipbase - Bolted Down (see SMD(SLIP-1) to (SLIP-3))

Sign Mounting Designation

P = Prefab. "Plain" (see SMD(SLIP-1) to (SLIP-3), (TWT), (FRP))
T = Prefab. "T" (see SMD(SLIP-1) to (SLIP-3), (TWT))
U = Prefab. "U" (see SMD(SLIP-1) to (SLIP-3))
IF REQUIRED
1EXT or 2EXT = Number of Extensions (see SMD(SLIP-1) to (SLIP-3), (TWT))
BW = Extruded Wind Beam (see SMD(SLIP-1) to (SLIP-3))
WC = 1.12 #/ft Wing Channel (see SMD(SLIP-1) to (SLIP-3))
EXAL = Extruded Aluminum Sign Panels (see SMD(SLIP-1))


REQUIRED CLEARANCE FOR BREAKAWAY SUPPORT

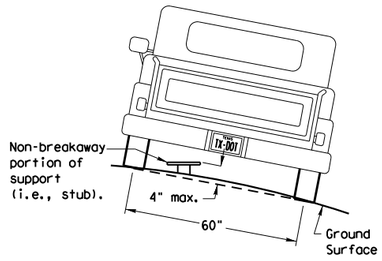

To avoid vehicle undercarriage snagging, any substantial remains of a breakaway support, when it is broken away, should not project more than 4 inches above a 60-inch chord (i.e., typical space between wheel paths).


SIGN LOCATION

PAVED SHOULDERS

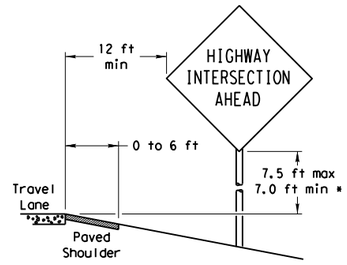

LESS THAN 6 FT. WIDE


When the shoulder is 6 ft. or less in width, the sign must be placed at least 12 ft. from the edge of the travel lane.

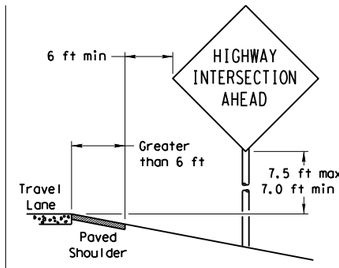


GREATER THAN 6 FT. WIDE

When the shoulder is greater than 6 ft in width, the sign must be placed at least 6 ft. from the edge of the shoulder.


T-INTERSECTION

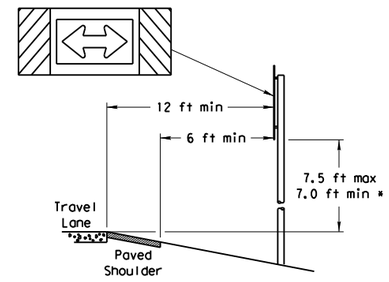


When this sign is needed at the end of a two-lane, two way roadway, the right edge of the sign should be in line with the centerline of the roadway. Place as close to ROW as practical.

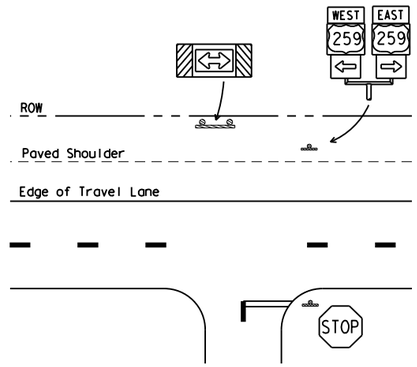

BEHIND BARRIER

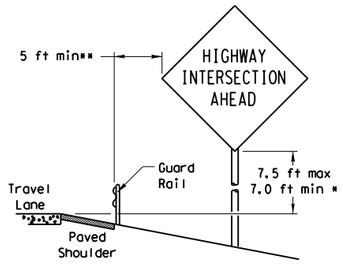

BEHIND GUARDRAIL

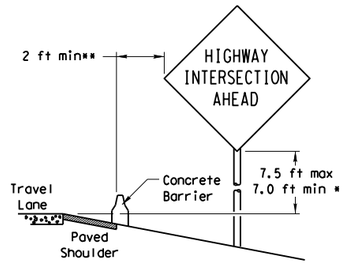

BEHIND CONCRETE BARRIER

**Sign clearance based on distance required for proper guard rail or concrete barrier performance.

* Signs shall be mounted using the following condition that results in the greatest sign elevation:

(1) a minimum of 7 to a maximum of 7.5 feet above the edge of the travel lane or


(2) a minimum of 7 to a maximum of 7.5 feet above the grade at the base of the support when sign is installed on the backslope.

The maximum values may be increased when directed by the Engineer.

See the Traffic Operations Division website for detailed drawings of sign clamps, Triangular Slipbase System components and Wedge Anchor System components.


The website address is:
http://www.txdot.gov/publications/traffic.htm

No more than 2 sign posts should be located within a 7 ft. circle.

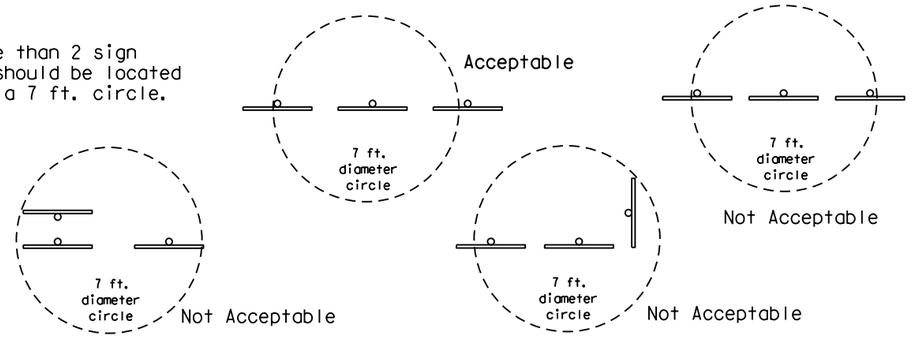

TYPICAL SIGN ATTACHMENT DETAIL

Single Signs

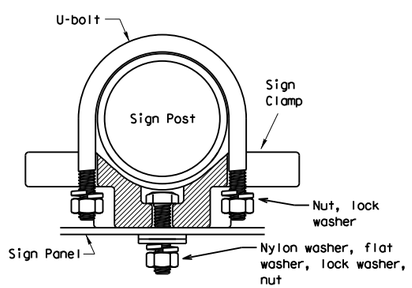


Bolts used to mount sign panels to the clamp are 5/16-18 UNC galvanized square head with nut, nylon washer, flat washer and lock washer. The bolt length is 1 inch for aluminum.

When two sign clamps are used to mount signs back-to-back, use a 5/16-18 UNC galvanized hex head per ASTM A307 with nut and helical-spring lock washer. The approximate bolt lengths for various post sizes and sign clamp types are given in the table at right. The bolt length may need to be adjusted depending upon field conditions.


Sign clamps may be either the specific size clamp or the universal clamp.

Back-to-Back Signs

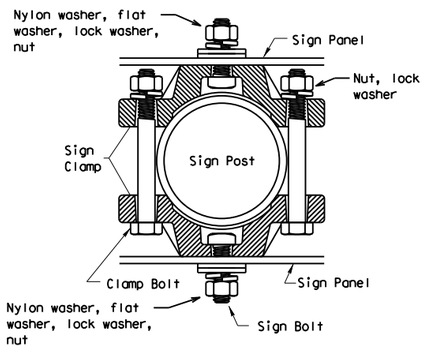


Pipe Diameter	Approximate Bolt Length	
	Specific Clamp	Universal Clamp
2" nominal	3"	3 or 3 1/2"
2 1/2" nominal	3 or 3 1/2"	3 1/2 or 4"
3" nominal	3 1/2 or 4"	4 1/2"

SIGNS WITH PLAQUES

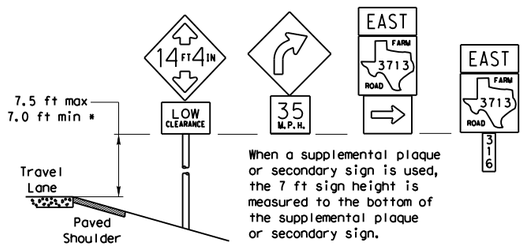


When a supplemental plaque or secondary sign is used, the 7 ft sign height is measured to the bottom of the supplemental plaque or secondary sign.

CURB & GUTTER OR RAISED ISLAND

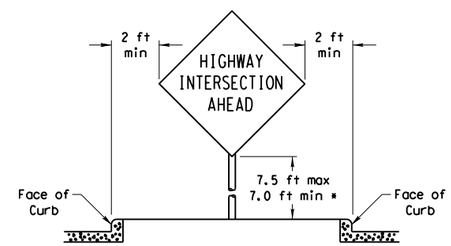

RESTRICTED RIGHT-OF-WAY

(When 6 ft min. is not possible.)

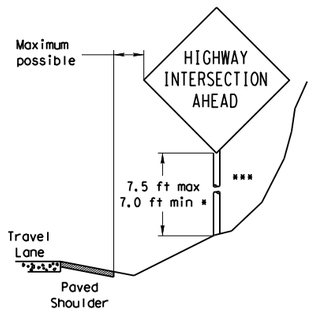

Right-of-way restrictions may be created by rocks, water, vegetation, forest, buildings, a narrow island, or other factors.

In situations where a lateral restriction prevents the minimum horizontal clearance from the edge of the travel lane, signs should be placed as far from the travel lane as practical.

*** Post may be shorter if protected by guardrail or if Engineer determines the post could not be hit due to extreme slope.

Texas Department of Transportation
Traffic Operations Division

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS GENERAL NOTES & DETAILS

SMD(GEN)-08


©TxDOT July 2002	DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
9-08 REVISIONS	CONT	SECT	JOB	HIGHWAY
	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		54

26A

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:17:10 PM
FILE: H:\OBES\CR 200\Documents\WA-4*CR201-BS\SHEETS\Standards\Signing*PavementMarking\smds1.dgn

TRIANGULAR SLIPBASE INSTALLATION GENERAL REQUIREMENTS

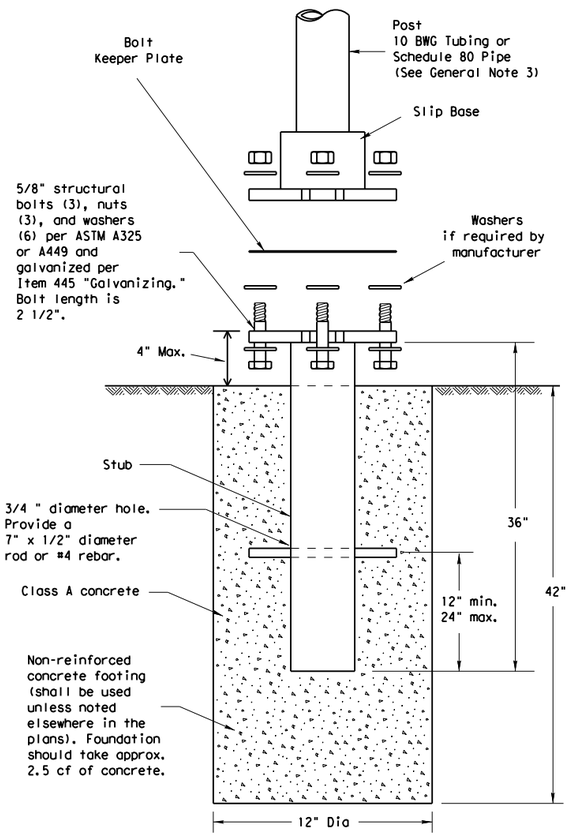

SM RD SGN ASSM TY XXXXX(X)SA(X-XXXX)

NOTE

There are various devices approved for the Triangular Slipbase System. Please reference the Material Producer List for approved slip base systems. http://www.txdot.gov/business/producer_list.htm The devices shall be installed per manufacturers' recommendations. Installation procedures shall be provided to the Engineer by Contractor.

GENERAL NOTES:


1. Slip base shall be permanently marked to indicate manufacturer. Method, design, and location of marking are subject to approval of the TxDOT Traffic Standards Engineer.
2. Material used as post with this system shall conform to the following specifications:
   10 BWG Tubing (2.875" outside diameter)
   0.134" nominal wall thickness
   Seamless or electric-resistance welded steel tubing or pipe
   Steel shall be HSLAS Gr 55 per ASTM A1011 or ASTM A1008
   Other steels may be used if they meet the following:
   55,000 PSI minimum yield strength
   70,000 PSI minimum tensile strength
   20% minimum elongation in 2"
   Wall thickness (uncoated) shall be within the range of 0.122" to 0.138"
   Outside diameter (uncoated) shall be within the range of 2.867" to 2.883"
   Galvanization per ASTM A123 or ASTM A653 G210. For precoated steel tubing (ASTM A653), recoat tube outside diameter weld seam by metallizing with zinc wire per ASTM B833.
   Schedule 80 Pipe (2.875" outside diameter)
   0.276" nominal wall thickness
   Steel tubing per ASTM A500 Gr C
   Other seamless or electric-resistance welded steel tubing or pipe with equivalent outside diameter and wall thickness may be used if they meet the following:
   46,000 PSI minimum yield strength
   62,000 PSI minimum tensile strength
   21% minimum elongation in 2"
   Wall thickness (uncoated) shall be within the range of 0.248" to 0.304"
   Outside diameter (uncoated) shall be within the range of 2.855" to 2.895"
   Galvanization per ASTM A123
3. See the Traffic Operations Division website for detailed drawings of sign clamps and Texas Universal Triangular Slipbase System components. The website address is: http://www.txdot.gov/publications/traffic.htm
4. Sign supports shall not be spliced except where shown. Sign support posts shall not be spliced.

ASSEMBLY PROCEDURE

Foundation
1. Prepare 12-inch diameter by 42-inch deep hole. If solid rock is encountered, the depth of the foundation may be reduced such that it is embedded a minimum of 18 inches into the solid rock.
2. The Engineer may permit batches of concrete less than 2 cubic yards to be mixed with a portable, motor-driven concrete mixer. For small placements less than 0.5 cubic yards, hand mixing in a suitable container may be allowed by Engineer. Concrete shall be Class A.
3. Push the pipe end of the slip base stub into the center of the concrete. Rotate the stub back and forth while pushing it down into the concrete to assure good contact between the concrete and stub. Continue to work the stub into the concrete until it is between 2 to 4 inches above the ground.
4. Plumb the stub. Allow a minimum of 4 days to set, unless otherwise directed by the Engineer.
5. The triangular slipbase system is multidirectional and is designed to release when struck from any direction.

Support
1. Cut support so that the bottom of the sign will be 7 to 7.5 feet above the edge of the travelway (i.e., edge of the closest lane) when slip plate is below the edge of pavement or 7 to 7.5 feet above slip plate when the slip plate is above the edge of the travelway. The cut shall be plumb and straight.
2. Attach sign to support using connections shown. When multiple signs are installed on the same support, ensure the minimum clearance between each sign is maintained. See SMD(SLIP-2) for clearances based on sign types.

CONCRETE ANCHOR

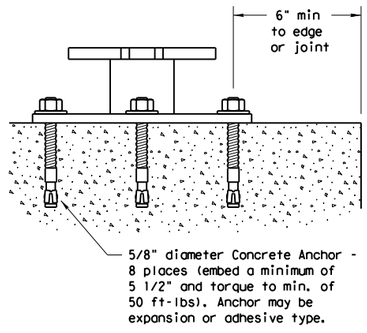

SM RD SGN ASSM TY XXXXX(X)SB(X-XXXX)

Concrete anchor consists of 5/8" diameter stud bolt with UNC series bolt threads on the upper end. Heavy hex nut per ASTM A563, and hardened washer per ASTM F436. The stud bolt shall have a minimum yield and ultimate tensile strength of 50 and 75 KSI, respectively. Nuts, bolts and washers shall be galvanized per Item 445, "Galvanizing." Adhesive type anchors shall have stud bolts installed with Type III epoxy per DMS-6100, "Epoxies and Adhesives." Adhesive anchors may be loaded after adequate epoxy cure time per the manufacturer's recommendations. Top of bolt shall extend at least flush with top of the nut when installed. The anchor, when installed in 4000 psi normal-weight concrete with a 5 1/2" minimum embedment, shall have a minimum allowable tension and shear of 3900 and 3100 psi, respectively.

Texas Department of Transportation
Traffic Operations Division

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM


SMD(SLIP-1)-08

©TxDOT July 2002	DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
9-08 REVISIONS	CONT	SECT	JOB	HIGHWAY
	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		55


26B

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 12/21/2017 9:17:10 PM
FILE: H:\OBESIGR 200\Documents\WA-4*CR201-BS\SHEETS\Standards\Signing*PavementMarking\smds2.dgn

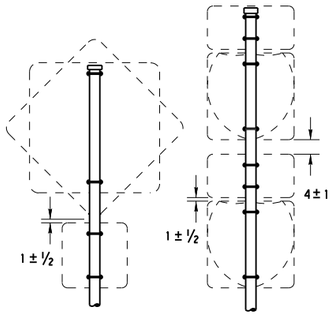


SM RD SGN ASSM TY XXXXX(1)XX(P)

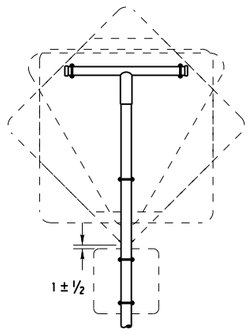


SM RD SGN ASSM TY XXXXX(1)XX(T)

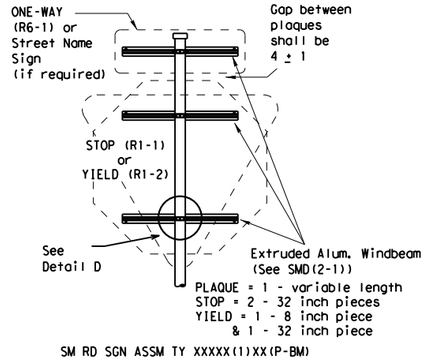


SM RD SGN ASSM TY XXXXX(1)XX(P-BM)

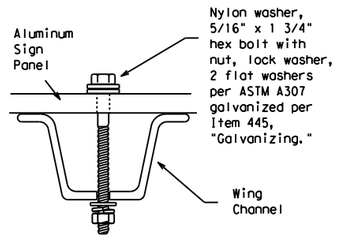


Detail A

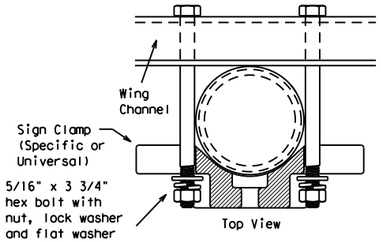


Detail B




SM RD SGN ASSM TY XXXXX(1)XX(U)

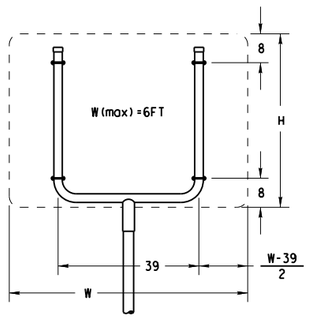

SM RD SGN ASSM TY XXXXX(1)XX(U)

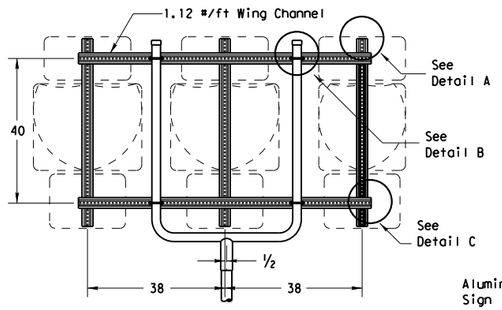


SM RD SGN ASSM TY XXXXX(1)XX(U-WC)
(See Note 11)

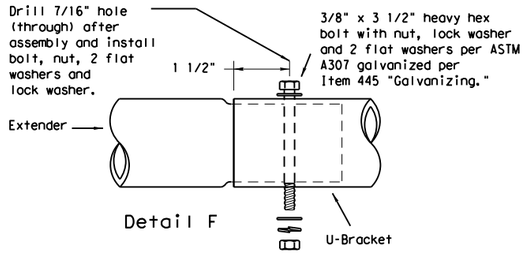


Detail F


Splices shall only be allowed behind the sign substrate.

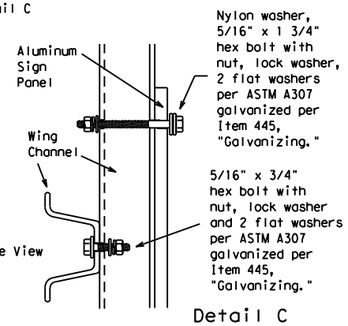


Detail C

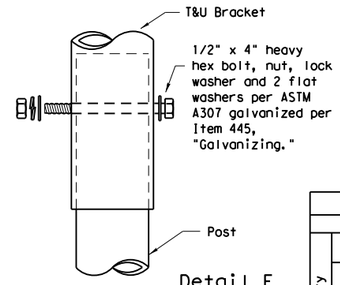


Detail E

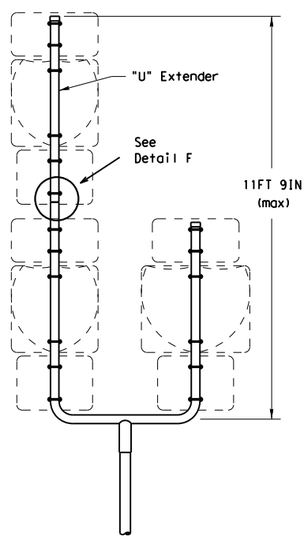

SM RD SGN ASSM TY S80(1)XX(U-1EXT)

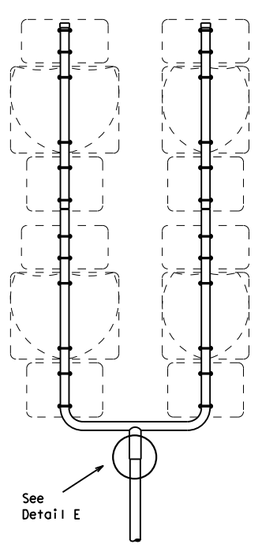


SM RD SGN ASSM TY S80(1)XX(U-2EXT)

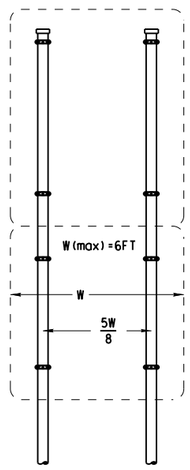



SM RD SGN ASSYM TY XXXXX(2)XX(P)

SIDE VIEW

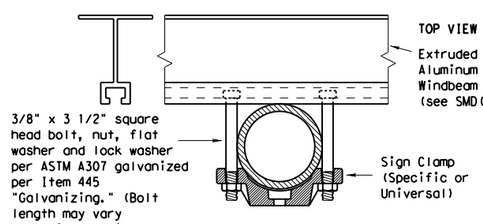

Detail D




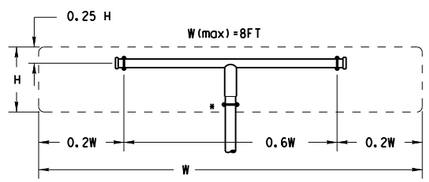

SM RD SGN ASSM TY XXXXX(1)XX(T)
(* - See Note 12)

All dimensions are in english unless detailed otherwise.

FRICTION CAP DETAIL

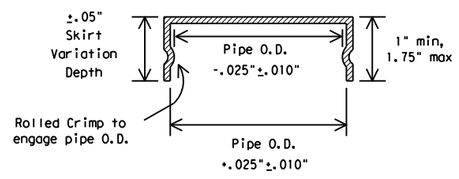

Friction caps may be manufactured from hot rolled or cold rolled steel sheets. The minimum sheet metal thickness shall be 24 gauge for all cap sizes.

The rim edges shall be reasonably straight and smooth. Caps shall be sized and formed in such a manner as to produce a drive-on friction fit and have no tendency to rock when seated on the pipe. The depth shall be sufficient to give positive protection against entrance of rainwater. They shall be free of sharp creases or indentations and show no evidence of metal fracture.

Caps shall have an electrodeposited coating of zinc in accordance with the requirements of ASTM B633 Class FE/ZN 8.

GENERAL NOTES:

1.

SIGN SUPPORT	# OF POSTS	MAX. SIGN AREA
10 BWG	1	16 SF
10 BWG	2	32 SF
Sch 80	1	32 SF
Sch 80	2	64 SF

2. The Engineer may require that a Schedule 80 post be used in place of a 10 BWG where a sign height is abnormally high due to a fill slope.
3. Sign supports shall not be spliced except where shown. Sign support posts shall not be spliced.
4. Aluminum sign blanks shall conform to Departmental Material Specifications DMS-7110 and shall have the following minimum thicknesses: 0.080 for signs less than 7.5 sq. ft., 0.100 for signs 7.5 to 15 sq. ft., and 0.125 for signs greater than 15 sq. ft.
5. Signs that require specific supports due to reasons in addition to windloading are indicated on the "REQUIRED SUPPORT" table on this sheet.
6. For horizontal rectangular signs fabricated from flat aluminum, T-brackets are used for signs 24 inches or less in height. U-brackets are used for signs of greater height.
7. When two triangular slipbase supports are used to support a single sign, they shall not be "rigidly" connected to each other except through the sign panel. This will allow each support to act independently when impacted by an errant vehicle.
8. Wing channel shall meet ASTM A 1011 SS Gr 50 and be galvanized per ASTM A 123.
9. Excess pipe, wing channel, or windbeam shall be cut off so that it does not extend beyond the sign panel (i.e., excess support shall not be visible when the sign is viewed from the front.) Repair galvanized coating at cut support ends per Item 445, "Galvanizing."
10. Additional route markers may be added vertically, provided the total sign area does not exceed the maximum allowable amount per Note 1.
11. Additional sign clamp required on the "T-bracket" post for 24 inch height signs. Place the clamp 3 inches above bottom of sign when possible.
12. Post open ends shall be fitted with Friction Caps.
13. Sign blanks shall be the sizes and shapes shown on the plans.

REQUIRED SUPPORT

	SIGN DESCRIPTION	SUPPORT
Regulatory	48-inch STOP sign (R1-1)	TY 10BWG(1)XX(T) TY 10BWG(1)XX(P-BM)
	60-inch YIELD sign (R1-2)	TY 10BWG(1)XX(T) TY 10BWG(1)XX(P-BM)
	48x16-inch ONE-WAY sign (R6-1)	TY 10BWG(1)XX(T) TY 10BWG(1)XX(P-BM)
	36x48, 48x36, and 48x48-inch signs	TY 10BWG(1)XX(T)
	48x60-inch signs	TY S80(1)XX(T)
Warning	48x48-inch signs (diamond or square)	TY 10BWG(1)XX(T)
	48x60-inch signs	TY S80(1)XX(T)
	48-inch Advance School X-ing sign (S1-1)	TY 10BWG(1)XX(T)
	48-inch School X-ing sign (S2-1)	TY 10BWG(1)XX(T)
	Large Arrow sign (W1-6 & W1-7)	TY 10BWG(1)XX(T)

Texas Department of Transportation
Traffic Operations Division

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM

SMD(SLIP-2)-08


©TxDOT July 2002

REVISIONS	TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
9-08	CONT	SECT	JOB	HIGHWAY
	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		56


26C

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 12/21/2017 9:17:11 PM
FILE: H:\OBES\CR 200\Documents\WA-4*CR201-BS\SHEETS\Standards\Signing*PavementMarking\smd(slip-3).dgn

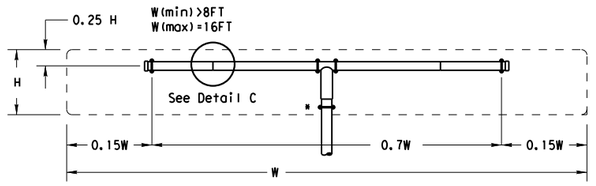


SM RD SGN ASSM TY XXXXX(1)XX(T-2EXT)
(* - See Note 12)

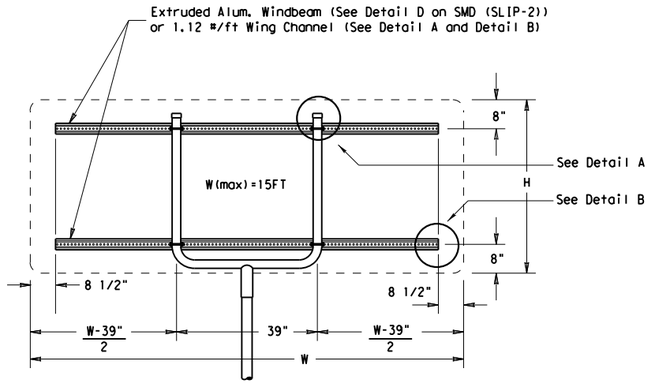


SM RD SGN ASSM TY XXXXX(1)XX(U-XX)

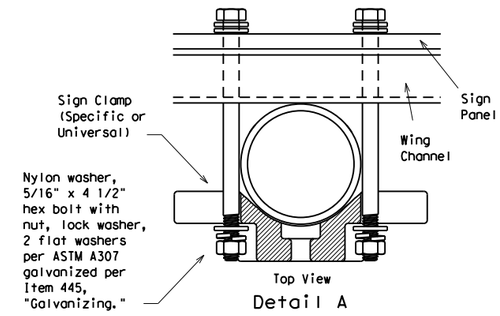


Detail A

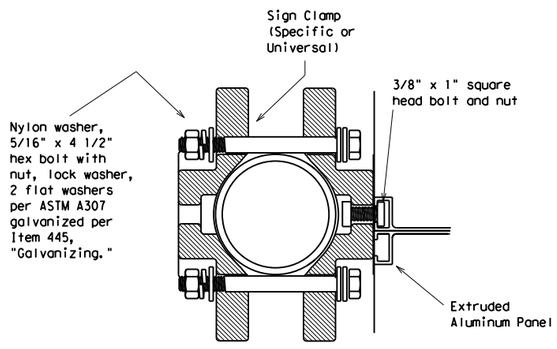

Detail D
EXTRUDED ALUMINUM SIGN WITH T BRACKET

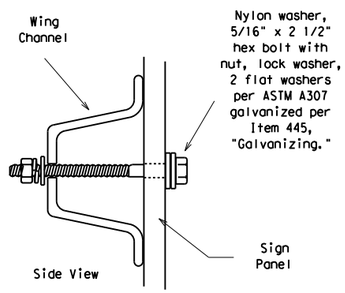


Detail B

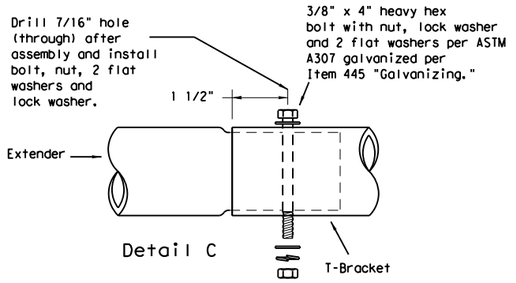


Detail C

Splices shall only be allowed behind the sign substrate.

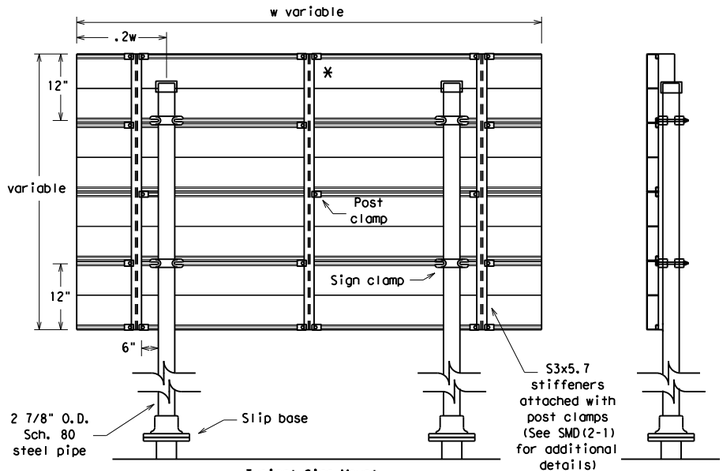


Typical Sign Mount
SM RD SGN ASSM TY S80(2)XX(P-EXAL)


* Additional stiffener placed at approximate center of signs when sign width is greater than 10'.

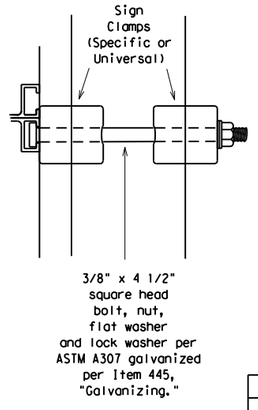

Detail E

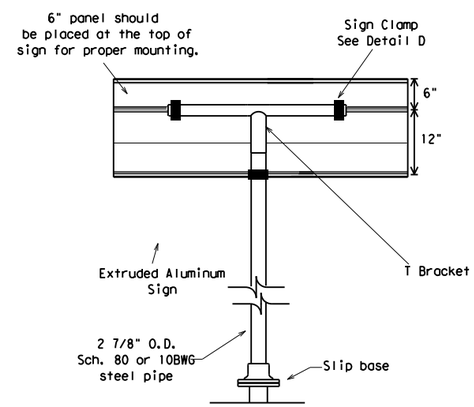

Extruded Aluminum Sign
With T Bracket

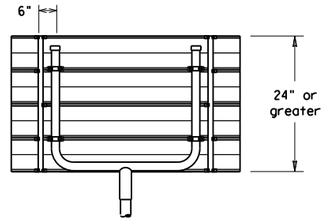

Use Extruded Alum. Windbeam as stiffeners
See SMD (2-1) for additional details

See Detail E
for clamp installation

GENERAL NOTES:

SIGN SUPPORT	# OF POSTS	MAX. SIGN AREA
10 BWG	1	16 SF
10 BWG	2	32 SF
Sch 80	1	32 SF
Sch 80	2	64 SF

1. The Engineer may require that a Schedule 80 post be used in place of a 10 BWG where a sign height is abnormally high due to a fill slope.
2. Sign supports shall not be spliced except where shown. Sign support posts shall not be spliced.
3. Aluminum sign blanks shall conform to Departmental Material Specifications DMS-7110 and shall have the following minimum thicknesses: 0.080 for signs less than 7.5 sq. ft., 0.100 for signs 7.5 to 15 sq. ft., and 0.125 for signs greater than 15 sq. ft.
4. Signs that require specific supports due to reasons in addition to windloading are indicated on the "REQUIRED SUPPORT" table on this sheet.
5. For horizontal rectangular signs fabricated from flat aluminum, T-brackets are used for signs 24 inches or less in height. U-brackets are used for signs of greater height.
6. When two triangular slipbase supports are used to support a single sign, they shall not be "rigidly" connected to each other except through the sign panel. This will allow each support to act independently when impacted by an errant vehicle.
7. Wing channel shall meet ASTM A 1011 SS Gr 50 and be galvanized per ASTM A 123.
8. Excess pipe, wing channel, or windbeam shall be cut off so that it does not extend beyond the sign panel (i.e., excess support shall not be visible when the sign is viewed from the front.) Repair galvanized coating at cut support ends per Item 445, "Galvanizing."
9. Sign blanks shall be the sizes and shapes shown on the plans.
10. Additional sign clamp required on the "T-bracket" post for 24 inch high signs. Place the clamp 3 inches above bottom of sign when possible.
11. Post open ends shall be fitted with Friction Caps.

REQUIRED SUPPORT

	SIGN DESCRIPTION	SUPPORT
Regulatory	48-inch STOP sign (R1-1)	TY 10BWG(1)XX(T) TY 10BWG(1)XX(P-BM)
	60-inch YIELD sign (R1-2)	TY 10BWG(1)XX(T) TY 10BWG(1)XX(P-BM)
	48x16-inch ONE-WAY sign (R6-1)	TY 10BWG(1)XX(T) TY 10BWG(1)XX(P-BM)
	36x48, 48x36, and 48x48-inch signs	TY 10BWG(1)XX(T)
	48x60-inch signs	TY S80(1)XX(T)
Warning	48x48-inch signs (diamond or square)	TY 10BWG(1)XX(T)
	48x60-inch signs	TY S80(1)XX(T)
	48-inch Advance School X-ing sign (S1-1)	TY 10BWG(1)XX(T)
	48-inch School X-ing sign (S2-1)	TY 10BWG(1)XX(T)
	Large Arrow sign (W1-6 & W1-7)	TY 10BWG(1)XX(T)

Texas Department of Transportation
Traffic Operations Division

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM

SMD(SLIP-3)-08

©TxDOT July 2002


REVISIONS	DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
9-08	CONT	SECT	JOB	HIGHWAY
	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		57

26D

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 12/21/2017 9:17:11 PM
FILE: H:\OBES\CR 200\Documents\WA-4*CR201-BS\SHEETS\Standards\Signing*Pavement*Marking\smdtwt.dgn

Wedge Anchor Steel System

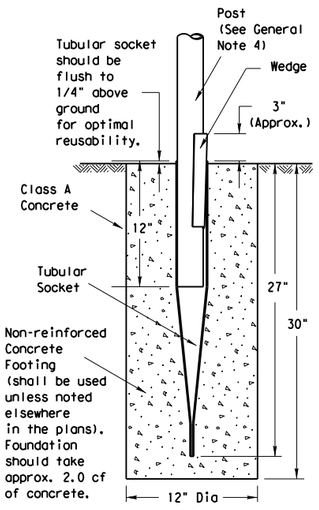


SM RD SGN ASSM TY TWT(X)WS(X)

Wedge Anchor High Density Polyethylene (HDPE) System

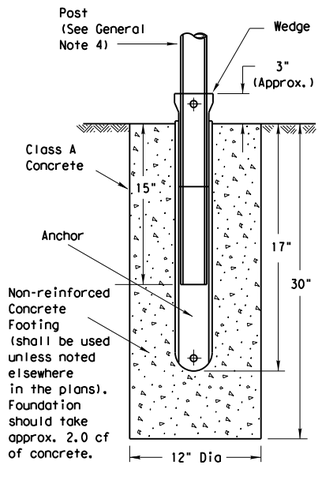


SMD RD SGN ASSM TY TWT(X)WP(X)


Universal Anchor System with Thin-Walled Tubing Post

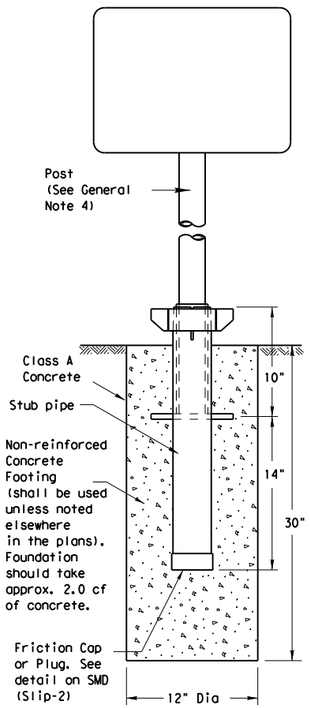


SM RD SGN ASSM TY TWT(X)UA(P)

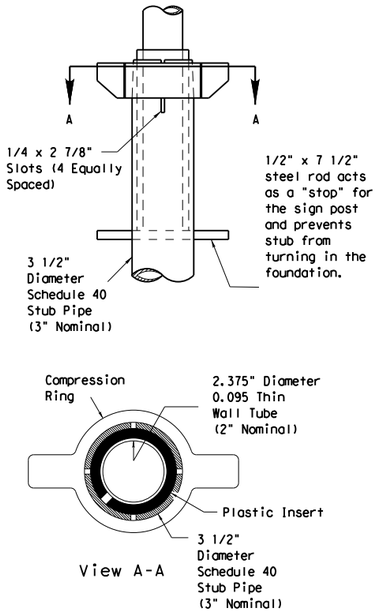

Plastic insert must be used when using the TWT with either the Universal Anchor System or the Bolt Down Universal Anchor System. The insert should be approx. 10" long and cover the tubing from just above the top of the stub pipe to the bottom of the sign post when using the Universal Anchor System. The insert should be cut to approx. 4 1/2" when used with the Bolt Down Universal Anchor System.

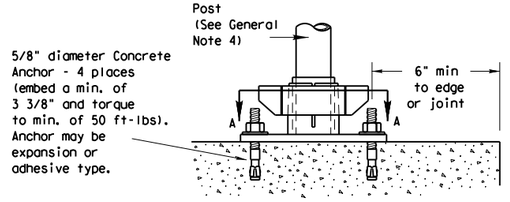



Concrete anchor consists of 5/8" diameter stud bolt with UNC series bolt threads on the upper end. A heavy hex nut per ASTM A563 and hardened washer per ASTM F436. The stud bolt shall have minimum yield and ultimate tensile strengths of 50 and 75 ksi, respectively. Nuts, bolts and washers shall be galvanized per Item 445, "Galvanizing." Top of bolt shall extend at least flush with top of nut when installed. The anchor, when installed in 4000 psi normal-weight concrete with a 3 3/8" minimum embedment, shall have a minimum allowable tension and shear of 2450 and 1525 psi, respectively. Adhesive type anchors shall have stud bolts installed with Type III epoxy per DMS-6100, "Epoxies and Adhesives." Adhesive anchors may be loaded after adequate epoxy cure time per the manufacturer's recommendations.

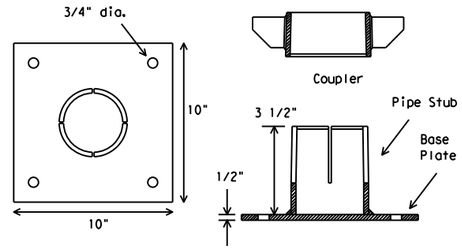


SM RD SGN ASSM TY TWT(X)UB(P)

Sign Installation Using a Prefabricated T-Bracket for Thin-Wall Tubing Post

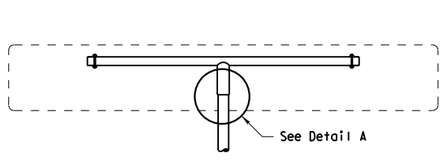

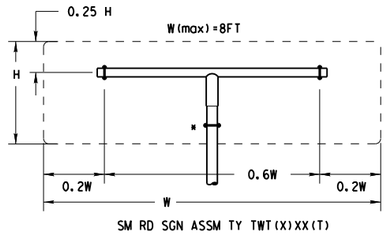

SM RD SGN ASSM TY TWT(X)XX(T)
(* - See General Note 6)

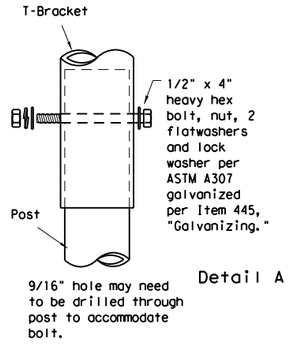

Detail A

NOTE

The devices shall be installed per manufacturer's recommendations.
Installation procedures shall be provided to the Engineer by Contractor.

GENERAL NOTES:

1. The Wedge Anchor System and the Universal Anchor System with thin wall tubing post may be used to support up to 10 square feet of sign area.
2. The tubular socket, wedge and prefabricated T-bracket shall be permanently marked to indicate manufacturer. Method, design, and location of marking are subject to the approval of the TxDOT Traffic Standards Engineer.
3. Except for posts (13 BWG Tubing), clamps, nuts and bolts, all components shall be prequalified. A list of prequalified vendors may be obtained from the Material Producer List web page. The website address is: http://www.txdot.gov/business/producer list.htm
4. Material used as post with this system shall conform to the following specifications:
   13 BWG Tubing (2.375" outside diameter) (TWT)
   0.095" nominal wall thickness
   Seamless or electric-resistance welded steel tubing
   Steel shall be HSLAS Gr 55 per ASTM A1011 or ASTM A1008
   Other steels may be used if they meet the following:
   55,000 PSI minimum yield strength
   70,000 PSI minimum tensile strength
   18% minimum elongation in 2"
   Wall thickness (uncoated) shall be within the range of .083" to .099"
   Outside diameter (uncoated) shall be within the range of 2.369" to 2.381"
   Galvanization per ASTM 123 or ASTM A653 G210. For precoated steel tubing (ASTM A653), recoat tube outside diameter weld seam by metallizing with zinc wire per ASTM B833.
5. Sign blanks shall be the sizes and shapes shown on the plans.
6. Additional sign clamp required on the "T-bracket" post for 24" high signs. Place clamp at least 3" above bottom of sign when possible.
7. Sign supports shall not be spliced except where shown. Sign support posts shall not be spliced.
8. See the Traffic Operations Division website for detailed drawings of sign clamps and Wedge Anchor System components. The website address is: http://www.txdot.gov/publications/traffic.htm

WEDGE ANCHOR SYSTEM INSTALLATION PROCEDURE

1. Dig foundation hole. Where solid rock is encountered at ground level, the foundation shall be a minimum depth of 18". When solid rock is encountered below ground level, the foundation shall extend in the solid rock a minimum depth of 18" or provide a minimum foundation depth of 30". If solid rock is encountered, the socket/stub may be reduced in length as required to a minimum length of 18". Any material removed from the socket/stub shall be from the bottom and the clearance requirements given on SMD(GEN) must be followed. The inner surfaces of the socket/stub must remain free of concrete or other debris.
2. The Engineer may permit batches of concrete less than 2 cubic yards to be mixed with a portable, motor driven concrete mixer. For small placements less than 0.5 cubic yards, hand mixing in a suitable container may be allowed by Engineer. Place concrete into hole until it is approximately flush with the ground. Concrete shall be Class A.
3. Insert tubular socket into concrete until top of socket is approximaely 1/4 " above the concrete footing.
4. Plumb the socket. Allow a minimum 4 days for concrete to set, unless otherwise directed by Engineer..
5. Attach the sign to the sign post.
6. Insert the sign post into socket and align sign face with roadway.
7. Drive the wedge into the socket to secure post. This will leave approximately 3 inches of the wedge exposed.

UNIVERSAL ANCHOR SYSTEM INSTALLATION PROCEDURE

1. Dig foundation hole. Where solid rock is encountered at ground level, the foundation shall be a minimum depth of 18". When solid rock is encountered below ground level, the foundation shall extend in the solid rock a minimum depth of 18" or provide a minimum foundation depth of 30". If solid rock is encountered, the socket/stub may be reduced in length as required to a minimum length of 18". Any material removed from the socket/stub shall be from the bottom and the clearance requirements given on SMD(GEN) must be followed. The inner surfaces of the socket/stub must remain free of concrete or other debris.
2. Insert base post in hole to depths shown and backfill hole with concrete.
3. Level and plumb the base post using a torpedo level and allow concrete adequate time to set. The bottom of the slots provided in the stub pipe shall remain above the top of the concrete foundation.
4. Attach the sign to the sign post.
5. Install plastic insert around bottom of post.
6. Insert sign post into base post. Lower until the post comes to rest on steel rod.
7. Seat compression ring using a hammer. Typically, the top of compression ring will be approximately level with top of stub post when optimally installed.
8. Check sign post by hand to ensure it is unable to turn. If loose, increase the tightening of the compression ring.

Texas Department of Transportation
Traffic Operations Division

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS WEDGE & UNIVERSAL ANCHOR WITH THIN WALL TUBING POST

SMD(TWT)-08

©TxDOT July 2002

REVISIONS	DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
9-08	CONT	SECT	JOB	HIGHWAY
	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		58

26E


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:17:11 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\Signing_PavementMarking\tsr3-13.dgn

REQUIREMENTS FOR INDEPENDENT MOUNTED ROUTE SIGNS

SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	WHITE	TYPE A SHEETING
BACKGROUND	ALL OTHERS	TYPE B OR C SHEETING
LEGEND & BORDERS	WHITE	TYPE A SHEETING
LEGEND & BORDERS	BLACK	ACRYLIC NON-REFLECTIVE FILM
LEGEND & BORDERS	ALL OTHERS	TYPE B or C SHEETING








TYPICAL EXAMPLES

REQUIREMENTS FOR BLUE, BROWN & GREEN D AND I SERIES GUIDE SIGNS

SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	ALL	TYPE B OR C SHEETING
LEGEND & BORDERS	WHITE	TYPE D SHEETING
LEGEND, SYMBOLS & BORDERS	ALL OTHERS	TYPE B OR C SHEETING













TYPICAL EXAMPLES

GENERAL NOTES

1. Signs to be furnished shall be as detailed elsewhere in the plans and/or as shown on sign tabulation sheet. Standard sign designs and arrow dimensions can be found in the "Standard Highway Sign Designs for Texas" (SHSD).

2. White legend shall use the Clearview Alphabet. The following Clearview fonts shall be used to replace the existing white Federal Highway Administration (FHWA) Standard Highway Alphabets, when not specified in the SHSD, or in the plans.

B	CV-1W
C	CV-2W
D	CV-3W
E	CV-4W
Emod	CV-5WR
F	CV-6W

3. Route sign legend (ie. IH, US, SH and FM shields) shall use the Federal Highway Administration (FHWA) Standard Highway Alphabets B, C, D, E, Emod or F).

4. Lateral spacing between letters and numerals shall conform with the SHSD, and any approved changes thereto. Lateral spacing of legend shall provide a balanced appearance when spacing is not shown.

5. Independent mounted route sign with white or colored legend and borders shall be applied by screening process with transparent color ink, transparent colored overlay film to white background sheeting or cut-out white sheeting to colored background sheeting, or combination thereof. White legend, symbols and borders on all other signs shall be cut-out white sheeting applied to colored background sheeting.

6. Information regarding borders and radii for signs is found in the "Standard Highway Sign Designs for Texas". Dimensions shown and described for borders and corner radii on parent sign are nominal. Borders may vary in width as much as 1/2 inch. Corner radii above 3 inches may vary in width as much as 1 inch. Borders and corner radii within a parent sign must be of matching widths. The sign area outside the corner radius should be trimmed or rounded.

7. Sign substrate shall be any material that meets the Departmental Material Specification requirements of DMS-7110 or approved alternative.

8. Mounting details of roadside signs are shown in the "SMD series" Standard Plan Sheets.

DEPARTMENTAL MATERIAL SPECIFICATIONS	
ALUMINUM SIGN BLANKS	DMS-7110
SIGN FACE MATERIALS	DMS-8300

ALUMINUM SIGN BLANKS THICKNESS	
Square Feet	Minimum Thickness
Less than 7.5	0.080
7.5 to 15	0.100
Greater than 15	0.125

The Standard Highway Sign Designs for Texas (SHSD) can be found at the following website.

http://www.txdot.gov/

Texas Department of Transportation

Traffic Operations Division Standard

TYPICAL SIGN REQUIREMENTS

TSR(3)-13

FILE: tsr3-13.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT October 2003	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
12-03 7-13	DIST	COUNTY		SHEET NO.
9-08	AUS	WILLIAMSON		59


3

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:17:12 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\Signing_PavementMarking\tsr4-13.dgn

REQUIREMENTS FOR RED BACKGROUND REGULATORY SIGNS

(STOP, YIELD, DO NOT ENTER AND WRONG WAY SIGNS)

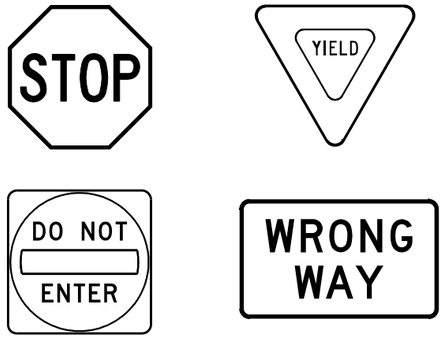

REQUIREMENTS FOR FOUR SPECIFIC SIGNS ONLY

SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	RED	TYPE B OR C SHEETING
BACKGROUND	WHITE	TYPE B OR C SHEETING
LEGEND & BORDERS	WHITE	TYPE B OR C SHEETING
LEGEND	RED	TYPE B OR C SHEETING

REQUIREMENTS FOR WHITE BACKGROUND REGULATORY SIGNS


(EXCLUDING STOP, YIELD, DO NOT ENTER AND WRONG WAY SIGNS)



TYPICAL EXAMPLES

SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	WHITE	TYPE A SHEETING
BACKGROUND	ALL OTHERS	TYPE B OR C SHEETING
LEGEND, BORDERS AND SYMBOLS	BLACK	ACRYLIC NON-REFLECTIVE FILM
LEGEND, BORDERS AND SYMBOLS	ALL OTHER	TYPE B OR C SHEETING

REQUIREMENTS FOR WARNING SIGNS

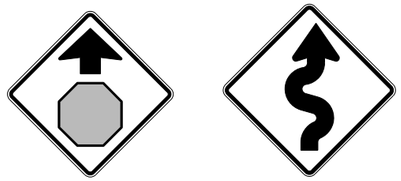

TYPICAL EXAMPLES

SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	FLOURESCENT YELLOW	TYPE B_{FL} OR C_{FL} SHEETING
LEGEND & BORDERS	BLACK	ACRYLIC NON-REFLECTIVE FILM
LEGEND & SYMBOLS	ALL OTHER	TYPE B OR C SHEETING

REQUIREMENTS FOR SCHOOL SIGNS



TYPICAL EXAMPLES

SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	WHITE	TYPE A SHEETING
BACKGROUND	FLOURESCENT YELLOW GREEN	TYPE B_{FL} OR C_{FL} SHEETING
LEGEND, BORDERS AND SYMBOLS	BLACK	ACRYLIC NON-REFLECTIVE FILM
SYMBOLS	RED	TYPE B OR C SHEETING

GENERAL NOTES

1. Signs to be furnished shall be as detailed elsewhere in the plans and/or as shown on sign tabulation sheet. Standard sign designs and arrow dimensions can be found in the "Standard Highway Sign Designs for Texas" (SHSD).
2. Sign legend shall use the Federal Highway Administration (FHWA) Standard Highway Alphabets (B, C, D, E, Emod or F).
3. Lateral spacing between letters and numerals shall conform with the SHSD, and any approved changes thereto. Lateral spacing of legend shall provide a balanced appearance when spacing is not shown.
4. Black legend and borders shall be applied by screening process or cut-out acrylic non-reflective black film to background sheeting, or combination thereof.
5. White legend and borders shall be applied by screening process with transparent colored ink, transparent colored overlay film to white background sheeting or cut-out white sheeting to colored background sheeting, or combination thereof.
6. Colored legend shall be applied by screening process with transparent colored ink, transparent colored overlay film or colored sheeting to background sheeting, or combination thereof.
7. Sign substrate shall be any material that meets the Departmental Material Specification requirements of DMS-7110 or approved alternative.
8. Mounting details for roadside mounted signs are shown in the "SMD series" Standard Plan Sheets.

ALUMINUM SIGN BLANKS THICKNESS	
Square Feet	Minimum Thickness
Less than 7.5	0.080
7.5 to 15	0.100
Greater than 15	0.125

DEPARTMENTAL MATERIAL SPECIFICATIONS	
ALUMINUM SIGN BLANKS	DMS-7110
SIGN FACE MATERIALS	DMS-8300

The Standard Highway Sign Designs for Texas (SHSD) can be found at the following website.

http://www.txdot.gov/

Texas Department of Transportation

Traffic Operations Division Standard

TYPICAL SIGN REQUIREMENTS

TSR(4)-13

FILE: tsr4-13.dgn		CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT October 2003	CONT	SECT	JOB	HIGHWAY
REVISIONS 12-03 7-13 9-08	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		60

4

A. GENERAL SITE DATA

1. PROJECT LIMITS: *From Approximately 550' South of Bold Sundown To Approximately 375' North of Bold Sundown.*

Begin Project Coordinates : Latitude (N): 30° 42' 57.70" Longitude (W): -97° 55' 42.36"

2. PROJECT SITE MAPS:

- *Project Location Map: Title Sheet*
- *Drainage Patterns: See Drainage Area Maps*
- *Slopes Anticipated After Major Gradings or Areas of Soil Disturbance: Typical Sections (Sheet 7)*
- *Location of Erosion and Sediment Controls: SW3P Site Plans (Sheet 62)*
- *Surface Waters and Discharge Locations: Drainage and Culvert Layouts (Sheet 40)*
- *Project Specific Location(s) (PSL): To be determined by the project Construction Personnel. Location(s) shown on SW3P Site Map (If PSL location(s) is within one mile of project) and information located in project SW3P Binder (Reference item #10 below).*

3. PROJECT DESCRIPTION:

For the Widening of the Existing Roadway Consisting of Grading, Drainage Improvements, Flexible Base, HMACP, Striping and Pavement Markings.

4. MAJOR SOIL DISTURBING ACTIVITIES:

Pavement removal, reconstruction & widening.

5. EXISTING CONDITION OF SOIL & VEGETATIVE COVER AND % OF EXISTING VEGETATIVE COVER:

Project area consists of clay and silty loam soils with rock outcroppings. Vegetative cover is mostly natural, undisturbed with vegetative cover of approximately 70% of the project area.

6. TOTAL PROJECT AREA: *2.52* Acres

7. TOTAL AREA TO BE DISTURBED: *2.52* Acres *(100 %)*

8. WEIGHTED RUNOFF COEFFICIENT

BEFORE CONSTRUCTION: *0.51*
AFTER CONSTRUCTION: *0.59*

9. NAME OF RECEIVING WATERS:

Project area drains by swales and overland flow to Lackey Creek which is a tributary to North Fork San Gabriel River (Segment ID# 1251).

10. PROJECT SW3P Binder:

A. For projects disturbing one to five acres, The Contractor will maintain a SW3P Binder at the project field office (If there is not a project field office, should be kept on the Job Site at all times) which contains the following: Index Sheet, TCEQ Signature Authority, TCEQ Small Construction Site Notice, Contractor Certification of Compliance, SW3P Inspector Qualification Statements, Inspection and Maintenance Reports (Form 2118), SW3P Sheet, Site Location Maps, Stored Material Lists specifying associated control measures and the Appendix which contains the TPDES Construction General Permit, MS4 Operator Notification(s) and the Construction PSL Permits per all applicable requirements.

B. For projects disturbing 5 acres or more, the Contractor will follow the actions listed in (10.A.) above with the addition of the following: Notice Of Intent (N.O.I.) and Fee Payment Form, TCEQ Large Construction Site Notice (to be used instead of Small Site Notice), and TPDES Permit Coverage Notice.

C. For projects disturbing less than one acre, actions described in (10.A.) and (10.B.) above are not required. Acreage is calculated by adding Total Area To Be Disturbed Acres on project (See #7 above) and the PSL(s) acreage located within one mile of project.

FILE NAME
DATE
DESIGNER

B. EROSION AND SEDIMENT CONTROLS

1. SOIL STABILIZATION PRACTICES: (Select T = Temporary or P = Permanent, as applicable)

- T TEMPORARY SEEDING
- T MULCHING (Hay or Straw)
- ___ BUFFER ZONES
- ___ PLANTING
- P SEEDING
- P SODDING
- P PRESERVATION OF NATURAL RESOURCES
- ___ FLEXIBLE CHANNEL LINER
- ___ RIGID CHANNEL LINER
- T SOIL RETENTION BLANKET
- ___ COMPOST MANUFACTURED TOPSOIL
- ___ VERTICAL TRACKING
- T OTHER: *Disturbed areas on which construction activity has ceased, either temporarily or permanently, shall be stabilized within 14 days unless activities are scheduled to resume and do so within 21 days.*

2. STRUCTURAL PRACTICES:
(T = Temporary or P = Permanent)

- ___ SILT FENCES
- T EROSION CONTROL LOGS
- ___ EROSION CONTROL COMPOST BERMS (Low Velocity)
- T ROCK FILTER DAMS
- ___ DIVERSION, INTERCEPTOR, OR PERIMETER DIKES
- ___ DIVERSION, INTERCEPTOR, OR PERIMETER SWALES
- ___ DIVERSION DIKE AND SWALE COMBINATIONS
- ___ PIPE SLOPE DRAINS
- ___ PAVED FLUMES
- T ROCK BEDDING AT CONSTRUCTION EXIT
- ___ TIMBER MATTING AT CONSTRUCTION EXIT
- ___ CHANNEL LINERS
- ___ SEDIMENT TRAPS
- ___ SEDIMENT BASINS
- ___ STORM INLET SEDIMENT TRAP
- ___ STONE OUTLET STRUCTURES
- ___ CURBS AND GUTTERS
- ___ STORM SEWERS
- ___ VELOCITY CONTROL DEVICES
- P OTHER: *Vegetative filter strips*

NOTE: TOP OF BMP'S SHOULD NOT BE HIGHER THAN ROADWAY ELEVATION AS NOT TO FLOOD ROADWAY UNLESS PRIOR APPROVAL FROM ENGINEER IS OBTAINED.

3. STORM WATER MANAGEMENT:

A. Storm water drainage will be provided by ditches and culverts which will carry drainage within the R.O.W. to the lows within the roadway and project site which drains to natural facilities.

B. Non paved areas and ditches shall be stabilized with a permanent vegetative cover.

C. Other permanent erosion controls include hydraulic design to limit structure outlet velocities and grading design generally consisting of 4 :1 or flatter slopes with permanent vegetative cover.

4. STORM WATER MANAGEMENT ACTIVITIES: (Sequence of Construction)

1. *Place Temporary SW3P measures.*
2. *Prepare ROW.*
3. *Construct roadway. Activities to include excavation, embankment, pavement. Sediment control devices will be added or adjusted as needed to continue controlling runoff.*
4. *Stabilize disturbed areas with seeding.*
5. *Structural practices on grassed slopes will remain in place until seeding is effective. Inlet protection controls may be removed upon completion of pavement construction activities.*

5. NON-STORM WATER DISCHARGES:

C. OTHER REQUIREMENTS & PRACTICES

1. MAINTENANCE:

Maintain all erosion and sediment controls in good working order. Perform any necessary cleaning/repairs/replacements at the earliest possible date prior to next rain event, but no later than 7 calendar days. Ensure the surrounding ground has dried sufficiently to prevent damage from equipment. "Too Wet" is the only reason for not adhering to time frames described. When construction activities permanently or temporarily cease and are not expected to resume for 14 or more days on a disturbed portion of the site, stabilization measures must be initiated immediately.

2. INSPECTION:

A Construction Observer will perform a regularly scheduled SW3P inspection every 7 calendar days. An Inspection and Maintenance Report, signed by the Construction Observer and the Contractor, will be filed for each inspection. Revise/clean/repair/replace each BMP control device in accordance with the current Field Inspection and Maintenance Report (Form 2118) and item 1 (Maintenance) above.

3. WASTE MATERIALS:

On a daily basis, or as may be directed, collect all waste materials, trash and debris from the construction site and deposit into a metal dumpster having a secure cover and which meets all state and local city solid waste management requirements. Empty the dumpster as required by regulation, or as may be directed, at a local approved landfill site. Do not bury construction waste on the construction project site.

4. HAZARDOUS WASTE & SPILL REPORTING:

As a minimum, any products in the following categories are considered to be hazardous: Paints, Acids, Solvents, Fuels, Asphalt Products, Chemical Additives for Soil Stabilization, and Concrete Curing Compounds or Additives. When storing hazardous material on the project site, or at a Project Specific Location, take all practicable precaution to prevent and/or contain any spillage of these materials. In the event of a spill, contact the spill coordinator immediately.

5. SANITARY WASTE:

Use a licensed sanitary waste management contractor to collect all sanitary waste from portable units as may be required by local regulation, or as directed.

6. CONSTRUCTION VEHICLE TRACKING:

On a regular basis, or as may be directed, dampen haul roads for dust control and stabilize construction entrances/exits. Provide for a motorized broom or vacuum type sweeper to be available on a daily basis, or as may be directed, to remove sediment from paved roadways abutting or traversing the project site.

7. MANAGEMENT PRACTICES:

A. Construct disposal areas, stockpiles, haul roads and PSL's in a manner that will minimize and control the amount of sediment that may enter receiving waters. Do not locate disposal areas in any wetland, waterbody or streambed.

B. Locate construction staging areas, vehicle maintenance and PSL's areas in a manner to minimize the runoff of pollutants.

C. When working in or near a wetland, install and maintain operating soil erosion and sediment controls at all times during construction and isolate the work from the wetland.

D. Clear all waterways as soon as practicable of temporary embankment, temporary bridges, matting, falsework, piling, debris or other obstructions placed during construction operations that are not a part of the finished work.

E. Procedures and/or practices should be taken to control dust.

F. Sediment to be removed from roadways daily or when work begins after weather events if construction activities have ceased due to weather event.

G. The Contractor will be required to contain wash water from concrete trucks in a manner that will prevent same from entering any waterway.

H. The Contractor is responsible for insuring that all Subcontractors are aware and comply with all components of the Temporary Erosion Control Plans.

WILLIAMSON COUNTY

O'BRIEN Engineering Services

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED PROFESSIONAL ENGINEER


J. Kent O'Brien, P.E. 12/21/17
Signature of Registrant & Date

WILLIAMSON COUNTY

STORM WATER POLLUTION PREVENTION PLAN (SW3P)

TEMPLATE REVISION DATE: 06/12/2015

DESIGN	FED.RD. DIV.NO.	FEDERAL AID PROJECT NO.		HIGHWAY NO.
GRAPHICS	6			CR 200
CHECK	STATE	DISTRICT	COUNTY	SHEET NO.
	TEXAS		WILLIAMSON	
CHECK	CONTROL	SECTION	JOB	61

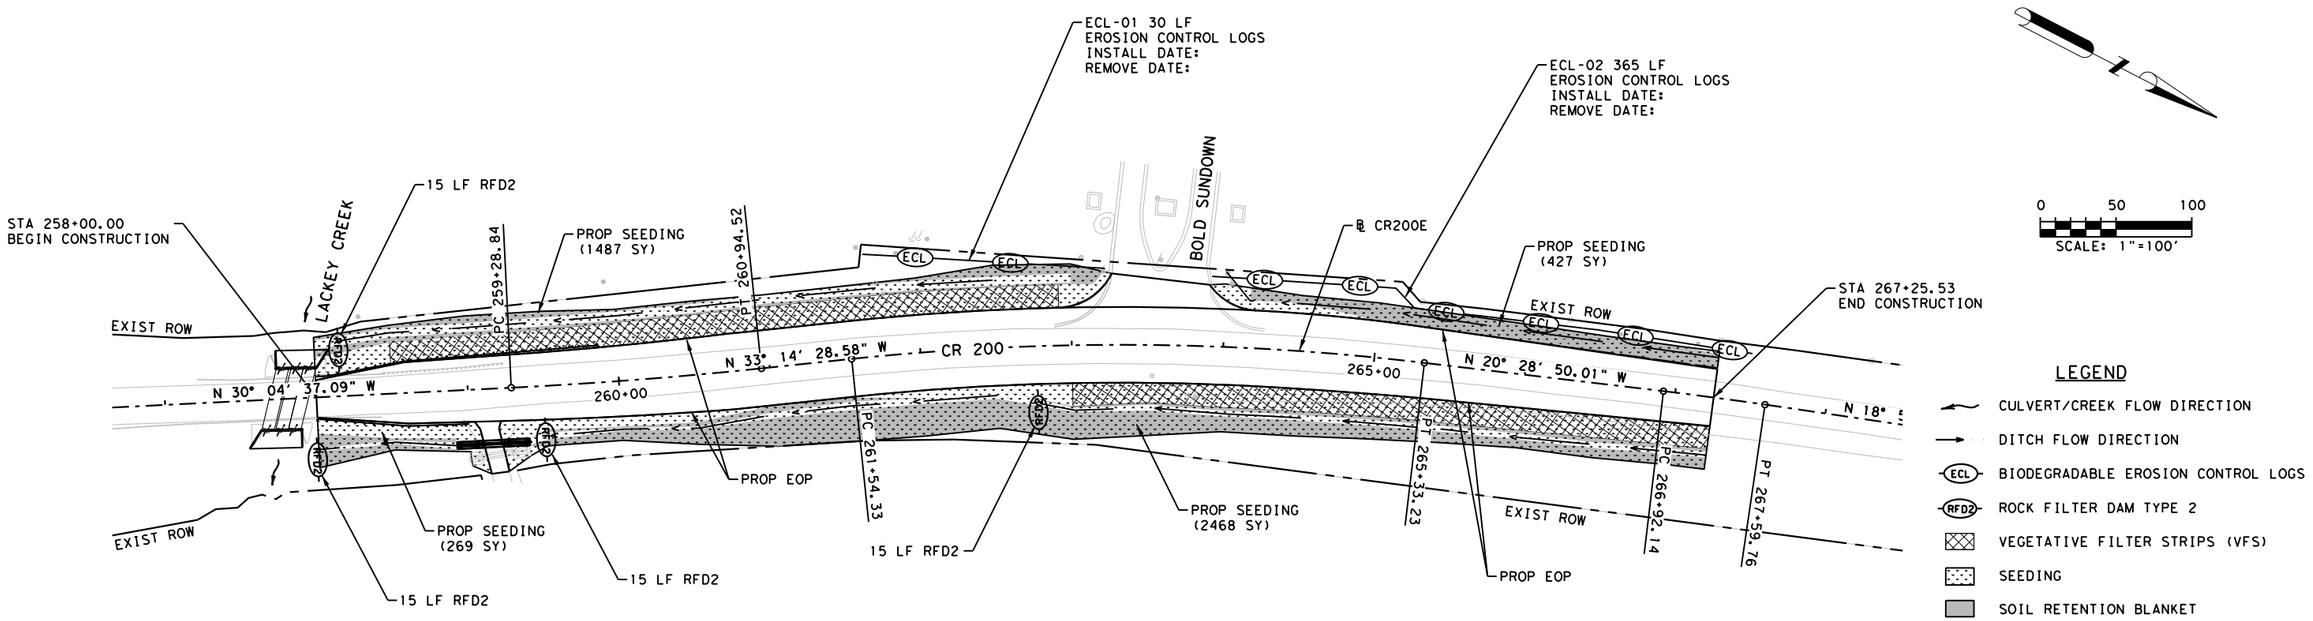

NOTE: CONSTRUCTION EXITS TO BE CONSTRUCTED PRIOR TO ANY CONSTRUCTION ACTIVITY. COORDINATE WITH CONSTRUCTION OBSERVER REGARDING PLACEMENT OF ITEMS 161 & 162.

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
3/13/2018

WILLIAMSON COUNTY
1848

WILLIAMSON COUNTY PRECINCT #2


O'BRIEN Engineering Services LLC

TBPE FIRM # 14060

CR 200
AT BOLD SUNDOWN
SW3P PLAN
TEMPORARY & PERMANENT

SHEET 1 OF 2 | SHEET # 62

CR200 PDF - GS.pltcfg
CR200
3/13/2018 7:47:51 PM
C:\DES\CR 200\Documents\WA-4xCR201-BS\SHEETS\ECV\CR200-WA4b-SW3P01.DGN

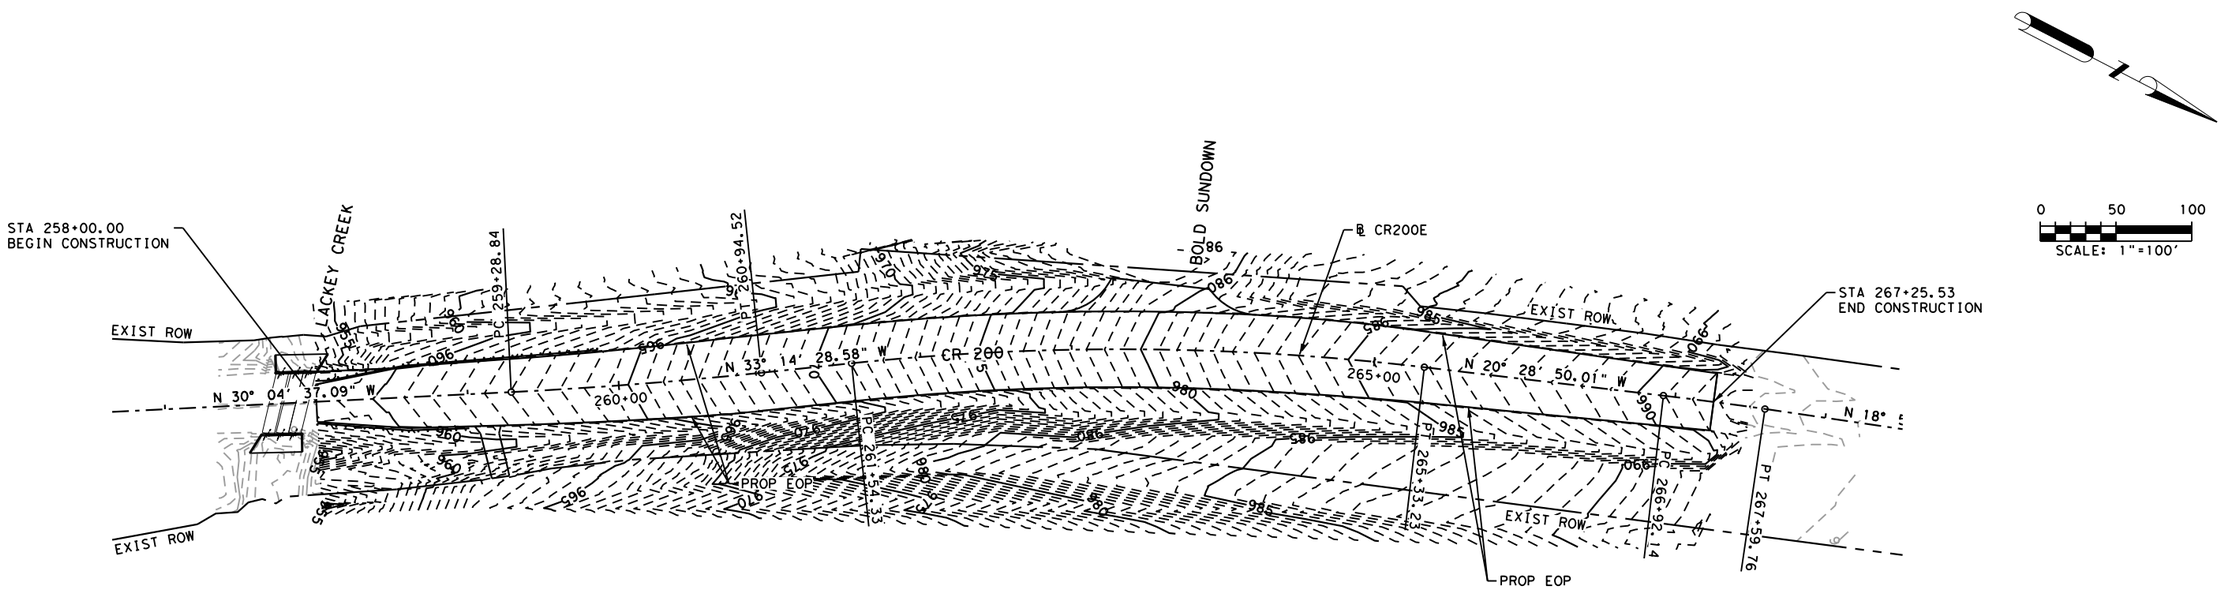

STATE OF TEXAS
J. KENT O'BRIEN
64398
REGISTERED
PROFESSIONAL ENGINEER
12/21/2017

WILLIAMSON COUNTY 1848

WILLIAMSON COUNTY PRECINCT #2

O'BRIEN Engineering Services LLC


TBPE FIRM # 14060

CR 200
AT BOLD SUNDOWN
SW3P PLAN
TEMPORARY & PERMANENT

SHEET 2 OF 2 | SHEET # 63


CR200 PDF - GS.pltcfg
12/21/2017 5:17:14 PM
C:\Users\CR 200\Documents\WA-44\CR201-BS\SHEETS\EC\CR200-WA4b-SW3P02-Contours.DGN


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion to other formats or for incorrect results or damages resulting from its use.

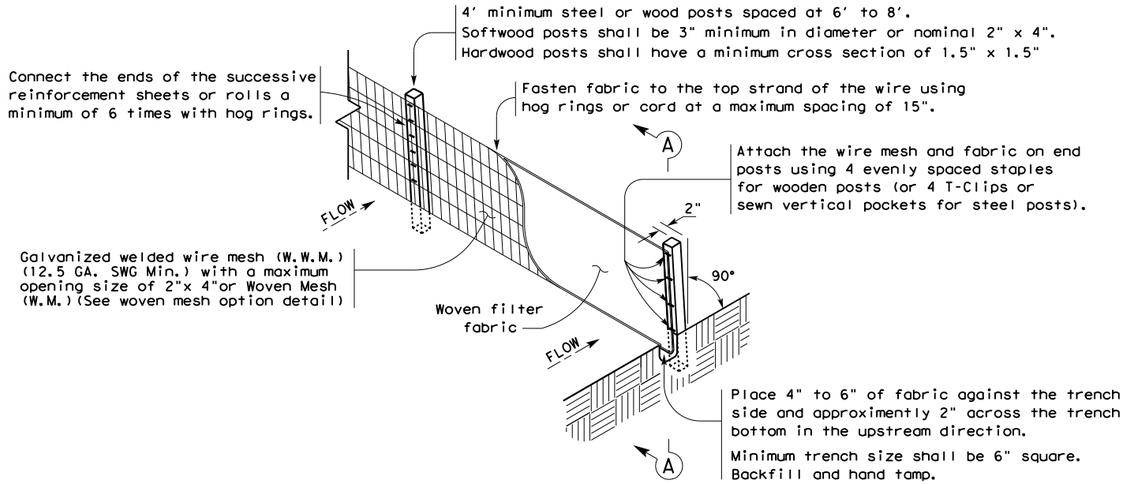

TEMPORARY SEDIMENT CONTROL FENCE

SCF

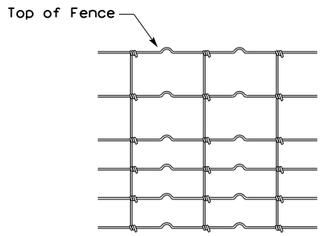

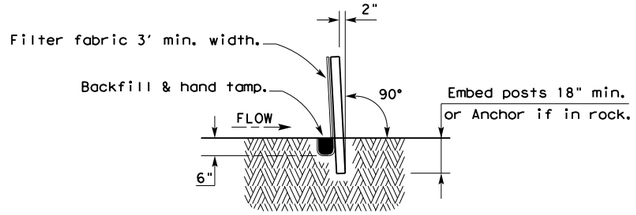

SECTION A-A

HINGE JOINT KNOT WOVEN MESH (OPTION) DETAIL

Galvanized hinge joint knot woven mesh (12.5 GA.SWG Min.) requires a minimum of five horizontal wires spaced at a maximum of 12 inches apart and all vertical wires spaced at a maximum of 12 inches apart.

SEDIMENT CONTROL FENCE USAGE GUIDELINES

A sediment control fence may be constructed near the downstream perimeter of a disturbed area along a contour to intercept sediment from overland runoff. A 2 year storm frequency may be used to calculate the flow rate to be filtered.

Sediment control fence should be sized to filter a maximum flow through rate of 100 GPM/FT^2. Sediment control fence is not recommended to control erosion from a drainage area larger than 2 acres.


LEGEND

Sediment Control Fence

SCF

GENERAL NOTES

1. Vertical tracking is required on projects where soil distributing activities have occurred unless otherwise approved.
2. Perform vertical tracking on slopes to temporarily stabilize soil.
3. Provide equipment with a track undercarriage capable of producing linear soil impressions measuring a minimum of 12" in length by 2" to 4" in width by 1/2" to 2" in depth.
4. Do not exceed 12" between track impressions.
5. Install continous linear track impressions where the minimum 12" length impressions are perpendicular to the slope or direction of water flow.

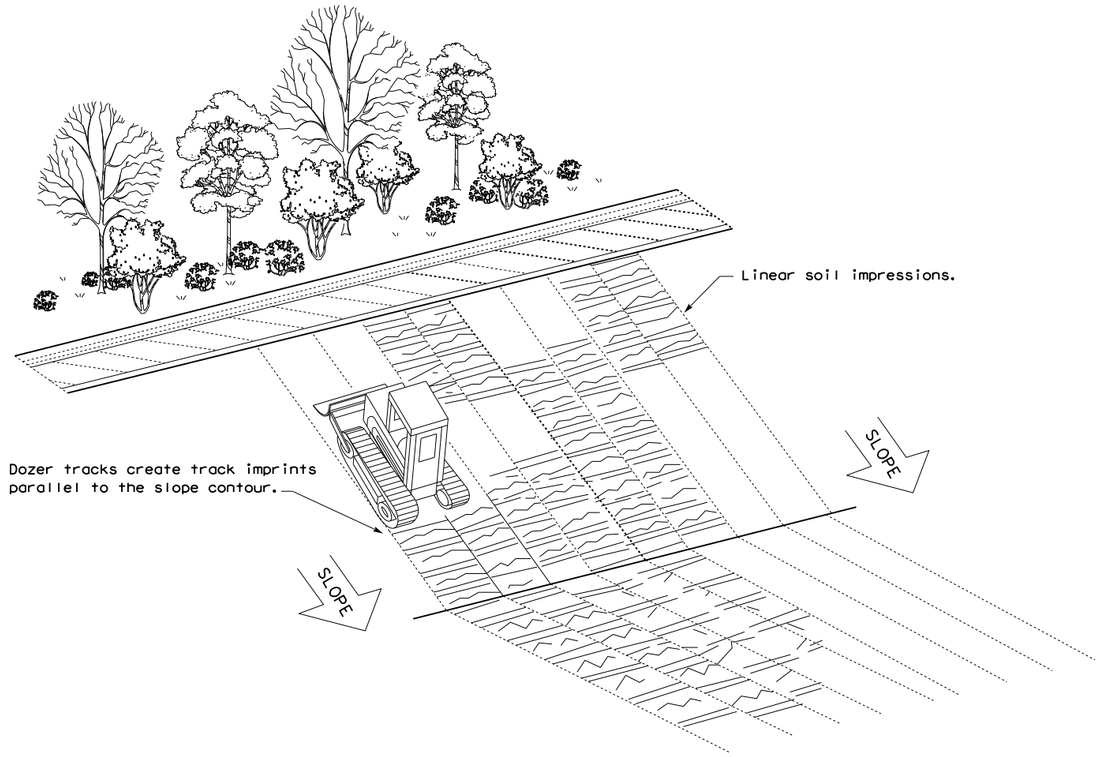

VERTICAL TRACKING

Texas Department of Transportation — Design Division Standard

TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES

FENCE & VERTICAL TRACKING


EC(1)-16

FILE: ec116	DN: TxDOT	CK: KM	DW: VP	DN/CK: LS		
© TxDOT: JULY 2016	CONT	SECT	JOB	HIGHWAY		
REVISIONS	TBD	TBD	TBD	CR 200		
	DIST	COUNTY		SHEET NO.		
	AUS	WILLIAMSON		64		

12/21/2017 9:17:14 PM
H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\ErosionControl\ec116.dgn


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017 9:17:15 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\ErosionControl\rfd123.dgn

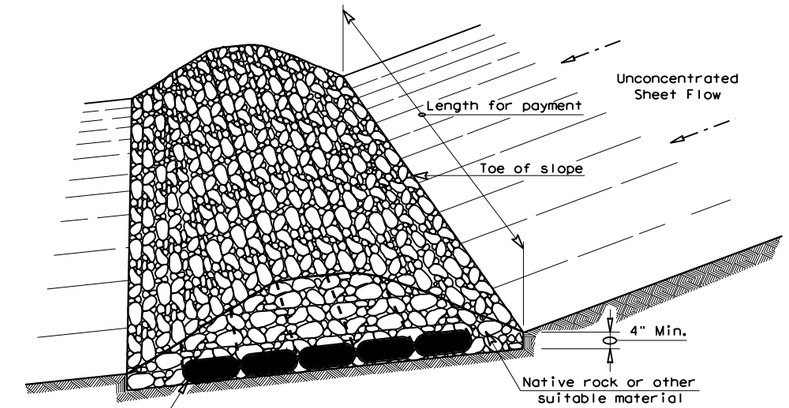


FILTER DAM AT TOE OF SLOPE


RFD1

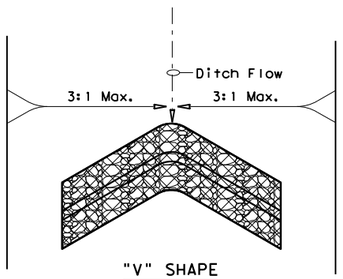


"V" SHAPE
PLAN VIEW

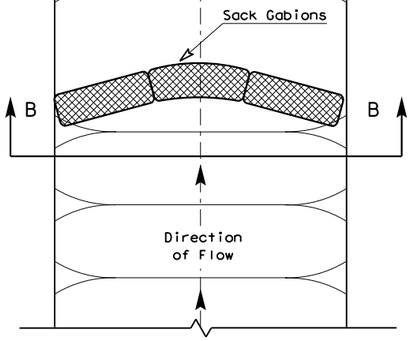

PLAN VIEW

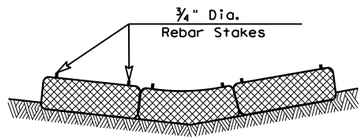


SECTION B-B

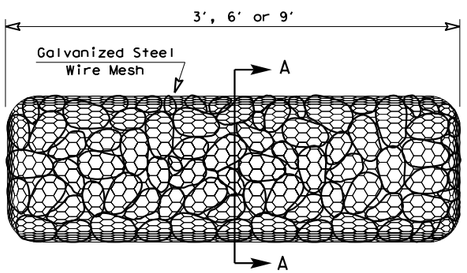


TYPE 4 (SACK GABIONS)

RFD4




SECTION A-A

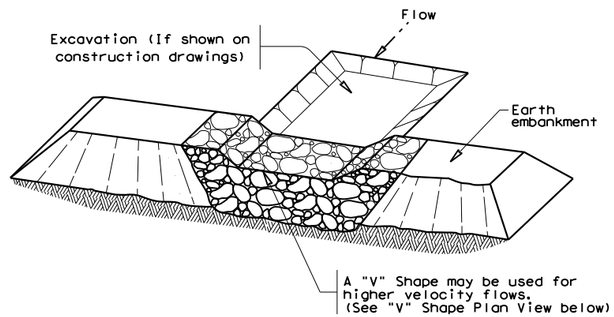


FILTER DAM AT SEDIMENT TRAP


RFD1 OR RFD2

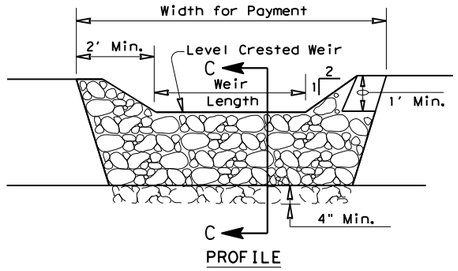

PROFILE

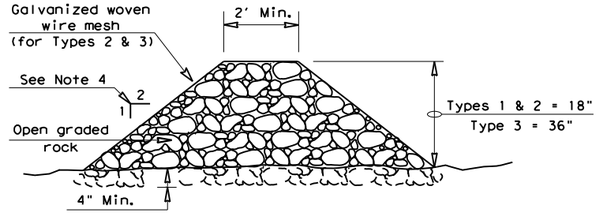

SECTION C-C

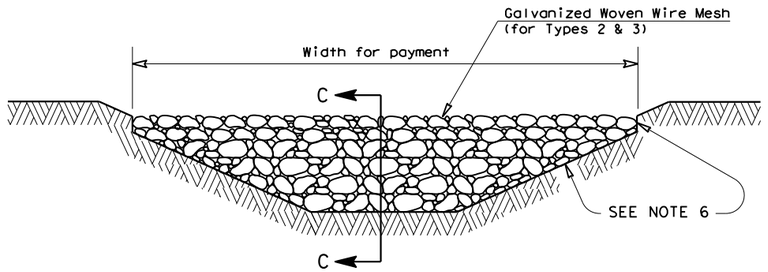

FILTER DAM AT CHANNEL SECTIONS

RFD1 OR RFD2 OR RFD3

ROCK FILTER DAM USAGE GUIDELINES

Rock Filter Dams should be constructed downstream from disturbed areas to intercept sediment from overland runoff and/or concentrated flow. The dams should be sized to filter a maximum flow through rate of 60 GPM/FT^2 of cross sectional area. A 2 year storm frequency may be used to calculate the flow rate.

Type 1 (18" high with no wire mesh) (3" to 6" aggregate): Type 1 may be used at the toe of slopes, around inlets, in small ditches, and at dike or swale outlets. This type of dam is recommended to control erosion from a drainage area of 5 acres or less. Type 1 may not be used in concentrated high velocity flows (approximently 8 Ft/Sec or more) in which aggregate wash out may occur. Sandbags may be used at the embedded foundation (4" deep min.) for better filtering efficiency of low flows if called for on the plans or directed by the Engineer.

Type 2 (18" high with wire mesh) (3" to 6" aggregate): Type 2 may be used in ditches and at dike or swale outlets.

Type 3 (36" high with wire mesh) (4" to 8" aggregate): Type 3 may be used in stream flow and should be secured to the stream bed.

Type 4 (Sack gabions) (3" to 6" aggregate): Type 4 May be used in ditches and smaller channels to form an erosion control dam.

Type 5: Provide rock filter dams as shown on plans.

GENERAL NOTES

1. If shown on the plans or directed by the Engineer, filter dams should be placed near the toe of slopes where erosion is anticipated, upstream and/or downstream at drainage structures, and in roadway ditches and channels to collect sediment.
2. Materials (aggregate, wire mesh, sandbags, etc.) shall be as indicated by the specification for "Rock Filter Dams for Erosion and Sedimentation Control".
3. The rock filter dam dimensions shall be as indicated on the SW3P plans.
4. Side slopes should be 2:1 or flatter. Dams within the safety zone shall have sideslopes of 6:1 or flatter.
5. Maintain a minimum of 1' between top of rock filter dam weir and top of embankment for filter dams at sediment traps.
6. Filter dams should be embedded a minimum of 4" into existing ground.
7. The sediment trap for ponding of sediment laden runoff shall be of the dimensions shown on the plans.
8. Rock filter dam types 2 & 3 shall be secured with 20 gauge galvanized woven wire mesh with 1" diameter hexagonal openings. The aggregate shall be placed on the mesh to the height & slopes specified. The mesh shall be folded at the upstream side over the aggregate and tightly secured to itself on the downstream side using wire ties or hog rings. For in stream use, the mesh should be secured or staked to the stream bed prior to aggregate placement.
9. Sack Gabions should be staked down with ¾" dia. rebar stakes, and have a double-twisted hexagonal weave with a nominal mesh opening of 2 ½" x 3 ¼"
10. Flow outlet should be onto a stabilized area (vegetation, rock, etc.).
11. The guidelines shown hereon are suggestions only and may be modified by the Engineer.

PLAN SHEET LEGEND

Type 1 Rock Filter Dam	RFD1
Type 2 Rock Filter Dam	RFD2
Type 3 Rock Filter Dam	RFD3
Type 4 Rock Filter Dam	RFD4

Texas Department of Transportation — Design Division Standard


TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES

ROCK FILTER DAMS


EC(2)-16

FILE: ec216	DN: TxDOT	CK: KM	DW: VP	DN/CK: LS		
© TxDOT: JULY 2016	CONT	SECT	JOB		HIGHWAY	
REVISIONS	TBD	TBD	TBD		CR 200	
	DIST	COUNTY			SHEET NO.	
	AUS	WILLIAMSON			65	


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

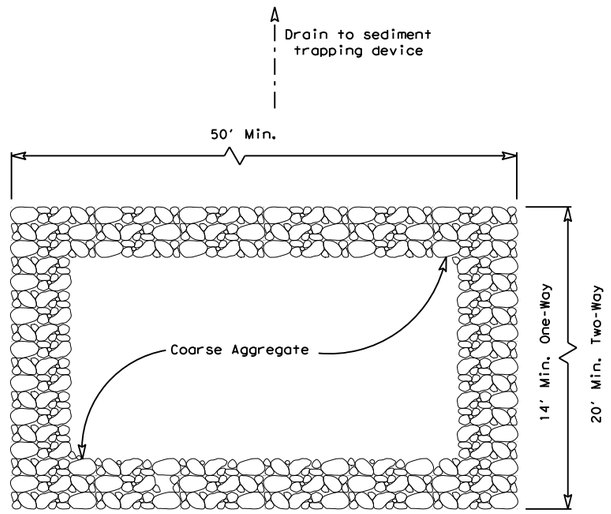


PLAN VIEW

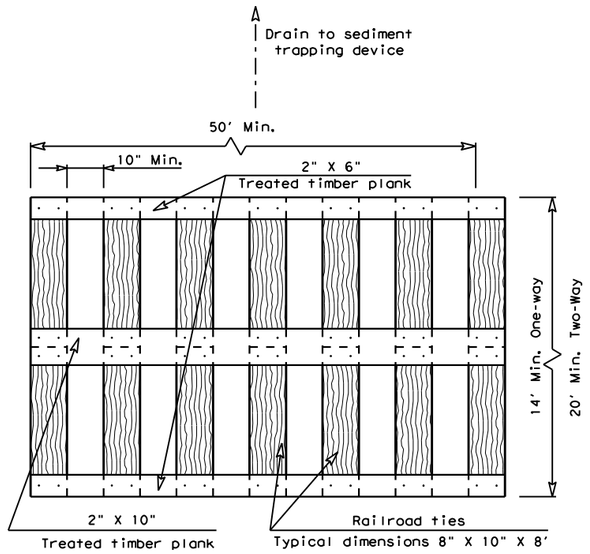

PLAN VIEW

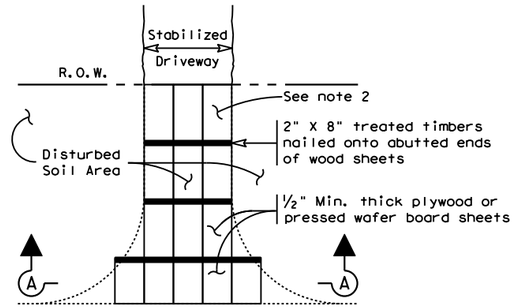


PLAN VIEW

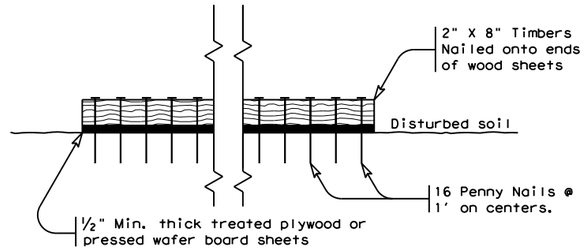

SECTION A-A

CONSTRUCTION EXIT (TYPE 3)

SHORT TERM

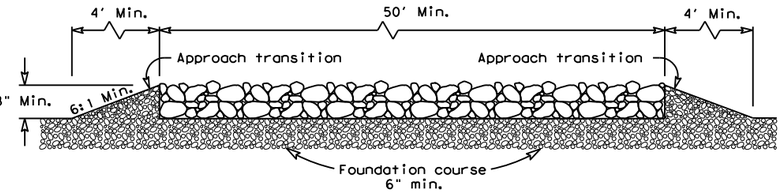


ELEVATION VIEW

CONSTRUCTION EXIT (TYPE 1)

ROCK CONSTRUCTION (LONG TERM)

GENERAL NOTES (TYPE 1)

1. The length of the type 1 construction exit shall be as indicated on the plans, but not less than 50'.
2. The coarse aggregate should be open graded with a size of 4" to 8".
3. The approach transitions should be no steeper than 6:1 and constructed as directed by the Engineer.
4. The construction exit foundation course shall be flexible base, bituminous concrete, portland cement concrete or other materialas approved by the Engineer.
5. The construction exit shall be graded to allow drainage to a sediment trapping device.
6. The guidelines shown hereon are suggestions only and may be modified by the Engineer.
7. Construct exits with a width of at least 14 ft. for one-way and 20 ft. for two-way traffic for the full width of the exit, or as directed by the engineer.

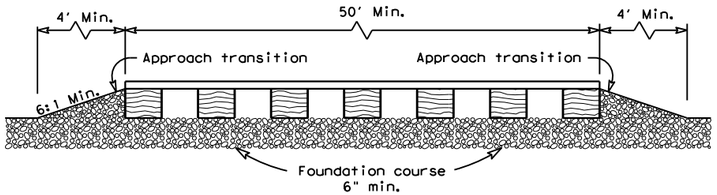

ELEVATION VIEW

CONSTRUCTION EXIT (TYPE 2)

TIMBER CONSTRUCTION (LONG TERM)

GENERAL NOTES (TYPE 2)

1. The length of the type 2 construction exit shall be as indicated on the plans, but not less than 50'.
2. The treated timber planks shall be attached to the railroad ties with ½"x 6" min. lag bolts. Other fasteners may be used as approved by the Engineer.
3. The treated timber planks shall be #2 grade min., and should be free from large and loose knots.
4. The approach transitions shall be no steeper than 6:1 and constructed as directed by the Engineer.
5. The construction exit foundation course shall be flexible base, bituminous concrete, portland cement concrete or other material as approved by the Engineer.
6. The construction exit should be graded to allow drainage to a sediment trapping device.
7. The guidelines shown hereon are suggestions only and may be modified by the Engineer.
8. Construct exits with a width of at least 14 ft. for one-way and 20 ft. for two-way traffic for the full width of the exit, or as directed by the engineer.

GENERAL NOTES (TYPE 3)

1. The length of the type 3 construction exit shall be as shown on the plans, or as directed by the Engineer.
2. The type 3 construction exit may be constructed from open graded crushed stone with a size of two to four inches spread a min. of 4" thick to the limits shown on the plans.
3. The treated timber planks shall be #2 grade min., and should be free from large and loose knots.
4. The guidelines shown hereon are suggestions only and may be modified by the Engineer.

Texas Department of Transportation — Design Division Standard

TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES

CONSTRUCTION EXITS


EC(3)-16

FILE: ec316	DN: TxDOT	CK: KM	DW: VP	DN/CK: LS		
©TxDOT: JULY 2016	CONT	SECT	JOB	HIGHWAY		
REVISIONS	TBD	TBD	TBD	CR 200		
	DIST	COUNTY		SHEET NO.		
	AUS	WILLIAMSON		66		


DATE: 12/21/2017 9:17:15 PM
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\ErosionControl\ec316.dgn

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 12/21/2017
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\ErosionControl\ec916.dgn

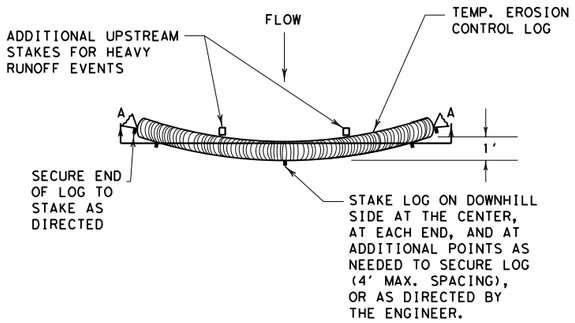


PLAN VIEW

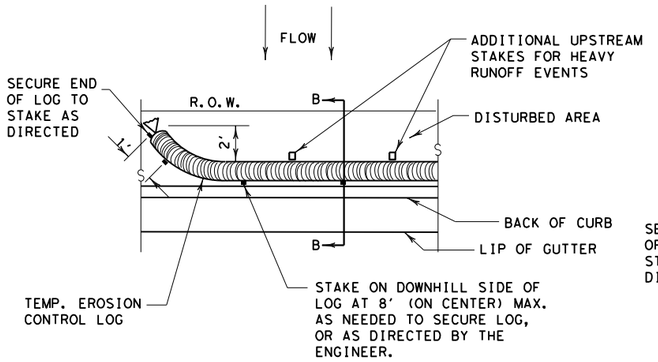

PLAN VIEW

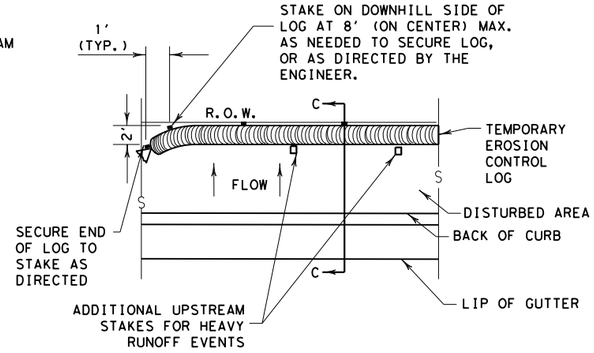


PLAN VIEW

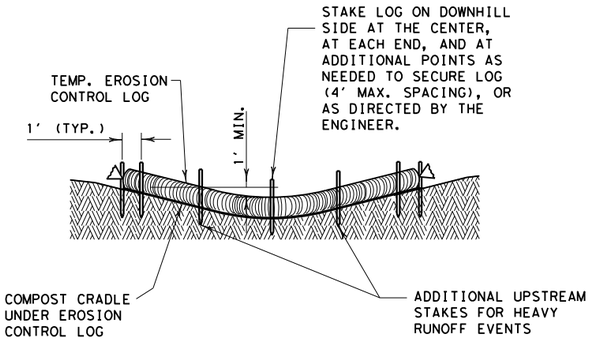

SECTION A-A

EROSION CONTROL LOG DAM


CL-D

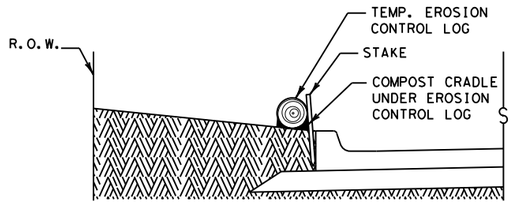

SECTION B-B

EROSION CONTROL LOG AT BACK OF CURB


CL-BOC

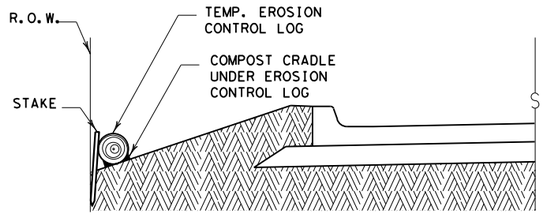


SECTION C-C

EROSION CONTROL LOG AT EDGE OF RIGHT-OF-WAY

CL-ROW



REBAR STAKE DETAIL

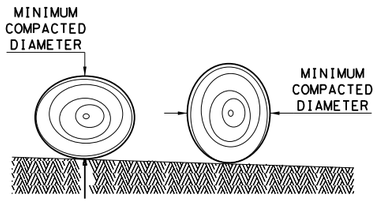

DIAMETER MEASUREMENTS OF EROSION CONTROL LOGS SPECIFIED IN PLANS

GENERAL NOTES:

1. EROSION CONTROL LOGS SHALL BE INSTALLED IN ACCORDANCE WITH MANFACTURER'S RECOMMENDATIONS, OR AS DIRECTED BY THE ENGINEER.
2. LENGTHS OF EROSION CONTROL LOGS SHALL BE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND AS REQUIRED FOR THE PURPOSE INTENDED.
3. UNLESS OTHERWISE DIRECTED, USE BIODEGRADABLE OR PHOTODEGRADABLE CONTAINMENT MESH ONLY WHERE LOG WILL REMAIN IN PLACE AS PART OF A VEGETATIVE SYSTEM. FOR TEMPORARY INSTALLATIONS, USE RECYCLABLE CONTAINMENT MESH.
4. FILL LOGS WITH SUFFICIENT FILTER MATERIAL TO ACHIEVE THE MINIMUM COMPACTED DIAMETER SPECIFIED IN THE PLANS WITHOUT EXCESSIVE DEFORMATION.
5. STAKES SHALL BE 2" X 2" WOOD OR #3 REBAR, 2'-4' LONG, EMBEDDED SUCH THAT 2" PROTRUDES ABOVE LOG, OR AS DIRECTED BY THE ENGINEER.
6. DO NOT PLACE STAKES THROUGH CONTAINMENT MESH.
7. COMPOST CRADLE MATERIAL IS INCIDENTAL & WILL NOT BE PAID FOR SEPARATELY.
8. SANDBAGS USED AS ANCHORS SHALL BE PLACED ON TOP OF LOGS & SHALL BE OF SUFFICIENT SIZE TO HOLD LOGS IN PLACE.
9. TURN THE ENDS OF EACH ROW OF LOGS UPSLOPE TO PREVENT RUNOFF FROM FLOWING AROUND THE LOG.
10. FOR HEAVY RUNOFF EVENTS, ADDITIONAL UPSTREAM STAKES MAY BE NECESSARY TO KEEP LOG FROM FOLDING IN ON ITSELF.

LEGEND

CL-D	EROSION CONTROL LOG DAM
CL-BOC	EROSION CONTROL LOG AT BACK OF CURB
CL-ROW	EROSION CONTROL LOG AT EDGE OF RIGHT-OF-WAY
CL-SST	EROSION CONTROL LOGS ON SLOPES STAKE AND TRENCHING ANCHORING
CL-SSL	EROSION CONTROL LOGS ON SLOPES STAKE AND LASHING ANCHORING
CL-DI	EROSION CONTROL LOG AT DROP INLET
CL-CI	EROSION CONTROL LOG AT CURB INLET
CL-GI	EROSION CONTROL LOG AT CURB & GRATE INLET

SEDIMENT BASIN & TRAP USAGE GUIDELINES

An erosion control log sediment trap may be used to filter sediment out of runoff draining from an unstabilized area.

Log Traps: The drainage area for a sediment trap should not exceed 5 acres. The trap capacity should be 1800 CF/Acre (0.5" over the drainage area).

Control logs should be placed in the following locations:

1. Within drainage ditches spaced as needed or min. 500' on center
2. Immediately preceding ditch inlets or drain inlets
3. Just before the drainage enters a water course
4. Just before the drainage leaves the right of way
5. Just before the drainage leaves the construction limits where drainage flows away from the project.

The logs should be cleaned when the sediment has accumulated to a depth of 1/2 the log diameter.

Cleaning and removal of accumulated sediment deposits is incidental and will not be paid for separately.

SHEET 1 OF 3

Texas Department of Transportation

Design Division Standard

TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES


EROSION CONTROL LOG

EC(9)-16

FILE: ec916	DN: TxDOT		CK: KM	DW: LS/PT		CK: LS
© TxDOT: JULY 2016	CONT	SECT	JOB		HIGHWAY	
REVISIONS	TBD	TBD	TBD		CR 200	
	DIST	COUNTY				SHEET NO.
	AUS	WILLIAMSON				67


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\ErosionControl\ec916.dgn

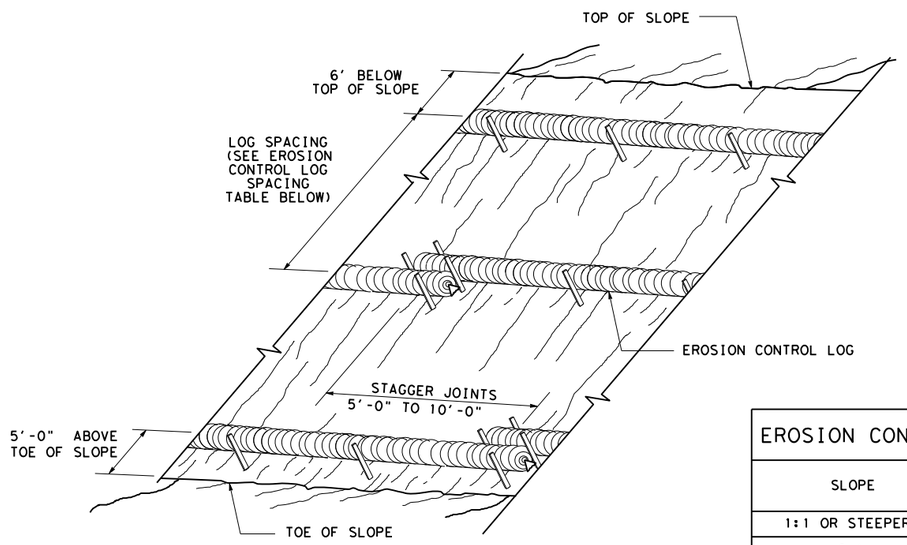

EROSION CONTROL LOGS ON SLOPES
STAKE AND TRENCHING ANCHORING


CL-SST

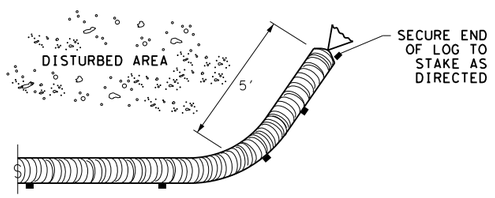

END SECTION RAP DETAIL


EROSION CONTROL LOG SPACING TABLE				
SLOPE	LOG DIAMETER			
	6"	8"	12"	18"
1:1 OR STEEPER	5'	10'	15'	20'
2:1	10'	20'	30'	40'
3:1	15'	30'	45'	60'
4:1 OR FLATTER	20'	40'	60'	80'


* ADJUSTMENTS CAN BE MADE FOR SOIL TYPE:
SOFT, LOAMY SOILS-ADJUST ROWS CLOSER TOGETHER;
HARD, ROCKY SOILS- ADJUST ROWS FARTHER APART

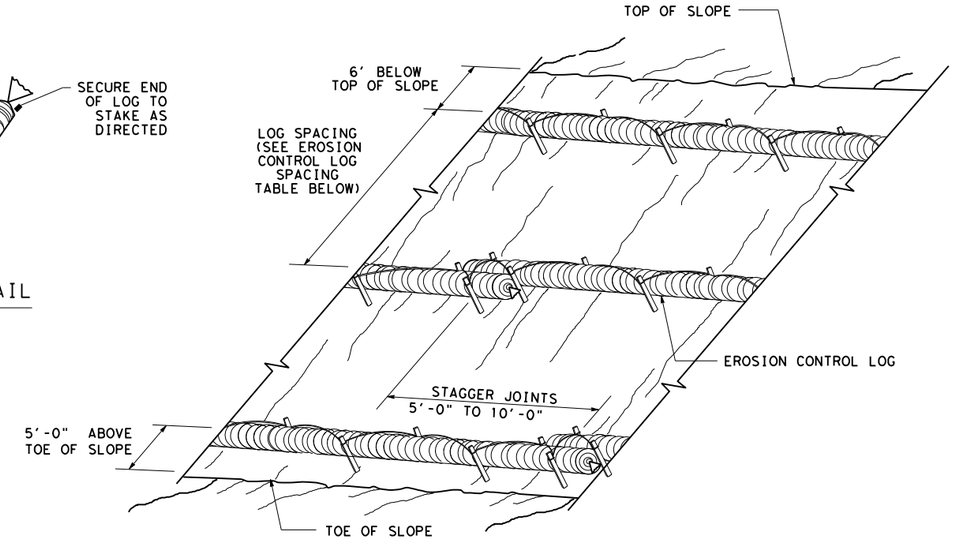

EROSION CONTROL LOGS ON SLOPES
STAKE AND LASHING ANCHORING

CL-SSL

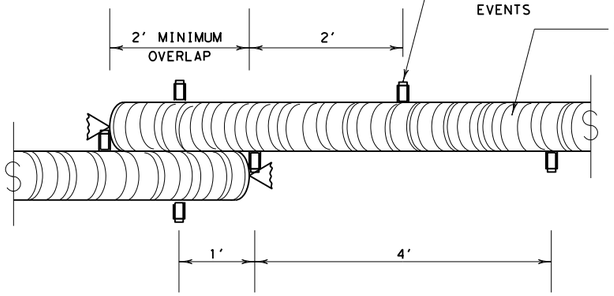


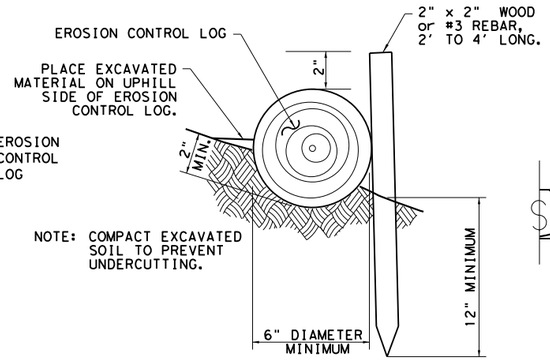


STAKE AND TRENCHING ANCHORING DETAIL

CL-SST


TRENCH DEPTH TABLE	
LOG DIAMETER	DEPTH
6"	2"
8"	3"
12"	4"
18"	5"

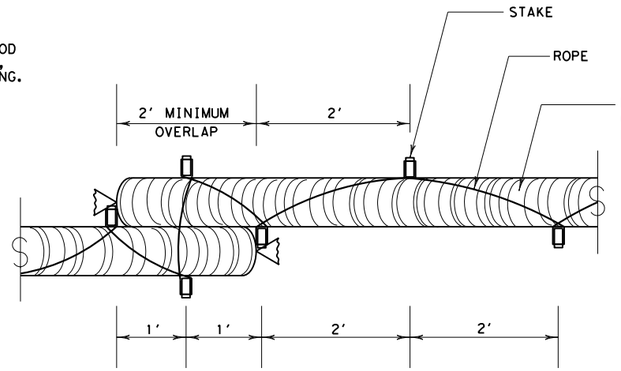

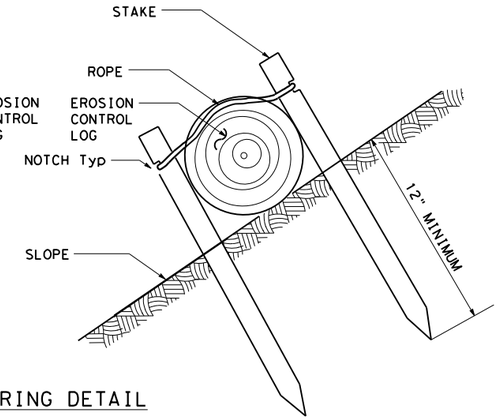

STAKE AND LASHING ANCHORING DETAIL

CL-SSL



STAKE NOTCH DETAIL

Texas Department of Transportation — Design Division Standard

TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES


EROSION CONTROL LOG

EC(9)-16

FILE: ec116	DN: TxDOT		CK: KM		DW: LS/PT	CK: LS
© TxDOT: JULY 2016	CONT	SECT	JOB		HIGHWAY	
REVISIONS	TBD	TBD	TBD		CR 200	
	DIST	COUNTY			SHEET NO.	
	AUS	WILLIAMSON			68	


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 12/21/2017
FILE: H:\OBES\CR 200\Documents\WA-4_CR201-BS\SHEETS\Standards\ErosionControl\ec916.dgn

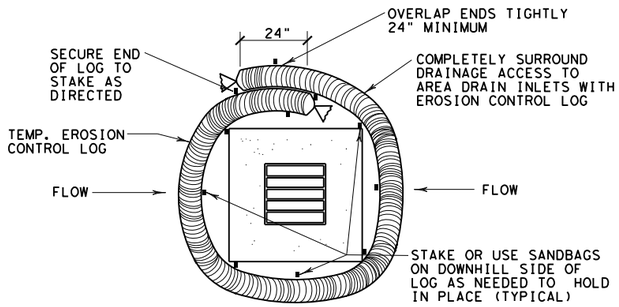


EROSION CONTROL LOG AT DROP INLET

CL-DI

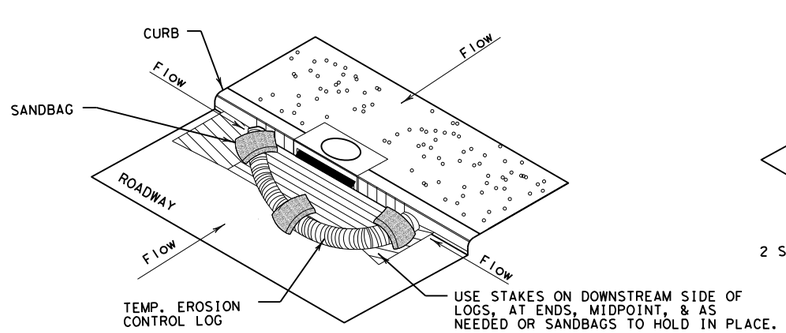

EROSION CONTROL LOG AT CURB INLET


CL-CI

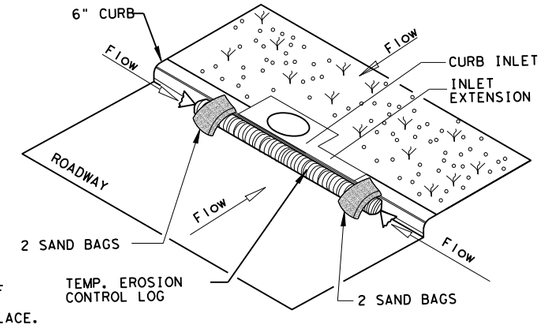

EROSION CONTROL LOG AT CURB INLET


CL-CI

NOTE:
EROSION CONTROL LOGS USED AT CURB INLETS SHOULD ONLY BE USED IF THEY WILL NOT IMPEDE TRAFFIC OR FLOOD THE ROADWAY OR WHEN THE STORM SEWER SYSTEM IS NOT FULLY FUNCTIONAL.

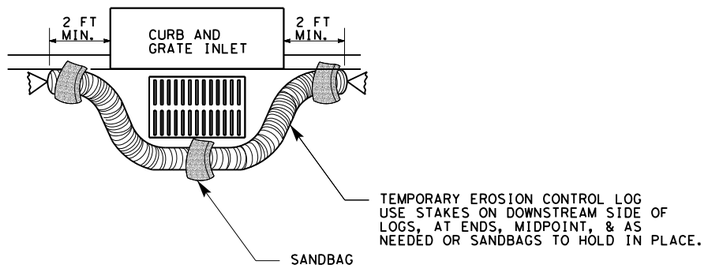


EROSION CONTROL LOG AT CURB & GRADE INLET

CL-GI

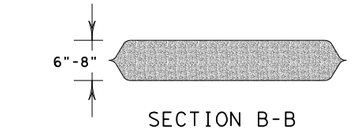

SECTION B-B

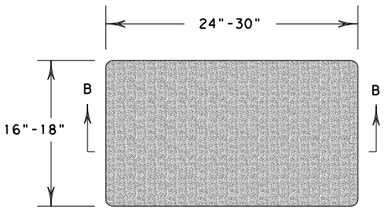

SANDBAG DETAIL

SHEET 3 OF 3

Texas Department of Transportation


Design Division Standard

TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES

EROSION CONTROL LOG

EC(9)-16

FILE: ec916	DN: TxDOT	CK: KM	DW: LS/PT	CK: LS
© TxDOT: JULY 2016	CONT	SECT	JOB	HIGHWAY
REVISIONS	TBD	TBD	TBD	CR 200
	DIST	COUNTY		SHEET NO.
	AUS	WILLIAMSON		69

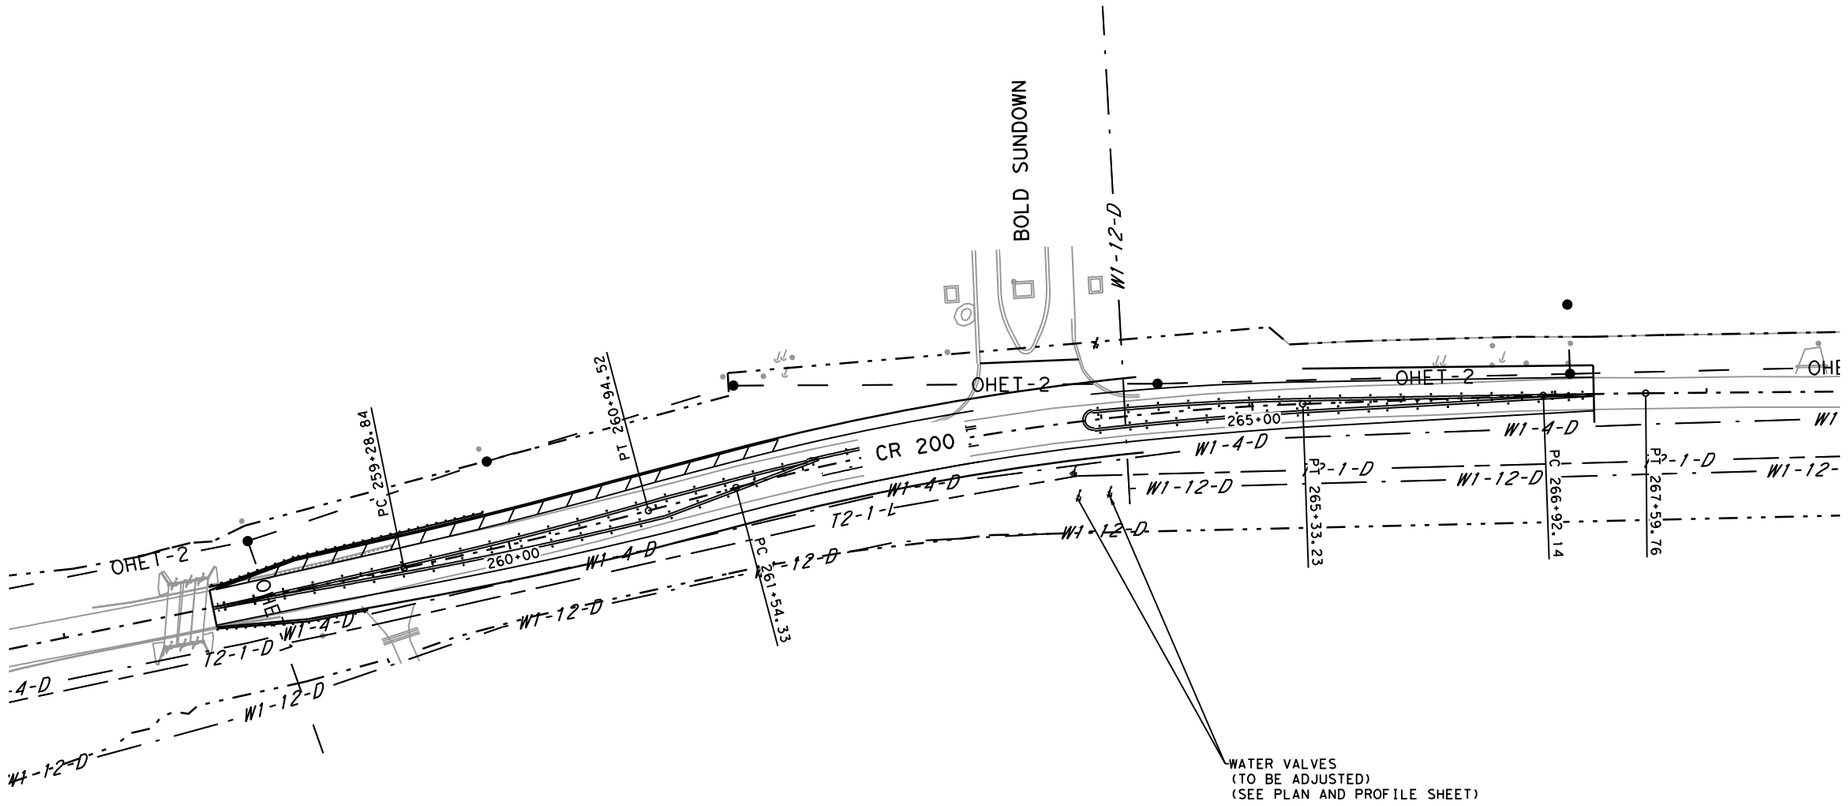




0 50 100
SCALE: 1"=100'

THE LOCATION OF UTILITIES INDICATED ON THE PLANS IS APPROXIMATE AND THEIR FULL EXTENTS ARE NOT SHOWN. IT IS THE CONTRACTOR'S RESPONSIBILITY TO MAKE ARRANGEMENTS WITH THE UTILITY OWNERS PRIOR TO WORKING IN THE AREA, TO CONFIRM THEIR EXACT LOCATIONS, AND TO DETERMINE WHETHER ANY ADDITIONAL UTILITIES OTHER THAN THOSE SHOWN ON THE PLANS MAY BE PRESENT.

THE PLANS SHOW THE STATUS OF UTILITY LOCATIONS AS OF JANUARY 28, 2013.



12/21/2017

WILLIAMSON COUNTY PRECINCT #2

TBPE FIRM # 14060


ROGERS DESIGN SERVICES FIRM # 9994

CR 200 AT BOLD SUNDOWN

EXISTING UTILITIES

SHEET 1 OF 1 | SHEET # 70

$$ILTDRV$$
12/21/2017 8:54:47 AM
C:\Projects\CR 200\WA-44-CR20\-BS\SHEETS\Utilities\WA4b-UTIL-01.dgn

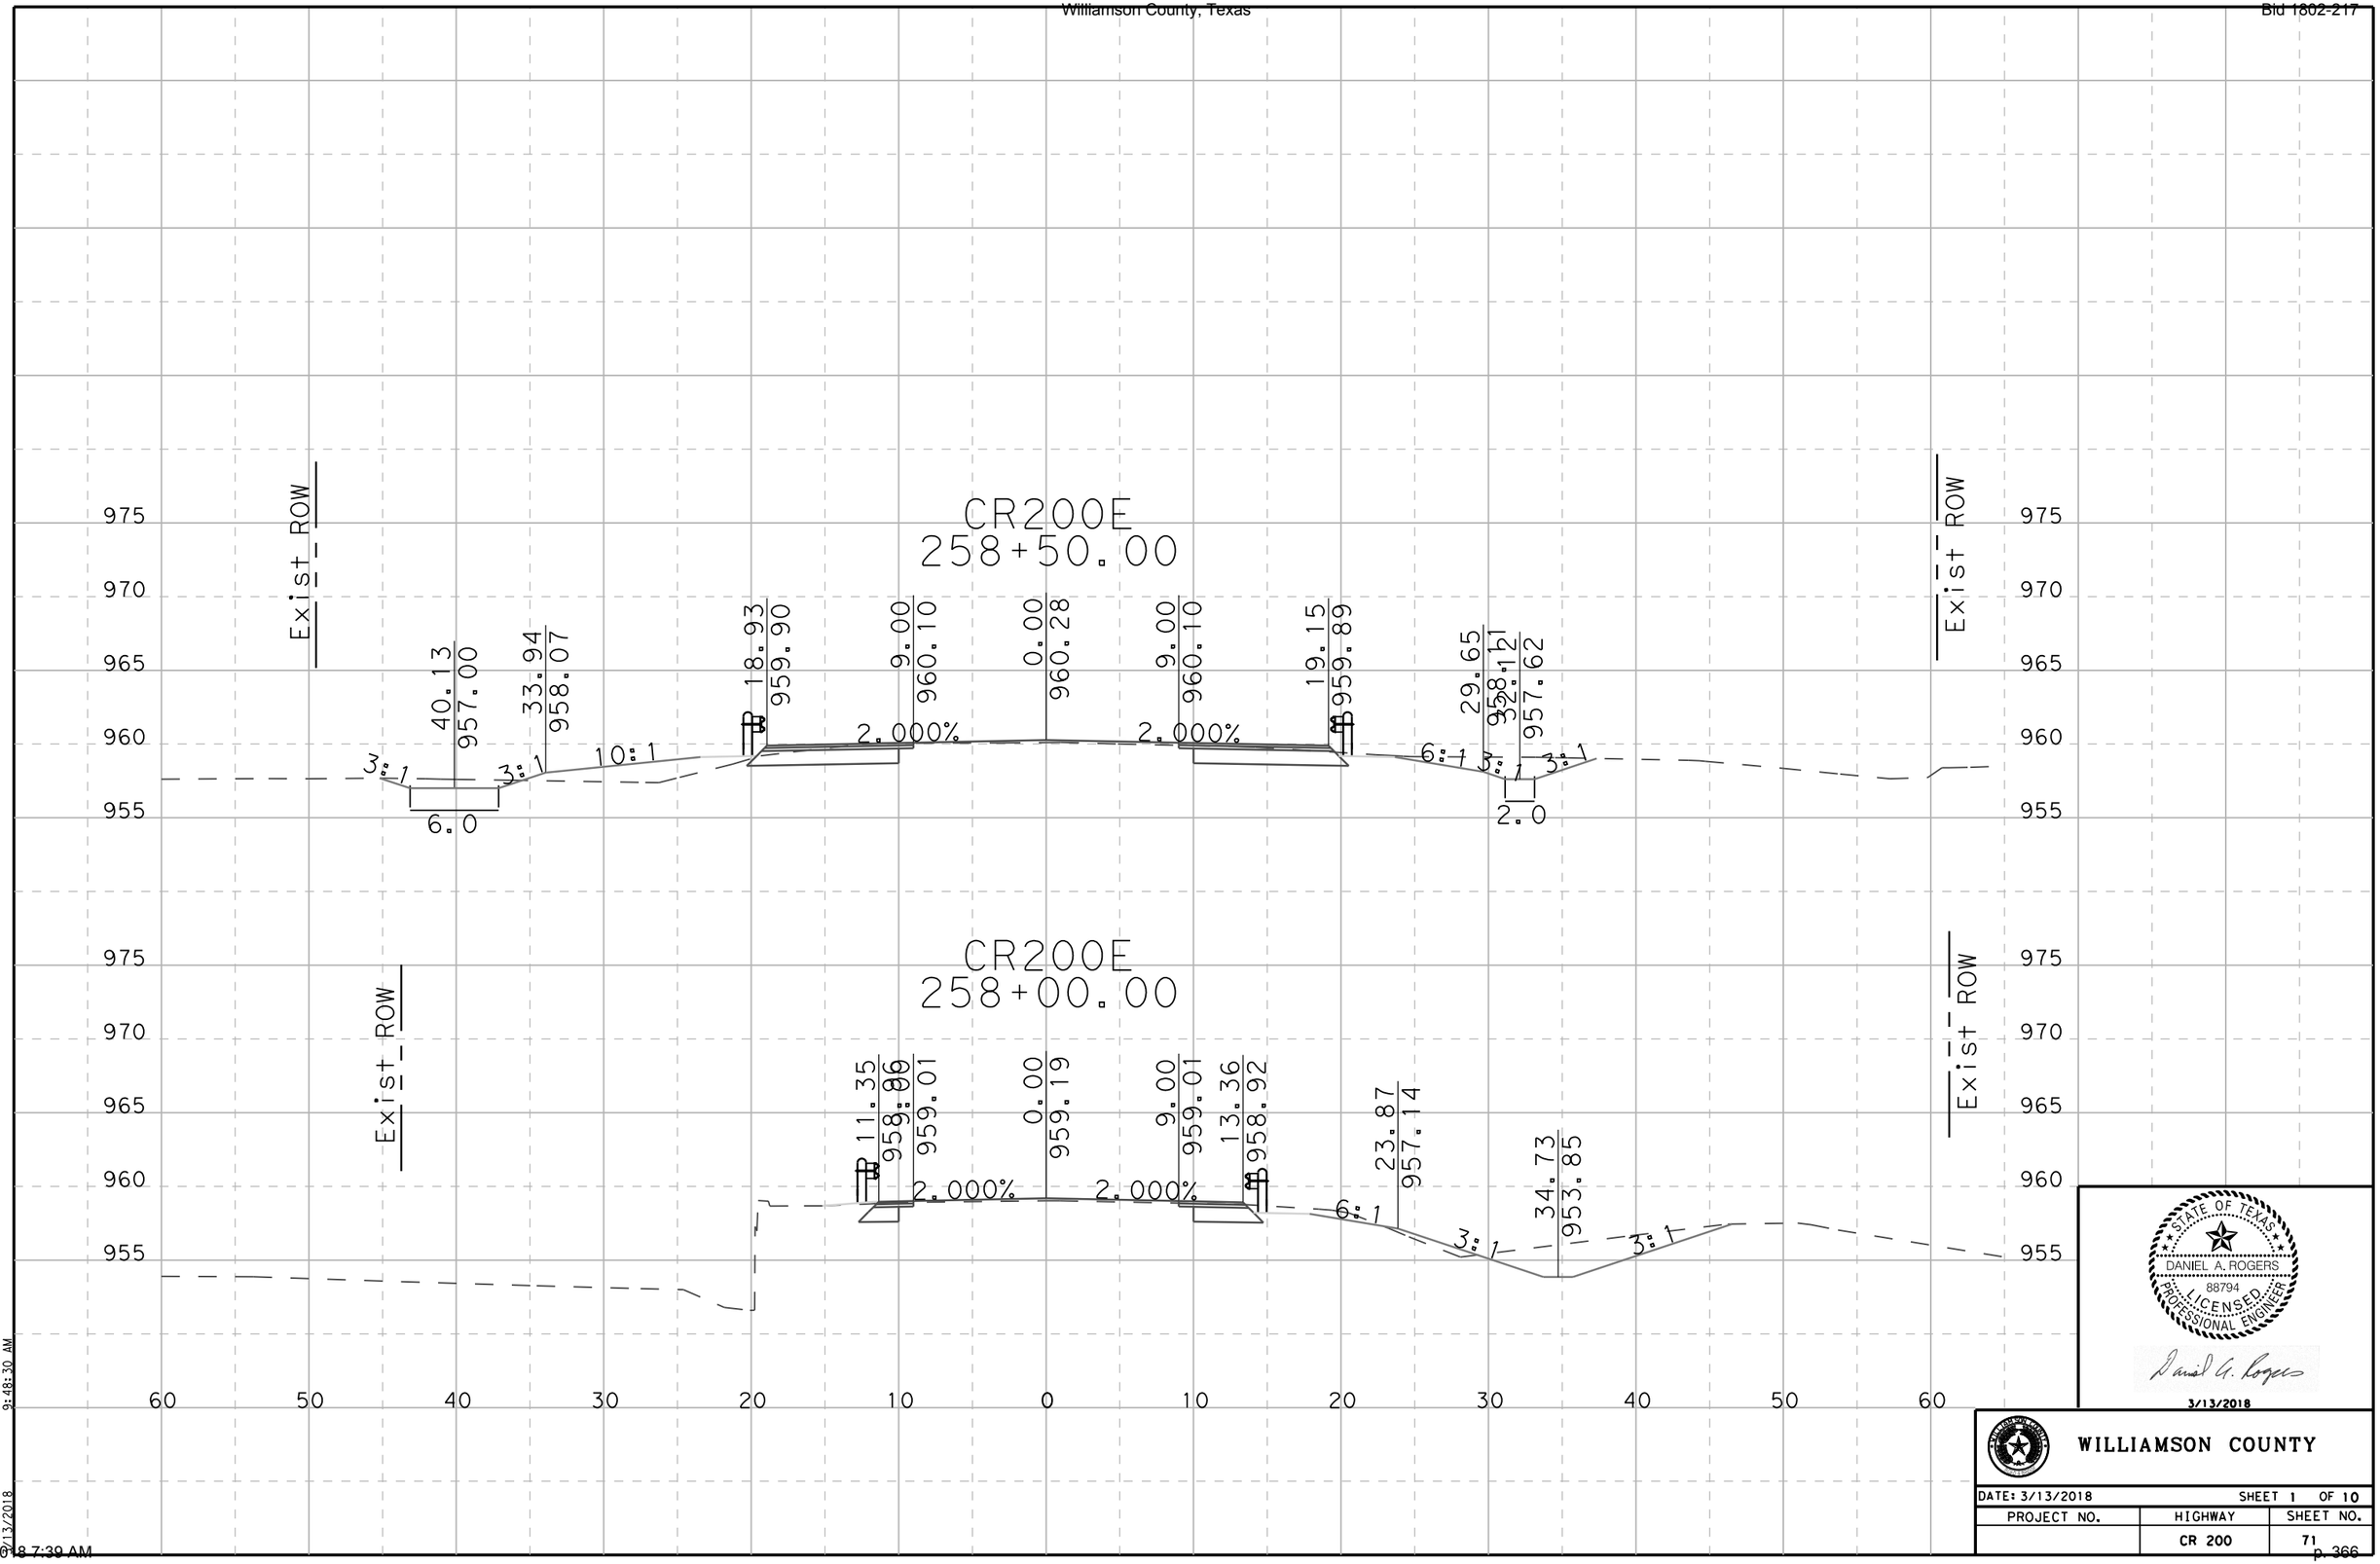


STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED
PROFESSIONAL ENGINEER
3/13/2018

WILLIAMSON COUNTY

DATE: 3/13/2018		SHEET 1 OF 10
PROJECT NO.	HIGHWAY	SHEET NO.
	CR 200	71

I:\011570-000\CR 200\GEOPAK\WA4b+xsplot.dgn
3/13/2018 9:48:30 AM
3/15/2018 7:39 AM

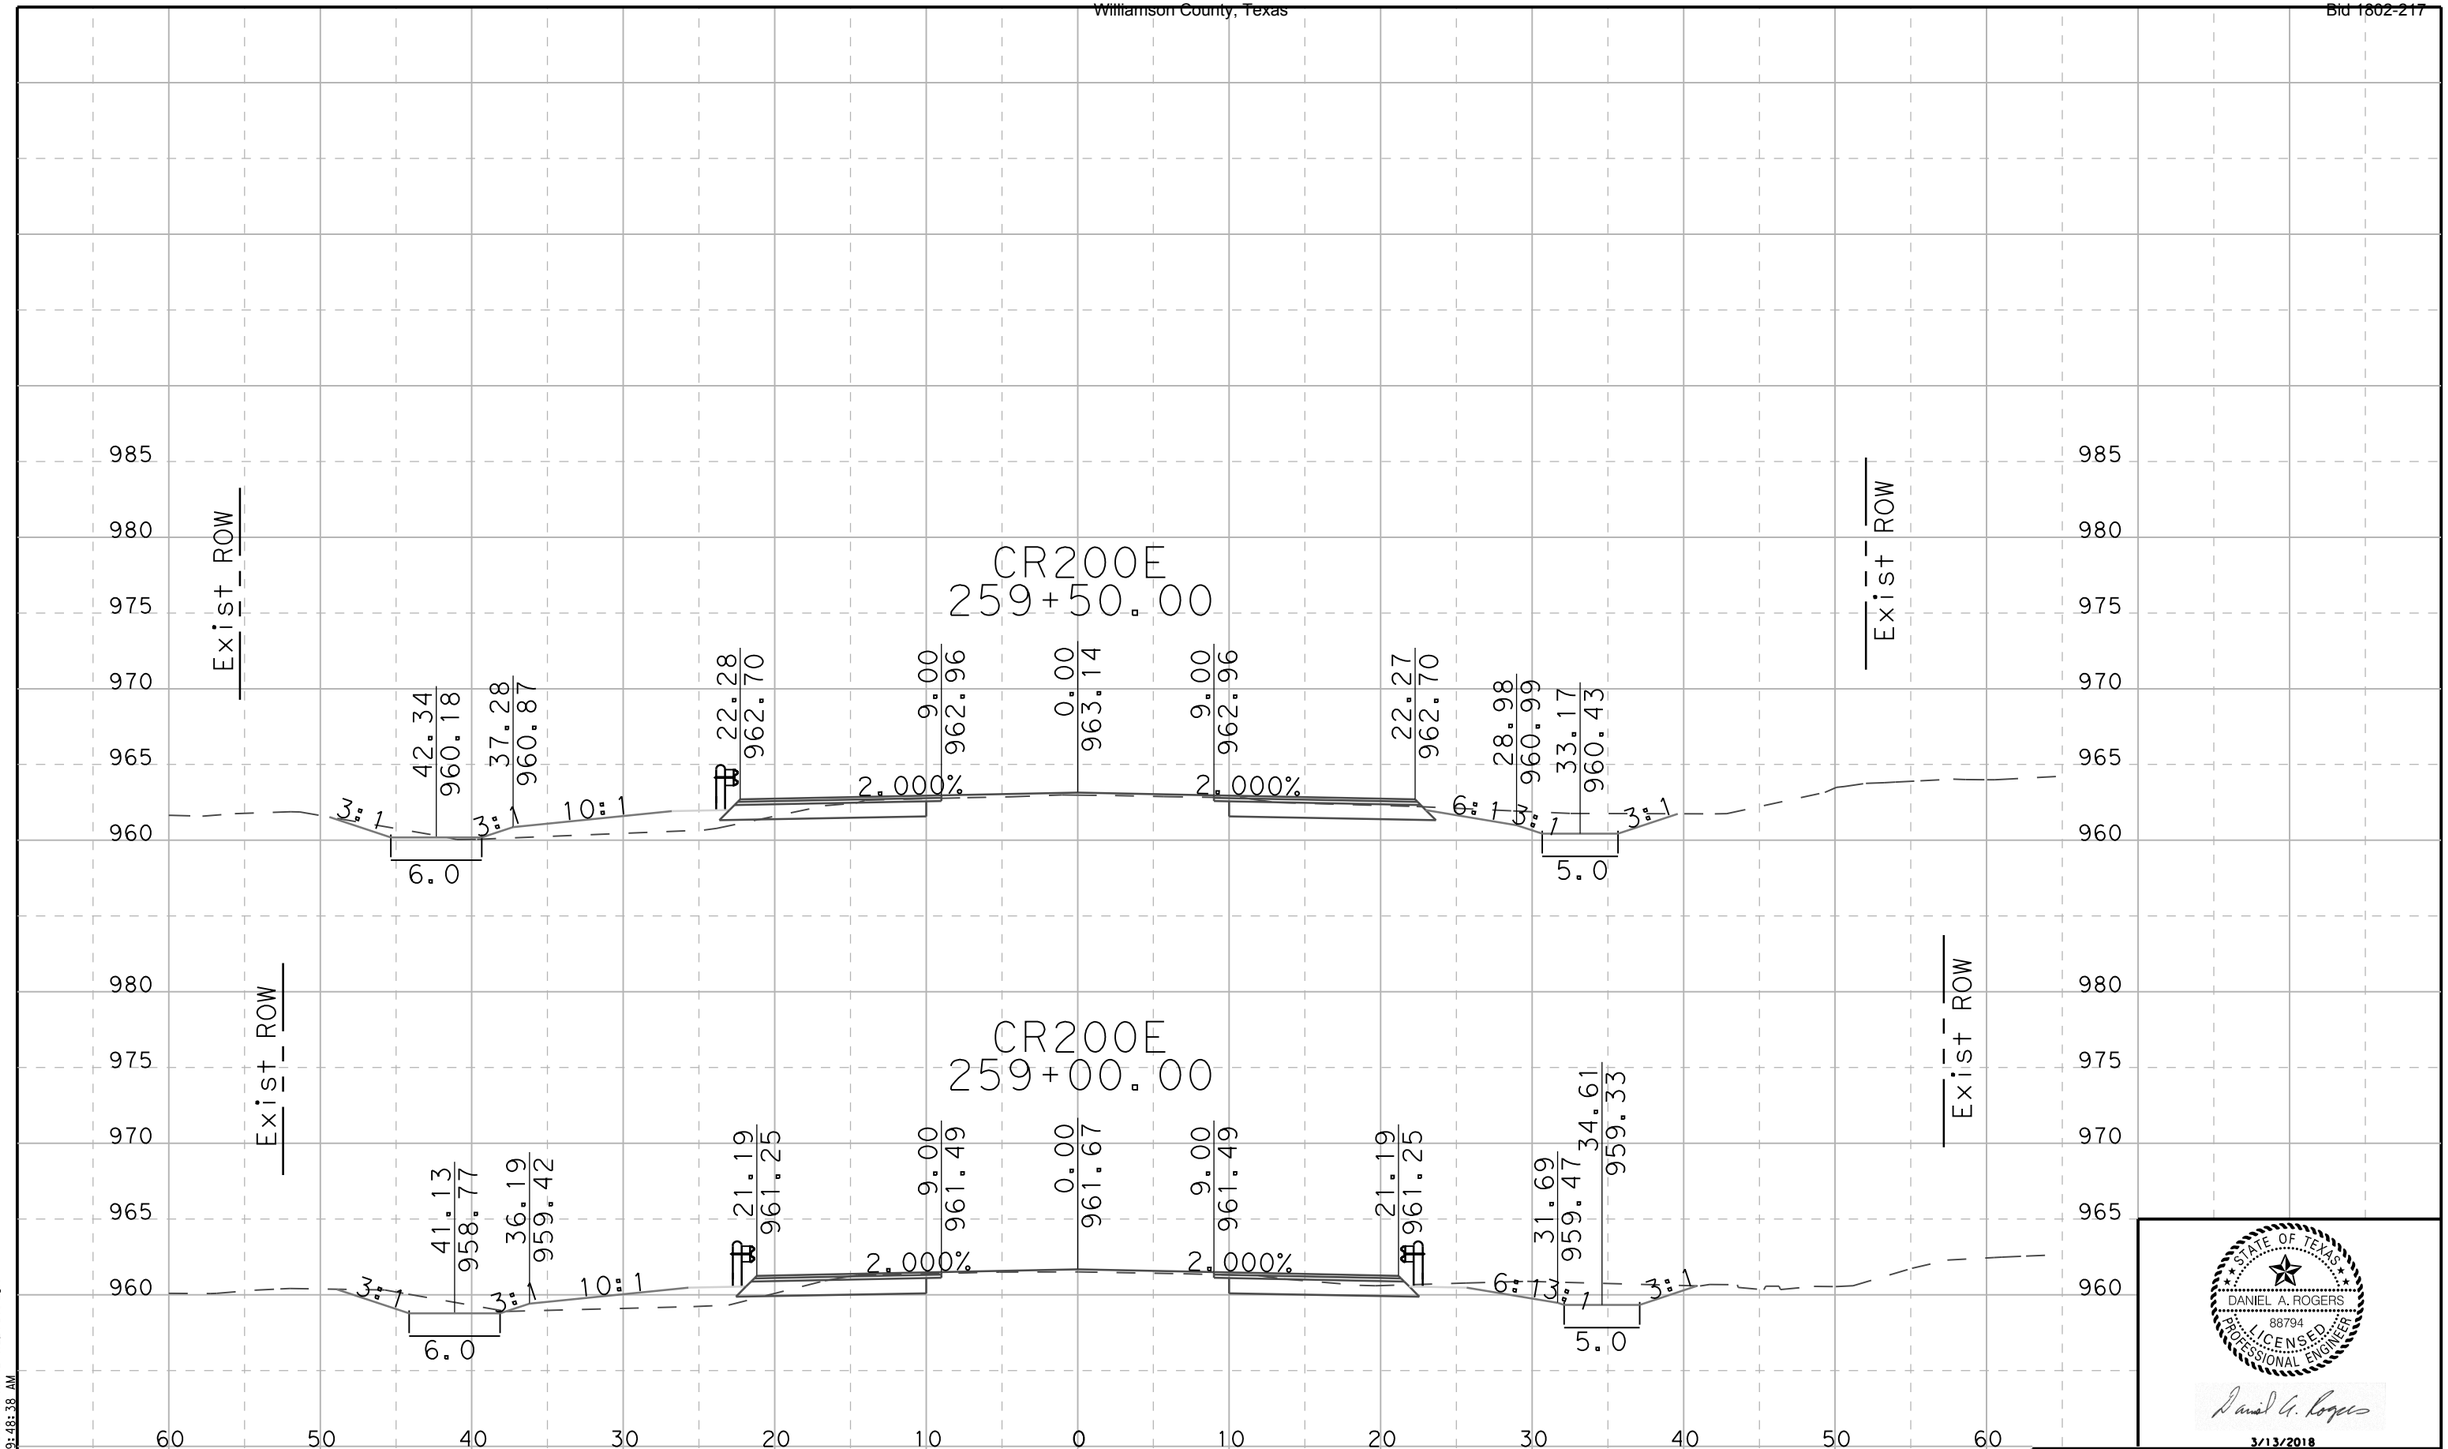


STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED
PROFESSIONAL ENGINEER
Daniel A. Rogers
3/13/2018

WILLIAMSON COUNTY

DATE: 3/13/2018		SHEET 2 OF 10
PROJECT NO.	HIGHWAY	SHEET NO.
	CR 200	72

\011570-000\CR 200\GEOPAK\WA4bxsplot.dgn
3/13/2018 9:48:38 AM
3/15/2018 7:39 AM

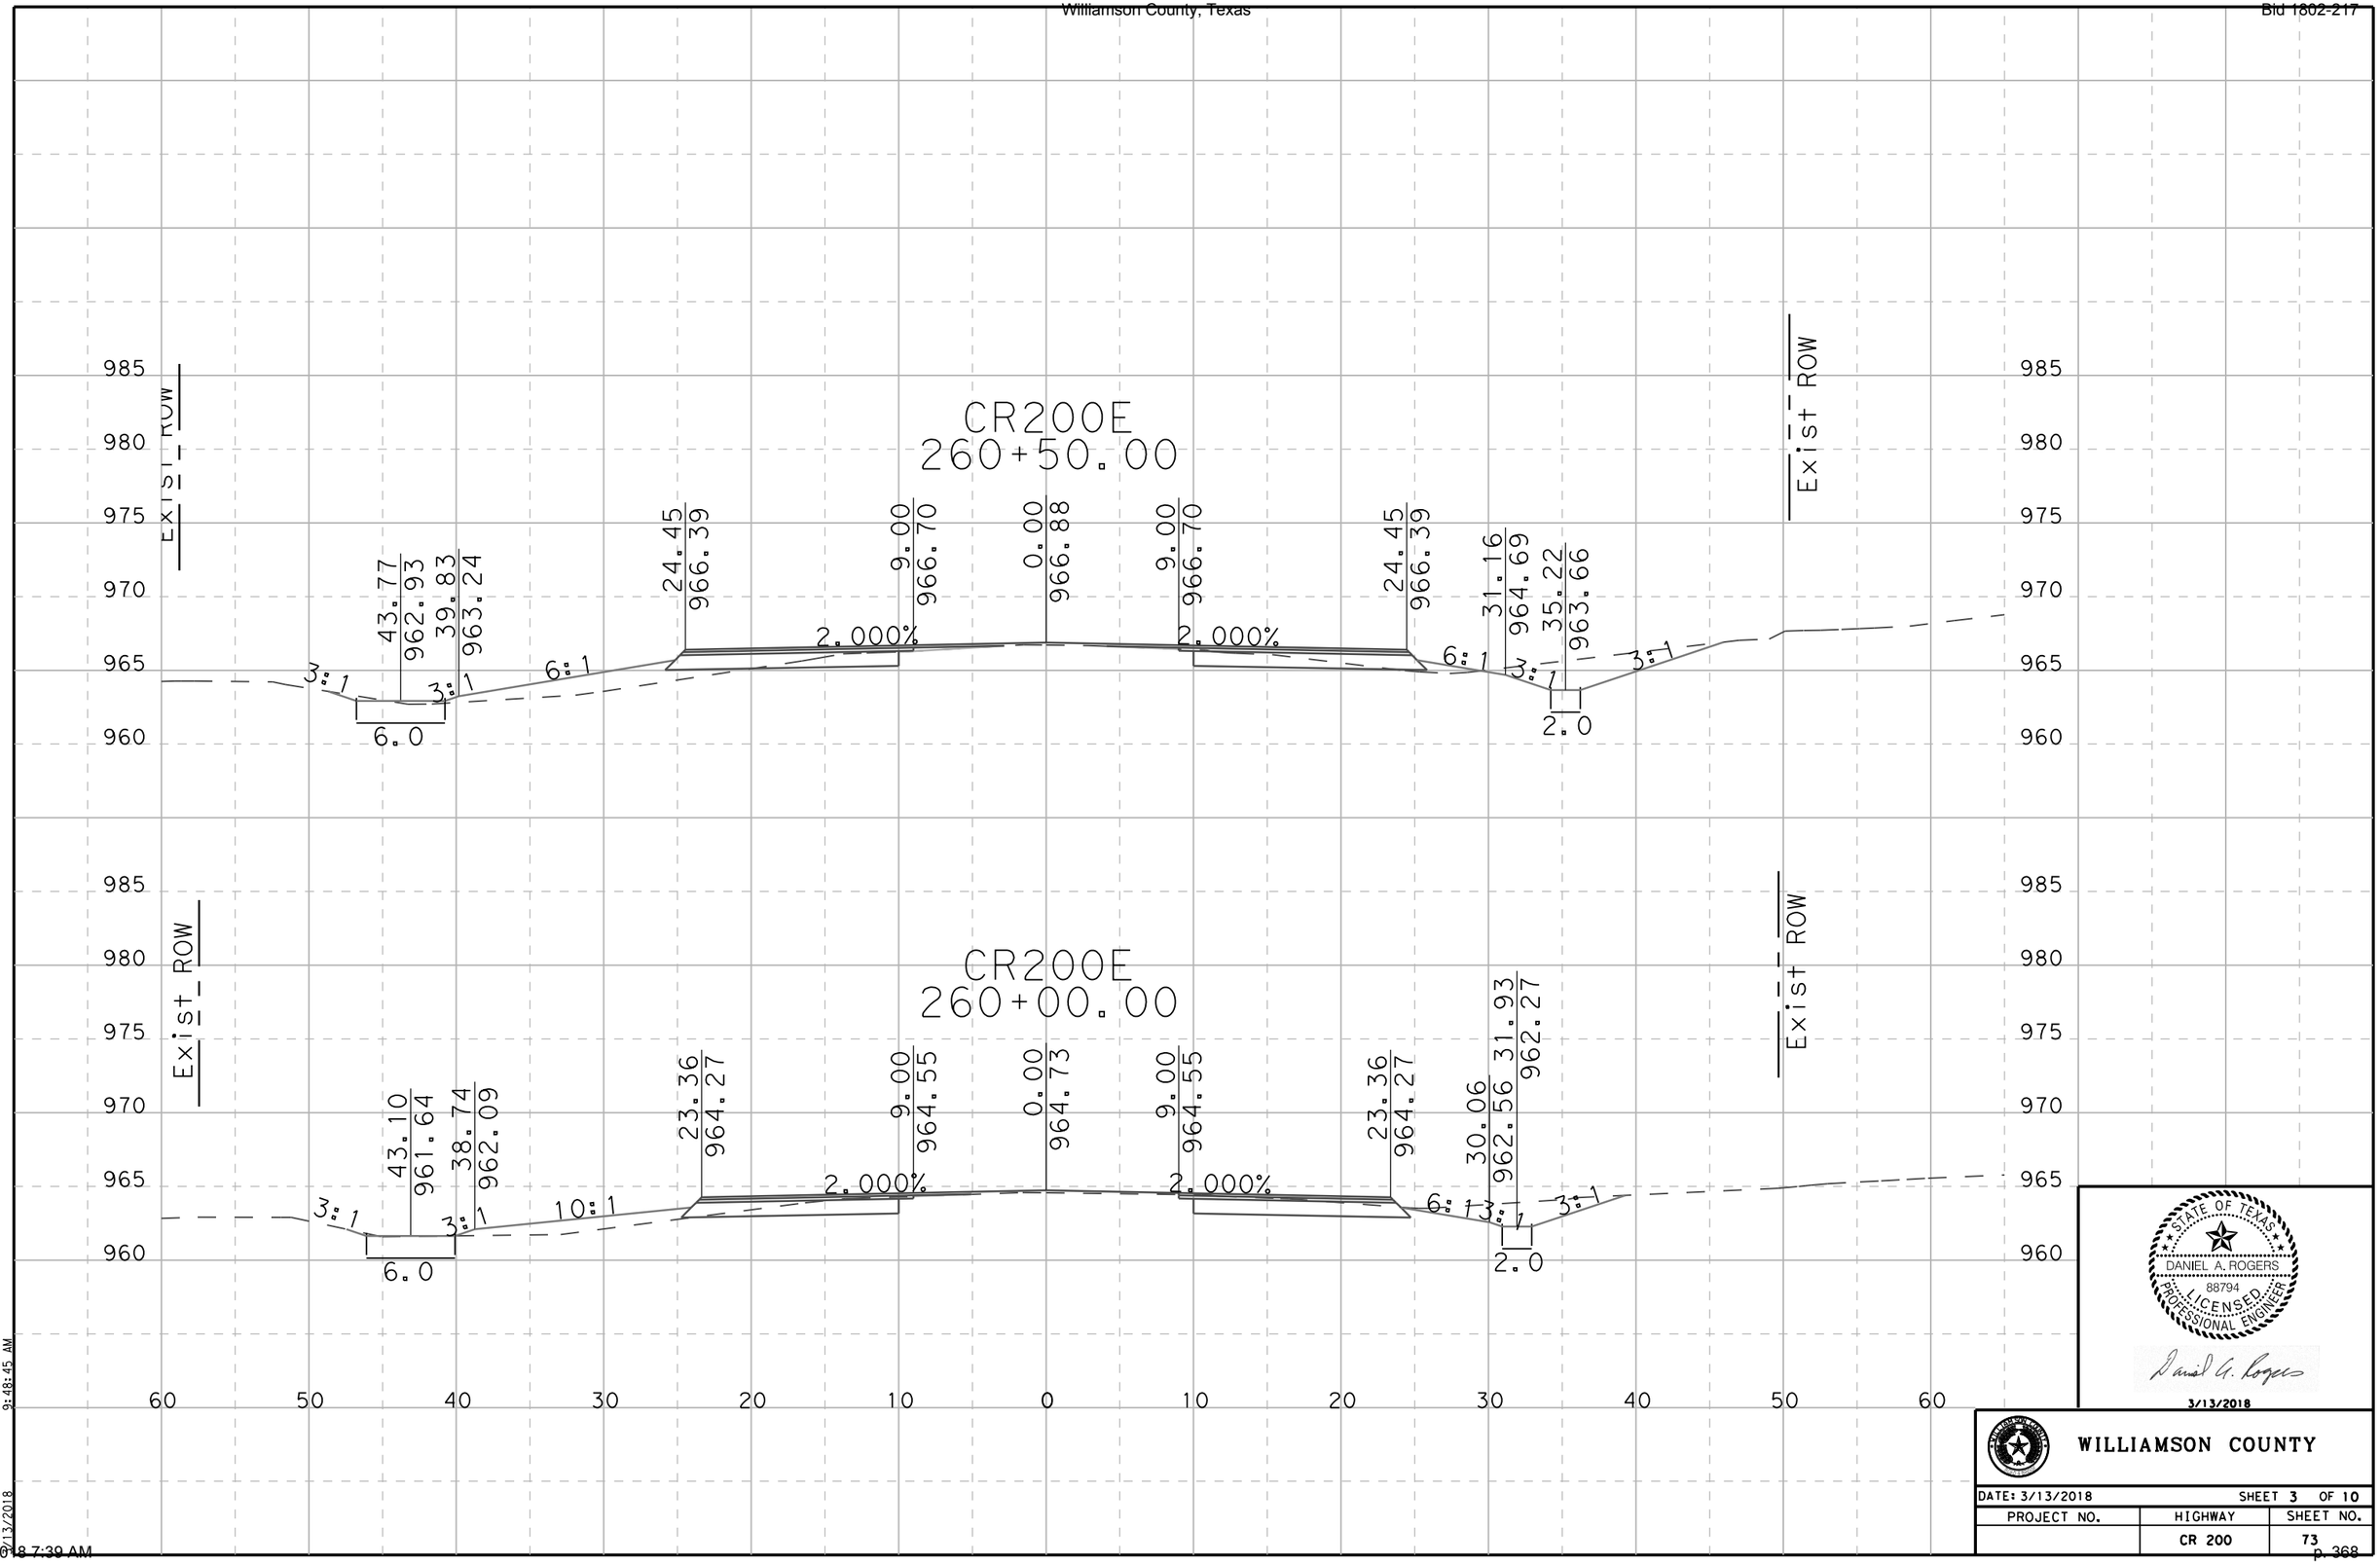


STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED
PROFESSIONAL ENGINEER
Daniel A. Rogers
3/13/2018

WILLIAMSON COUNTY

DATE: 3/13/2018		SHEET 3 OF 10
PROJECT NO.	HIGHWAY	SHEET NO.
	CR 200	73


\\011570-000\CR 200\GEOPAK\WA4d*xsplot.dgn
9:48:45 AM
3/13/2018
3/15/2018 7:39 AM

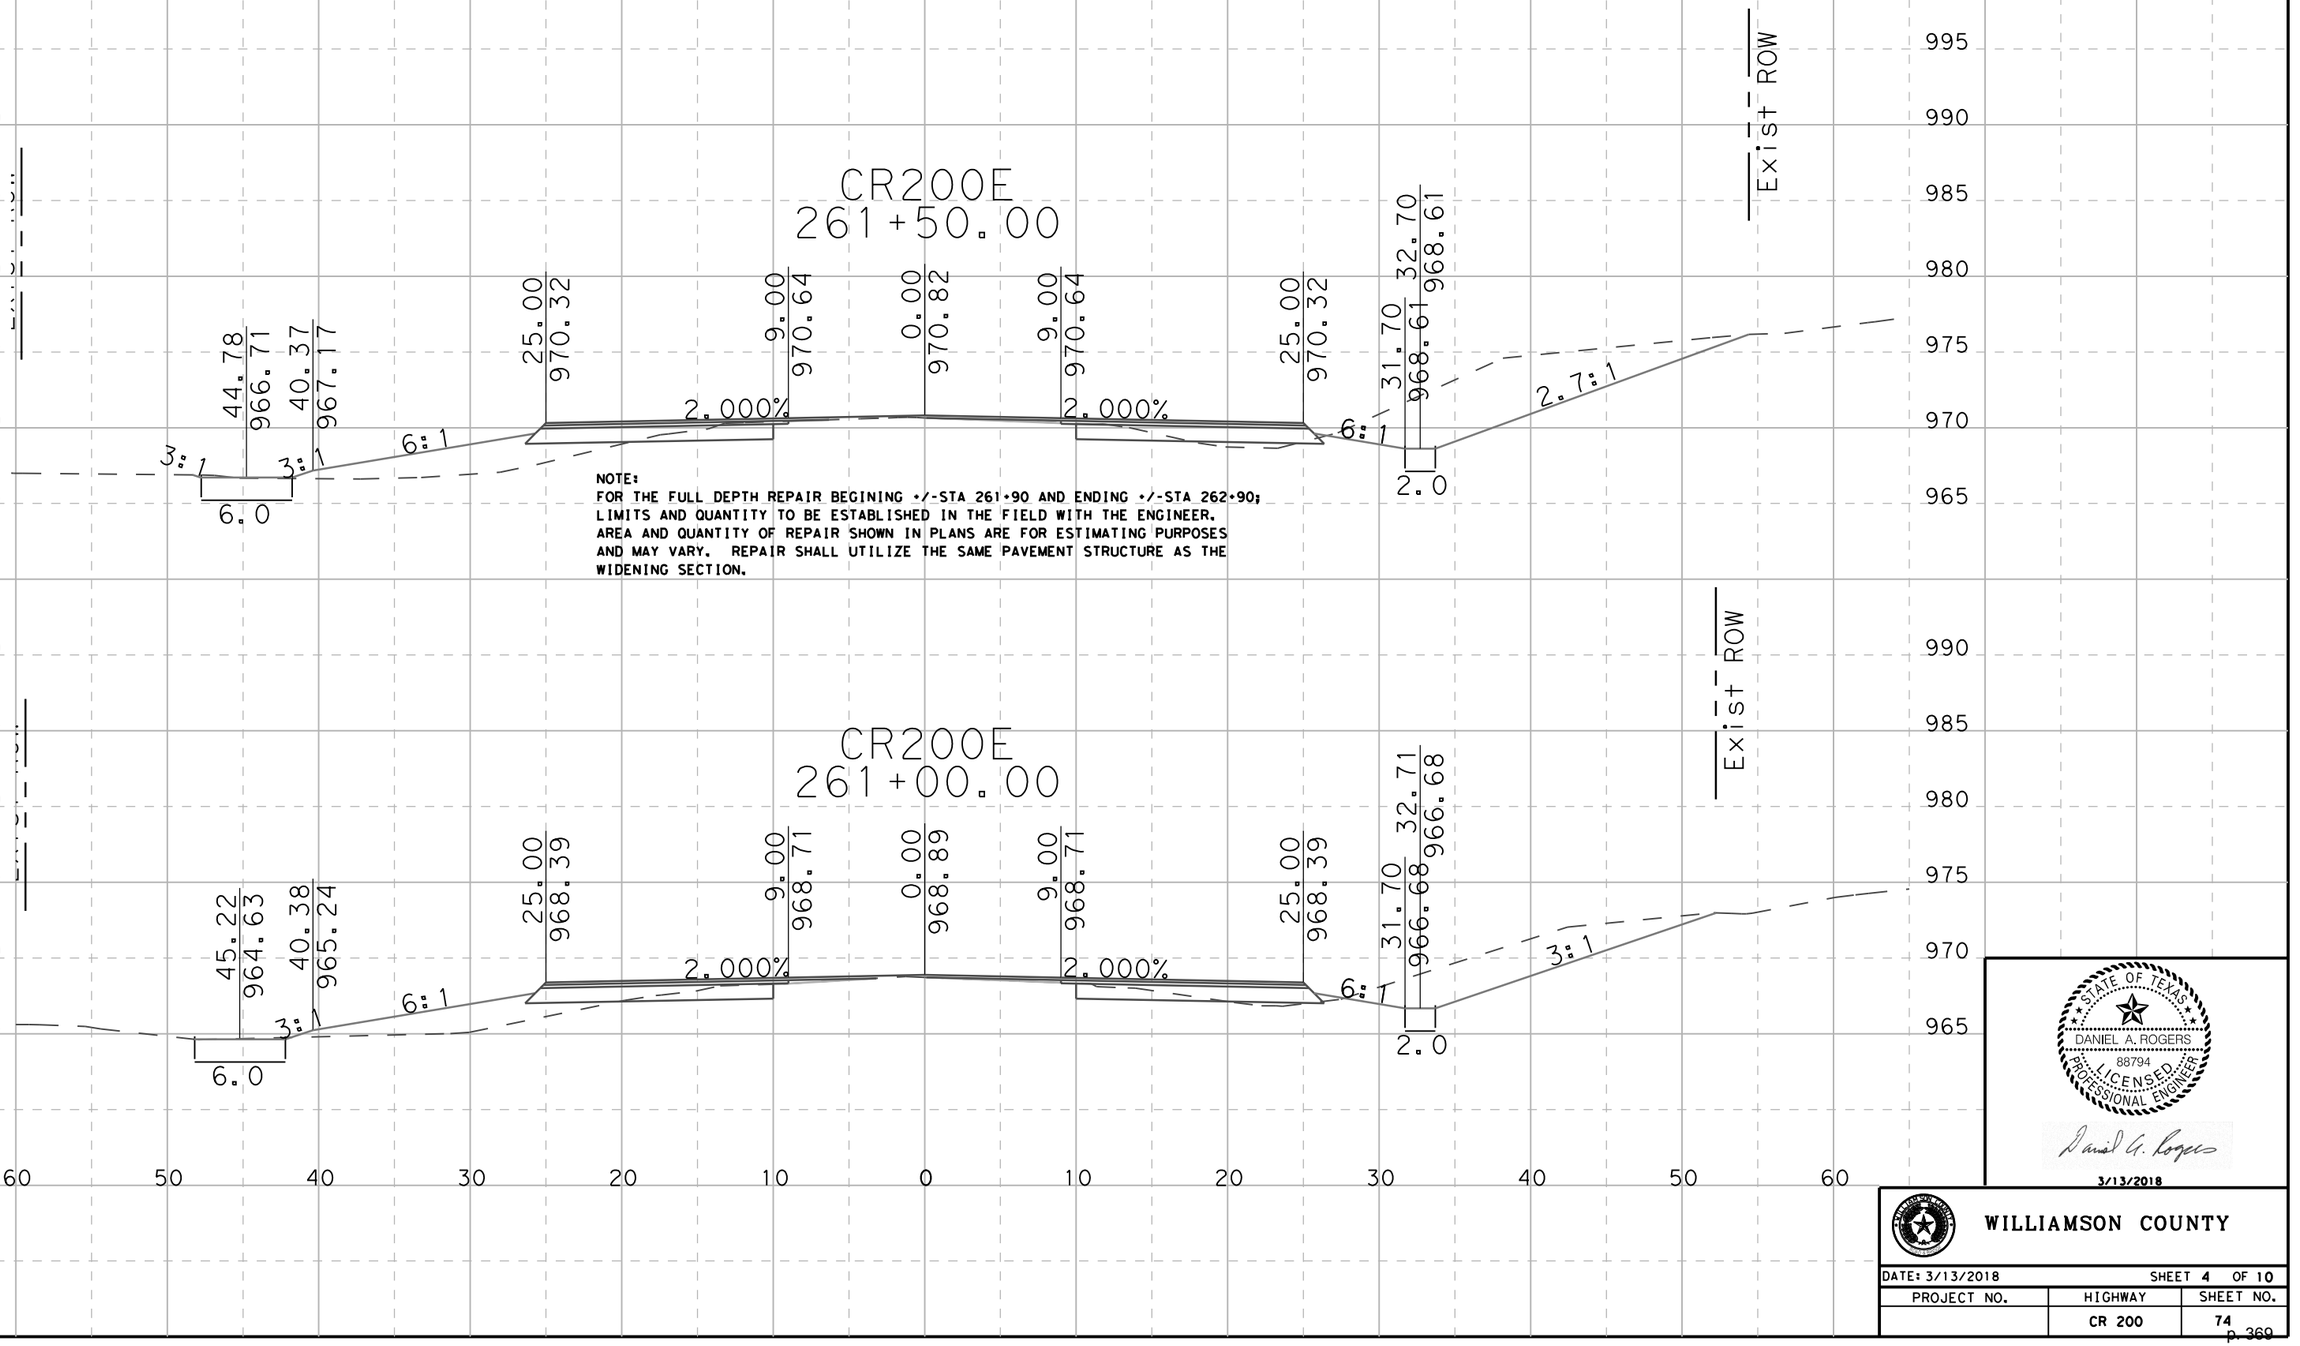

STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED
PROFESSIONAL ENGINEER
Daniel A. Rogers
3/13/2018

WILLIAMSON COUNTY

DATE: 3/13/2018		SHEET 4 OF 10
PROJECT NO.	HIGHWAY	SHEET NO.
	CR 200	74

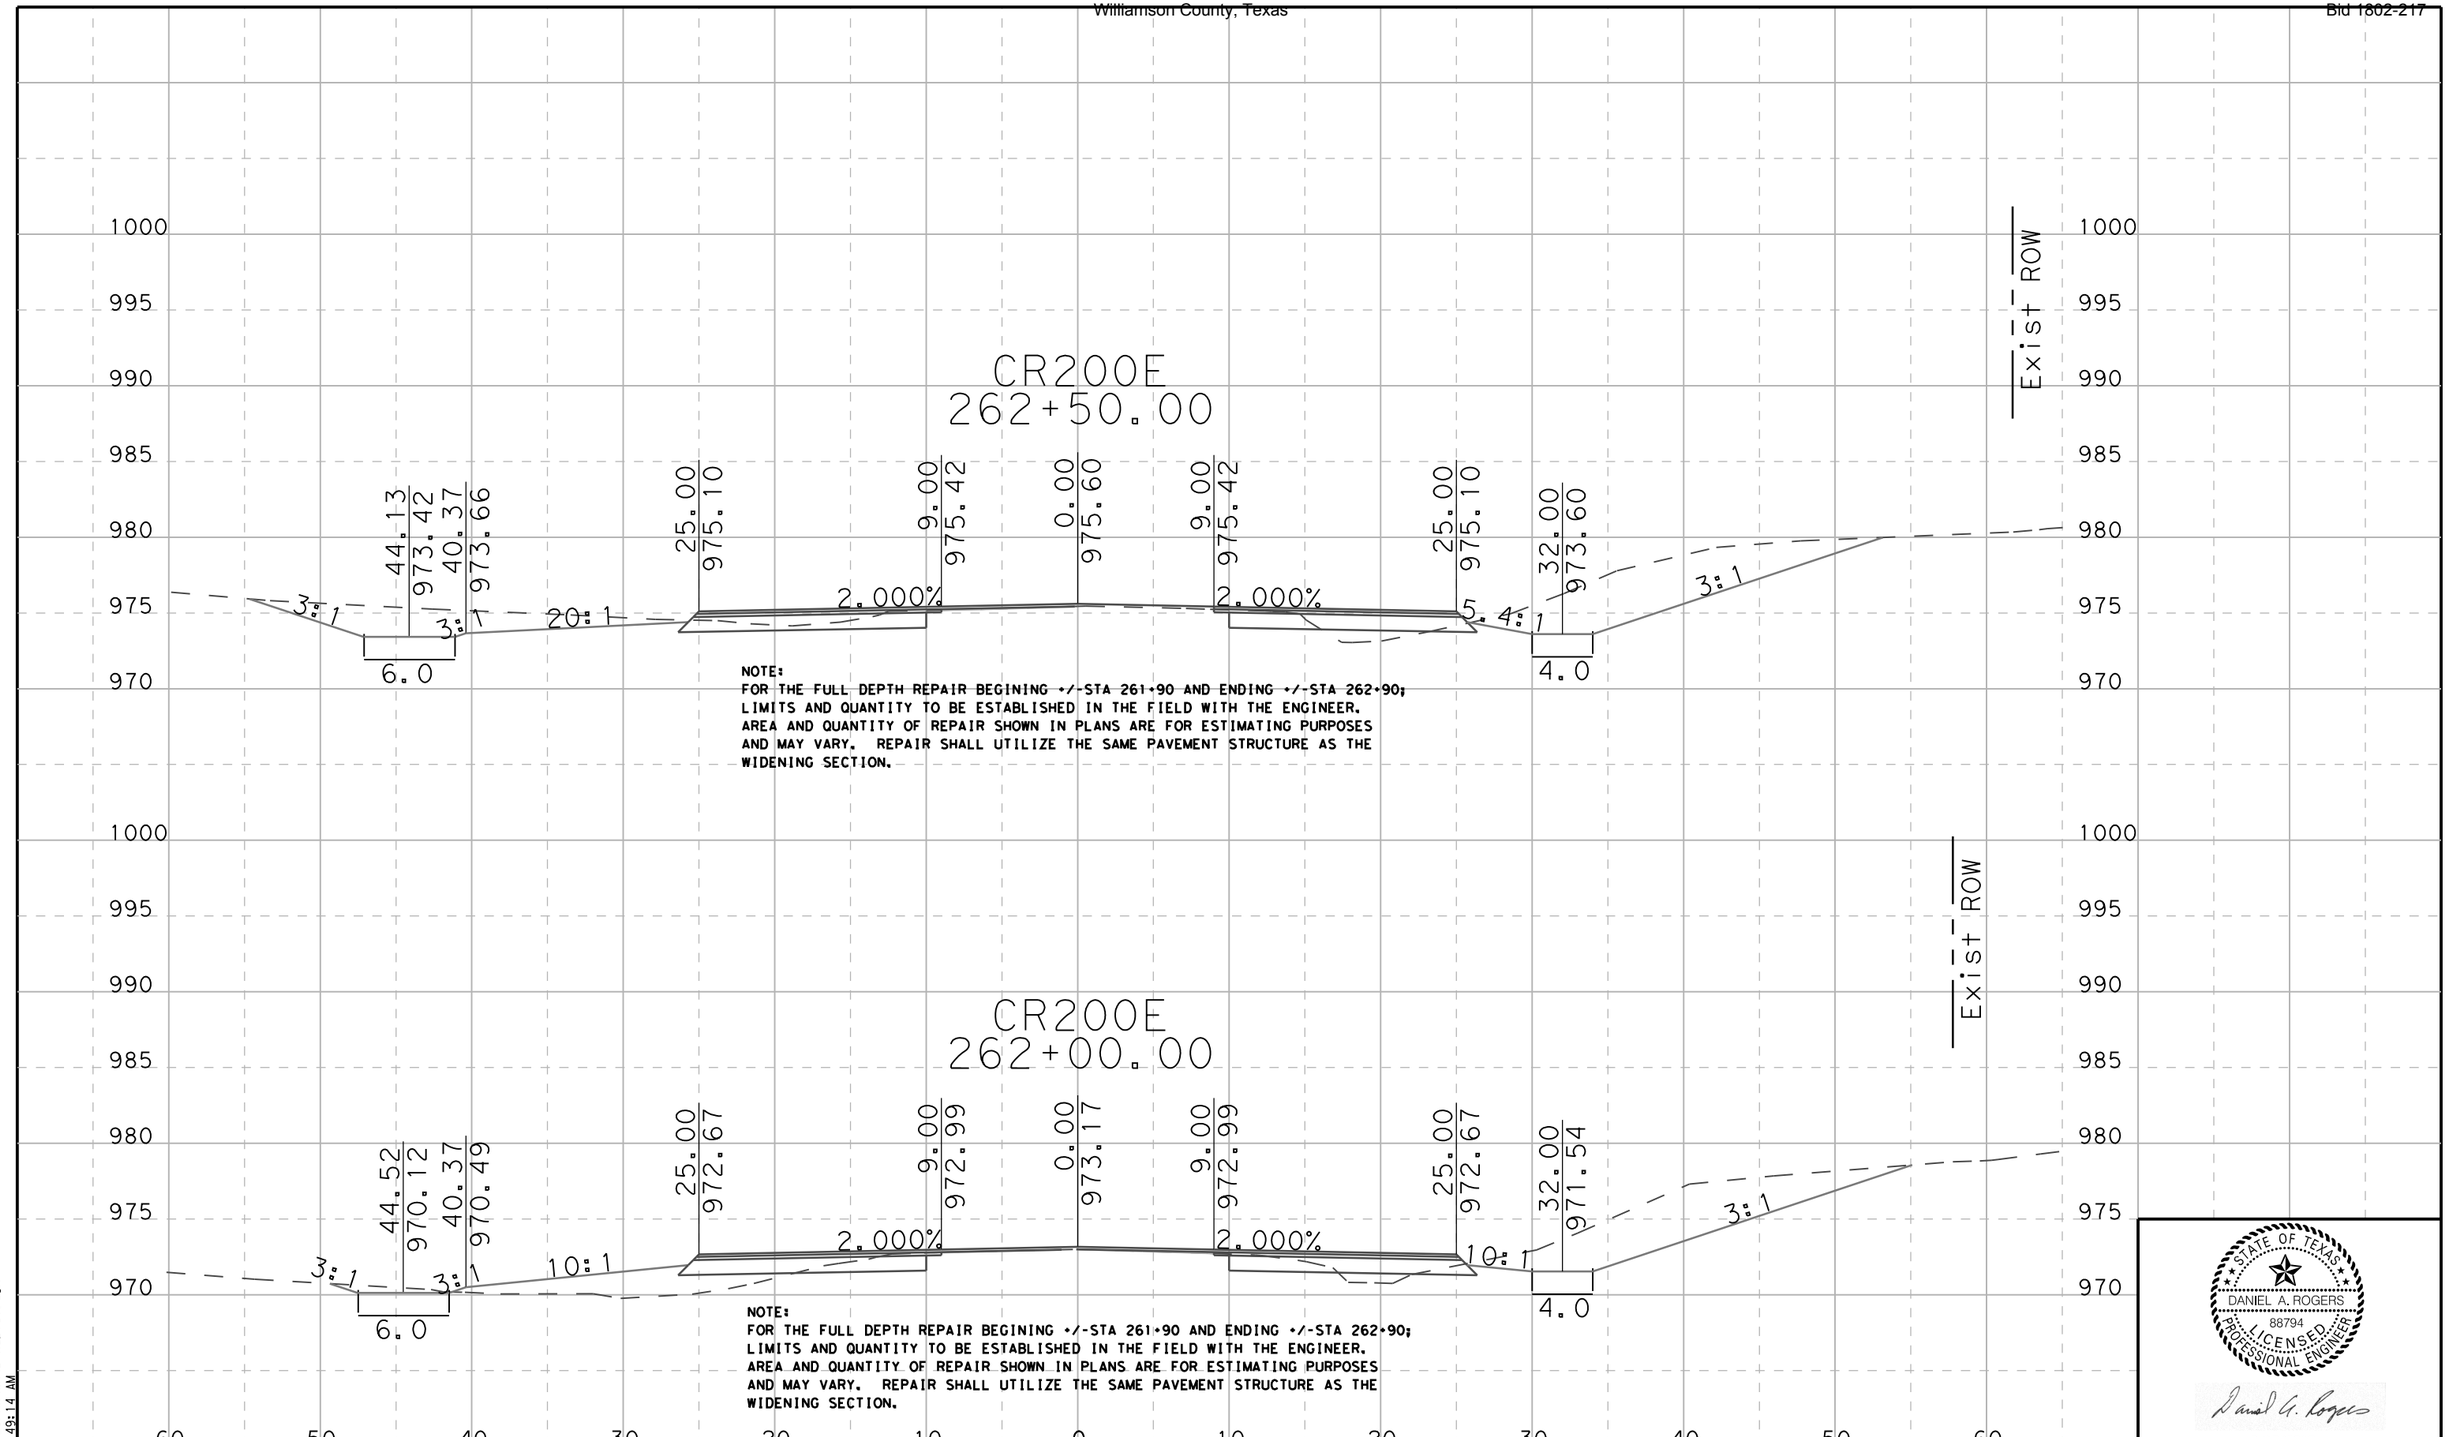


STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED PROFESSIONAL ENGINEER
Daniel A. Rogers
3/13/2018

WILLIAMSON COUNTY

DATE: 3/13/2018		SHEET 5 OF 10
PROJECT NO.	HIGHWAY	SHEET NO.
	CR 200	75

...\011570-000\CR 200\GEOPAK\WA4b*xsplot.dgn
3/13/2018 9:49:14 AM
3/15/2018 7:39 AM

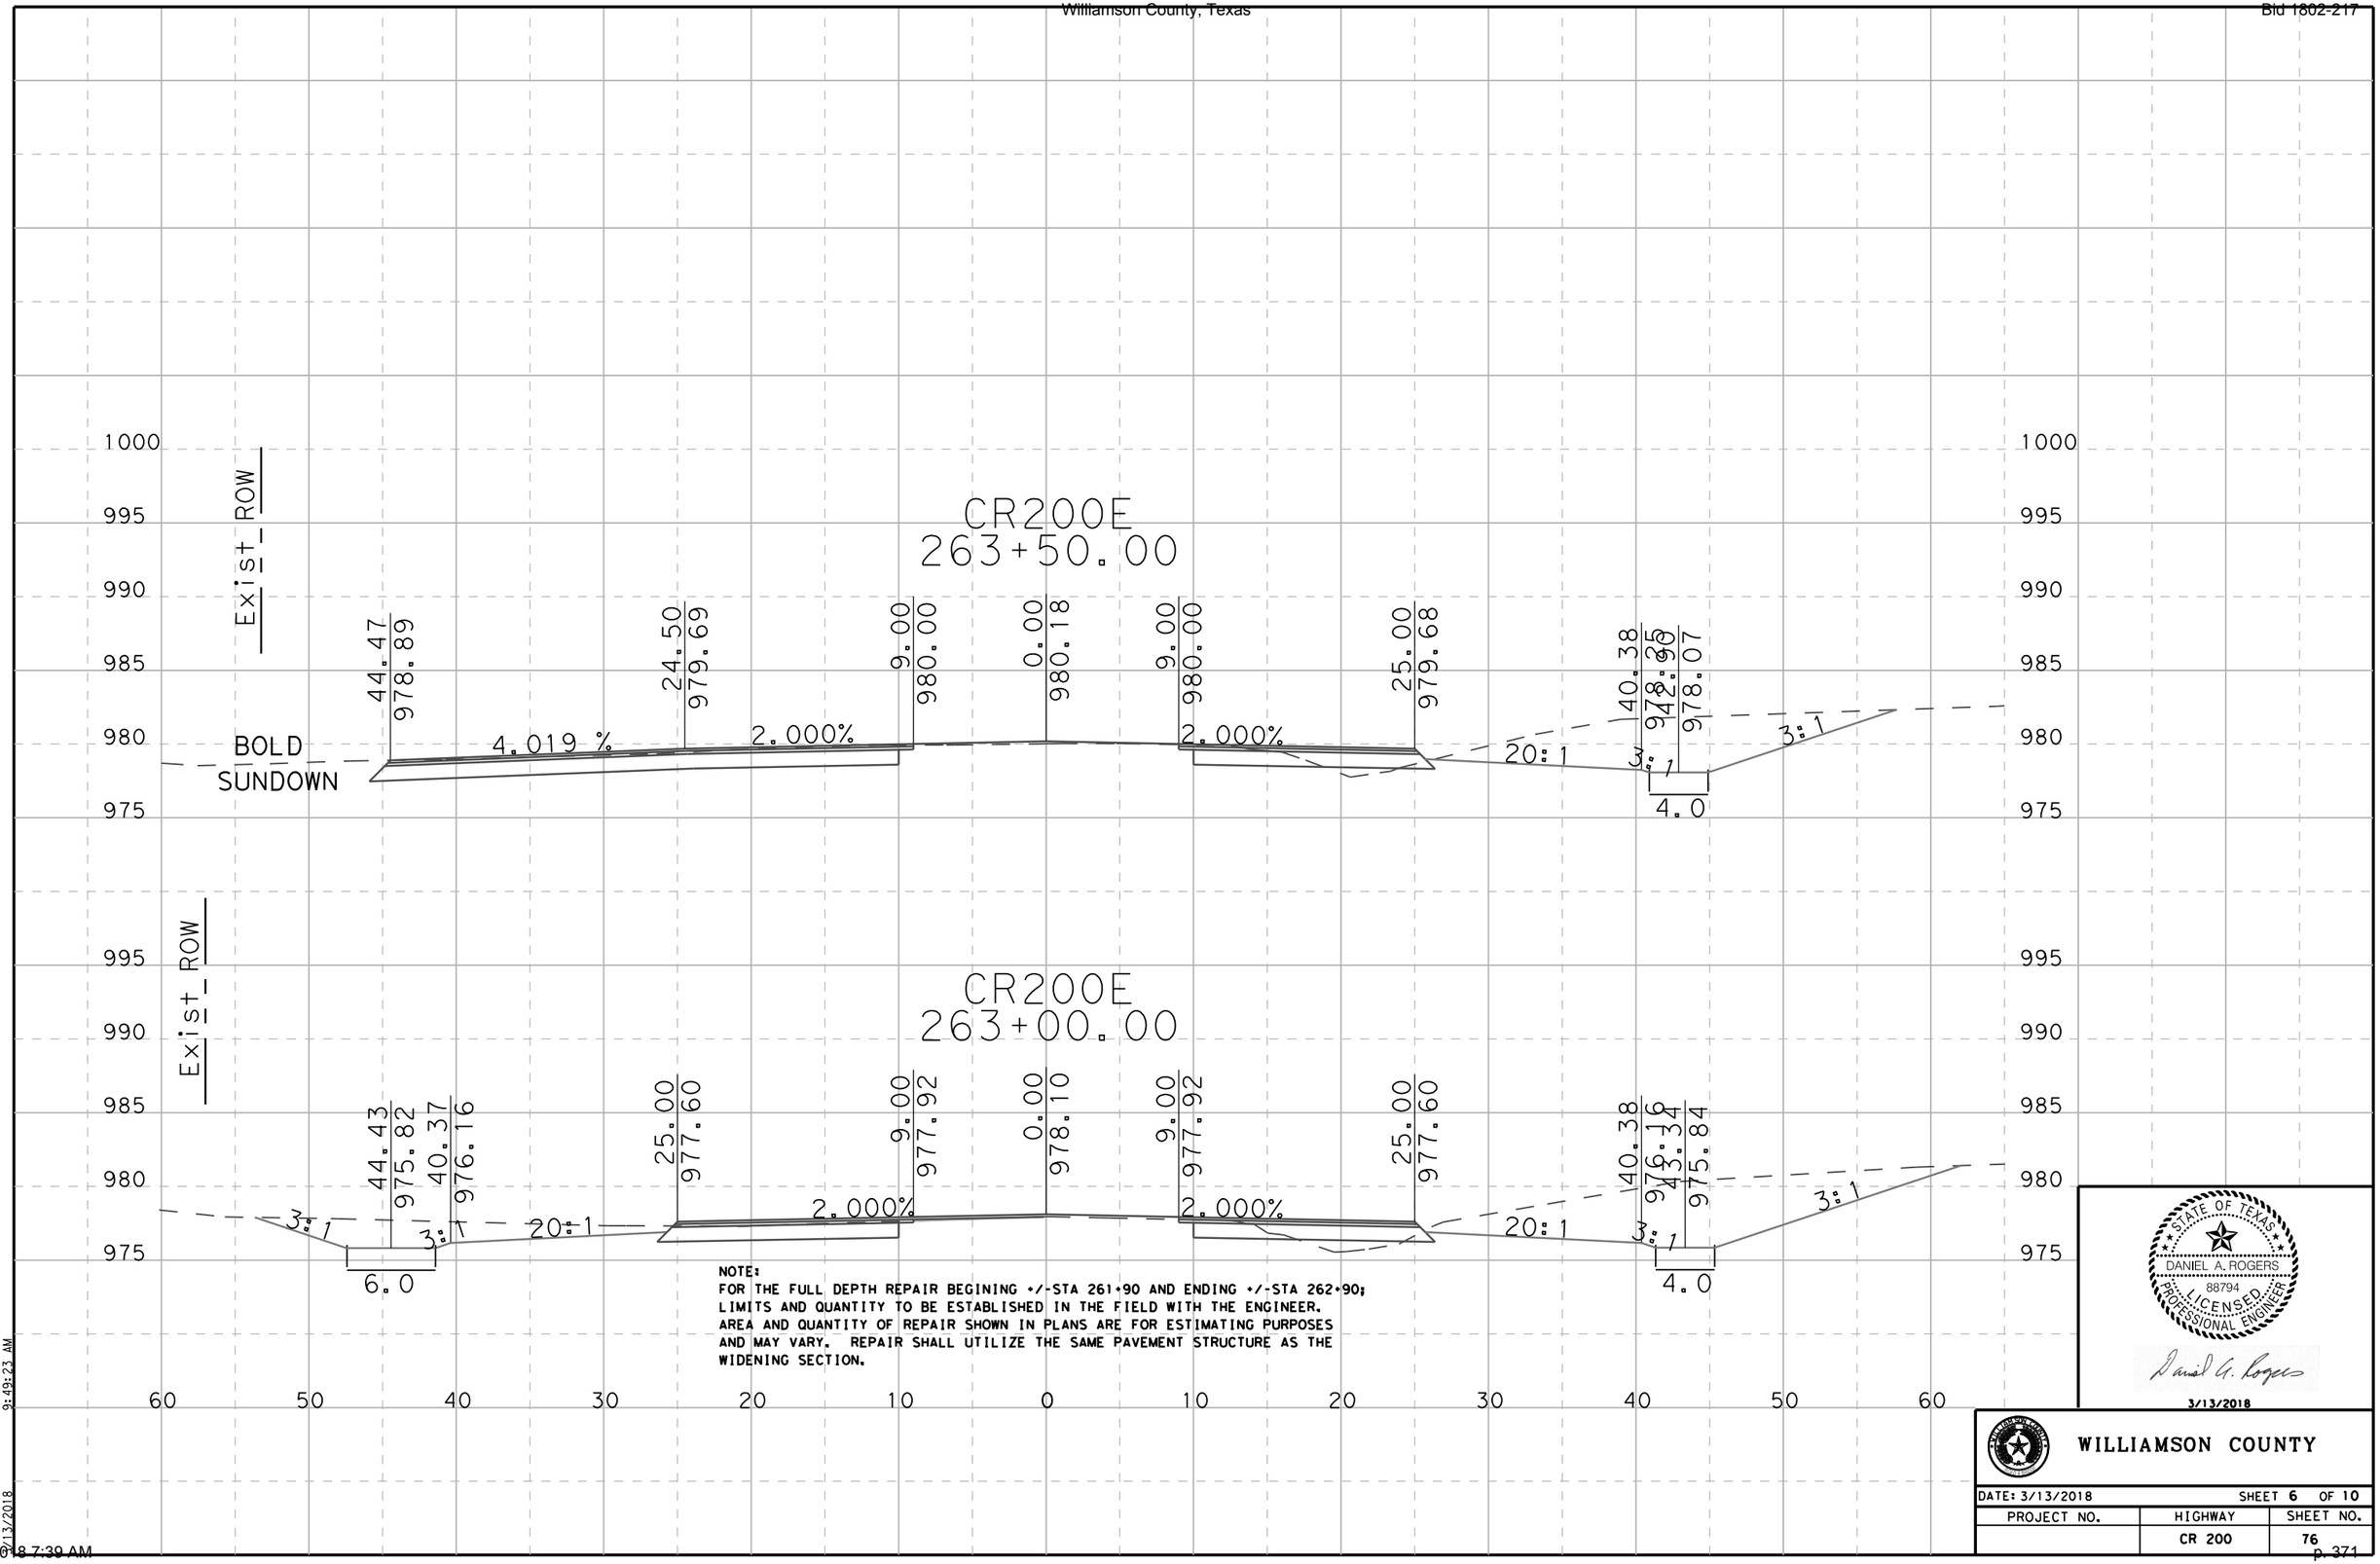


NOTE:
FOR THE FULL DEPTH REPAIR BEGINING +/-STA 261+90 AND ENDING +/-STA 262+90; LIMITS AND QUANTITY TO BE ESTABLISHED IN THE FIELD WITH THE ENGINEER. AREA AND QUANTITY OF REPAIR SHOWN IN PLANS ARE FOR ESTIMATING PURPOSES AND MAY VARY. REPAIR SHALL UTILIZE THE SAME PAVEMENT STRUCTURE AS THE WIDENING SECTION.

STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED
PROFESSIONAL ENGINEER
3/13/2018

WILLIAMSON COUNTY

DATE: 3/13/2018		SHEET 6 OF 10
PROJECT NO.	HIGHWAY	SHEET NO.
	CR 200	76

P:\011570-000\CR 200\GEOPAK\WA4b+xsplot.dgn 9:49:23 AM 3/13/2018
3/15/2018 7:39 AM

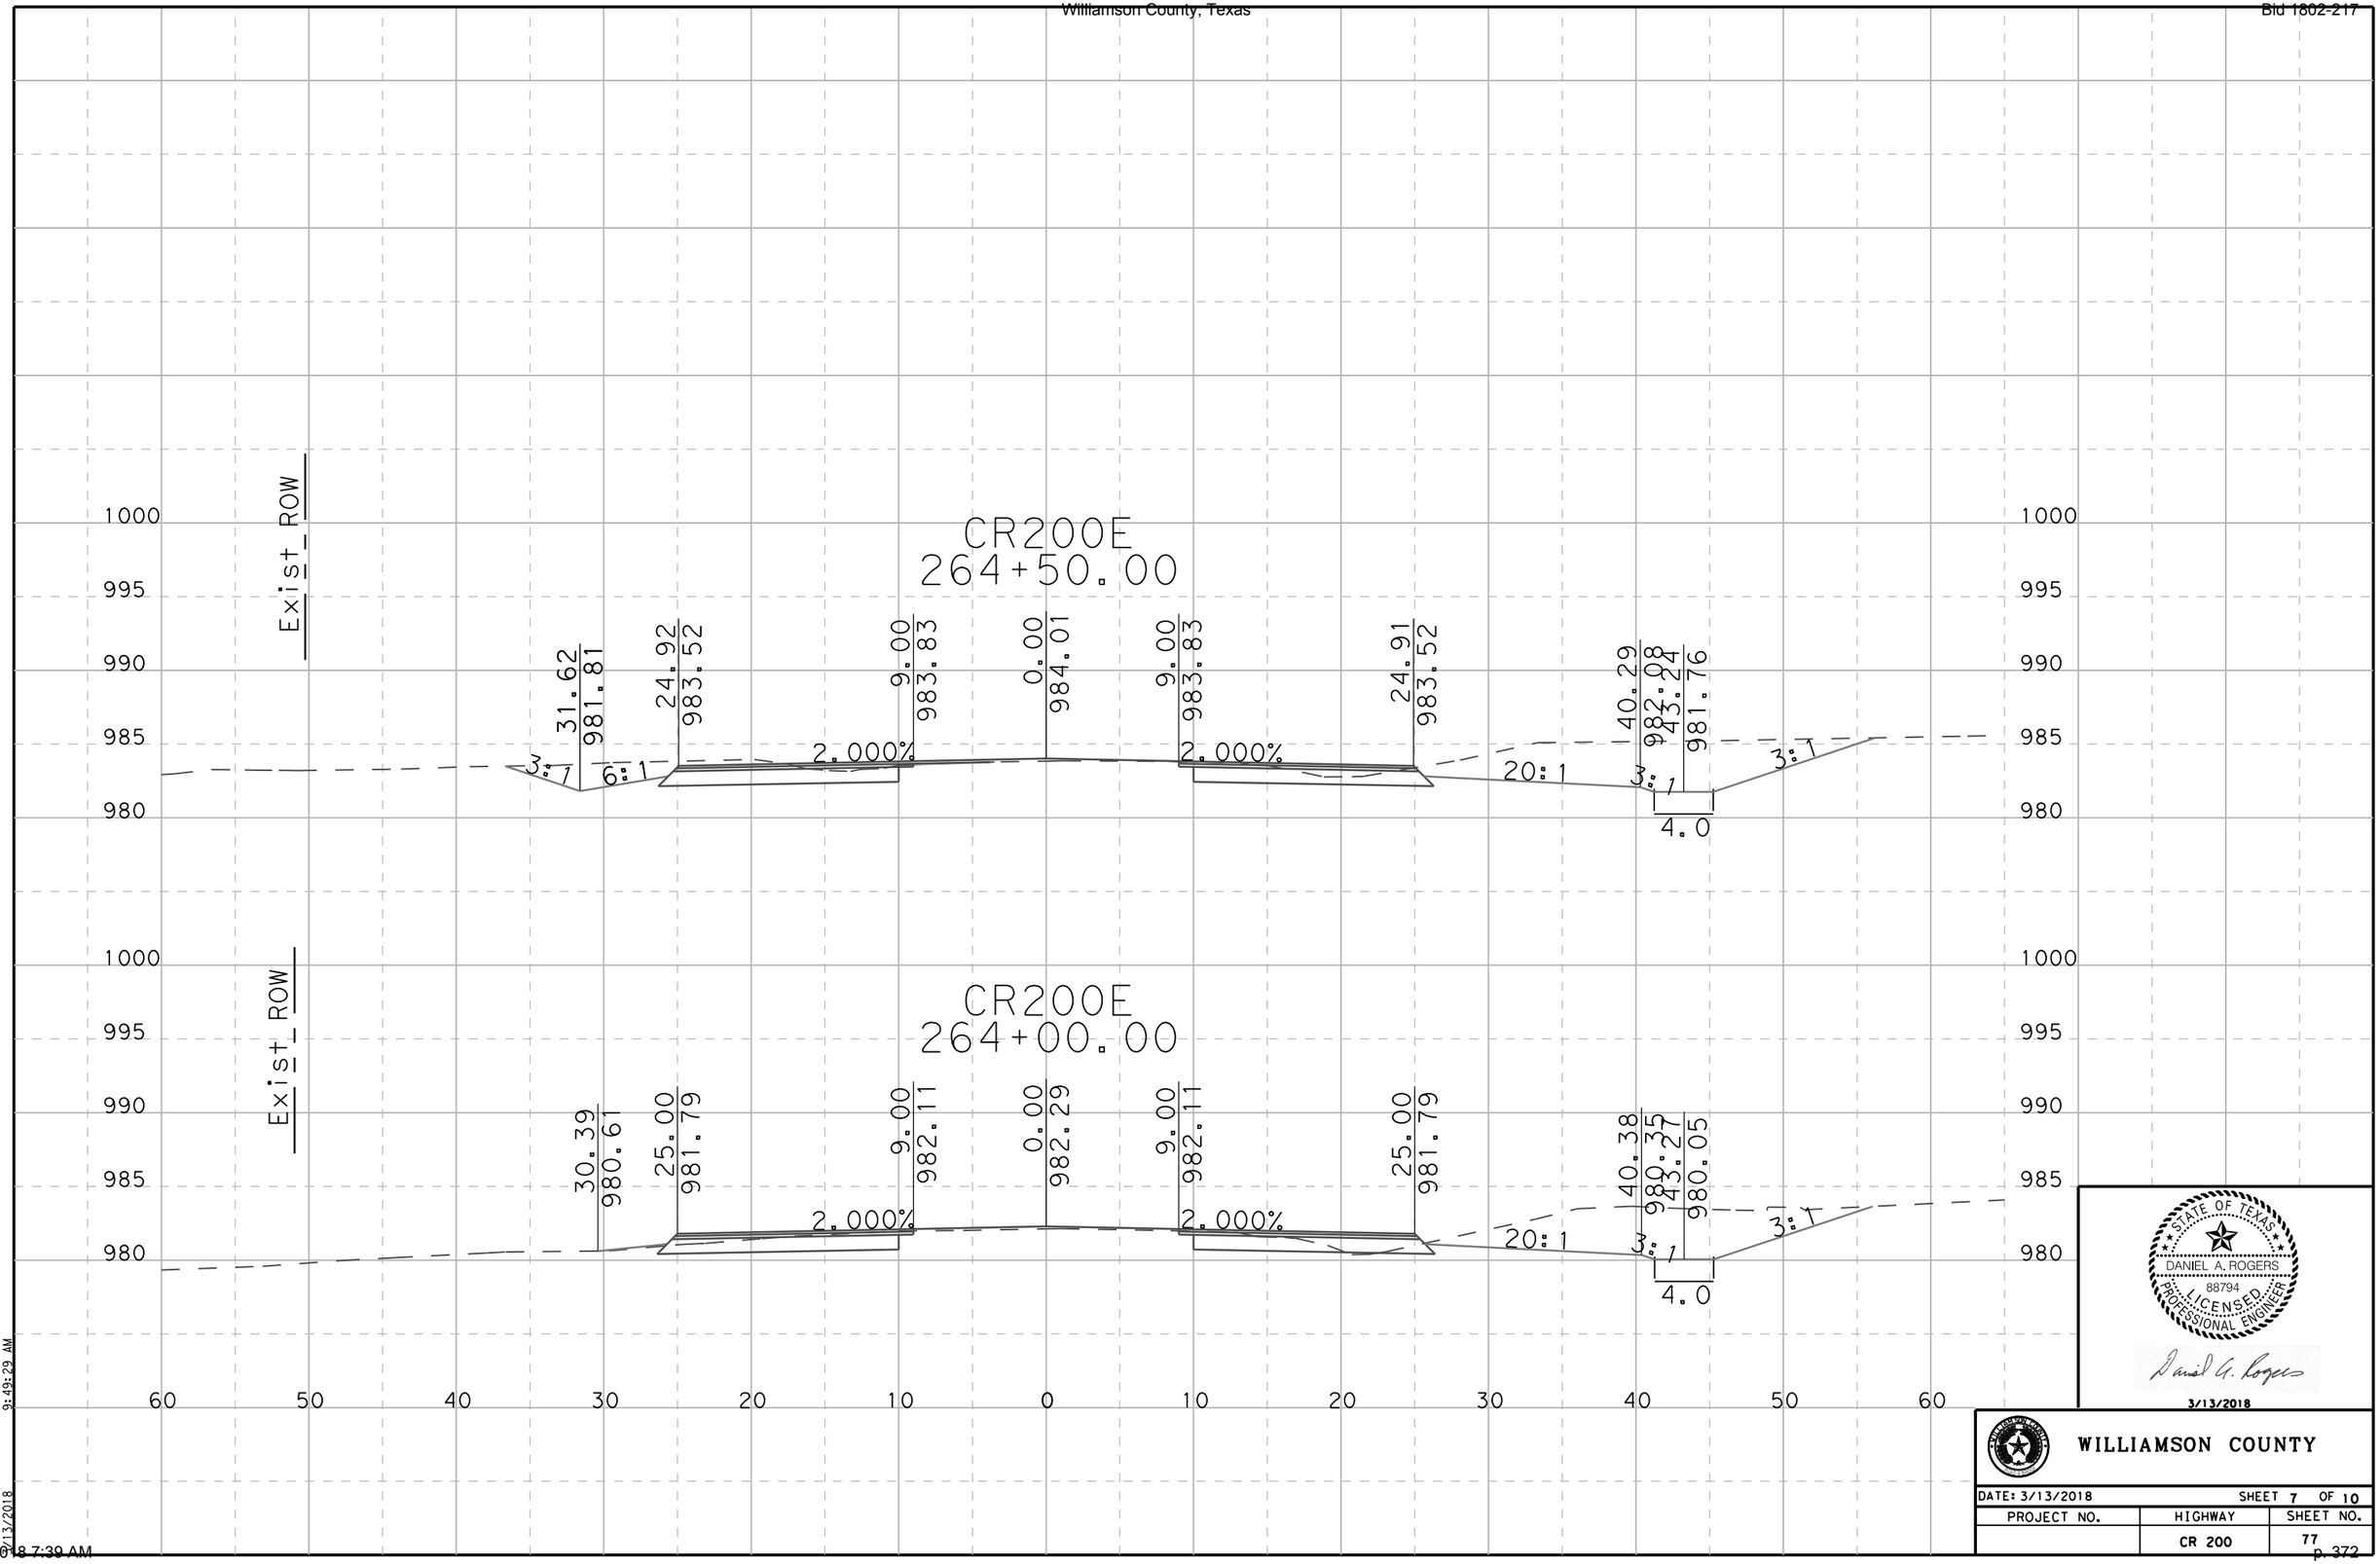


STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED PROFESSIONAL ENGINEER
3/13/2018

WILLIAMSON COUNTY

DATE: 3/13/2018		SHEET 7 OF 10
PROJECT NO.	HIGHWAY	SHEET NO.
	CR 200	77

P:\011570-000\CR 200\GEOPAK\WA4b+xsplot.dgn
3/13/2018 9:49:29 AM
3/15/2018 7:39 AM

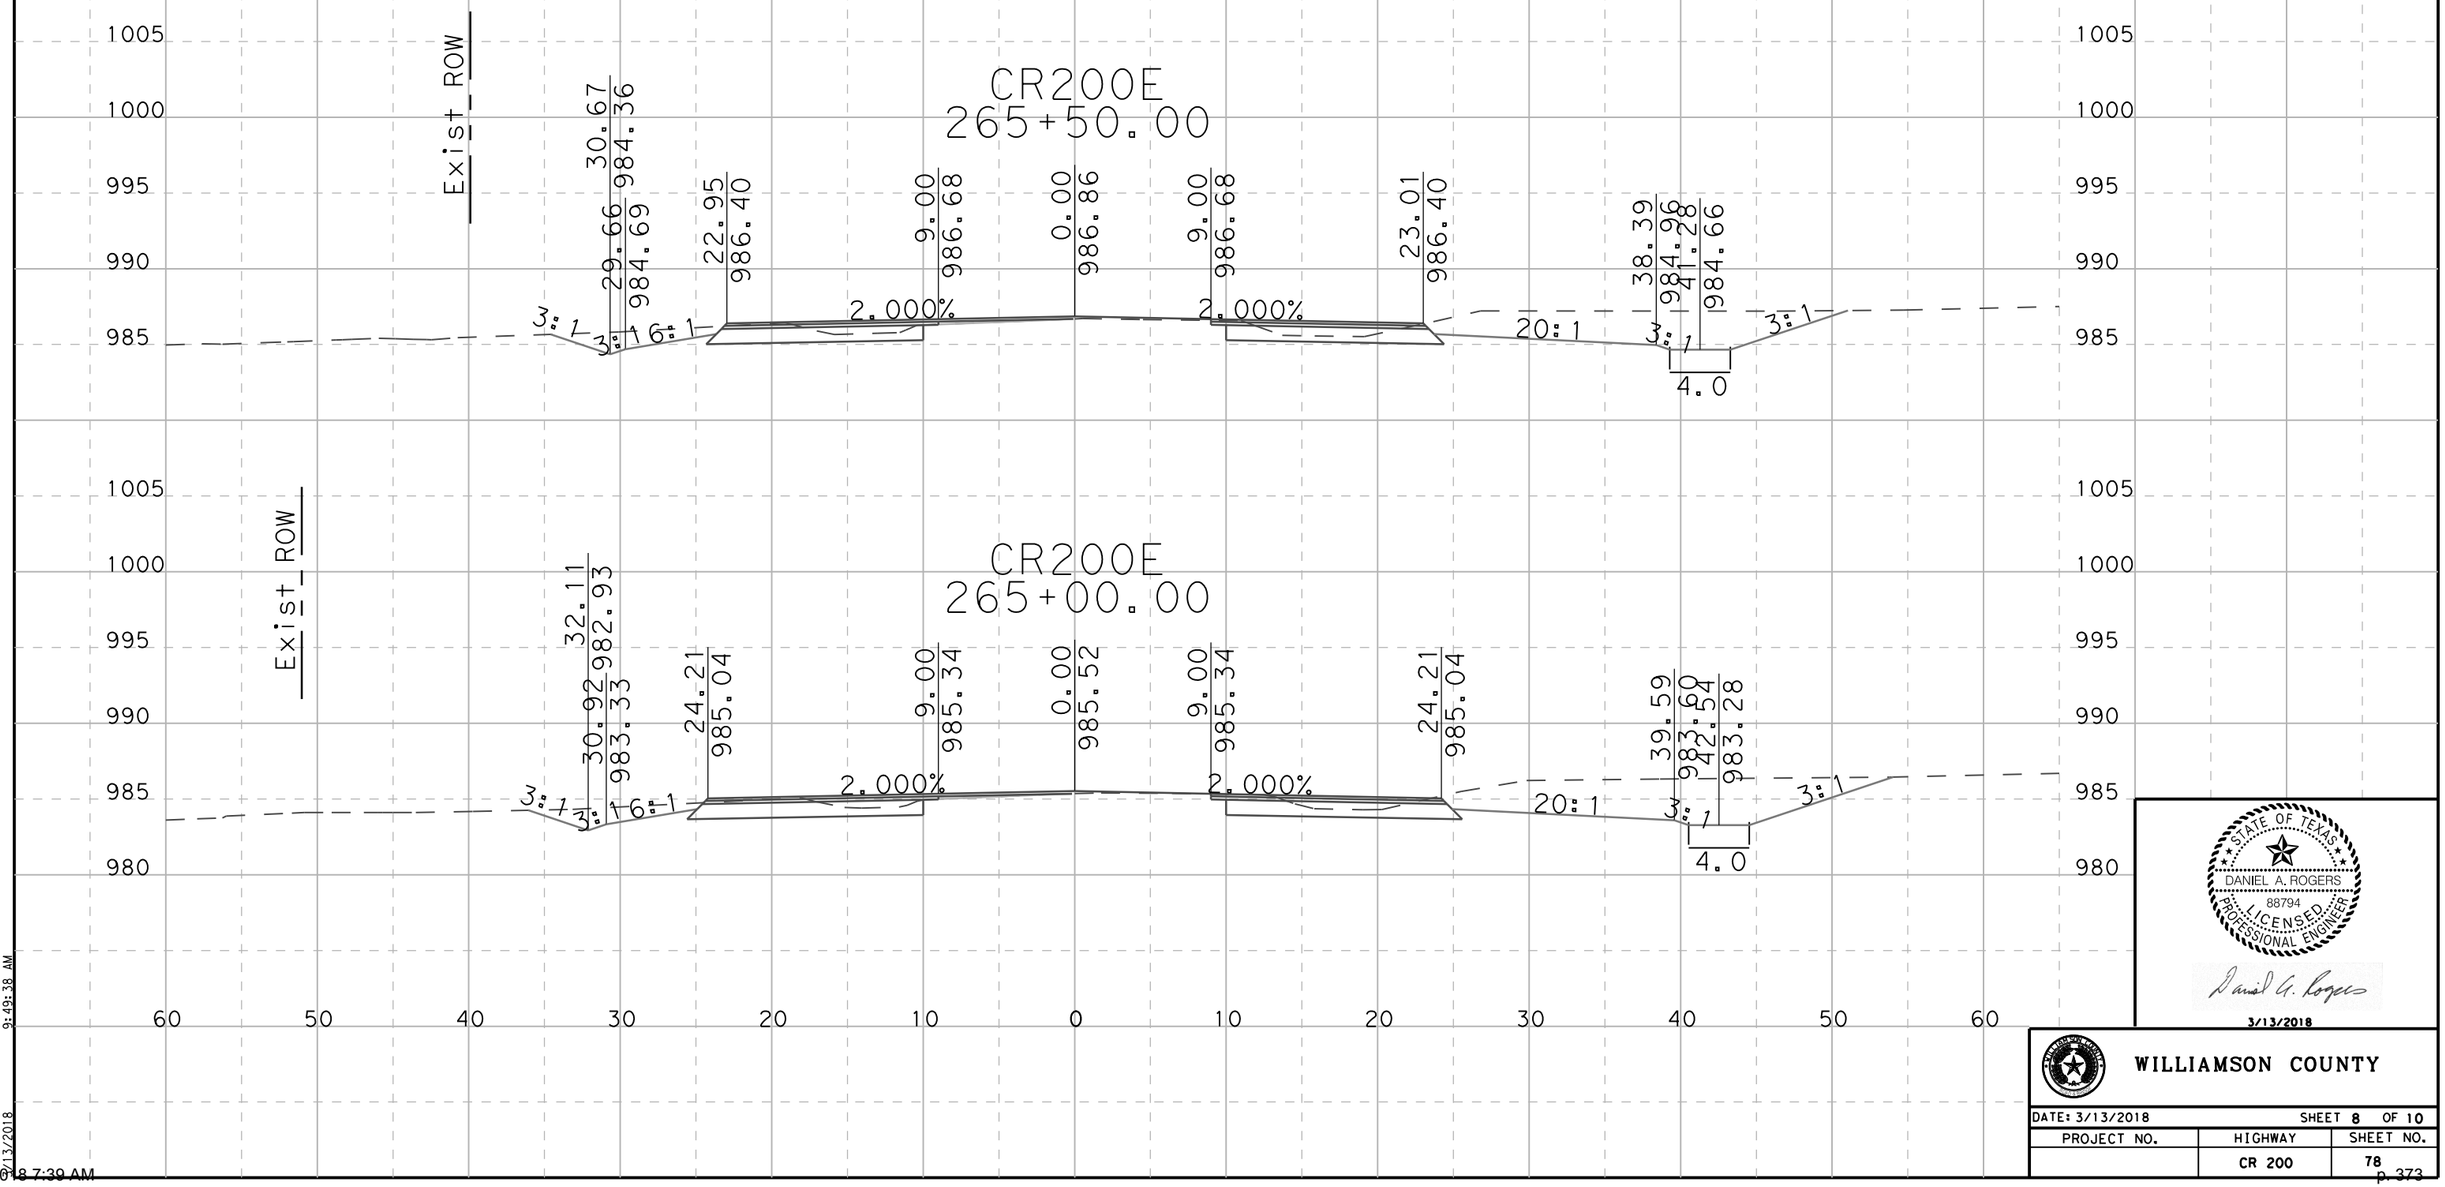


STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED
PROFESSIONAL ENGINEER
3/13/2018

WILLIAMSON COUNTY

DATE: 3/13/2018		SHEET 8 OF 10
PROJECT NO.	HIGHWAY	SHEET NO.
	CR 200	78

\011570-000\CR 200\GEOPAK\WA4d*xsplot.dgn
9:49:38 AM
3/13/2018
3/15/2018 7:39 AM

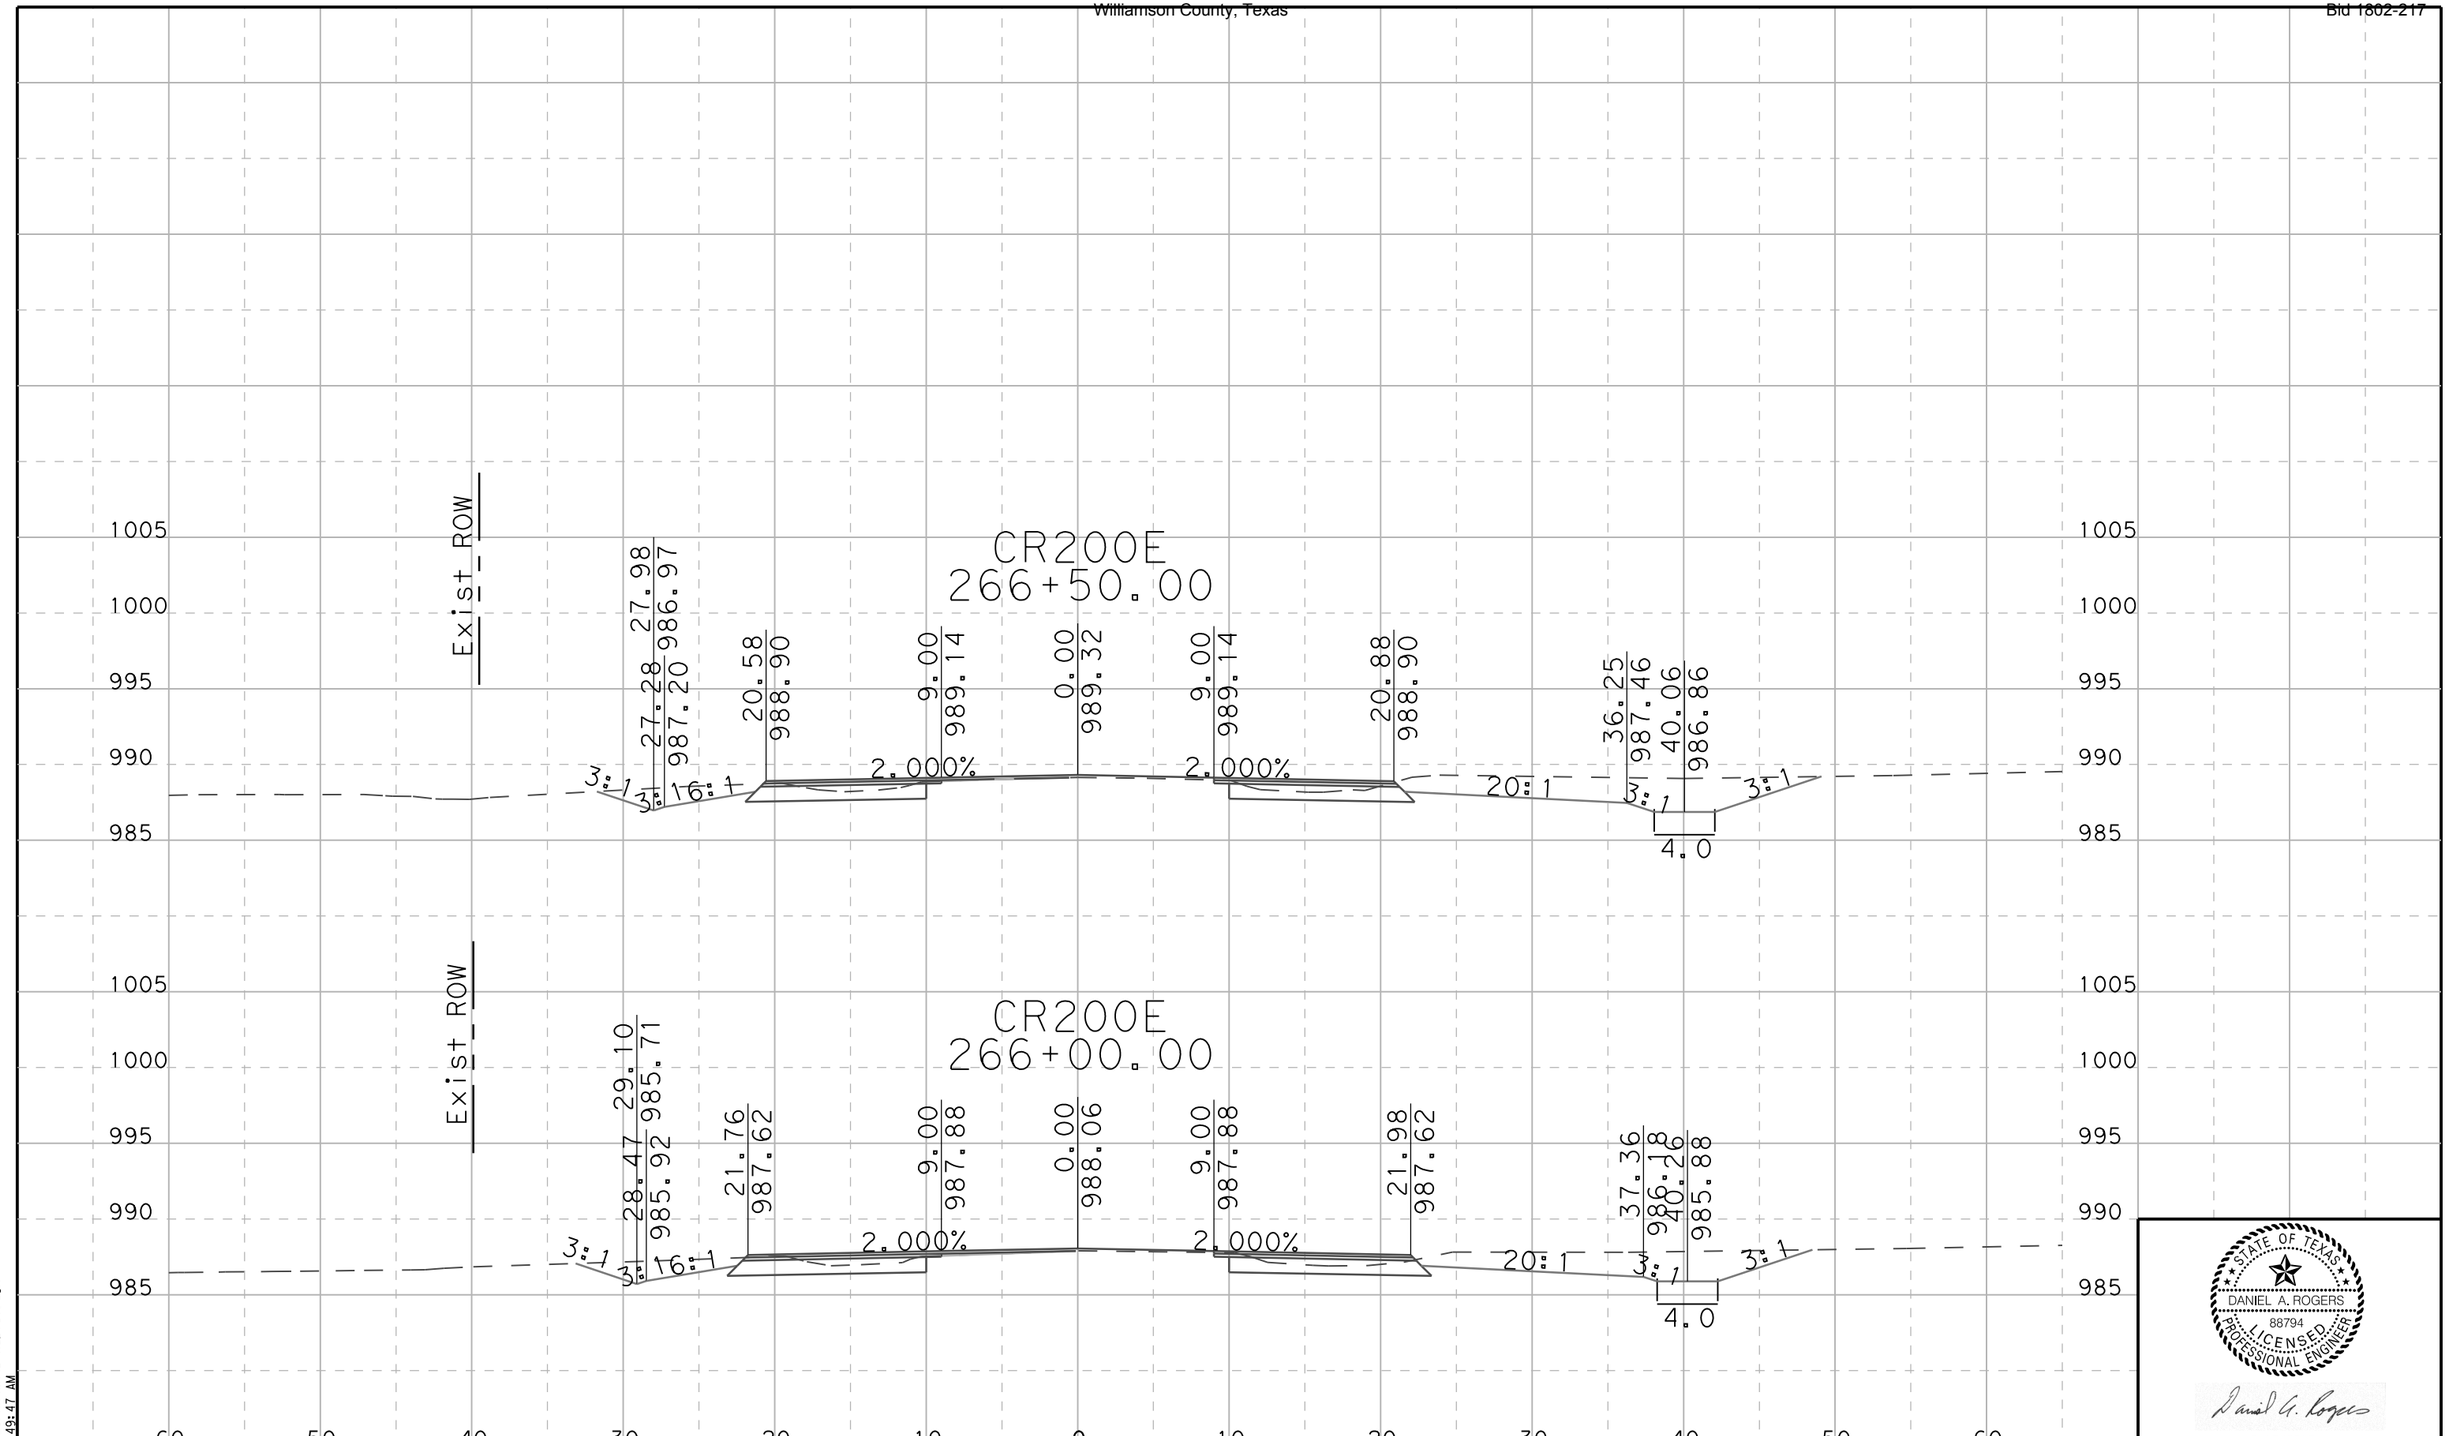


STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED PROFESSIONAL ENGINEER
3/13/2018

WILLIAMSON COUNTY

DATE: 3/13/2018		SHEET 9 OF 10
PROJECT NO.	HIGHWAY	SHEET NO.
	CR 200	79

3/15/2018 7:39 AM
...\011570-000\CR 200\GEOPAK\WA4b*xsplot.dgn
9:49:47 AM
3/13/2018

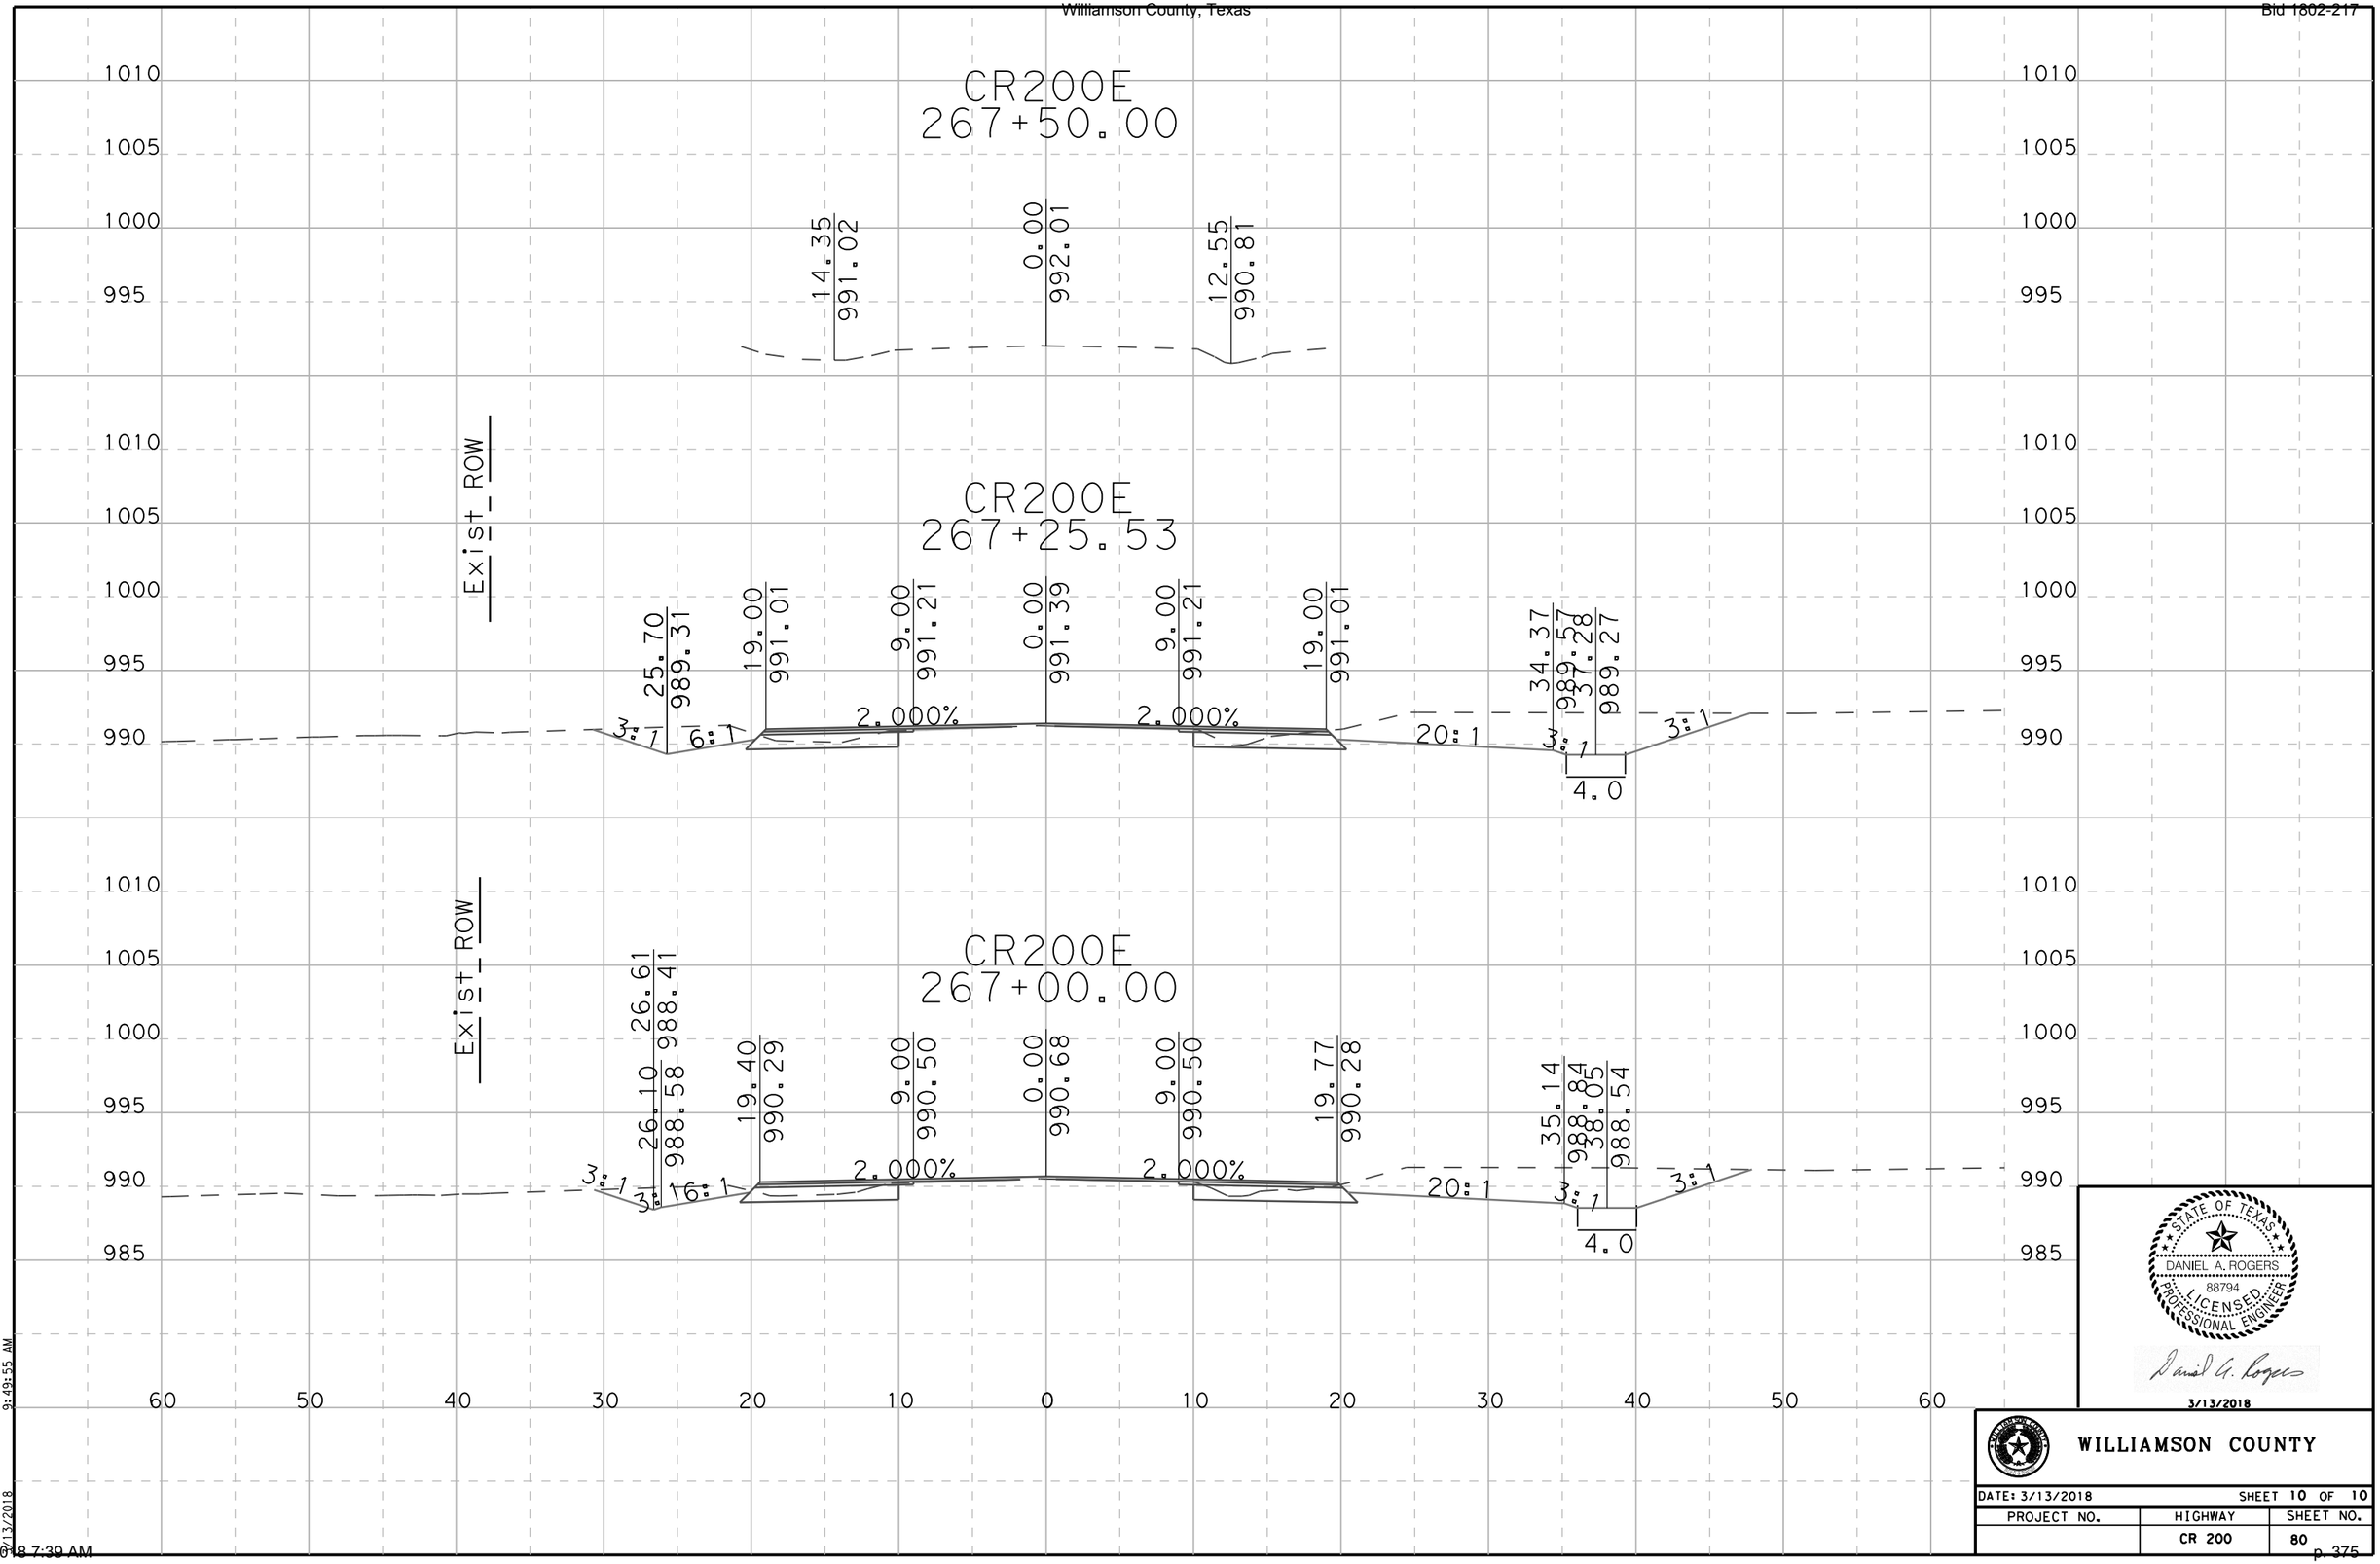

STATE OF TEXAS
DANIEL A. ROGERS
88794
LICENSED
PROFESSIONAL ENGINEER
3/13/2018

WILLIAMSON COUNTY

DATE: 3/13/2018		SHEET 10 OF 10
PROJECT NO.	HIGHWAY	SHEET NO.
	CR 200	80

3/15/2018 7:39 AM
\011570-000\CR 200\GEOPAK\WA4d*xsplot.dgn
3/13/2018 9:49:55 AM

BID FORM
WILLIAMSON COUNTY, TEXAS

PROJECT: County Road 200 at Bold Sundown **BIDDER:** _____

Full compensation for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract will be considered as included in the unit prices for the work set forth below, and no separate payment will be made for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract, unless separate payment is expressly provided for therein.

BID ITEM	TECH SPEC[1]	DESCRIPTION	BID QUANTITY	UNIT MEASURE	UNIT COST	AMOUNT BID
1	100-6002	PREPARING RIGHT OF WAY	9.3	STA		$ -
2	110-6001	EXCAVATION (ROADWAY)	2644	CY		$ -
3	132-6003	EMBANKMENT (FINAL)(ORD COMP)(TY B)	388	CY		$ -
4	160-WC02	FURNISHIING & PLACING TOPSOIL (4")	4651	SY		$ -
5	161-WC001	EROSION CONTROL COMPOST (3")	1163	SY		$ -
6	162-WC103	MULCH TOPDRESSING (5")	1163	SY		$ -
7	164-WC04	SEEDING FOR EROSION CONTROL(TEMP)(COOL)(TY 4)	2326	SY		$ -
8	164-WC05	SEEDING FOR EROSION CONTROL(PERM)(WARM)(TY 5)	4651	SY		$ -
9	164-WC10	SEEDING FOR EROSION CONTROL(TEMP)(WARM)(TY 10)	2326	SY		$ -
10	166-6002	FERTILIZER	0.3	TON		$ -
11	168-WC01	VEGETATIVE WATERING	160	MG		$ -
12	169-6001	SOIL RETENTION BLANKETS (CL 1)(TY A)	2180	SY		$ -
13	247-6044	FL BS (CMP IN PLC)(TY A)(GR 4)	1059	CY		$ -
14	310-6001	PRIME COAT (MULTIOPTION)	636	GAL		$ -
15	316-6193	AGGR (TY-D GR-5 SAC-B)	42	CY		$ -
16	316-6413	ASPH (AC-15P, HFRS-2P OR CRS-2P)	2014	GAL		$ -

[1]Refer to the Technical Specifications section for a description of the specific reference number.

BID FORM
WILLIAMSON COUNTY, TEXAS

PROJECT: **County Road 200 at Bold Sundown** **BIDDER:** _____

Full compensation for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract will be considered as included in the unit prices for the work set forth below, and no separate payment will be made for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract, unless separate payment is expressly provided for therein.

BID ITEM	TECH SPEC[1]	DESCRIPTION	BID QUANTITY	UNIT MEASURE	UNIT COST	AMOUNT BID
17	340-6011	D-GR HMA TY-B PG64-22	547	TON		$ -
18	340-6120	D-GR HMA TY-D SAC-B PG70-22	579	TON		$ -
19	340-6246	D-GR HMA TY-D PG64-22(LEVEL-UP)	100	TON		$ -
20	464-6005	RC PIPE (CL III) (24IN)	30	LF		$ -
21	467-6395	SET (TY II) (24 IN) (RCP) (6:1) (P)	4	EA		$ -
21	500-6001	MOBILIZATION	1	LS		$ -
22	502-6001	BARRICADES, SIGNS AND TRAFFIC HANDLING	3	MO		$ -
21	506-6002	ROCK FILTER DAMS(INSTALL)(TY 2)	45	LF		$ -
22	506-6011	ROCK FILTER DAMS(REMOVE)	45	LF		$ -
23	506-6020	CONSTRUCTION EXITS (INSTALL)(TY 1)	224	SY		$ -
24	506-6024	CONSTRUCTION EXITS (REMOVE)	224	SY		$ -
25	506-6040	BIODEG EROSN CONT LOGS(INSTL)(8")	365	LF		$ -
26	506-6043	BIODEG EROSN CONT LOGS(REMOVE)	365	LF		$ -
27	530-6005	DRIVEWAYS (ACP)	51	SY		$ -
28	540-6001	MTL W-BEAM GD FEN(TIM POST)	287.5	LF		$ -
29	542-6001	REMOVE METAL BEAM GUARD FENCE	117	LF		$ -

[1]Refer to the Technical Specifications section for a description of the specific reference number.

BID FORM
WILLIAMSON COUNTY, TEXAS

PROJECT: **County Road 200 at Bold Sundown** **BIDDER:** _____

Full compensation for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract will be considered as included in the unit prices for the work set forth below, and no separate payment will be made for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract, unless separate payment is expressly provided for therein.

BID ITEM	TECH SPEC[1]	DESCRIPTION	BID QUANTITY	UNIT MEASURE	UNIT COST	AMOUNT BID
30	542-6002	REMOVE TERMINAL ANCHOR SECTION	1	EA		$ -
31	544-6001	GUARDRAIL END TREATMENT(INSTALL)	2	EA		$ -
32	544-6003	GUARDRAIL END TREATMENT(REMOVE)	1	EA		$ -
33	644-6001	IN SM RD SN SUP&AM TY 10BWG (1) SA (P)	1	EA		$ -
34	644-6060	INS SM RD SN SUP & AM TY TWT(1)WS(P)	3	EA		$ -
35	644-6076	REMOVE SM RD SN SUP & AM	3	EA		$ -
36	658-6062	INSTL DEL ASSM(D-SW)SZ 1(BRF)GF 2(BI)	6	EA		$ -
37	662-6109	WK ZN PAV MRK SHT TERM(TAB)TY W	64	EA		$ -
38	662-6110	WK ZN PAV MRK SHT TERM(TAB)TY Y	93	EA		$ -
39	666-6003	REFL PAV MRK TY I(W)4"(SLD)(100 MIL)	2359	LF		$ -
40	666-6036	REFL PAV MRK TY I(W)8"(SLD)(100 MIL)	234	LF		$ -
41	666-6042	REFL PAV MRK TY I(W)12"(SLD)(100 MIL)	140	LF		$ -
42	666-6048	REFL PAV MRK TY I(W)24"(SLD)(100 MIL)	391	LF		$ -
43	666-6054	REFL PAV MRK TY I(W)(ARROW)(100 MIL)	2	LF		$ -
44	666-6096	REFL PAV MRK TY I(W)(WORD)(100 MIL)	2	EA		$ -
45	666-6126	REFL PAV MRK TY I(Y)4"(SLD)(100 MIL)	2275	LF		$ -

[1]Refer to the Technical Specifications section for a description of the specific reference number.

BID FORM
WILLIAMSON COUNTY, TEXAS

PROJECT: **County Road 200 at Bold Sundown** **BIDDER:** _____

Full compensation for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract will be considered as included in the unit prices for the work set forth below, and no separate payment will be made for compliance with each and every provision of the Request for Bids, the Bid, the Specifications, and the Contract, unless separate payment is expressly provided for therein.

BID ITEM	TECH SPEC[1]	DESCRIPTION	BID QUANTITY	UNIT MEASURE	UNIT COST	AMOUNT BID
46	672-6007	REFL PAV MRKR TY I-C	12	EA		$ -
47	672-6009	REFL PAV MRKR TY II-A-A	150	EA		$ -
48	672-6010	REFL PAV MRKR TY II-A-A	151	EA		$ -

NON-BID ITEMS TO BE INCLUDED IN BID AND CONTRACT AMOUNT. DO NOT MAKE CHANGES TO THIS SECTION.

49	999-WC01	FORCE ACCOUNT	10,000.00	DOL	$ 1.00	$ 10,000.00

TOTAL AMOUNT OF BID

_____ **Dollars and** _____ **Cents** $ 10,000.00

NOTE: THE COURT MAY EITHER REJECT ALL BIDS OR AWARD A CONTRACT TO THE LOWEST AND BEST BID.

[1]Refer to the Technical Specifications section for a description of the specific reference number.

BID AFFIDAVIT

This form must be completed, signed, notarized and returned with Bid package

The undersigned attests that the company named below, under the provisions of Subtitle F, Title 10, Texas Government Code Chapter 2270:

1. Does not boycott Israel currently; and
2. Will not boycott Israel during the term of the contract.

Pursuant to Section 2270.001, Texas Government Code:

1. "Boycott Israel" means refusing to deal with, terminating business activities with, or otherwise taking any action that is intended to penalize, inflict economic harm on, or limit commercial relations specifically with Israel, or with a person or entity doing business in Israel or in an Israeli-controlled territory, but does not include an action made for ordinary business purposes; and
2. "Company" means a for-profit sole proprietorship, organization, association, corporation, partnership, joint venture, limited partnership, or any limited liability company, including a wholly owned subsidiary, majority-owned subsidiary, parent company or affiliate of those entities or business associations that exist to make a profit.

The undersigned certifies that the IFB and the Bidder's Bid have been carefully reviewed and are submitted as correct and final. Bidder further certifies and agrees to furnish any and/or all goods and/or services upon which prices are extended at the price Bid, and upon the conditions contained in the IFB.

I hereby certify that the foregoing Bid has not been prepared in collusion with any other Bidder or other person or persons engaged in the same line of business prior to the official opening of this Bid. Further, I certify that the Bidder is not now, nor has been for the past six (6) months, directly or indirectly concerned in any pool or agreement or combination, to control the price of services/commodities Bid on, or to influence any person or persons to submit a Bid or not to submit a Bid thereon."

Name of Bidder:	
Address of Bidder:	
Email:	
Telephone:	
Printed Name of Person Submitting Affidavit:	
Signature of Person Submitting Affidavit:	

Cooperative Purchasing Program

Check one of the following options below. A non-affirmative Bid will in no way have a negative impact on the County's evaluation of the Bid.

☐	I will offer the quoted prices to all authorized entities during the term of the County's Contract.
☐	I will not offer the quoted prices to all authorized entities.

If no box is checked, the Bidder agrees to make best efforts in good faith to offer the quoted prices to all authorized entities.

BEFORE ME, the undersigned authority, a Notary Public, personally appeared _____ (*Name of Signer*), who after being by me duly sworn, did depose and say: "I, _____, (*Name of Signer*) am a duly authorized officer of/agent for _____ (*Name of Bidder*) and have been duly authorized to execute the foregoing on behalf of the said _____ (*Name of Bidder*).

SUBSCRIBED AND SWORN to before me by the above-named _____

on this the _____ day of _____, 20_____.

_____

Notary Public in and for

The State of _____

The County of _____

SIGNATURE AND NOTARY NOT REQUIRED IF COMPLETING IN BIDSYNC ELECTRONICALLY.

CONFLICT OF INTEREST QUESTIONNAIRE

For vendor or other person doing business with local governmental entity

Form CIQ

This questionnaire is being filed in accordance with chapter 176 of the Local Government Code by a person doing business with the governmental entity.

By law this questionnaire must be filed with the records administrator of the local government not later than the 7th business day after the date the person becomes aware of facts that require the statement to be filed. See Section 176.006, Local Government Code.

A person commits an offense if the person violates Section 176.006, Local Government Code. An offense under this section is a Class C misdemeanor.

OFFICE USE ONLY

Date Received

1 **Name of person doing business with local governmental entity.**

2 ☐ **Check this box if you are filing an update to a previously filed questionnaire.**

(The law requires that you file an updated completed questionnaire with the appropriate filing authority not later than September 1 of the year for which an activity described in Section 176.006(a), Local Government Code, is pending and not later than the 7th business day after the date the originally filed questionnaire becomes incomplete or inaccurate.)

3 **Describe each affiliation or business relationship with an employee or contractor of the local governmental entity who makes recommendations to a local government officer of the local governmental entity with respect to expenditure of money.**

4 **Describe each affiliation or business relationship with a person who is a local government officer and who appoints or employs a local government officer of the local governmental entity that is the subject of this questionnaire.**

CONFLICT OF INTEREST QUESTIONNAIRE

For vendor or other person doing business with local governmental entity

Form CIQ
Page 2

5 **Name of local government officer with whom filer has affiliation or business relationship.**
(Complete this section only if the answer to A, B, or C is YES.)

This section, item 5 including subparts A, B, C & D, must be completed for each officer with whom the filer has affiliation or other relationship. Attach additional pages to this Form CIQ as necessary.

A. Is the local government officer named in this section receiving or likely to receive taxable income from the filer of the questionnaire?

☐ Yes ☐ No

B. Is the filer of the questionnaire receiving or likely to receive taxable income from or at the direction of the local government officer named in this section AND the taxable income is not from the local governmental entity?

☐ Yes ☐ No

C. Is the filer of this questionnaire affiliated with a corporation or other business entity that the local government officer serves as an officer or director, or holds an ownership of 10 percent or more?

☐ Yes ☐ No

D. Describe each affiliation or business relationship.

6. Describe any other affiliation or business relationship that might cause conflict of interest:

7

Signature of person doing business with the governmental entity	Date

Signature not required if completing in BIDSYNC electronically.

Bidder References

List the last (3) companies or governmental agencies, where the same or similar goods and/or services as contained in this IFB package, were recently provided by Bidder.

Reference 1

Client Name: Location:

Contact Name: Title:

Phone: E-mail

Contract Date To: Contract Date From: Contract Value: $

Scope of Work:

Reference 2

Client Name: Location:

Contact Name: Title:

Phone: E-mail

Contract Date To: Contract Date From: Contract Value: $

Scope of Work:

Reference 3

Client Name: Location:

Contact Name: Title:

Phone: E-mail

Contract Date To: Contract Date From: Contract Value: $

Scope of Work:

Question and Answers for Bid #1802-217 - County Road 200 at Bold Sundown

Overall Bid Questions
There are no questions associated with this bid.